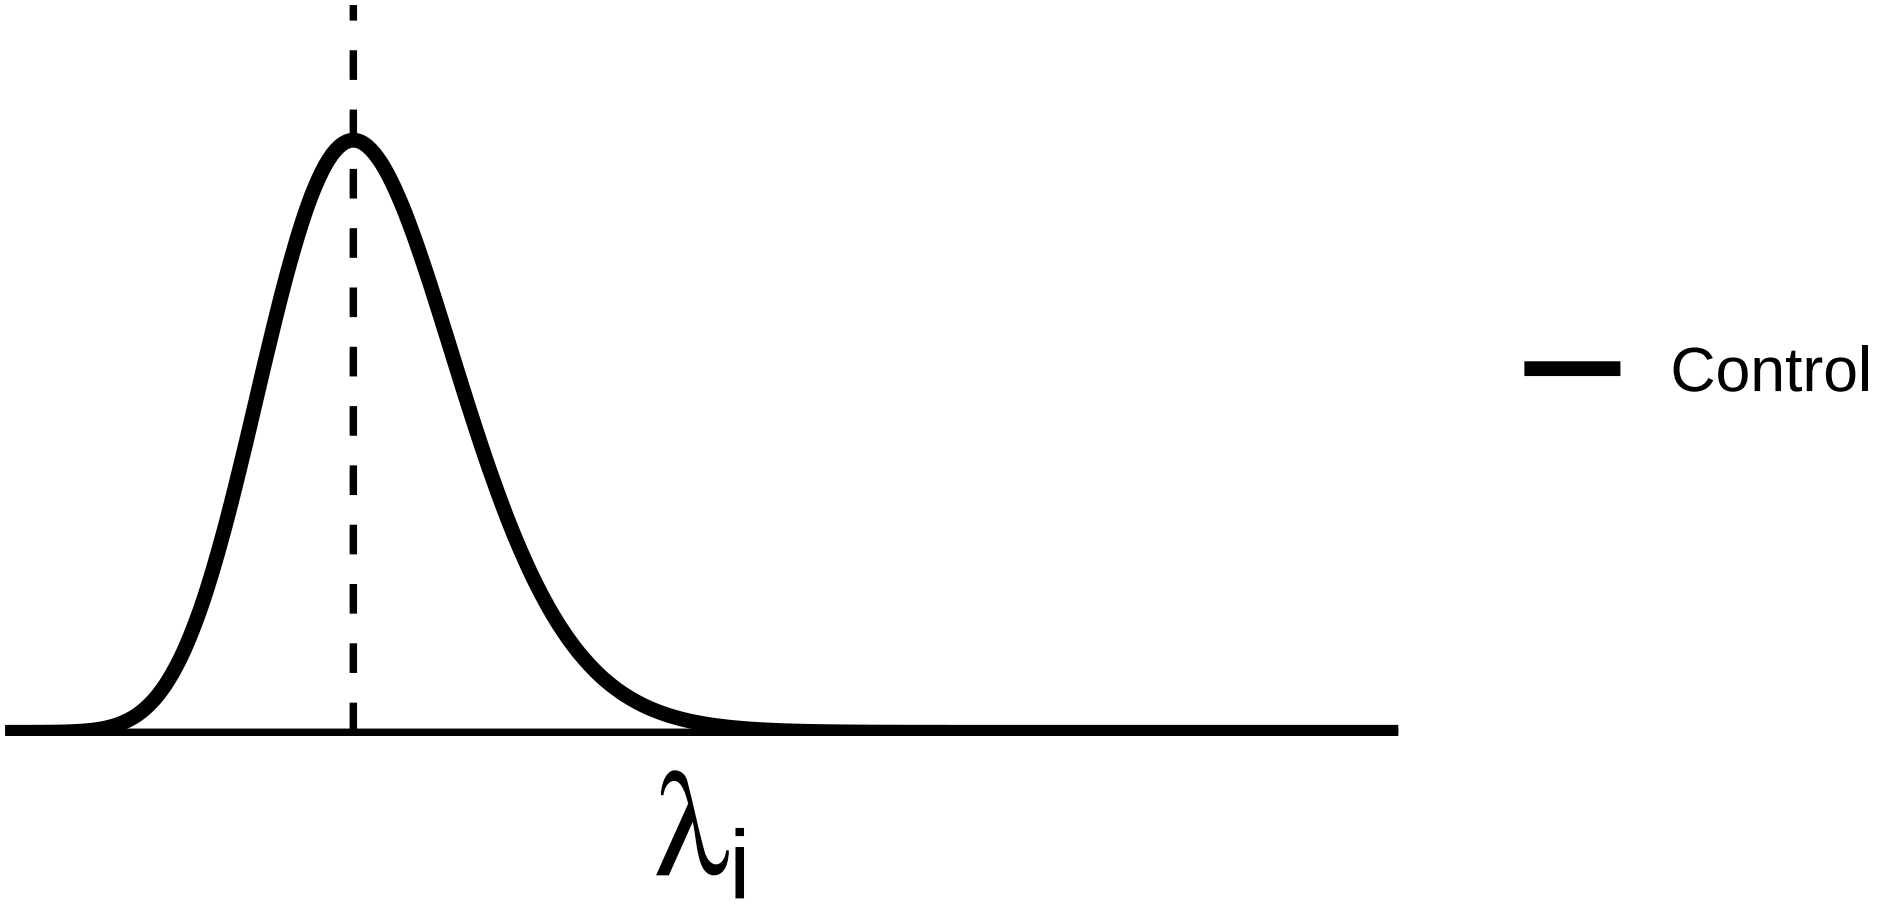
Control
λ_i