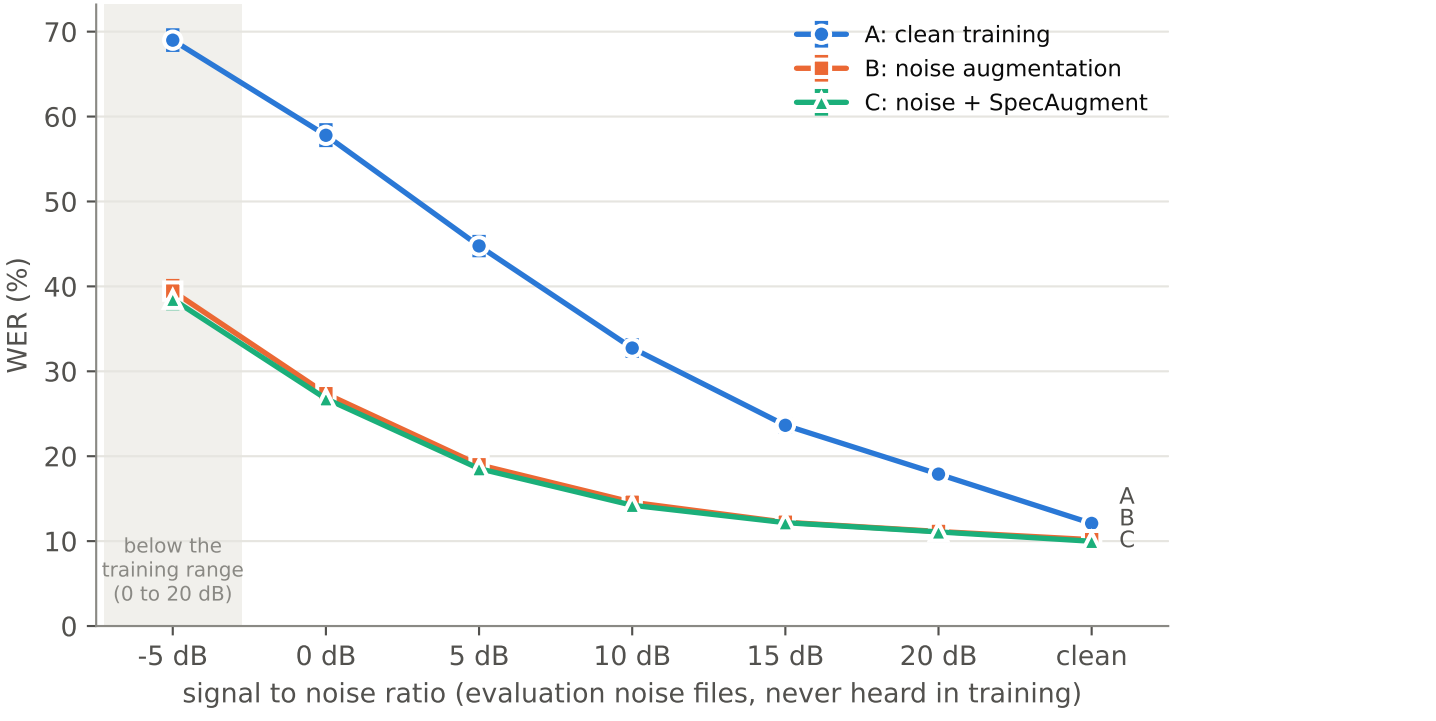
WER vs noise level, test-clean (2,620 utterances), 3-gram LM decoding, 95% bootstrap CIs
A: clean training
B: noise augmentation
C: noise + SpecAugment
WER (%)
70
60
50
40
30
20
10
0
below the training range (0 to 20 dB)
A
B
C
-5 dB
0 dB
5 dB
10 dB
15 dB
20 dB
clean
signal to noise ratio (evaluation noise files, never heard in training)