

MONTH OF OCTOBER 2024
ACCOMPLISHMENT & PROGRESS PHOTOS

Submitted By:

شركة نباتات
للمقاولات 
NABATAT CONTRACTING COMPANY

Electrical Group

DAILY ACCOMPLISHMENT ACTIVITY						Date: 01 October 2024		
Trades:		Streetlight				Log No.24-66929,67011		
Location/Area		Dammam Airport Landside area, North Service road						
Activities	Activity Start	Activity End	Extended Work	Preventive & Corrective Maintenance of streetlight & control panel EEC-044, EPL-044,EPC-044				
Time	6:00 AM	3:00 PM	3:00-5:00 PM 7:00-9:00 PM					
Description of Activities				Material Quantities				
<input checked="" type="checkbox"/> Checking/cleaning the breaker panel, and contactor panel from dirt. <input checked="" type="checkbox"/> Voltage measuring/reading <input type="checkbox"/> Replacement of new photocell/selector switch <input checked="" type="checkbox"/> Tightening of loose contact breaker <input checked="" type="checkbox"/> Troubleshooting, wiring & repairing (breaker,panel, lamp) <input checked="" type="checkbox"/> Grease and anti rust application <input type="checkbox"/> Manual Operation of circuit breaker/Control panel <input type="checkbox"/> Lamp/ driver installation <input type="checkbox"/> Receive emergency call from station 1 during streetlight trouble <input checked="" type="checkbox"/> Checking/inspection of non functional streetlight <input type="checkbox"/> Rewiring, cable pulling, cable termination <input type="checkbox"/> Assist damaged streetlight pole cause by car accident <input type="checkbox"/> _____				Lamp installed				
				<input type="checkbox"/> ___ SODIUM <input type="checkbox"/> 350W LED <input type="checkbox"/> 250W MERCURY <input type="checkbox"/> ___				
				Size of copper wires & cable installed (roll,meters)				
				<input type="checkbox"/> 35 mm ² <input type="checkbox"/> 50 mm ² <input type="checkbox"/> 70 mm ² <input type="checkbox"/> 2.5 mm ²				
				Spareparts & others				
				<input type="checkbox"/> Photocell <input type="checkbox"/> <input type="checkbox"/> selector switch <input type="checkbox"/> <input type="checkbox"/> contactor <input type="checkbox"/> <input type="checkbox"/> breaker <input type="checkbox"/> <input type="checkbox"/> 4A fuse <input type="checkbox"/> <input type="checkbox"/> driver/ballast <input type="checkbox"/>				
				Other works				
				<input type="checkbox"/> <input type="checkbox"/>				
				Manpower				
				Quantity	Engineer	Supervisor	Safety	Elec/Technician
	1	1		6	1			9
Equipment				SAFETY EQUIPMENT & DEVICES				
<input type="checkbox"/> JCB/LOADER <input checked="" type="checkbox"/> MANLIFT <input type="checkbox"/> BOBCAT <input type="checkbox"/> Hedge trimmer <input type="checkbox"/> BOOM TRUCK <input type="checkbox"/> Mower Grass <input type="checkbox"/> SWEEPER <input type="checkbox"/> GARBAGE COMPACTOR <input checked="" type="checkbox"/> PICK UP <input type="checkbox"/> _____ <input type="checkbox"/> HAULING TRUCK/DYNA <input type="checkbox"/> _____				<input checked="" type="checkbox"/> traffic cone <input type="checkbox"/> sign board <input type="checkbox"/> blinker light <input type="checkbox"/> _____ <input type="checkbox"/> hard barricade <input type="checkbox"/> _____ <input type="checkbox"/> warning tape <input type="checkbox"/> _____ <input type="checkbox"/> fire extinguisher <input type="checkbox"/> _____ <input checked="" type="checkbox"/> PPE <input type="checkbox"/> _____				
Supervisor's Remarks:		All job completed. Logs closed			Supervisor's Name:		Alamin	
General Notes:		Proceed to the next activities						



Document routing:	Supervisors	→	Service chief/Engr	→	Document Controller
--------------------------	-------------	---	--------------------	---	---------------------


DAILY ACCOMPLISHMENT ACTIVITY				Date: 02 October 2024
Trades:	Streetlight			Log No.24-67218, 67295
Location/Area	Dammam Airport Landside area, Admin Building			
Activities	Activity Start	Activity End	Extended Work	Preventive & Corrective Maintenance of streetlight & control panel
Time	6:00 AM	3:00 PM	3:00-5:00 PM 7:00-9:00 PM	

Description of Activities				Material Quantities
<input checked="" type="checkbox"/>	Checking/cleaning the breaker panel, and contactor panel from dirt.			Lamp installed
<input checked="" type="checkbox"/>	Voltage measuring/reading			<input type="checkbox"/> ___ SODIUM <input checked="" type="checkbox"/> 13 350W LED
<input type="checkbox"/>	Replacement of new photocell/selector switch			<input type="checkbox"/> 400W MERCURY <input type="checkbox"/> HPS
<input type="checkbox"/>	Tightening of loose contact breaker			Size of copper wires & cable installed (roll,meters)
<input type="checkbox"/>	Troubleshooting, wiring & repairing (breaker,panel, lamp)			<input type="checkbox"/> 35 mm ² <input type="checkbox"/> 50 mm ²
<input type="checkbox"/>	Grease and anti rust application			<input type="checkbox"/> 70 mm ² <input type="checkbox"/> 2.5 mm ²
<input type="checkbox"/>	Manual Operation of circuit breaker/Control panel			Spareparts & others
<input checked="" type="checkbox"/>	Lamp/ driver installation			<input type="checkbox"/> Photocell <input type="checkbox"/>
<input type="checkbox"/>	Receive emergency call from station 1 during streetlight trouble			<input type="checkbox"/> selector switch <input type="checkbox"/>
<input checked="" type="checkbox"/>	Checking/inspection of non functional streetlight			<input type="checkbox"/> contactor <input type="checkbox"/>
<input type="checkbox"/>	Rewiring, cable pulling, cable termination			<input type="checkbox"/> breaker <input type="checkbox"/>
<input type="checkbox"/>	Assist damaged streetlight pole cause by car accident			<input type="checkbox"/> 4A fuse <input type="checkbox"/>
<input type="checkbox"/>				<input type="checkbox"/> driver/ballast <input type="checkbox"/>

Manpower									Other works
Quantity	Engineer	Supervisor	Safety	Elec/Technician	Driver/Operator	Labor	Others	Total	<input type="checkbox"/>
	1	1		6	1			9	<input type="checkbox"/>

Equipment				SAFETY EQUIPMENT & DEVICES			
<input type="checkbox"/>	JCB/LOADER	<input checked="" type="checkbox"/>	MANLIFT	<input checked="" type="checkbox"/>	traffic cone	<input type="checkbox"/>	sign board
<input type="checkbox"/>	BOBCAT	<input type="checkbox"/>	Hedge trimmer	<input type="checkbox"/>	blinker light	<input type="checkbox"/>	
<input type="checkbox"/>	BOOM TRUCK	<input type="checkbox"/>	Mower Grass	<input type="checkbox"/>	hard barricade	<input type="checkbox"/>	
<input type="checkbox"/>	SWEEPER	<input type="checkbox"/>	GARBAGE COMPACTOR	<input type="checkbox"/>	warning tape	<input type="checkbox"/>	
<input checked="" type="checkbox"/>	PICK UP	<input type="checkbox"/>		<input type="checkbox"/>	fire extinguisher	<input type="checkbox"/>	
<input type="checkbox"/>	HAULING TRUCK/DYNA	<input type="checkbox"/>		<input checked="" type="checkbox"/>	PPE	<input type="checkbox"/>	

Supervisor's Remarks:	All job completed. Logs closed	Supervisor's Name:	Alamin
General Notes:	Proceed to the next activities		

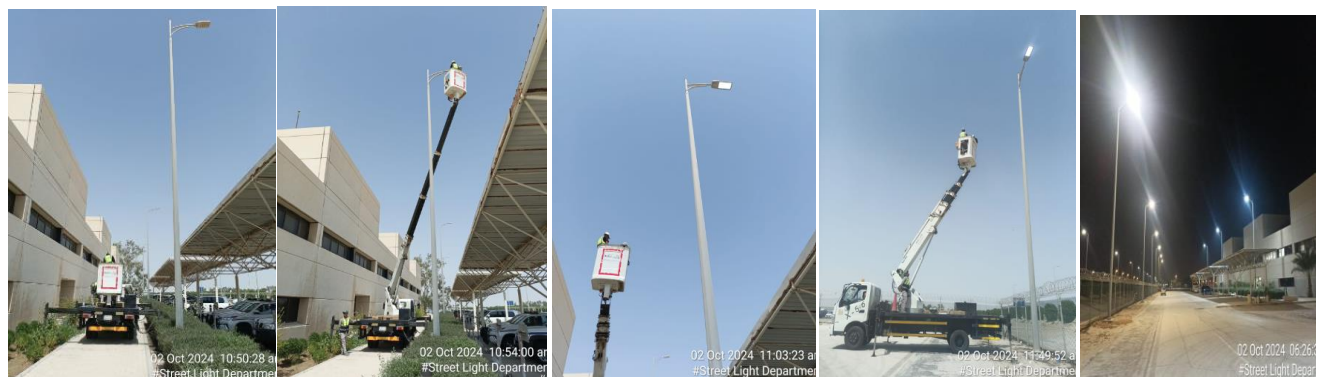

Document routing:	Supervisors	→	Service chief/Engr	→	Document Controller
-------------------	-------------	---	--------------------	---	---------------------

DAILY ACCOMPLISHMENT ACTIVITY				Date: 03 October 2024
Trades:	Streetlight			Log No.24-67412, 67534
Location/Area	Dammam Airport Landside area, Passenger Terminal			
Activities	Activity Start	Activity End	Extended Work	Preventive & Corrective Maintenance of streetlight & control panel EEC-019, EPL-019,EPC-019
Time	6:00 AM	3:00 PM	3:00-5:00 PM 7:00-9:00 PM	

Description of Activities

- ☒ Checking/cleaning the breaker panel, and contactor panel from dirt.
- ☒ Voltage measuring/reading
- ☐ Replacement of new photocell/selector switch
- ☐ Tightening of loose contact breaker
- ☐ Troubleshooting, wiring & repairing (breaker,panel, lamp)
- ☒ Grease and anti rust application
- ☐ Manual Operation of circuit breaker/Control panel
- ☐ Lamp/ driver installation
- ☐ Receive emergency call from station 1 during streetlight trouble
- ☒ Checking/inspection of non functional streetlight
- ☐ Rewiring, cable pulling, cable termination
- ☐ Assist damaged streetlight pole cause by car accident
- ☐ Isolation of exposed bare cable

Material Quantities

Lamp installed

- | | |
|---------------------------------------|-----------------------------------|
| <input type="checkbox"/> ___ SODIUM | <input type="checkbox"/> 350W LED |
| <input type="checkbox"/> 250W MERCURY | <input type="checkbox"/> ___ |

Size of copper wires & cable installed (roll,meters)

- | | |
|---|--|
| <input type="checkbox"/> 35 mm ² | <input type="checkbox"/> 50 mm ² |
| <input type="checkbox"/> 70 mm ² | <input type="checkbox"/> 2.5 mm ² |

Spareparts & others

- | | |
|--|--------------------------|
| <input type="checkbox"/> Photocell | <input type="checkbox"/> |
| <input type="checkbox"/> selector switch | <input type="checkbox"/> |
| <input type="checkbox"/> contactor | <input type="checkbox"/> |
| <input type="checkbox"/> breaker | <input type="checkbox"/> |
| <input type="checkbox"/> 4A fuse | <input type="checkbox"/> |
| <input type="checkbox"/> driver/ballast | <input type="checkbox"/> |

Manpower

Quantity	Engineer	Supervisor	Safety	Elec/Technician	Driver/Operator	Labor	Others	Total
	1	1		6	1			9

Other works

- | | |
|--------------------------|--------------------------|
| <input type="checkbox"/> | <input type="checkbox"/> |
|--------------------------|--------------------------|

Equipment

- | | |
|---|---|
| <input type="checkbox"/> JCB/LOADER | <input checked="" type="checkbox"/> MANLIFT |
| <input type="checkbox"/> BOBCAT | <input type="checkbox"/> Hedge trimmer |
| <input type="checkbox"/> BOOM TRUCK | <input type="checkbox"/> Mower Grass |
| <input type="checkbox"/> SWEEPER | <input type="checkbox"/> GARBAGE COMPACTOR |
| <input checked="" type="checkbox"/> PICK UP | <input type="checkbox"/> |
| <input type="checkbox"/> HAULING TRUCK/DYNA | <input type="checkbox"/> |

SAFETY EQUIPMENT & DEVICES

- | | |
|--|-------------------------------------|
| <input checked="" type="checkbox"/> traffic cone | <input type="checkbox"/> sign board |
| <input type="checkbox"/> blinker light | <input type="checkbox"/> |
| <input type="checkbox"/> hard barricade | <input type="checkbox"/> |
| <input type="checkbox"/> warning tape | <input type="checkbox"/> |
| <input type="checkbox"/> fire extinguisher | <input type="checkbox"/> |
| <input checked="" type="checkbox"/> PPE | <input type="checkbox"/> |

Supervisor's Remarks:	All job completed. Logs closed	Supervisor's Name:	Alamin
-----------------------	--------------------------------	--------------------	--------

General Notes:	Proceed to the next activities	
----------------	--------------------------------	--






Document routing: Supervisors → Service chief/Engr → Document Controller

DAILY ACCOMPLISHMENT ACTIVITY					Date: 04 October 2024																			
Trades:		Streetlight			Log No.24-67707																			
Location/Area		Dammam Airport Landside area, Blue zone																						
Activities	Activity Start	Activity End	Extended Work	Preventive & Corrective Maintenance of streetlight & control panel																				
Time	6:00 AM	3:00 PM	3:00-5:00 PM 7:00-9:00 PM																					
Description of Activities <input type="checkbox"/> Checking/cleaning the breaker panel, and contactor panel from dirt. <input type="checkbox"/> Voltage measuring/reading <input type="checkbox"/> Replacement of new photocell/selector switch <input type="checkbox"/> Tightening of loose contact breaker <input type="checkbox"/> Troubleshooting, wiring & repairing (breaker,panel, lamp) <input type="checkbox"/> Grease and anti rust application <input type="checkbox"/> Manual Operation of circuit breaker/Control panel <input type="checkbox"/> Lamp/ driver installation <input type="checkbox"/> Receive emergency call from station 1 during streetlight trouble <input checked="" type="checkbox"/> Checking/inspection of non functional streetlight <input type="checkbox"/> Rewiring, cable pulling, cable termination <input type="checkbox"/> Assist damaged streetlight pole cause by car accident <input type="checkbox"/> _____				Material Quantities Lamp installed <input type="checkbox"/> ___ SODIUM <input type="checkbox"/> 350W LED <input type="checkbox"/> 250W MERCURY <input type="checkbox"/> ___ Size of copper wires & cable installed (roll,meters) <input type="checkbox"/> 35 mm ² <input type="checkbox"/> 50 mm ² <input type="checkbox"/> 70 mm ² <input type="checkbox"/> 2.5 mm ² Spareparts & others <input type="checkbox"/> Photocell <input type="checkbox"/> <input type="checkbox"/> selector switch <input type="checkbox"/> <input type="checkbox"/> contactor <input type="checkbox"/> <input type="checkbox"/> breaker <input type="checkbox"/> <input type="checkbox"/> 4A fuse <input type="checkbox"/> <input type="checkbox"/> driver/ballast <input type="checkbox"/> Other works <input type="checkbox"/> <input type="checkbox"/>																				
				Manpower <table border="1"> <tr> <th>Quantity</th> <th>Engineer</th> <th>Supervisor</th> <th>Safety</th> <th>Elec/Technician</th> <th>Driver/Operator</th> <th>Labor</th> <th>Others</th> <th>Total</th> </tr> <tr> <td>1</td> <td>1</td> <td></td> <td></td> <td>6</td> <td>1</td> <td></td> <td></td> <td>9</td> </tr> </table>			Quantity	Engineer	Supervisor	Safety	Elec/Technician	Driver/Operator	Labor	Others	Total	1	1			6	1			9
				Quantity	Engineer	Supervisor	Safety	Elec/Technician	Driver/Operator	Labor	Others	Total												
				1	1			6	1			9												
				Equipment <input type="checkbox"/> JCB/LOADER <input type="checkbox"/> MANLIFT <input type="checkbox"/> BOBCAT <input type="checkbox"/> Hedge trimmer <input type="checkbox"/> BOOM TRUCK <input type="checkbox"/> Mower Grass <input type="checkbox"/> SWEEPER <input type="checkbox"/> GARBAGE COMPACTOR <input checked="" type="checkbox"/> PICK UP <input type="checkbox"/> _____ <input type="checkbox"/> HAULING TRUCK/DYNA <input type="checkbox"/> _____			SAFETY EQUIPMENT & DEVICES <input type="checkbox"/> traffic cone <input type="checkbox"/> sign board <input type="checkbox"/> blinker light <input type="checkbox"/> _____ <input type="checkbox"/> hard barricade <input type="checkbox"/> _____ <input type="checkbox"/> warning tape <input type="checkbox"/> _____ <input type="checkbox"/> fire extinguisher <input type="checkbox"/> _____ <input checked="" type="checkbox"/> PPE <input type="checkbox"/> _____																	
				Supervisor's Remarks:		All job completed. Logs closed			Supervisor's Name: Alamin															
				General Notes:		Proceed to the next activities																		



Document routing:	Supervisors	→ Service chief/Engr	→ Document Controller
--------------------------	-------------	----------------------	-----------------------

DAILY ACCOMPLISHMENT ACTIVITY					Date: 05 October 2024					
Trades:		Streetlight			Log No.24-67874					
Location/Area		Dammam Airport Landside area, North Acc Road								
Activities	Activity Start	Activity End	Extended Work	Preventive & Corrective Maintenance of streetlight & control panel EEC-044, EPL-044,EPC-044						
Time	6:00 AM	3:00 PM	3:00-5:00 PM 7:00-9:00 PM							
Description of Activities				Material Quantities						
<input checked="" type="checkbox"/> Checking/cleaning the breaker panel, and contactor panel from dirt. <input checked="" type="checkbox"/> Voltage measuring/reading <input type="checkbox"/> Replacement of new photocell/selector switch <input checked="" type="checkbox"/> Tightening of loose contact breaker <input type="checkbox"/> Troubleshooting, wiring & repairing (breaker,panel, lamp) <input checked="" type="checkbox"/> Grease/W40, anti rust application <input type="checkbox"/> Manual Operation of circuit breaker/Control panel <input type="checkbox"/> Lamp/ driver installation <input type="checkbox"/> Receive emergency call from station 1 during streetlight trouble <input checked="" type="checkbox"/> Checking/inspection of non functional streetlight <input type="checkbox"/> Rewiring, cable pulling, cable termination <input type="checkbox"/> Assist damaged streetlight pole cause by car accident <input type="checkbox"/> _____				Lamp installed						
				<input type="checkbox"/> ___ SODIUM <input type="checkbox"/> 350W LED <input type="checkbox"/> 250W MERCURY <input type="checkbox"/> ___						
				Size of copper wires & cable installed (roll,meters)						
				<input type="checkbox"/> 35 mm ² <input type="checkbox"/> 50 mm ² <input type="checkbox"/> 70 mm ² <input type="checkbox"/> 2.5 mm ²						
				Spareparts & others						
				<input type="checkbox"/> Photocell <input type="checkbox"/> <input type="checkbox"/> selector switch <input type="checkbox"/> <input type="checkbox"/> contactor <input type="checkbox"/> <input type="checkbox"/> breaker <input type="checkbox"/> <input type="checkbox"/> 4A fuse <input type="checkbox"/> <input type="checkbox"/> driver/ballast <input type="checkbox"/>						
				Other works						
				<input type="checkbox"/> <input type="checkbox"/>						
				Manpower						
				Quantity	Engineer	Supervisor	Safety	Elec/Technician	Driver/Operator	Labor
	1	1		6	1			9		
Equipment				SAFETY EQUIPMENT & DEVICES						
<input type="checkbox"/> JCB/LOADER <input checked="" type="checkbox"/> MANLIFT <input type="checkbox"/> BOBCAT <input type="checkbox"/> Hedge trimmer <input type="checkbox"/> BOOM TRUCK <input type="checkbox"/> Mower Grass <input type="checkbox"/> SWEEPER <input type="checkbox"/> GARBAGE COMPACTOR <input checked="" type="checkbox"/> PICK UP <input type="checkbox"/> _____ <input type="checkbox"/> HAULING TRUCK/DYNA <input type="checkbox"/> _____				<input checked="" type="checkbox"/> traffic cone <input type="checkbox"/> sign board <input type="checkbox"/> blinker light <input type="checkbox"/> _____ <input type="checkbox"/> hard barricade <input type="checkbox"/> _____ <input type="checkbox"/> warning tape <input type="checkbox"/> _____ <input type="checkbox"/> fire extinguisher <input type="checkbox"/> _____ <input checked="" type="checkbox"/> PPE <input type="checkbox"/> _____						
Supervisor's Remarks:				All job completed. Logs closed		Supervisor's Name: Alamin				
General Notes:				Proceed to the next activities						

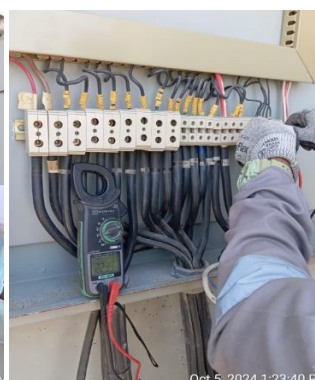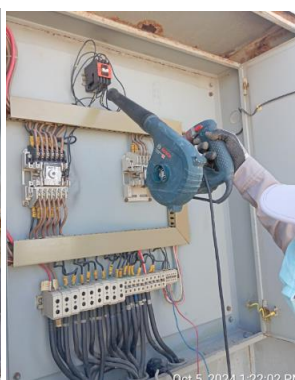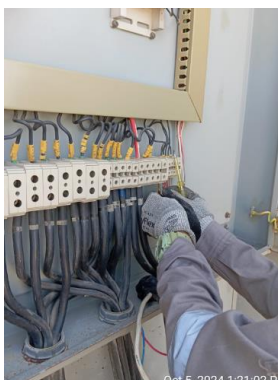


Document routing:	Supervisors	→ Service chief/Engr	→ Document Controller
--------------------------	-------------	----------------------	-----------------------

DAILY ACCOMPLISHMENT ACTIVITY						Date: 06 October 2024	
Trades:		Streetlight				Log No.24-68041	
Location/Area		Dammam Airport Landside area, North Acc Road					
Activities	Activity Start	Activity End	Extended Work	Preventive & Corrective Maintenance of streetlight & control panel EEC-043, EPL-043,EPC-043			
Time	6:00 AM	3:00 PM	3:00-5:00 PM 7:00-9:00 PM				
Description of Activities				Material Quantities			
<input type="checkbox"/> Checking/cleaning the breaker panel, and contactor panel from dirt. <input type="checkbox"/> Voltage measuring/reading <input type="checkbox"/> Replacement of new photocell/selector switch <input type="checkbox"/> Tightening of loose contact breaker <input type="checkbox"/> Troubleshooting, wiring & repairing (breaker,panel, lamp) <input type="checkbox"/> Grease and anti rust application <input type="checkbox"/> Manual Operation of circuit breaker/Control panel <input type="checkbox"/> Lamp/ driver installation <input type="checkbox"/> Receive emergency call from station 1 during streetlight trouble <input type="checkbox"/> Checking/inspection of non functional streetlight <input type="checkbox"/> Rewiring, cable pulling, cable termination <input type="checkbox"/> Assist damaged streetlight pole cause by car accident <input type="checkbox"/> _____				Lamp installed <input type="checkbox"/> ___ SODIUM <input type="checkbox"/> 350W LED <input type="checkbox"/> 250W MERCURY <input type="checkbox"/> ___ Size of copper wires & cable installed (roll,meters) <input type="checkbox"/> 35 mm ² <input type="checkbox"/> 50 mm ² <input type="checkbox"/> 70 mm ² <input type="checkbox"/> 2.5 mm ² Spareparts & others <input type="checkbox"/> Photocell <input type="checkbox"/> <input type="checkbox"/> selector switch <input type="checkbox"/> <input type="checkbox"/> contactor <input type="checkbox"/> <input type="checkbox"/> breaker <input type="checkbox"/> <input type="checkbox"/> 4A fuse <input type="checkbox"/> <input type="checkbox"/> driver/ballast <input type="checkbox"/> Other works <input type="checkbox"/> <input type="checkbox"/>			
Manpower							
Quantity	Engineer	Supervisor	Safety	Elec/Technician	Driver/Operator	Labor	Others
	1	1		6	1		
							Total 9
Equipment				SAFETY EQUIPMENT & DEVICES			
<input type="checkbox"/> JCB/LOADER <input type="checkbox"/> MANLIFT <input type="checkbox"/> BOBCAT <input type="checkbox"/> Hedge trimmer <input type="checkbox"/> BOOM TRUCK <input type="checkbox"/> Mower Grass <input type="checkbox"/> SWEEPER <input type="checkbox"/> GARBAGE COMPACTOR <input type="checkbox"/> PICK UP <input type="checkbox"/> _____ <input type="checkbox"/> HAULING TRUCK/DYNA <input type="checkbox"/> _____				<input type="checkbox"/> traffic cone <input type="checkbox"/> sign board <input type="checkbox"/> blinker light <input type="checkbox"/> _____ <input type="checkbox"/> hard barricade <input type="checkbox"/> _____ <input type="checkbox"/> warning tape <input type="checkbox"/> _____ <input type="checkbox"/> fire extinguisher <input type="checkbox"/> _____ <input type="checkbox"/> PPE <input type="checkbox"/> _____			
Supervisor's Remarks:		All job completed. Logs closed				Supervisor's Name: Alamin	
General Notes:		Proceed to the next activities					



Document routing:	Supervisors	→	Service chief/Engr	→	Document Controller
--------------------------	-------------	---	--------------------	---	---------------------

DAILY ACCOMPLISHMENT ACTIVITY								Date: 07 October 2024																			
Trades:		Streetlight						Log No.24-68337, 68449																			
Location/Area		Dammam Airport Landside area, Green zone																									
Activities	Activity Start	Activity End	Preventive & Corrective Maintenance of streetlight & control panel																								
Time	6:00 AM	3:00 PM	<div>Extended Work</div> <div>3:00-5:00 PM</div> <div>7:00-9:00 PM</div>																								
Description of Activities <div> <input checked="" type="checkbox"/> Checking/cleaning the breaker panel, and contactor panel from dirt. <input checked="" type="checkbox"/> Voltage measuring/reading <input type="checkbox"/> Replacement of new photocell/selector switch <input checked="" type="checkbox"/> Tightening of loose contact breaker <input type="checkbox"/> Troubleshooting, wiring & repairing (breaker, panel, lamp) <input type="checkbox"/> Grease and anti rust application <input type="checkbox"/> Manual Operation of circuit breaker/Control panel <input checked="" type="checkbox"/> Lamp/ driver installation <input type="checkbox"/> Receive emergency call from station 1 during streetlight trouble <input checked="" type="checkbox"/> Checking/inspection of non functional streetlight <input type="checkbox"/> Rewiring, cable pulling, cable termination <input type="checkbox"/> Assist damaged streetlight pole cause by car accident <input type="checkbox"/> _____ </div>								Material Quantities <div> Lamp installed <div> <input type="checkbox"/> ___ SODIUM <input checked="" type="checkbox"/> 1 350W LED <input type="checkbox"/> ___ MERCURY <input type="checkbox"/> ___ </div> </div> <div> Size of copper wires & cable installed (roll, meters) <div> <input type="checkbox"/> 35 mm² <input type="checkbox"/> 50 mm² <input type="checkbox"/> 70 mm² <input type="checkbox"/> 2.5 mm² </div> </div> <div> Spareparts & others <div> <input type="checkbox"/> Photocell <input type="checkbox"/> selector switch <input type="checkbox"/> contactor <input type="checkbox"/> breaker <input type="checkbox"/> 4A fuse <input checked="" type="checkbox"/> 5 driver/ballast </div> </div> <div> Other works <div> <input type="checkbox"/> <input type="checkbox"/> </div> </div>																			
Manpower <table border="1"> <thead> <tr> <th>Quantity</th> <th>Engineer</th> <th>Supervisor</th> <th>Safety</th> <th>Elec/Technician</th> <th>Driver/Operator</th> <th>Labor</th> <th>Others</th> <th>Total</th> </tr> </thead> <tbody> <tr> <td>1</td> <td>1</td> <td></td> <td></td> <td>6</td> <td>1</td> <td></td> <td></td> <td>9</td> </tr> </tbody> </table>								Quantity	Engineer	Supervisor	Safety	Elec/Technician	Driver/Operator	Labor	Others	Total	1	1			6	1			9		
Quantity	Engineer	Supervisor	Safety	Elec/Technician	Driver/Operator	Labor	Others	Total																			
1	1			6	1			9																			
Equipment <div> <input type="checkbox"/> JCB/LOADER <input checked="" type="checkbox"/> MANLIFT <input type="checkbox"/> BOBCAT <input type="checkbox"/> Hedge trimmer <input type="checkbox"/> BOOM TRUCK <input type="checkbox"/> Mower Grass <input type="checkbox"/> SWEEPER <input type="checkbox"/> GARBAGE COMPACTOR <input checked="" type="checkbox"/> PICK UP <input type="checkbox"/> _____ <input type="checkbox"/> HAULING TRUCK/DYNA <input type="checkbox"/> _____ </div>								SAFETY EQUIPMENT & DEVICES <div> <input checked="" type="checkbox"/> traffic cone <input type="checkbox"/> sign board <input type="checkbox"/> blinker light <input type="checkbox"/> hard barricade <input type="checkbox"/> warning tape <input type="checkbox"/> fire extinguisher <input checked="" type="checkbox"/> PPE <input type="checkbox"/> _____ <input type="checkbox"/> _____ <input type="checkbox"/> _____ </div>																			
Supervisor's Remarks:		All job completed. Logs closed						Supervisor's Name: Alamin																			
General Notes:		Proceed to the next activities																									

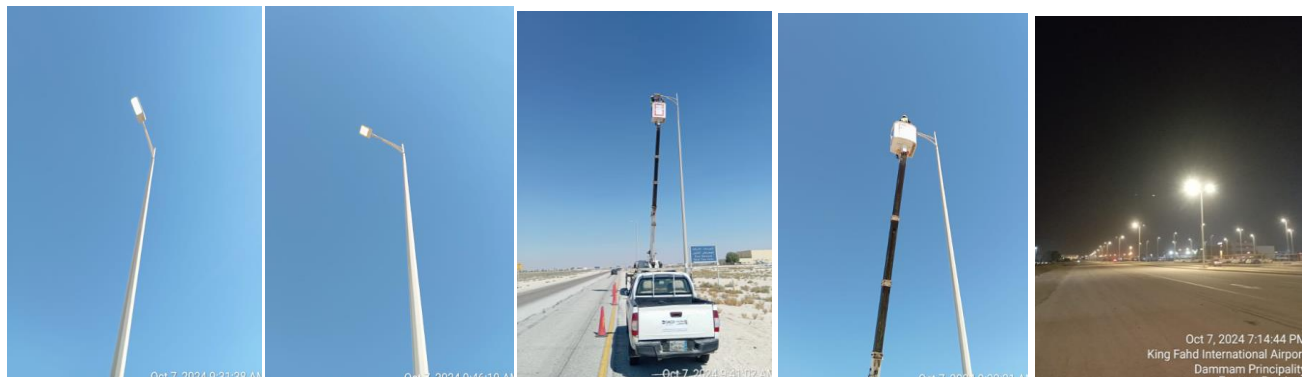

Document routing: Supervisors → Service chief/Engr → Document Controller

DAILY ACCOMPLISHMENT ACTIVITY						Date: 08 October 2024	
Trades:		Streetlight				Log No.24-68636	
Location/Area		Dammam Airport Landside area, RSAF Camp					
Activities	Activity Start	Activity End	Extended Work	Preventive & Corrective Maintenance of streetlight & control panel			
Time	6:00 AM	3:00 PM	3:00-5:00 PM 7:00-9:00 PM				
Description of Activities <input type="checkbox"/> Checking/cleaning the breaker panel, and contactor panel from dirt. <input checked="" type="checkbox"/> Voltage measuring/reading <input type="checkbox"/> Replacement of new photocell/selector switch <input checked="" type="checkbox"/> Tightening of loose contact breaker <input type="checkbox"/> Troubleshooting, wiring & repairing (breaker,panel, lamp) <input type="checkbox"/> Grease and anti rust application <input type="checkbox"/> Manual Operation of circuit breaker/Control panel <input checked="" type="checkbox"/> Lamp/ driver installation <input type="checkbox"/> Receive emergency call from station 1 during streetlight trouble <input checked="" type="checkbox"/> Checking/inspection of non functional streetlight <input type="checkbox"/> Rewiring, cable pulling, cable termination <input type="checkbox"/> Assist damaged streetlight pole cause by car accident <input type="checkbox"/> _____						Material Quantities	
						Lamp installed	
						<input type="checkbox"/> SODIUM	<input type="checkbox"/> 350W LED
						<input checked="" type="checkbox"/> 4 MERCURY	<input type="checkbox"/> HPS
						Size of copper wires & cable installed (roll,meters)	
						<input type="checkbox"/> 35 mm ²	<input type="checkbox"/> 50 mm ²
						<input type="checkbox"/> 70 mm ²	<input type="checkbox"/> 2.5 mm ²
						Spareparts & others	
						<input checked="" type="checkbox"/> 1 Photocell	<input type="checkbox"/>
						<input type="checkbox"/> selector switch	<input type="checkbox"/>
<input type="checkbox"/> contactor	<input type="checkbox"/>						
<input type="checkbox"/> breaker	<input type="checkbox"/>						
<input checked="" type="checkbox"/> 2 4A fuse	<input type="checkbox"/>						
<input type="checkbox"/> driver/ballast	<input type="checkbox"/>						
Manpower						Other works	
Quantity	Engineer	Supervisor	Safety	Elec/Technician	Driver/Operator	Labor	Others
	1	1		6	1		
						Total	9
Equipment						SAFETY EQUIPMENT & DEVICES	
<input type="checkbox"/> JCB/LOADER	<input checked="" type="checkbox"/> MANLIFT	<input checked="" type="checkbox"/> traffic cone	<input type="checkbox"/> sign board				
<input type="checkbox"/> BOBCAT	<input type="checkbox"/> Hedge trimmer	<input type="checkbox"/> blinker light	<input type="checkbox"/>				
<input type="checkbox"/> BOOM TRUCK	<input type="checkbox"/> Mower Grass	<input type="checkbox"/> hard barricade	<input type="checkbox"/>				
<input type="checkbox"/> SWEEPER	<input type="checkbox"/> GARBAGE COMPACTOR	<input type="checkbox"/> warning tape	<input type="checkbox"/>				
<input checked="" type="checkbox"/> PICK UP	<input type="checkbox"/>	<input type="checkbox"/> fire extinguisher	<input type="checkbox"/>				
<input type="checkbox"/> HAULING TRUCK/DYNA	<input type="checkbox"/>	<input checked="" type="checkbox"/> PPE	<input type="checkbox"/>				
Supervisor's Remarks:						Supervisor's Name:	
All job completed. Logs closed						Alamin	
General Notes:							
Proceed to the next activities							




Document routing:	Supervisors	→	Service chief/Engr	→	Document Controller
--------------------------	-------------	---	--------------------	---	---------------------

DAILY ACCOMPLISHMENT ACTIVITY					Date: 09 October 2024					
Trades:		Streetlight			Log No.24-68863, 68989					
Location/Area		Dammam Airport Landside area, East Service Road								
Activities	Activity Start	Activity End	Extended Work	Preventive & Corrective Maintenance of streetlight & control panel EEC-032, EPL-032,EPC-032						
Time	6:00 AM	3:00 PM	3:00-5:00 PM 7:00-9:00 PM							
Description of Activities				Material Quantities						
<input checked="" type="checkbox"/> Checking/cleaning the breaker panel, and contactor panel from dirt. <input checked="" type="checkbox"/> Voltage measuring/reading <input type="checkbox"/> Replacement of new photocell/selector switch <input checked="" type="checkbox"/> Tightening of loose contact breaker <input type="checkbox"/> Troubleshooting, wiring & repairing (breaker,panel, lamp) <input checked="" type="checkbox"/> Grease and anti rust application <input type="checkbox"/> Manual Operation of circuit breaker/Control panel <input type="checkbox"/> Lamp/ driver installation <input type="checkbox"/> Receive emergency call from station 1 during streetlight trouble <input checked="" type="checkbox"/> Checking/inspection of non functional streetlight <input type="checkbox"/> Rewiring, cable pulling, cable termination <input type="checkbox"/> Assist damaged streetlight pole cause by car accident <input type="checkbox"/> _____				Lamp installed						
				<input type="checkbox"/> ___ SODIUM <input type="checkbox"/> 350W LED <input type="checkbox"/> ___ MERCURY <input type="checkbox"/> ___ HPS						
				Size of copper wires & cable installed (roll,meters)						
				<input type="checkbox"/> 35 mm ² <input type="checkbox"/> 50 mm ² <input type="checkbox"/> 70 mm ² <input type="checkbox"/> 2.5 mm ²						
				Spareparts & others						
				<input type="checkbox"/> Photocell <input type="checkbox"/> <input type="checkbox"/> selector switch <input type="checkbox"/> <input type="checkbox"/> contactor <input type="checkbox"/> <input type="checkbox"/> breaker <input type="checkbox"/> <input type="checkbox"/> 4A fuse <input type="checkbox"/> <input type="checkbox"/> driver/ballast <input type="checkbox"/>						
				Other works						
				<input type="checkbox"/> <input type="checkbox"/>						
				Manpower						
				Quantity	Engineer	Supervisor	Safety	Elec/Technician	Driver/Operator	Labor
	1	1		6	1			9		
Equipment				SAFETY EQUIPMENT & DEVICES						
<input type="checkbox"/> JCB/LOADER <input checked="" type="checkbox"/> MANLIFT <input type="checkbox"/> BOBCAT <input type="checkbox"/> Hedge trimmer <input type="checkbox"/> BOOM TRUCK <input type="checkbox"/> Mower Grass <input type="checkbox"/> SWEEPER <input type="checkbox"/> GARBAGE COMPACTOR <input checked="" type="checkbox"/> PICK UP <input type="checkbox"/> _____ <input type="checkbox"/> HAULING TRUCK/DYNA <input type="checkbox"/> _____				<input checked="" type="checkbox"/> traffic cone <input type="checkbox"/> sign board <input type="checkbox"/> blinker light <input type="checkbox"/> _____ <input type="checkbox"/> hard barricade <input type="checkbox"/> _____ <input type="checkbox"/> warning tape <input type="checkbox"/> _____ <input type="checkbox"/> fire extinguisher <input type="checkbox"/> _____ <input checked="" type="checkbox"/> PPE <input type="checkbox"/> _____						
Supervisor's Remarks:				All job completed. Logs closed		Supervisor's Name: Alamin				
General Notes:				Proceed to the next activities						




Document routing:	Supervisors	→	Service chief/Engr	→	Document Controller
--------------------------	-------------	---	--------------------	---	---------------------

DAILY ACCOMPLISHMENT ACTIVITY						Date: 10 October 2024		
Trades:		Streetlight				Log No.24-69143, 69255		
Location/Area		Dammam Airport Landside area, South Service level						
Activities	Activity Start	Activity End	Extended Work	Preventive & Corrective Maintenance of streetlight & control panel G9-G13, W1a-W2a				
Time	6:00 AM	3:00 PM	3:00-5:00 PM 7:00-9:00 PM					
Description of Activities				Material Quantities				
<input checked="" type="checkbox"/> Checking/cleaning the breaker panel, and contactor panel from dirt. <input type="checkbox"/> Voltage measuring/reading <input type="checkbox"/> Replacement of new photocell/selector switch <input checked="" type="checkbox"/> Tightening of loose contact breaker <input type="checkbox"/> Troubleshooting, wiring & repairing (breaker,panel, lamp) <input type="checkbox"/> Grease and anti rust application <input type="checkbox"/> Manual Operation of circuit breaker/Control panel <input checked="" type="checkbox"/> Lamp/ driver installation <input type="checkbox"/> Receive emergency call from station 1 during streetlight trouble <input checked="" type="checkbox"/> Checking/inspection of non functional streetlight <input type="checkbox"/> Rewiring, cable pulling, cable termination <input type="checkbox"/> Assist damaged streetlight pole cause by car accident <input type="checkbox"/> _____				Lamp installed				
				<input type="checkbox"/> ___ SODIUM <input type="checkbox"/> 350W LED <input type="checkbox"/> ___ MERCURY <input type="checkbox"/> ___ HPS				
				Size of copper wires & cable installed (roll,meters)				
				<input type="checkbox"/> 35 mm ² <input type="checkbox"/> 50 mm ² <input type="checkbox"/> 70 mm ² <input type="checkbox"/> 2.5 mm ²				
				Spareparts & others				
				<input type="checkbox"/> Photocell <input type="checkbox"/> <input type="checkbox"/> selector switch <input type="checkbox"/> <input type="checkbox"/> contactor <input type="checkbox"/> <input type="checkbox"/> breaker <input type="checkbox"/> <input type="checkbox"/> 4A fuse <input type="checkbox"/> <input checked="" type="checkbox"/> 4 driver/ballast <input type="checkbox"/>				
				Other works				
				<input type="checkbox"/> <input type="checkbox"/>				
				Manpower				
				Quantity	Engineer	Supervisor	Safety	Elec/Technician
	1	1		6	1			9
Equipment				SAFETY EQUIPMENT & DEVICES				
<input type="checkbox"/> JCB/LOADER <input checked="" type="checkbox"/> MANLIFT <input type="checkbox"/> BOBCAT <input type="checkbox"/> Hedge trimmer <input type="checkbox"/> BOOM TRUCK <input type="checkbox"/> Mower Grass <input type="checkbox"/> SWEEPER <input type="checkbox"/> GARBAGE COMPACTOR <input checked="" type="checkbox"/> PICK UP <input type="checkbox"/> _____ <input type="checkbox"/> HAULING TRUCK/DYNA <input type="checkbox"/> _____				<input checked="" type="checkbox"/> traffic cone <input type="checkbox"/> sign board <input type="checkbox"/> blinker light <input type="checkbox"/> _____ <input type="checkbox"/> hard barricade <input type="checkbox"/> _____ <input type="checkbox"/> warning tape <input type="checkbox"/> _____ <input type="checkbox"/> fire extinguisher <input type="checkbox"/> _____ <input checked="" type="checkbox"/> PPE <input type="checkbox"/> _____				
Supervisor's Remarks:		All job completed. Logs closed			Supervisor's Name:		Alamin	
General Notes:		Proceed to the next activities						

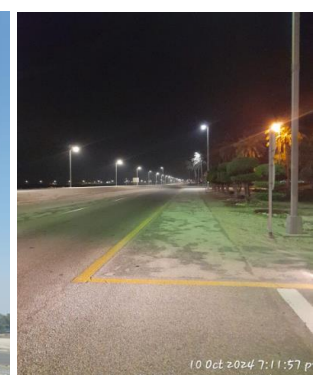

Document routing:	Supervisors	→ Service chief/Engr	→ Document Controller
-------------------	-------------	----------------------	-----------------------

DAILY ACCOMPLISHMENT ACTIVITY								Date: 12 October 2024	
Trades:		Streetlight						Log No.24-69589,69673	
Location/Area		Dammam Airport Landside area, Near Aramco gate							
Activities	Activity Start	Activity End	Extended Work		Preventive & Corrective Maintenance of streetlight & control panel EEC-030, EPL-030,EPC-030				
Time	6:00 AM	3:00 PM	3:00-5:00 PM 7:00-9:00 PM						
Description of Activities					Material Quantities				
<input checked="" type="checkbox"/> Checking/cleaning the breaker panel, and contactor panel from dirt. <input checked="" type="checkbox"/> Voltage measuring/reading <input type="checkbox"/> Replacement of new photocell/selector switch <input checked="" type="checkbox"/> Tightening of loose contact breaker <input type="checkbox"/> Troubleshooting, wiring & repairing (breaker,panel, lamp) <input checked="" type="checkbox"/> Grease and anti rust application <input checked="" type="checkbox"/> Manual Operation of circuit breaker/Control panel <input type="checkbox"/> Lamp/ driver installation <input type="checkbox"/> Receive emergency call from station 1 during streetlight trouble <input checked="" type="checkbox"/> Checking/inspection of non functional streetlight <input type="checkbox"/> Rewiring, cable pulling, cable termination <input type="checkbox"/> Assist damaged streetlight pole cause by car accident <input type="checkbox"/> _____					Lamp installed				
					<input type="checkbox"/> ___ SODIUM <input type="checkbox"/> 350W LED <input type="checkbox"/> ___ MERCURY <input type="checkbox"/> ___ HPS				
					Size of copper wires & cable installed (roll,meters)				
					<input type="checkbox"/> 35 mm ² <input type="checkbox"/> 50 mm ² <input type="checkbox"/> 70 mm ² <input type="checkbox"/> 2.5 mm ²				
					Spareparts & others				
					<input type="checkbox"/> Photocell <input type="checkbox"/> <input type="checkbox"/> selector switch <input type="checkbox"/> <input type="checkbox"/> contactor <input type="checkbox"/> <input type="checkbox"/> breaker <input type="checkbox"/> <input type="checkbox"/> 4A fuse <input type="checkbox"/> <input type="checkbox"/> driver/ballast <input type="checkbox"/>				
					Other works				
					<input type="checkbox"/> <input type="checkbox"/>				
					Manpower				
					Quantity	Engineer	Supervisor	Safety	Elec/Technician
	1	1		6	1			9	
Equipment					SAFETY EQUIPMENT & DEVICES				
<input type="checkbox"/> JCB/LOADER <input checked="" type="checkbox"/> MANLIFT <input type="checkbox"/> BOBCAT <input type="checkbox"/> Hedge trimmer <input type="checkbox"/> BOOM TRUCK <input type="checkbox"/> Mower Grass <input type="checkbox"/> SWEEPER <input type="checkbox"/> GARBAGE COMPACTOR <input checked="" type="checkbox"/> PICK UP <input type="checkbox"/> _____ <input type="checkbox"/> HAULING TRUCK/DYNA <input type="checkbox"/> _____					<input checked="" type="checkbox"/> traffic cone <input type="checkbox"/> sign board <input type="checkbox"/> blinker light <input type="checkbox"/> _____ <input type="checkbox"/> hard barricade <input type="checkbox"/> _____ <input type="checkbox"/> warning tape <input type="checkbox"/> _____ <input type="checkbox"/> fire extinguisher <input type="checkbox"/> _____ <input checked="" type="checkbox"/> PPE <input type="checkbox"/> _____				
Supervisor's Remarks:		All job completed. Logs closed						Supervisor's Name: Alamin	
General Notes:		Proceed to the next activities							

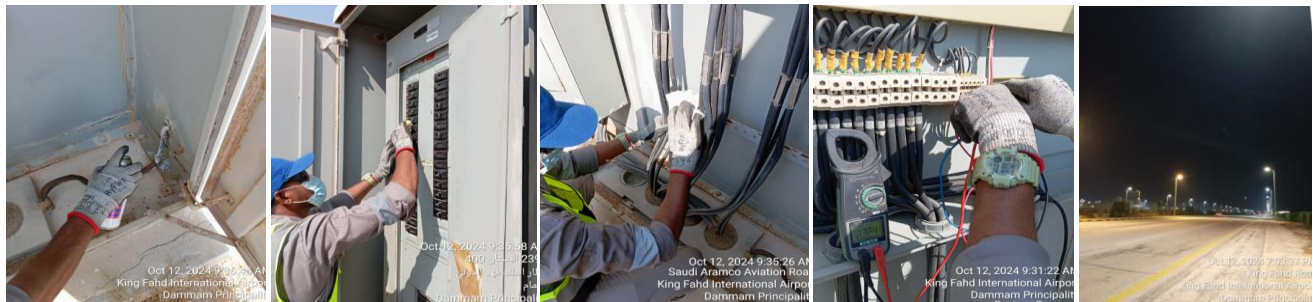

Document routing:	Supervisors	→	Service chief/Engr	→	Document Controller
-------------------	-------------	---	--------------------	---	---------------------

DAILY ACCOMPLISHMENT ACTIVITY					Date: 13 October 2024					
Trades:		Streetlight			Log No.24-69826, 69932, 69948					
Location/Area		Dammam Airport Landside area, East Service Road								
Activities	Activity Start	Activity End	Extended Work	Preventive & Corrective Maintenance of streetlight & control panel EEC-028, EPL-028,EPC-028 & Dammam mai gate						
Time	6:00 AM	3:00 PM	3:00-5:00 PM 7:00-9:00 PM							
Description of Activities				Material Quantities						
<input checked="" type="checkbox"/> Checking/cleaning the breaker panel, and contactor panel from dirt. <input checked="" type="checkbox"/> Voltage measuring/reading <input type="checkbox"/> Replacement of new photocell/selector switch <input checked="" type="checkbox"/> Tightening of loose contact breaker <input type="checkbox"/> Troubleshooting, wiring & repairing (breaker,panel, lamp) <input checked="" type="checkbox"/> Grease and anti rust application <input type="checkbox"/> Manual Operation of circuit breaker/Control panel <input type="checkbox"/> Lamp/ driver installation <input type="checkbox"/> Receive emergency call from station 1 during streetlight trouble <input checked="" type="checkbox"/> Checking/inspection of non functional streetlight <input type="checkbox"/> Rewiring, cable pulling, cable termination <input type="checkbox"/> Assist damaged streetlight pole cause by car accident <input type="checkbox"/> _____				Lamp installed						
				<input type="checkbox"/> ___ SODIUM <input type="checkbox"/> 350W LED <input type="checkbox"/> ___ MERCURY <input type="checkbox"/> ___ HPS						
				Size of copper wires & cable installed (roll,meters)						
				<input type="checkbox"/> 35 mm ² <input type="checkbox"/> 50 mm ² <input type="checkbox"/> 70 mm ² <input type="checkbox"/> 2.5 mm ²						
				Spareparts & others						
				<input type="checkbox"/> Photocell <input type="checkbox"/> <input type="checkbox"/> selector switch <input type="checkbox"/> <input type="checkbox"/> contactor <input type="checkbox"/> <input type="checkbox"/> breaker <input type="checkbox"/> <input type="checkbox"/> 4A fuse <input type="checkbox"/> <input type="checkbox"/> driver/ballast <input type="checkbox"/>						
				Other works						
				<input type="checkbox"/> <input type="checkbox"/>						
				Manpower						
				Quantity	Engineer	Supervisor	Safety	Elec/Technician	Driver/Operator	Labor
	1	1		6	1			9		
Equipment				SAFETY EQUIPMENT & DEVICES						
<input type="checkbox"/> JCB/LOADER <input checked="" type="checkbox"/> MANLIFT <input type="checkbox"/> BOBCAT <input type="checkbox"/> Hedge trimmer <input type="checkbox"/> BOOM TRUCK <input type="checkbox"/> Mower Grass <input type="checkbox"/> SWEEPER <input type="checkbox"/> GARBAGE COMPACTOR <input checked="" type="checkbox"/> PICK UP <input type="checkbox"/> _____ <input type="checkbox"/> HAULING TRUCK/DYNA <input type="checkbox"/> _____				<input checked="" type="checkbox"/> traffic cone <input type="checkbox"/> sign board <input type="checkbox"/> blinker light <input type="checkbox"/> _____ <input type="checkbox"/> hard barricade <input type="checkbox"/> _____ <input type="checkbox"/> warning tape <input type="checkbox"/> _____ <input type="checkbox"/> fire extinguisher <input type="checkbox"/> _____ <input checked="" type="checkbox"/> PPE <input type="checkbox"/> _____						
Supervisor's Remarks:				All job completed. Logs closed		Supervisor's Name: Alamin				
General Notes:				Proceed to the next activities						




Document routing:	Supervisors	→ Service chief/Engr	→ Document Controller
-------------------	-------------	----------------------	-----------------------

DAILY ACCOMPLISHMENT ACTIVITY								Date: 14 October 2024																			
Trades:		Streetlight						Log No.24-70096																			
Location/Area		Dammam Airport Landside area, Custom, Cargo Village																									
Activities	Activity Start	Activity End	Extended Work		Preventive & Corrective Maintenance of streetlight & control panel																						
Time	6:00 AM	3:00 PM	3:00-5:00 PM 7:00-9:00 PM																								
Description of Activities <div> <input checked="" type="checkbox"/> Checking/cleaning the breaker panel, and contactor panel from dirt. <input checked="" type="checkbox"/> Voltage measuring/reading <input type="checkbox"/> Replacement of new photocell/selector switch <input checked="" type="checkbox"/> Tightening of loose contact breaker <input checked="" type="checkbox"/> Troubleshooting, wiring & repairing (breaker,panel, lamp) <input type="checkbox"/> Grease and anti rust application <input type="checkbox"/> Manual Operation of circuit breaker/Control panel <input checked="" type="checkbox"/> Lamp/ driver installation <input type="checkbox"/> Receive emergency call from station 1 during streetlight trouble <input checked="" type="checkbox"/> Checking/inspection of non functional streetlight <input type="checkbox"/> Rewiring, cable pulling, cable termination <input type="checkbox"/> Assist damaged streetlight pole cause by car accident <input type="checkbox"/> _____ </div>								Material Quantities <div> Lamp installed <div> <input type="checkbox"/> ___ SODIUM <input checked="" type="checkbox"/> 2 350W LED <input type="checkbox"/> ___ MERCURY <input type="checkbox"/> ___ HPS </div> Size of copper wires & cable installed (roll,meters) <div> <input type="checkbox"/> 35 mm² <input type="checkbox"/> 50 mm² <input type="checkbox"/> 70 mm² <input type="checkbox"/> 2.5 mm² </div> Spareparts & others <div> <input type="checkbox"/> Photocell <input type="checkbox"/> fuse holder <input type="checkbox"/> selector switch <input type="checkbox"/> contactor <input type="checkbox"/> breaker <input type="checkbox"/> 4A fuse <input type="checkbox"/> driver/ballast </div> Other works <div> <input type="checkbox"/> <input type="checkbox"/> </div> </div>																			
Manpower <table border="1"> <thead> <tr> <th>Quantity</th> <th>Engineer</th> <th>Supervisor</th> <th>Safety</th> <th>Elec/Technician</th> <th>Driver/Operator</th> <th>Labor</th> <th>Others</th> <th>Total</th> </tr> </thead> <tbody> <tr> <td>1</td> <td>1</td> <td></td> <td></td> <td>6</td> <td>1</td> <td></td> <td></td> <td>9</td> </tr> </tbody> </table>								Quantity	Engineer	Supervisor	Safety	Elec/Technician	Driver/Operator	Labor	Others	Total	1	1			6	1			9		
Quantity	Engineer	Supervisor	Safety	Elec/Technician	Driver/Operator	Labor	Others	Total																			
1	1			6	1			9																			
Equipment <div> <input type="checkbox"/> JCB/LOADER <input checked="" type="checkbox"/> MANLIFT <input type="checkbox"/> BOBCAT <input type="checkbox"/> Hedge trimmer <input type="checkbox"/> BOOM TRUCK <input type="checkbox"/> Mower Grass <input type="checkbox"/> SWEEPER <input type="checkbox"/> GARBAGE COMPACTOR <input checked="" type="checkbox"/> PICK UP <input type="checkbox"/> _____ <input type="checkbox"/> HAULING TRUCK/DYNA <input type="checkbox"/> _____ </div>								SAFETY EQUIPMENT & DEVICES <div> <input checked="" type="checkbox"/> traffic cone <input type="checkbox"/> sign board <input type="checkbox"/> blinker light <input type="checkbox"/> hard barricade <input type="checkbox"/> warning tape <input type="checkbox"/> fire extinguisher <input checked="" type="checkbox"/> PPE </div>																			
Supervisor's Remarks:		All job completed. Logs closed						Supervisor's Name: Alamin																			
General Notes:		Proceed to the next activities																									



Document routing:	Supervisors	→	Service chief/Engr	→	Document Controller
-------------------	-------------	---	--------------------	---	---------------------

DAILY ACCOMPLISHMENT ACTIVITY						Date: 15 October 2024							
Trades:		Streetlight				Log No.24-70356,70401, 70481							
Location/Area		Dammam Airport Landside area, Cargo- SAL											
Activities	Activity Start	Activity End	Extended Work	Preventive & Corrective Maintenance of streetlight & control panel									
Time	6:00 AM	3:00 PM	3:00-5:00 PM 7:00-9:00 PM										
Description of Activities <input checked="" type="checkbox"/> Checking/cleaning the breaker panel, and contactor panel from dirt. <input checked="" type="checkbox"/> Voltage measuring/reading <input type="checkbox"/> Replacement of new photocell/selector switch <input checked="" type="checkbox"/> Tightening of loose contact breaker <input checked="" type="checkbox"/> Troubleshooting, wiring & repairing (breaker,panel, lamp) <input type="checkbox"/> Grease and anti rust application <input type="checkbox"/> Manual Operation of circuit breaker/Control panel <input type="checkbox"/> Lamp/ driver installation <input type="checkbox"/> Receive emergency call from station 1 during streetlight trouble <input checked="" type="checkbox"/> Checking/inspection of non functional streetlight <input type="checkbox"/> Rewiring, cable pulling, cable termination <input type="checkbox"/> Assist damaged streetlight pole cause by car accident <input checked="" type="checkbox"/> <u>Fixing the felldown control panel</u>						Material Quantities							
						Lamp installed							
						<input type="checkbox"/> ___ SODIUM	<input type="checkbox"/> 350W LED						
						<input type="checkbox"/> ___ MERCURY	<input type="checkbox"/> ___ HPS						
						Size of copper wires & cable installed (roll,meters)							
						<input type="checkbox"/> 35 mm ²	<input type="checkbox"/> 50 mm ²						
						<input type="checkbox"/> 70 mm ²	<input type="checkbox"/> 2.5 mm ²						
						Spareparts & others							
						<input type="checkbox"/> Photocell	<input type="checkbox"/>						
						<input type="checkbox"/> selector switch	<input type="checkbox"/>						
						<input type="checkbox"/> contactor	<input type="checkbox"/>						
						<input type="checkbox"/> breaker	<input type="checkbox"/>						
						<input type="checkbox"/> 4A fuse	<input type="checkbox"/>						
						<input type="checkbox"/> driver/ballast	<input type="checkbox"/>						
						Manpower						Other works	
<input checked="" type="checkbox"/> Conrete	<input checked="" type="checkbox"/> steel braces												
Quantity	Engineer	Supervisor	Safety	Elec/Technician	Driver/Operator	Labor	Others	Total					
	1	1		6	1			9					
Equipment <input type="checkbox"/> JCB/LOADER <input type="checkbox"/> BOBCAT <input type="checkbox"/> BOOM TRUCK <input type="checkbox"/> SWEEPER <input checked="" type="checkbox"/> PICK UP <input type="checkbox"/> HAULING TRUCK/DYNA <input checked="" type="checkbox"/> MANLIFT <input type="checkbox"/> Hedge trimmer <input type="checkbox"/> Mower Grass <input type="checkbox"/> GARBAGE COMPACTOR <input type="checkbox"/> _____ <input type="checkbox"/> _____						SAFETY EQUIPMENT & DEVICES							
						<input checked="" type="checkbox"/> traffic cone	<input type="checkbox"/> sign board						
						<input type="checkbox"/> blinker light	<input type="checkbox"/> _____						
						<input type="checkbox"/> hard barricade	<input type="checkbox"/> _____						
						<input type="checkbox"/> warning tape	<input type="checkbox"/> _____						
						<input type="checkbox"/> fire extiguisher	<input type="checkbox"/> _____						
						<input checked="" type="checkbox"/> PPE	<input type="checkbox"/> _____						
						Supervisor's Remarks:						Supervisor's Name:	
						All job completed. Logs closed						Alamin	
						General Notes:							
Proceed to the next activities													

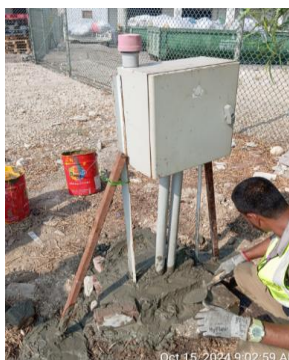

Document routing:	Supervisors	→	Service chief/Engr	→	Document Controller
--------------------------	-------------	---	--------------------	---	---------------------


DAILY ACCOMPLISHMENT ACTIVITY				Date: 16 October 2024
Trades:	Streetlight			Log No.24-70714
Location/Area	Dammam Airport Landside area, East Service Road			
Activities	Activity Start	Activity End	Extended Work	Preventive & Corrective Maintenance of streetlight & control panel EEC-027, EPL-027,EPC-027
Time	6:00 AM	3:00 PM	3:00-5:00 PM 7:00-9:00 PM	

Description of Activities		Material Quantities	
<input checked="" type="checkbox"/> Checking/cleaning the breaker panel, and contactor panel from dirt. <input checked="" type="checkbox"/> Voltage measuring/reading <input type="checkbox"/> Replacement of new photocell/selector switch <input checked="" type="checkbox"/> Tightening of loose contact breaker <input type="checkbox"/> Troubleshooting, wiring & repairing (breaker,panel, lamp) <input checked="" type="checkbox"/> Grease and anti rust application <input type="checkbox"/> Manual Operation of circuit breaker/Control panel <input type="checkbox"/> Lamp/ driver installation <input type="checkbox"/> Receive emergency call from station 1 during streetlight trouble <input checked="" type="checkbox"/> Checking/inspection of non functional streetlight <input type="checkbox"/> Rewiring, cable pulling, cable termination <input type="checkbox"/> Assist damaged streetlight pole cause by car accident <input type="checkbox"/> _____		Lamp installed <input type="checkbox"/> ___ SODIUM <input type="checkbox"/> LED <input type="checkbox"/> ___ MERCURY <input type="checkbox"/> ___ HPS Size of copper wires & cable installed (roll,meters) <input type="checkbox"/> 35 mm ² <input type="checkbox"/> 50 mm ² <input type="checkbox"/> 70 mm ² <input type="checkbox"/> 2.5 mm ² Spareparts & others <input type="checkbox"/> Photocell <input type="checkbox"/> <input type="checkbox"/> SW/TERMINAL BLOCK <input type="checkbox"/> contactor <input type="checkbox"/> <input type="checkbox"/> breaker <input type="checkbox"/> <input type="checkbox"/> 4A fuse <input type="checkbox"/> <input type="checkbox"/> driver/ballast <input type="checkbox"/>	

Manpower									Other works	
Quantity	Engineer	Supervisor	Safety	Elec/Technician	Driver/Operator	Labor	Others	Total	<input type="checkbox"/>	<input type="checkbox"/>
	1	1		6	1			9		

Equipment		SAFETY EQUIPMENT & DEVICES	
<input type="checkbox"/> JCB/LOADER <input type="checkbox"/> BOBCAT <input type="checkbox"/> BOOM TRUCK <input type="checkbox"/> SWEEPER <input checked="" type="checkbox"/> PICK UP <input type="checkbox"/> HAULING TRUCK/DYNA	<input checked="" type="checkbox"/> MANLIFT <input type="checkbox"/> Hedge trimmer <input type="checkbox"/> Mower Grass <input type="checkbox"/> GARBAGE COMPACTOR <input type="checkbox"/> _____ <input type="checkbox"/> _____	<input checked="" type="checkbox"/> traffic cone <input type="checkbox"/> blinker light <input type="checkbox"/> hard barricade <input type="checkbox"/> warning tape <input type="checkbox"/> fire extiguisher <input checked="" type="checkbox"/> PPE	<input type="checkbox"/> sign board <input type="checkbox"/> _____ <input type="checkbox"/> _____ <input type="checkbox"/> _____ <input type="checkbox"/> _____ <input type="checkbox"/> _____

Supervisor's Remarks:	All job completed. Logs closed	Supervisor's Name:	Alamin
General Notes:	Proceed to the next activities		

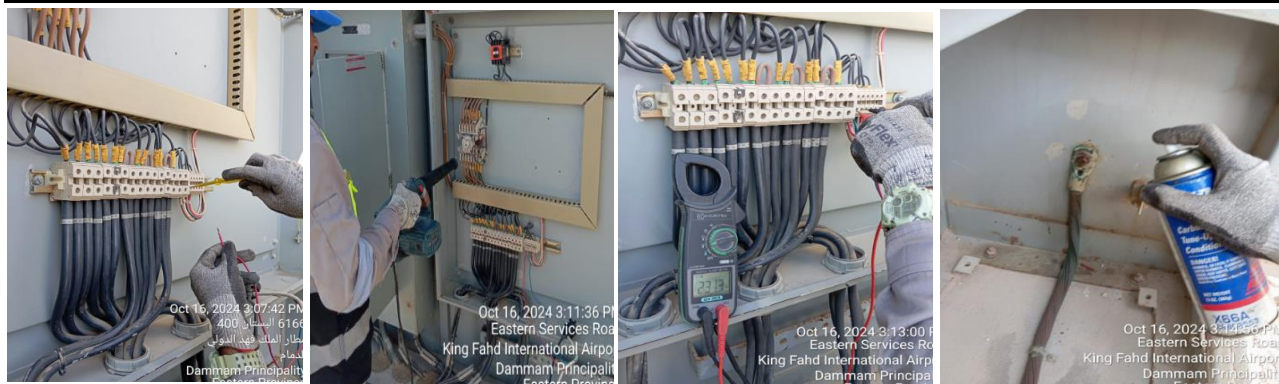

Document routing:	Supervisors	→ Service chief/Engr	→ Document Controller
--------------------------	-------------	----------------------	-----------------------


DAILY ACCOMPLISHMENT ACTIVITY				Date: 16 October 2024
Trades:	Streetlight			Log No.24-70715
Location/Area	Dammam Airport Landside area, Back of cargo vil.			
Activities	Activity Start	Activity End	Extended Work	Preventive & Corrective Maintenance of streetlight & control panel, DHL,AIRFREIGHT, FEDEX, ETC.
Time	6:00 AM	3:00 PM	3:00-5:00 PM 7:00-9:00 PM	

Description of Activities		Material Quantities	
<input type="checkbox"/> Checking/cleaning the breaker panel, and contactor panel from dirt. <input checked="" type="checkbox"/> Voltage measuring/reading <input type="checkbox"/> Replacement of new photocell/selector switch <input checked="" type="checkbox"/> Tightening of loose contact breaker <input checked="" type="checkbox"/> Troubleshooting, wiring & repairing (breaker,panel, lamp) <input type="checkbox"/> Grease and anti rust application <input type="checkbox"/> Manual Operation of circuit breaker/Control panel <input type="checkbox"/> Lamp/ driver installation <input type="checkbox"/> Receive emergency call from station 1 during streetlight trouble <input checked="" type="checkbox"/> Checking/inspection of non functional streetlight <input type="checkbox"/> Rewiring, cable pulling, cable termination <input type="checkbox"/> Assist damaged streetlight pole cause by car accident <input checked="" type="checkbox"/> Install magnetic contactor		Lamp installed <input type="checkbox"/> ___ SODIUM <input type="checkbox"/> LED <input type="checkbox"/> ___ MERCURY <input type="checkbox"/> ___ HPS Size of copper wires & cable installed (roll,meters) <input type="checkbox"/> 35 mm ² <input type="checkbox"/> 50 mm ² <input type="checkbox"/> 70 mm ² <input type="checkbox"/> 2.5 mm ² Spareparts & others <input type="checkbox"/> Photocell <input type="checkbox"/> <input type="checkbox"/> Selector switch <input type="checkbox"/> <input checked="" type="checkbox"/> contactor <input type="checkbox"/> <input type="checkbox"/> breaker <input type="checkbox"/> <input type="checkbox"/> 4A fuse <input type="checkbox"/> <input type="checkbox"/> driver/ballast <input type="checkbox"/>	

Manpower									Other works	
Quantity	Engineer	Supervisor	Safety	Elec/Technician	Driver/Operator	Labor	Others	Total	<input type="checkbox"/>	<input type="checkbox"/>
	1	1		6	1			9		




Equipment		SAFETY EQUIPMENT & DEVICES	
<input type="checkbox"/> JCB/LOADER <input type="checkbox"/> BOBCAT <input type="checkbox"/> BOOM TRUCK <input type="checkbox"/> SWEEPER <input checked="" type="checkbox"/> PICK UP <input type="checkbox"/> HAULING TRUCK/DYNA	<input checked="" type="checkbox"/> MANLIFT <input type="checkbox"/> Hedge trimmer <input type="checkbox"/> Mower Grass <input type="checkbox"/> GARBAGE COMPACTOR <input type="checkbox"/> _____ <input type="checkbox"/> _____	<input type="checkbox"/> traffic cone <input type="checkbox"/> sign board <input type="checkbox"/> blinker light <input type="checkbox"/> _____ <input type="checkbox"/> hard barricade <input type="checkbox"/> _____ <input type="checkbox"/> warning tape <input type="checkbox"/> _____ <input type="checkbox"/> fire extiguisher <input type="checkbox"/> _____ <input checked="" type="checkbox"/> PPE <input type="checkbox"/> _____	

Supervisor's Remarks:	All job completed. Logs closed	Supervisor's Name:	Alamin
General Notes:	Proceed to the next activities		

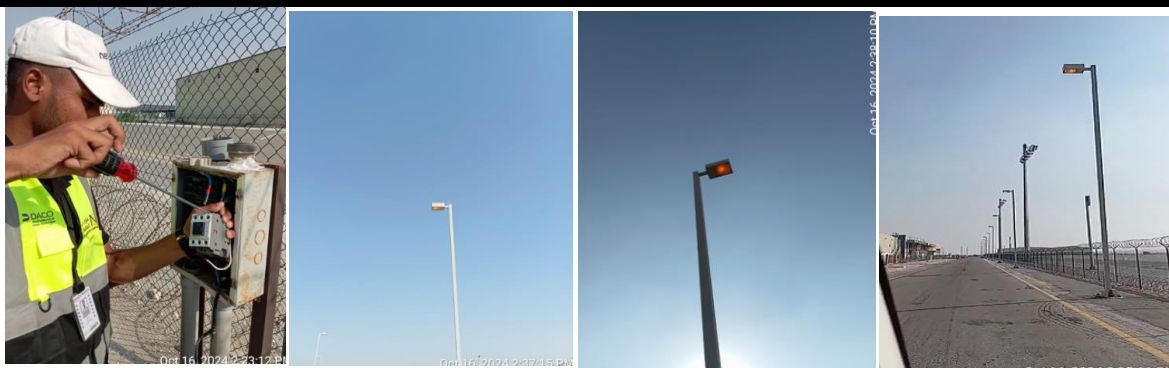


Document routing:	Supervisors	→ Service chief/Engr	→ Document Controller
--------------------------	-------------	----------------------	-----------------------

DAILY ACCOMPLISHMENT ACTIVITY						Date: 17 October 2024	
Trades:		Streetlight				Log No.24- 71022	
Location/Area		Dammam Airport Landside area, Royal Terminal					
Activities	Activity Start	Activity End	Extended Work	Preventive & Corrective Maintenance of streetlight & control panel EPL 025 Zone w1a-w2a			
Time	6:00 AM	3:00 PM	3:00-5:00 PM 7:00-9:00 PM				
Description of Activities				Material Quantities			
<input type="checkbox"/> Checking/cleaning the breaker panel, and contactor panel from dirt. <input type="checkbox"/> Voltage measuring/reading <input type="checkbox"/> Replacement of new photocell/selector switch <input type="checkbox"/> Tightening of loose contact breaker <input type="checkbox"/> Troubleshooting, wiring & repairing (breaker,panel, lamp) <input type="checkbox"/> Grease and anti rust application <input type="checkbox"/> Manual Operation of circuit breaker/Control panel <input type="checkbox"/> Lamp/ driver installation <input type="checkbox"/> Receive emergency call from station 1 during streetlight trouble <input type="checkbox"/> Checking/inspection of non functional streetlight <input type="checkbox"/> Rewiring, cable pulling, cable termination <input type="checkbox"/> Assist damaged streetlight pole cause by car accident <input type="checkbox"/> _____				Lamp installed <input type="checkbox"/> ___ SODIUM <input type="checkbox"/> LED <input type="checkbox"/> ___ MERCURY <input type="checkbox"/> ___ HPS Size of copper wires & cable installed (roll,meters) <input type="checkbox"/> 35 mm ² <input type="checkbox"/> 50 mm ² <input type="checkbox"/> 70 mm ² <input type="checkbox"/> 2.5 mm ² Spareparts & others <input type="checkbox"/> Photocell <input type="checkbox"/> <input type="checkbox"/> Selector switch <input type="checkbox"/> <input type="checkbox"/> contactor <input type="checkbox"/> <input type="checkbox"/> breaker <input type="checkbox"/> <input type="checkbox"/> 4A fuse <input type="checkbox"/> <input type="checkbox"/> driver/ballast <input type="checkbox"/> Other works <input type="checkbox"/> <input type="checkbox"/>			
Manpower							
Quantity	Engineer	Supervisor	Safety	Elec/Technician	Driver/Operator	Labor	Others
	1	1		6	1		
							Total
							9
Equipment				SAFETY EQUIPMENT & DEVICES			
<input type="checkbox"/> JCB/LOADER <input type="checkbox"/> MANLIFT <input type="checkbox"/> BOBCAT <input type="checkbox"/> Hedge trimmer <input type="checkbox"/> BOOM TRUCK <input type="checkbox"/> Mower Grass <input type="checkbox"/> SWEEPER <input type="checkbox"/> GARBAGE COMPACTOR <input type="checkbox"/> PICK UP <input type="checkbox"/> _____ <input type="checkbox"/> HAULING TRUCK/DYNA <input type="checkbox"/> _____				<input type="checkbox"/> traffic cone <input type="checkbox"/> sign board <input type="checkbox"/> blinker light <input type="checkbox"/> _____ <input type="checkbox"/> hard barricade <input type="checkbox"/> _____ <input type="checkbox"/> warning tape <input type="checkbox"/> _____ <input type="checkbox"/> fire extinguisher <input type="checkbox"/> _____ <input type="checkbox"/> PPE <input type="checkbox"/> _____			
Supervisor's Remarks:		All job completed. Logs closed				Supervisor's Name: Alamin	
General Notes:		Proceed to the next activities					

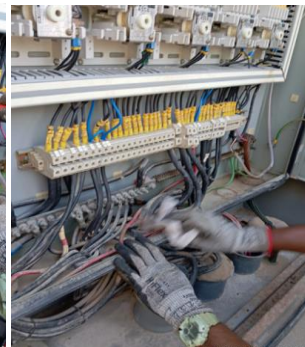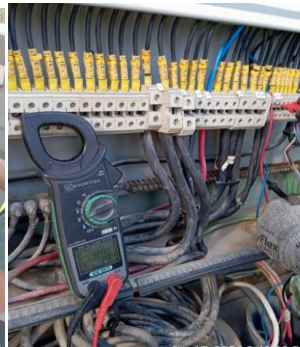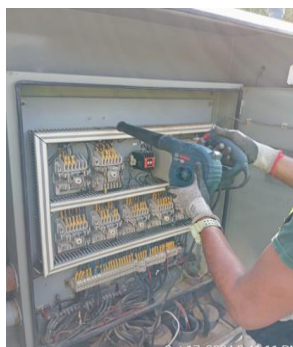


Document routing:	Supervisors	→	Service chief/Engr	→	Document Controller
-------------------	-------------	---	--------------------	---	---------------------

DAILY ACCOMPLISHMENT ACTIVITY						Date: 18 October 2024	
Trades:		Streetlight				Log No.24-71202	
Location/Area		Dammam Airport Landside area, Passenger Terminal					
Activities	Activity Start	Activity End	Extended Work	Preventive & Corrective Maintenance of streetlight & control panel			
Time	6:00 AM	3:00 PM	3:00-5:00 PM 7:00-9:00 PM				
Description of Activities				Material Quantities			
<input type="checkbox"/> Checking/cleaning the breaker panel, and contactor panel from dirt. <input type="checkbox"/> Voltage measuring/reading <input type="checkbox"/> Replacement of new photocell/selector switch Tightening of loose contact breaker <input type="checkbox"/> Troubleshooting, wiring & repairing (breaker,panel, lamp) <input type="checkbox"/> Grease and anti rust application <input type="checkbox"/> Manual Operation of circuit breaker/Control panel <input type="checkbox"/> Lamp/ driver installation <input type="checkbox"/> Receive emergency call from station 1 during streetlight trouble <input checked="" type="checkbox"/> Checking/inspection of non functional streetlight <input type="checkbox"/> Rewiring, cable pulling, cable termination <input type="checkbox"/> Assist damaged streetlight pole cause by car accident <input type="checkbox"/> _____				Lamp installed <input type="checkbox"/> ___ SODIUM <input type="checkbox"/> LED <input type="checkbox"/> ___ MERCURY <input type="checkbox"/> ___ HPS Size of copper wires & cable installed (roll,meters) <input type="checkbox"/> 35 mm ² <input type="checkbox"/> 50 mm ² <input type="checkbox"/> 70 mm ² <input type="checkbox"/> 2.5 mm ² Spareparts & others <input type="checkbox"/> Photocell <input type="checkbox"/> <input type="checkbox"/> Selector switch <input type="checkbox"/> <input type="checkbox"/> contactor <input type="checkbox"/> <input type="checkbox"/> breaker <input type="checkbox"/> <input type="checkbox"/> 4A fuse <input type="checkbox"/> <input type="checkbox"/> driver/ballast <input type="checkbox"/> Other works <input type="checkbox"/> <input type="checkbox"/>			
Manpower							
Quantity	Engineer	Supervisor	Safety	Elec/Technician	Driver/Operator	Labor	Others
	1	1		6	1		
							Total 9
Equipment				SAFETY EQUIPMENT & DEVICES			
<input type="checkbox"/> JCB/LOADER <input checked="" type="checkbox"/> MANLIFT <input type="checkbox"/> BOBCAT <input type="checkbox"/> Hedge trimmer <input type="checkbox"/> BOOM TRUCK <input type="checkbox"/> Mower Grass <input type="checkbox"/> SWEEPER <input type="checkbox"/> GARBAGE COMPACTOR <input checked="" type="checkbox"/> PICK UP <input type="checkbox"/> _____ <input type="checkbox"/> HAULING TRUCK/DYNA <input type="checkbox"/> _____				<input type="checkbox"/> traffic cone <input type="checkbox"/> sign board <input type="checkbox"/> blinker light <input type="checkbox"/> _____ <input type="checkbox"/> hard barricade <input type="checkbox"/> _____ <input type="checkbox"/> warning tape <input type="checkbox"/> _____ <input type="checkbox"/> fire extinguisher <input type="checkbox"/> _____ <input checked="" type="checkbox"/> PPE <input type="checkbox"/> _____			
Supervisor's Remarks:		All job completed. Logs closed				Supervisor's Name: Alamin	
General Notes:		Proceed to the next activities					

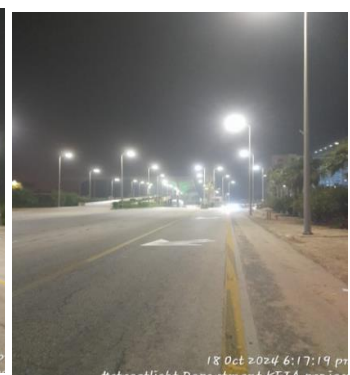

Document routing:	Supervisors	→ Service chief/Engr	→ Document Controller
--------------------------	-------------	----------------------	-----------------------

DAILY ACCOMPLISHMENT ACTIVITY						Date: 19 October 2024																			
Trades:		Streetlight				Log No.24-71377, 71419																			
Location/Area		Dammam Airport Landside area, Royal Terminal																							
Activities	Activity Start	Activity End	Extended Work	Preventive & Corrective Maintenance of streetlight & control panel EPL 025, zone w1a																					
Time	6:00 AM	3:00 PM	3:00-5:00 PM 7:00-9:00 PM																						
Description of Activities <input checked="" type="checkbox"/> Checking/cleaning the breaker panel, and contactor panel from dirt. <input checked="" type="checkbox"/> Voltage measuring/reading <input type="checkbox"/> Replacement of new photocell/selector switch <input checked="" type="checkbox"/> Tightening of loose contact breaker <input type="checkbox"/> Troubleshooting, wiring & repairing (breaker,panel, lamp) <input checked="" type="checkbox"/> Grease and anti rust application <input type="checkbox"/> Manual Operation of circuit breaker/Control panel <input type="checkbox"/> Lamp/ driver installation <input type="checkbox"/> Receive emergency call from station 1 during streetlight trouble <input checked="" type="checkbox"/> Checking/inspection of non functional streetlight <input type="checkbox"/> Rewiring, cable pulling, cable termination <input type="checkbox"/> Assist damaged streetlight pole cause by car accident <input type="checkbox"/> _____						Material Quantities																			
						Lamp installed																			
						<input type="checkbox"/> ___ SODIUM	<input type="checkbox"/> LED																		
						<input type="checkbox"/> 250W MERCURY	<input type="checkbox"/> ___ HPS																		
						Size of copper wires & cable installed (roll,meters)																			
						<input type="checkbox"/> 35 mm ²	<input type="checkbox"/> 50 mm ²																		
						<input type="checkbox"/> 70 mm ²	<input type="checkbox"/> 2.5 mm ²																		
						Spareparts & others																			
						<input type="checkbox"/> Photocell	<input type="checkbox"/> Fuse holder																		
						<input type="checkbox"/> Selector switch	<input type="checkbox"/>																		
						<input type="checkbox"/> contactor	<input type="checkbox"/>																		
						<input type="checkbox"/> breaker	<input type="checkbox"/>																		
						<input type="checkbox"/> 4A fuse	<input type="checkbox"/>																		
						<input type="checkbox"/> driver/ballast	<input type="checkbox"/>																		
						Manpower <table border="1"> <tr> <th>Quantity</th> <th>Engineer</th> <th>Supervisor</th> <th>Safety</th> <th>Elec/Technician</th> <th>Driver/Operator</th> <th>Labor</th> <th>Others</th> <th>Total</th> </tr> <tr> <td>1</td> <td>1</td> <td></td> <td></td> <td>6</td> <td>1</td> <td></td> <td></td> <td>9</td> </tr> </table>						Quantity	Engineer	Supervisor	Safety	Elec/Technician	Driver/Operator	Labor	Others	Total	1	1			6
Quantity	Engineer	Supervisor	Safety	Elec/Technician	Driver/Operator							Labor	Others	Total											
1	1			6	1			9																	
Equipment <input type="checkbox"/> JCB/LOADER <input type="checkbox"/> BOBCAT <input type="checkbox"/> BOOM TRUCK <input type="checkbox"/> SWEEPER <input checked="" type="checkbox"/> PICK UP <input type="checkbox"/> HAULING TRUCK/DYNA <input checked="" type="checkbox"/> MANLIFT <input type="checkbox"/> Hedge trimmer <input type="checkbox"/> Mower Grass <input type="checkbox"/> GARBAGE COMPACTOR <input type="checkbox"/> _____ <input type="checkbox"/> _____						SAFETY EQUIPMENT & DEVICES																			
						<input checked="" type="checkbox"/> traffic cone	<input type="checkbox"/> sign board																		
						<input type="checkbox"/> blinker light	<input type="checkbox"/>																		
						<input type="checkbox"/> hard barricade	<input type="checkbox"/>																		
						<input type="checkbox"/> warning tape	<input type="checkbox"/>																		
						<input type="checkbox"/> fire extinguisher	<input type="checkbox"/>																		
						<input checked="" type="checkbox"/> PPE	<input type="checkbox"/>																		
						Supervisor's Remarks:		All job completed. Logs closed		Supervisor's Name:		Alamin													
						General Notes:		Proceed to the next activities																	

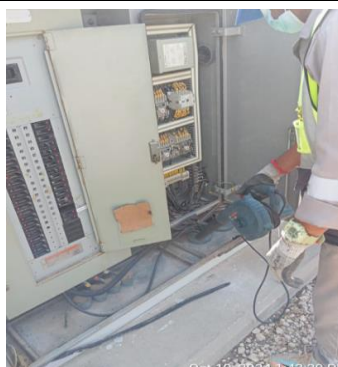

Document routing: Supervisors → Service chief/Engr → Document Controller

DAILY ACCOMPLISHMENT ACTIVITY						Date: 20 October 2024		
Trades:		Streetlight				Log No.24-71644,71695		
Location/Area		Dammam Airport Landside area, East service road						
Activities	Activity Start	Activity End	Extended Work	Preventive & Corrective Maintenance of streetlight & control panel JAG EEC 025, green zone				
Time	6:00 AM	3:00 PM	3:00-5:00 PM 7:00-9:00 PM					
Description of Activities <input checked="" type="checkbox"/> Checking/cleaning the breaker panel, and contactor panel from dirt. <input checked="" type="checkbox"/> Voltage measuring/reading <input type="checkbox"/> Replacement of new photocell/selector switch <input checked="" type="checkbox"/> Tightening of loose contact breaker <input type="checkbox"/> Troubleshooting, wiring & repairing (breaker,panel, lamp) <input checked="" type="checkbox"/> Grease and anti rust application <input checked="" type="checkbox"/> Manual Operation of circuit breaker/Control panel <input type="checkbox"/> Lamp/ driver installation <input type="checkbox"/> Receive emergency call from station 1 during streetlight trouble <input checked="" type="checkbox"/> Checking/inspection of non functional streetlight <input type="checkbox"/> Rewiring, cable pulling, cable termination <input type="checkbox"/> Assist damaged streetlight pole cause by car accident <input type="checkbox"/> _____						Material Quantities		
						Lamp installed		
						<input type="checkbox"/> SODIUM	<input type="checkbox"/> LED	
						<input type="checkbox"/> MERCURY	<input type="checkbox"/> 400W HPS	
						Size of copper wires & cable installed (roll,meters)		
						<input type="checkbox"/> 35 mm ²	<input type="checkbox"/> 50 mm ²	
						<input type="checkbox"/> 70 mm ²	<input type="checkbox"/> 2.5 mm ²	
						Spareparts & others		
						<input type="checkbox"/> Photocell	<input type="checkbox"/>	
						<input type="checkbox"/> Selector switch	<input type="checkbox"/>	
<input type="checkbox"/> 32A contactor	<input type="checkbox"/>							
<input type="checkbox"/> 50A breaker	<input type="checkbox"/>							
<input type="checkbox"/> 4A fuse	<input type="checkbox"/>							
<input type="checkbox"/> driver/ballast	<input type="checkbox"/>							
Manpower						Other works		
Quantity	Engineer	Supervisor	Safety	Elec/Technician	Driver/Operator	Labor	Others	Total
	1	1		6	1			9
Equipment						SAFETY EQUIPMENT & DEVICES		
<input type="checkbox"/> JCB/LOADER	<input checked="" type="checkbox"/> MANLIFT	<input type="checkbox"/> traffic cone	<input type="checkbox"/> sign board					
<input type="checkbox"/> BOBCAT	<input type="checkbox"/> Hedge trimmer	<input type="checkbox"/> blinker light	<input type="checkbox"/>					
<input type="checkbox"/> BOOM TRUCK	<input type="checkbox"/> Mower Grass	<input type="checkbox"/> hard barricade	<input type="checkbox"/>					
<input type="checkbox"/> SWEEPER	<input type="checkbox"/> GARBAGE COMPACTOR	<input type="checkbox"/> warning tape	<input type="checkbox"/>					
<input checked="" type="checkbox"/> PICK UP	<input type="checkbox"/>	<input type="checkbox"/> fire extinguisher	<input type="checkbox"/>					
<input type="checkbox"/> HAULING TRUCK/DYNA	<input type="checkbox"/>	<input checked="" type="checkbox"/> PPE	<input type="checkbox"/>					
Supervisor's Remarks:						Supervisor's Name:		
All job completed. Logs closed						Alamin		
General Notes:								
Proceed to the next activities								




Document routing: Supervisors → Service chief/Engr → Document Controller

DAILY ACCOMPLISHMENT ACTIVITY								Date: 21 October 2024	
Trades:		Streetlight						Log No.24-71916	
Location/Area		Dammam Airport Landside area, East service road							
Activities	Activity Start	Activity End	Extended Work		Preventive & Corrective Maintenance of streetlight & control panel EEC 013, Green zone, near aramco gate				
Time	6:00 AM	3:00 PM	3:00-5:00 PM 7:00-9:00 PM						
Description of Activities								Material Quantities	
<input checked="" type="checkbox"/> Checking/cleaning the breaker panel, and contactor panel from dirt. <input checked="" type="checkbox"/> Voltage measuring/reading <input type="checkbox"/> Replacement of new photocell/selector switch <input checked="" type="checkbox"/> Tightening of loose contact breaker <input type="checkbox"/> Troubleshooting, wiring & repairing (breaker,panel, lamp) <input type="checkbox"/> Grease and anti rust application <input type="checkbox"/> Manual Operation of circuit breaker/Control panel <input type="checkbox"/> Lamp/ driver installation <input type="checkbox"/> Receive emergency call from station 1 during streetlight trouble <input checked="" type="checkbox"/> Checking/inspection of non functional streetlight <input type="checkbox"/> Rewiring, cable pulling, cable termination <input type="checkbox"/> Assist damaged streetlight pole cause by car accident <input type="checkbox"/> _____								Lamp installed <input type="checkbox"/> ___ SODIUM <input type="checkbox"/> LED <input type="checkbox"/> ___ MERCURY <input type="checkbox"/> ___ HPS Size of copper wires & cable installed (roll,meters) <input type="checkbox"/> 35 mm ² <input type="checkbox"/> 50 mm ² <input type="checkbox"/> 70 mm ² <input type="checkbox"/> 2.5 mm ² Spareparts & others <input type="checkbox"/> Photocell <input type="checkbox"/> <input type="checkbox"/> Selector switch <input type="checkbox"/> <input type="checkbox"/> contactor <input type="checkbox"/> <input type="checkbox"/> breaker <input type="checkbox"/> <input type="checkbox"/> 4A fuse <input type="checkbox"/> <input type="checkbox"/> driver/ballast <input type="checkbox"/> Other works <input type="checkbox"/> <input type="checkbox"/>	
Manpower									
Quantity	Engineer	Supervisor	Safety	Elec/Technician	Driver/Operator	Labor	Others	Total	
	1	1		6	1			9	
Equipment								SAFETY EQUIPMENT & DEVICES	
<input type="checkbox"/> JCB/LOADER <input checked="" type="checkbox"/> MANLIFT <input type="checkbox"/> BOBCAT <input type="checkbox"/> Hedge trimmer <input type="checkbox"/> BOOM TRUCK <input type="checkbox"/> Mower Grass <input type="checkbox"/> SWEEPER <input type="checkbox"/> GARBAGE COMPACTOR <input checked="" type="checkbox"/> PICK UP <input type="checkbox"/> _____ <input type="checkbox"/> HAULING TRUCK/DYNA <input type="checkbox"/> _____								<input checked="" type="checkbox"/> traffic cone <input type="checkbox"/> sign board <input type="checkbox"/> blinker light <input type="checkbox"/> _____ <input type="checkbox"/> hard barricade <input type="checkbox"/> _____ <input type="checkbox"/> warning tape <input type="checkbox"/> _____ <input type="checkbox"/> fire extinguisher <input type="checkbox"/> _____ <input checked="" type="checkbox"/> PPE <input type="checkbox"/> _____	
Supervisor's Remarks:		All job completed. Logs closed						Supervisor's Name: Alamin	
General Notes:		Proceed to the next activities							





Document routing:	Supervisors	→ Service chief/Engr	→ Document Controller
-------------------	-------------	----------------------	-----------------------

DAILY ACCOMPLISHMENT ACTIVITY								Date: 22 October 2024									
Trades:		Streetlight						Log No.24-72176, 72216									
Location/Area		Dammam Airport Landside area, UBB gate															
Activities	Activity Start	Activity End	Extended Work		Preventive & Corrective Maintenance of streetlight & control panel EEC 014, Green zone												
Time	6:00 AM	3:00 PM	3:00-5:00 PM 7:00-9:00 PM														
Description of Activities								Material Quantities									
<input type="checkbox"/> Checking/cleaning the breaker panel, and contactor panel from dirt. <input checked="" type="checkbox"/> Voltage measuring/reading <input type="checkbox"/> Replacement of new photocell/selector switch <input checked="" type="checkbox"/> Tightening of loose contact breaker <input type="checkbox"/> Troubleshooting, wiring & repairing (breaker, panel, lamp) <input checked="" type="checkbox"/> Grease and anti rust application <input type="checkbox"/> Manual Operation of circuit breaker/Control panel <input type="checkbox"/> Lamp/ driver installation <input type="checkbox"/> Receive emergency call from station 1 during streetlight trouble <input checked="" type="checkbox"/> Checking/inspection of non functional streetlight <input type="checkbox"/> Rewiring, cable pulling, cable termination <input type="checkbox"/> Assist damaged streetlight pole cause by car accident <input type="checkbox"/> _____								Lamp installed									
								<input type="checkbox"/> __ SODIUM <input type="checkbox"/> LED <input type="checkbox"/> __ MERCURY <input type="checkbox"/> __ HPS									
								Size of copper wires & cable installed (roll, meters)									
								<input type="checkbox"/> 35 mm ² <input type="checkbox"/> 50 mm ² <input type="checkbox"/> 70 mm ² <input type="checkbox"/> 2.5 mm ²									
								Spareparts & others									
								<input type="checkbox"/> Photocell <input type="checkbox"/> <input type="checkbox"/> Selector switch <input type="checkbox"/> <input type="checkbox"/> contactor <input type="checkbox"/> <input type="checkbox"/> breaker <input type="checkbox"/> <input type="checkbox"/> 4A fuse <input type="checkbox"/> <input type="checkbox"/> driver/ballast <input type="checkbox"/>									
								Other works									
								<input type="checkbox"/> <input type="checkbox"/>									
								Manpower									
								Quantity	Engineer	Supervisor	Safety	Elec/Technician	Driver/Operator	Labor	Others	Total	
	1	1		6	1			9									
Equipment								SAFETY EQUIPMENT & DEVICES									
<input type="checkbox"/> JCB/LOADER <input checked="" type="checkbox"/> MANLIFT <input type="checkbox"/> BOBCAT <input type="checkbox"/> Hedge trimmer <input type="checkbox"/> BOOM TRUCK <input type="checkbox"/> Mower Grass <input type="checkbox"/> SWEEPER <input type="checkbox"/> GARBAGE COMPACTOR <input checked="" type="checkbox"/> PICK UP <input type="checkbox"/> _____ <input type="checkbox"/> HAULING TRUCK/DYNA <input type="checkbox"/> _____								<input checked="" type="checkbox"/> traffic cone <input type="checkbox"/> sign board <input type="checkbox"/> blinker light <input type="checkbox"/> _____ <input type="checkbox"/> hard barricade <input type="checkbox"/> _____ <input type="checkbox"/> warning tape <input type="checkbox"/> _____ <input type="checkbox"/> fire extinguisher <input type="checkbox"/> _____ <input checked="" type="checkbox"/> PPE <input type="checkbox"/> _____									
Supervisor's Remarks:		All job completed. Logs closed						Supervisor's Name: Alamin									
General Notes:		Proceed to the next activities															

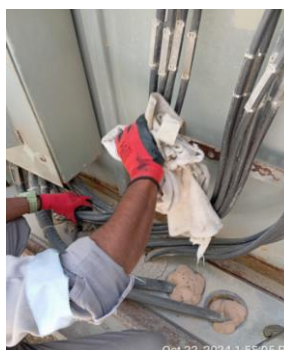


Document routing:	Supervisors	→	Service chief/Engr	→	Document Controller
-------------------	-------------	---	--------------------	---	---------------------

DAILY ACCOMPLISHMENT ACTIVITY								Date: 24 October 2024																			
Trades:		Streetlight						Log No.24- 72666, 72715																			
Location/Area		Dammam Airport Landside area, Control Tower																									
Activities	Activity Start	Activity End	Extended Work		Preventive & Corrective Maintenance of streetlight & control panel EEC 018, Yellow zone area																						
Time	6:00 AM	3:00 PM	3:00-5:00 PM 7:00-9:00 PM																								
Description of Activities <div> <input checked="" type="checkbox"/> Checking/cleaning the breaker panel, and contactor panel from dirt. <input checked="" type="checkbox"/> Voltage measuring/reading <input type="checkbox"/> Replacement of new photocell/selector switch <input checked="" type="checkbox"/> Tightening of loose contact breaker <input checked="" type="checkbox"/> Troubleshooting, wiring & repairing (breaker,panel, lamp) <input checked="" type="checkbox"/> Grease and anti rust application <input checked="" type="checkbox"/> Manual Operation of circuit breaker/Control panel <input type="checkbox"/> Lamp/ driver installation <input checked="" type="checkbox"/> Receive emergency call from station 1 during streetlight trouble <input checked="" type="checkbox"/> Checking/inspection of non functional streetlight <input type="checkbox"/> Rewiring, cable pulling, cable termination <input type="checkbox"/> Assist damaged streetlight pole cause by car accident <input type="checkbox"/> _____ </div>								Material Quantities <div> Lamp installed <div> <input type="checkbox"/> SODIUM <input type="checkbox"/> LED </div> <div> <input type="checkbox"/> MERCURY <input type="checkbox"/> 150W HPS </div> </div> Size of copper wires & cable installed (roll,meters) <div> <input type="checkbox"/> 35 mm² <input type="checkbox"/> 50 mm² </div> <div> <input type="checkbox"/> 70 mm² <input type="checkbox"/> 2.5 mm² </div>																			
Manpower <table border="1"> <thead> <tr> <th>Quantity</th> <th>Engineer</th> <th>Supervisor</th> <th>Safety</th> <th>Elec/Technician</th> <th>Driver/Operator</th> <th>Labor</th> <th>Others</th> <th>Total</th> </tr> </thead> <tbody> <tr> <td></td> <td>1</td> <td>1</td> <td></td> <td>6</td> <td>1</td> <td></td> <td></td> <td>9</td> </tr> </tbody> </table>								Quantity	Engineer	Supervisor	Safety	Elec/Technician	Driver/Operator	Labor	Others	Total		1	1		6	1			9	Spareparts & others <div> <input type="checkbox"/> Photocell <input type="checkbox"/> Selector switch <input type="checkbox"/> contactor <input type="checkbox"/> breaker <input type="checkbox"/> 4A fuse <input type="checkbox"/> driver/ballast </div>	
Quantity	Engineer	Supervisor	Safety	Elec/Technician	Driver/Operator	Labor	Others	Total																			
	1	1		6	1			9																			
Equipment <div> <input type="checkbox"/> JCB/LOADER <input checked="" type="checkbox"/> MANLIFT <input type="checkbox"/> BOBCAT <input type="checkbox"/> Hedge trimmer <input type="checkbox"/> BOOM TRUCK <input type="checkbox"/> Mower Grass <input type="checkbox"/> SWEEPER <input type="checkbox"/> GARBAGE COMPACTOR <input checked="" type="checkbox"/> PICK UP <input type="checkbox"/> _____ <input type="checkbox"/> HAULING TRUCK/DYNA <input type="checkbox"/> _____ </div>								SAFETY EQUIPMENT & DEVICES <div> <input checked="" type="checkbox"/> traffic cone <input type="checkbox"/> sign board <input type="checkbox"/> blinker light <input type="checkbox"/> hard barricade <input type="checkbox"/> warning tape <input type="checkbox"/> fire extinguisher <input checked="" type="checkbox"/> PPE </div>																			
Supervisor's Remarks:		All job completed. Logs closed						Supervisor's Name: Alamin																			
General Notes:		Proceed to the next activities																									

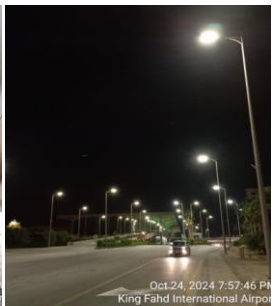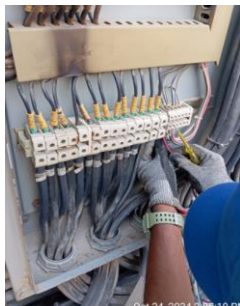


DAILY ACCOMPLISHMENT ACTIVITY					Date: 25 October 2024																			
Trades:		Streetlight			Log No.24- 72898																			
Location/Area		Dammam Airport Landside area, royal Terminal																						
Activities	Activity Start	Activity End	Extended Work	Preventive & Corrective Maintenance of streetlight & control panel																				
Time	6:00 AM	3:00 PM	3:00-5:00 PM 7:00-9:00 PM																					
Description of Activities <input type="checkbox"/> Checking/cleaning the breaker panel, and contactor panel from dirt. <input type="checkbox"/> Voltage measuring/reading <input type="checkbox"/> Replacement of new photocell/selector switch <input type="checkbox"/> Tightening of loose contact breaker <input type="checkbox"/> Troubleshooting, wiring & repairing (breaker,panel, lamp) <input type="checkbox"/> Grease and anti rust application <input type="checkbox"/> Manual Operation of circuit breaker/Control panel <input type="checkbox"/> Lamp/ driver installation <input type="checkbox"/> Receive emergency call from station 1 during streetlight trouble <input checked="" type="checkbox"/> Checking/inspection of non functional streetlight <input type="checkbox"/> Rewiring, cable pulling, cable termination <input type="checkbox"/> Assist damaged streetlight pole cause by car accident <input type="checkbox"/> Isolation of all exposed bare copper wire				Material Quantities Lamp installed <input type="checkbox"/> __ SODIUM <input type="checkbox"/> LED <input type="checkbox"/> __ MERCURY <input type="checkbox"/> __ HPS Size of copper wires & cable installed (roll,meters) <input type="checkbox"/> 35 mm ² <input type="checkbox"/> 50 mm ² <input type="checkbox"/> 70 mm ² <input type="checkbox"/> 2.5 mm ² Spareparts & others <input type="checkbox"/> Photocell <input type="checkbox"/> <input type="checkbox"/> Selector switch <input type="checkbox"/> <input type="checkbox"/> contactor <input type="checkbox"/> <input type="checkbox"/> breaker <input type="checkbox"/> <input type="checkbox"/> 4A fuse <input type="checkbox"/> <input type="checkbox"/> driver/ballast <input type="checkbox"/> Other works <input type="checkbox"/> <input type="checkbox"/>																				
				Manpower <table border="1"> <tr> <th>Quantity</th> <th>Engineer</th> <th>Supervisor</th> <th>Safety</th> <th>Elec/Technician</th> <th>Driver/Operator</th> <th>Labor</th> <th>Others</th> <th>Total</th> </tr> <tr> <td>1</td> <td>1</td> <td></td> <td></td> <td>6</td> <td>1</td> <td></td> <td></td> <td>9</td> </tr> </table>			Quantity	Engineer	Supervisor	Safety	Elec/Technician	Driver/Operator	Labor	Others	Total	1	1			6	1			9
				Quantity	Engineer	Supervisor	Safety	Elec/Technician	Driver/Operator	Labor	Others	Total												
				1	1			6	1			9												
				Equipment <input type="checkbox"/> JCB/LOADER <input checked="" type="checkbox"/> MANLIFT <input type="checkbox"/> BOBCAT <input type="checkbox"/> Hedge trimmer <input type="checkbox"/> BOOM TRUCK <input type="checkbox"/> Mower Grass <input type="checkbox"/> SWEEPER <input type="checkbox"/> GARBAGE COMPACTOR <input checked="" type="checkbox"/> PICK UP <input type="checkbox"/> _____ <input type="checkbox"/> HAULING TRUCK/DYNA <input type="checkbox"/> _____			SAFETY EQUIPMENT & DEVICES <input type="checkbox"/> traffic cone <input type="checkbox"/> sign board <input type="checkbox"/> blinker light <input type="checkbox"/> _____ <input type="checkbox"/> hard barricade <input type="checkbox"/> _____ <input type="checkbox"/> warning tape <input type="checkbox"/> _____ <input type="checkbox"/> fire extinguisher <input type="checkbox"/> _____ <input checked="" type="checkbox"/> PPE <input type="checkbox"/> _____																	
				Supervisor's Remarks:		All job completed. Logs closed			Supervisor's Name: Alamin															
				General Notes:		Proceed to the next activities																		

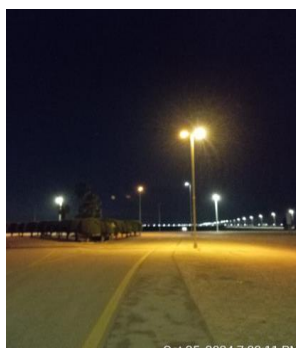

Document routing:	Supervisors	→	Service chief/Engr	→	Document Controller
--------------------------	-------------	---	--------------------	---	---------------------

DAILY ACCOMPLISHMENT ACTIVITY						Date: 26 October 2024	
Trades:		Streetlight				Log No.24- 73055	
Location/Area		Dammam Airport Landside area, Passenger Terminal					
Activities	Activity Start	Activity End	Extended Work	Preventive & Corrective Maintenance of streetlight & control panel EEC 019 A,B,C,D			
Time	6:00 AM	3:00 PM	3:00-5:00 PM 7:00-9:00 PM				
Description of Activities				Material Quantities			
<input checked="" type="checkbox"/> Checking/cleaning the breaker panel, and contactor panel from dirt. <input checked="" type="checkbox"/> Voltage measuring/reading <input type="checkbox"/> Replacement of new photocell/selector switch <input checked="" type="checkbox"/> Tightening of loose contact breaker <input checked="" type="checkbox"/> Troubleshooting, wiring & repairing (breaker,panel, lamp) <input checked="" type="checkbox"/> Grease and anti rust application <input checked="" type="checkbox"/> Manual Operation of circuit breaker/Control panel <input type="checkbox"/> Lamp/ driver installation <input type="checkbox"/> Receive emergency call from station 1 during streetlight trouble <input checked="" type="checkbox"/> Checking/inspection of non functional streetlight <input type="checkbox"/> Rewiring, cable pulling, cable termination <input type="checkbox"/> Assist damaged streetlight pole cause by car accident <input type="checkbox"/> _____				Lamp installed <input type="checkbox"/> ___ SODIUM <input type="checkbox"/> LED <input type="checkbox"/> 400W Mercury <input type="checkbox"/> ___ HPS Size of copper wires & cable installed (roll,meters) <input type="checkbox"/> 35 mm ² <input type="checkbox"/> 50 mm ² <input type="checkbox"/> 70 mm ² <input type="checkbox"/> 2.5 mm ² Spareparts & others <input type="checkbox"/> Photocell <input type="checkbox"/> Fuse holder <input type="checkbox"/> Selector switch <input type="checkbox"/> <input type="checkbox"/> contactor <input type="checkbox"/> <input type="checkbox"/> breaker <input type="checkbox"/> <input type="checkbox"/> 4A fuse <input type="checkbox"/> <input type="checkbox"/> driver/ballast <input type="checkbox"/> Other works <input type="checkbox"/> <input type="checkbox"/>			
Manpower							
Quantity	Engineer	Supervisor	Safety	Elec/Technician	Driver/Operator	Labor	Others
1	1			6	1		9
Equipment				SAFETY EQUIPMENT & DEVICES			
<input type="checkbox"/> JCB/LOADER <input checked="" type="checkbox"/> MANLIFT <input type="checkbox"/> BOBCAT <input type="checkbox"/> Hedge trimmer <input type="checkbox"/> BOOM TRUCK <input type="checkbox"/> Mower Grass <input type="checkbox"/> SWEEPER <input type="checkbox"/> GARBAGE COMPACTOR <input checked="" type="checkbox"/> PICK UP <input type="checkbox"/> _____ <input type="checkbox"/> HAULING TRUCK/DYNA <input type="checkbox"/> _____				<input checked="" type="checkbox"/> traffic cone <input type="checkbox"/> sign board <input type="checkbox"/> blinker light <input type="checkbox"/> _____ <input type="checkbox"/> hard barricade <input type="checkbox"/> _____ <input type="checkbox"/> warning tape <input type="checkbox"/> _____ <input type="checkbox"/> fire extinguisher <input type="checkbox"/> _____ <input checked="" type="checkbox"/> PPE <input type="checkbox"/> _____			
Supervisor's Remarks:		All job completed. Logs closed				Supervisor's Name: Alamin	
General Notes:		Proceed to the next activities					

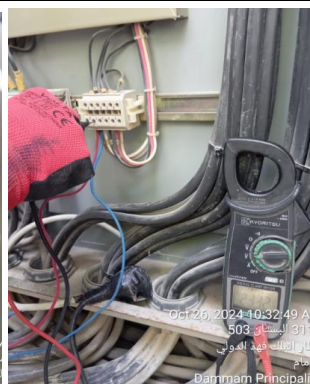


Document routing:	Supervisors	→ Service chief/Engr	→ Document Controller
-------------------	-------------	----------------------	-----------------------

DAILY ACCOMPLISHMENT ACTIVITY						Date: 27 October 2024		
Trades:		Streetlight				Log No.24- 73298,73380		
Location/Area		Dammam Airport Landside area, Passenger Terminal						
Activities	Activity Start	Activity End	Extended Work	Preventive & Corrective Maintenance of streetlight & control panel Eec 019 B,E,E				
Time	6:00 AM	3:00 PM	3:00-5:00 PM 7:00-9:00 PM					
Description of Activities				Material Quantities				
<input checked="" type="checkbox"/> Checking/cleaning the breaker panel, and contactor panel from dirt. <input checked="" type="checkbox"/> Voltage measuring/reading <input type="checkbox"/> Replacement of new photocell/selector switch <input checked="" type="checkbox"/> Tightening of loose contact breaker <input type="checkbox"/> Troubleshooting, wiring & repairing (breaker,panel, lamp) <input type="checkbox"/> Grease and anti rust application <input type="checkbox"/> Manual Operation of circuit breaker/Control panel <input type="checkbox"/> Lamp/ <u>driver installation</u> <input type="checkbox"/> Receive emergency call from station 1 during streetlight trouble <input checked="" type="checkbox"/> Checking/inspection of non functional streetlight <input type="checkbox"/> Rewiring, cable pulling, cable termination <input type="checkbox"/> Assist damaged streetlight pole cause by car accident <input type="checkbox"/> _____				Lamp installed				
				<input type="checkbox"/> ___ SODIUM <input type="checkbox"/> LED <input type="checkbox"/> ___ MERCURY <input type="checkbox"/> ___ HPS				
				Size of copper wires & cable installed (roll,meters)				
				<input type="checkbox"/> 35 mm ² <input type="checkbox"/> 50 mm ² <input type="checkbox"/> 70 mm ² <input type="checkbox"/> 2.5 mm ²				
				Spareparts & others				
				<input type="checkbox"/> Photocell <input type="checkbox"/> <input type="checkbox"/> Selector switch <input type="checkbox"/> <input type="checkbox"/> contactor <input type="checkbox"/> <input type="checkbox"/> breaker <input type="checkbox"/> <input type="checkbox"/> 4A fuse <input type="checkbox"/> <input type="checkbox"/> driver/ballast <input type="checkbox"/>				
				Other works				
				<input type="checkbox"/> <input type="checkbox"/>				
				Manpower				
				Quantity	Engineer	Supervisor	Safety	Elec/Technician
	1	1		6	1			9
Equipment				SAFETY EQUIPMENT & DEVICES				
<input type="checkbox"/> JCB/LOADER <input checked="" type="checkbox"/> MANLIFT <input type="checkbox"/> BOBCAT <input type="checkbox"/> Hedge trimmer <input type="checkbox"/> BOOM TRUCK <input type="checkbox"/> Mower Grass <input type="checkbox"/> SWEEPER <input type="checkbox"/> GARBAGE COMPACTOR <input checked="" type="checkbox"/> PICK UP <input type="checkbox"/> _____ <input type="checkbox"/> HAULING TRUCK/DYNA <input type="checkbox"/> _____				<input checked="" type="checkbox"/> traffic cone <input type="checkbox"/> sign board <input type="checkbox"/> blinker light <input type="checkbox"/> _____ <input type="checkbox"/> hard barricade <input type="checkbox"/> _____ <input type="checkbox"/> warning tape <input type="checkbox"/> _____ <input type="checkbox"/> fire extinguisher <input type="checkbox"/> _____ <input checked="" type="checkbox"/> PPE <input type="checkbox"/> _____				
Supervisor's Remarks:		All job completed. Logs closed				Supervisor's Name: Alamin		
General Notes:		Proceed to the next activities						



Document routing:	Supervisors	→	Service chief/Engr	→	Document Controller
--------------------------	-------------	---	--------------------	---	---------------------

DAILY ACCOMPLISHMENT ACTIVITY						Date: 29 October 2024	
Trades:		Streetlight				Log No.24-73814, 73898	
Location/Area		Dammam Airport Landside area, North service level gate					
Activities	Activity Start	Activity End	Extended Work	Preventive & Corrective Maintenance of streetlight & control panel EEC 019 C, D			
Time	6:00 AM	3:00 PM	3:00-5:00 PM 7:00-9:00 PM				
Description of Activities				Material Quantities			
<input checked="" type="checkbox"/> Checking/cleaning the breaker panel, and contactor panel from dirt. <input checked="" type="checkbox"/> Voltage measuring/reading <input type="checkbox"/> Replacement of new photocell/selector switch <input checked="" type="checkbox"/> Tightening of loose contact breaker <input type="checkbox"/> Troubleshooting, wiring & repairing (breaker,panel, lamp) <input checked="" type="checkbox"/> Grease and anti rust application <input type="checkbox"/> Manual Operation of circuit breaker/Control panel <input type="checkbox"/> Lamp/ driver installation <input type="checkbox"/> Receive emergency call from station 1 during streetlight trouble <input checked="" type="checkbox"/> Checking/inspection of non functional streetlight <input type="checkbox"/> Rewiring, cable pulling, cable termination <input type="checkbox"/> Assist damaged streetlight pole cause by car accident <input type="checkbox"/> _____				Lamp installed <input type="checkbox"/> ___ SODIUM <input type="checkbox"/> LED <input type="checkbox"/> ___ MERCURY <input type="checkbox"/> ___ HPS Size of copper wires & cable installed (roll,meters) <input type="checkbox"/> 35 mm ² <input type="checkbox"/> 50 mm ² <input type="checkbox"/> 70 mm ² <input type="checkbox"/> 2.5 mm ² Spareparts & others <input type="checkbox"/> Photocell <input type="checkbox"/> <input type="checkbox"/> Selector switch <input type="checkbox"/> <input type="checkbox"/> contactor <input type="checkbox"/> <input type="checkbox"/> breaker <input type="checkbox"/> <input type="checkbox"/> 4A fuse <input type="checkbox"/> <input type="checkbox"/> driver/ballast <input type="checkbox"/> Other works <input type="checkbox"/> <input type="checkbox"/>			
Manpower							
Quantity	Engineer	Supervisor	Safety	Elec/Technician	Driver/Operator	Labor	Others
	1	1		6	1		
							Total 9
Equipment				SAFETY EQUIPMENT & DEVICES			
<input type="checkbox"/> JCB/LOADER <input checked="" type="checkbox"/> MANLIFT <input type="checkbox"/> BOBCAT <input type="checkbox"/> Hedge trimmer <input type="checkbox"/> BOOM TRUCK <input type="checkbox"/> Mower Grass <input type="checkbox"/> SWEEPER <input type="checkbox"/> GARBAGE COMPACTOR <input checked="" type="checkbox"/> PICK UP <input type="checkbox"/> _____ <input type="checkbox"/> HAULING TRUCK/DYNA <input type="checkbox"/> _____				<input checked="" type="checkbox"/> traffic cone <input type="checkbox"/> sign board <input type="checkbox"/> blinker light <input type="checkbox"/> _____ <input type="checkbox"/> hard barricade <input type="checkbox"/> _____ <input type="checkbox"/> warning tape <input type="checkbox"/> _____ <input type="checkbox"/> fire extinguisher <input type="checkbox"/> _____ <input checked="" type="checkbox"/> PPE <input type="checkbox"/> _____			
Supervisor's Remarks:		All job completed. Logs closed				Supervisor's Name: Alamin	
General Notes:		Proceed to the next activities					

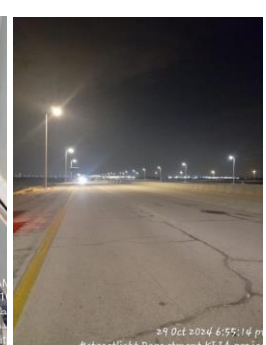

Document routing:	Supervisors	→	Service chief/Engr	→	Document Controller
--------------------------	-------------	---	--------------------	---	---------------------

DAILY ACCOMPLISHMENT ACTIVITY						Date: 30 October 2024																							
Trades:		Streetlight				Log No.24-																							
Location/Area		Dammam Airport Landside area, North Acc Road & Jubail road																											
Activities	Activity Start	Activity End	Extended Work	Preventive & Corrective Maintenance of streetlight & control panel																									
Time	6:00 AM	3:00 PM	3:00-5:00 PM 7:00-9:00 PM																										
Description of Activities <input type="checkbox"/> Checking/cleaning the breaker panel, and contactor panel from dirt. <input type="checkbox"/> Voltage measuring/reading <input type="checkbox"/> Replacement of new photocell/selector switch <input type="checkbox"/> Tightening of loose contact breaker <input type="checkbox"/> Troubleshooting, wiring & repairing (breaker,panel, lamp) <input type="checkbox"/> Grease and anti rust application <input type="checkbox"/> Manual Operation of circuit breaker/Control panel <input type="checkbox"/> Lamp/ driver installation <input type="checkbox"/> Receive emergency call from station 1 during streetlight trouble <input type="checkbox"/> Checking/inspection of non functional streetlight <input type="checkbox"/> Rewiring, cable pulling, cable termination <input type="checkbox"/> Assist damaged streetlight pole cause by car accident <input checked="" type="checkbox"/> Fixing the pole covers				Material Quantities Lamp installed <input type="checkbox"/> __ SODIUM <input type="checkbox"/> LED <input type="checkbox"/> __ MERCURY <input type="checkbox"/> __ HPS Size of copper wires & cable installed (roll,meters) <input type="checkbox"/> 35 mm ² <input type="checkbox"/> 50 mm ² <input type="checkbox"/> 70 mm ² <input type="checkbox"/> 2.5 mm ² Spareparts & others <input type="checkbox"/> Photocell <input type="checkbox"/> <input type="checkbox"/> Selector switch <input type="checkbox"/> <input type="checkbox"/> contactor <input type="checkbox"/> <input type="checkbox"/> breaker <input type="checkbox"/> <input type="checkbox"/> 4A fuse <input type="checkbox"/> <input type="checkbox"/> driver/ballast <input type="checkbox"/> Other works <input type="checkbox"/> <input type="checkbox"/>																									
				Manpower <table border="1"> <tr> <th>Quantity</th> <th>Engineer</th> <th>Supervisor</th> <th>Safety</th> <th>Elec/Technician</th> <th>Driver/Operator</th> <th>Labor</th> <th>Others</th> <th>Total</th> </tr> <tr> <td>1</td> <td>1</td> <td></td> <td></td> <td>6</td> <td>1</td> <td></td> <td></td> <td>9</td> </tr> </table>				Quantity	Engineer	Supervisor	Safety	Elec/Technician	Driver/Operator	Labor	Others	Total	1	1			6	1			9				
				Quantity	Engineer	Supervisor	Safety	Elec/Technician	Driver/Operator	Labor	Others	Total																	
				1	1			6	1			9																	
				Equipment <input type="checkbox"/> JCB/LOADER <input checked="" type="checkbox"/> MANLIFT <input type="checkbox"/> BOBCAT <input type="checkbox"/> Hedge trimmer <input type="checkbox"/> BOOM TRUCK <input type="checkbox"/> Mower Grass <input type="checkbox"/> SWEEPER <input type="checkbox"/> GARBAGE COMPACTOR <input checked="" type="checkbox"/> PICK UP <input type="checkbox"/> _____ <input type="checkbox"/> HAULING TRUCK/DYNA <input type="checkbox"/> _____				SAFETY EQUIPMENT & DEVICES <input checked="" type="checkbox"/> traffic cone <input type="checkbox"/> sign board <input type="checkbox"/> blinker light <input type="checkbox"/> _____ <input type="checkbox"/> hard barricade <input type="checkbox"/> _____ <input type="checkbox"/> warning tape <input type="checkbox"/> _____ <input type="checkbox"/> fire extinguisher <input type="checkbox"/> _____ <input checked="" type="checkbox"/> PPE <input type="checkbox"/> _____																					
				Supervisor's Remarks:		All job completed. Logs closed				Supervisor's Name: Alamin																			
				General Notes:		Proceed to the next activities																							



Document routing:	Supervisors	→	Service chief/Engr	→	Document Controller
--------------------------	-------------	---	--------------------	---	---------------------

DAILY ACCOMPLISHMENT ACTIVITY						Date: 31 October 2024		
Trades:		Streetlight				Log No.24-74338		
Location/Area		Dammam Airport Landside area, North Acc Road & Jubail road						
Activities	Activity Start	Activity End	Extended Work	Preventive & Corrective Maintenance of streetlight & control panel EEC, ECP, EPL 002 Blue zone area				
Time	6:00 AM	3:00 PM	3:00-5:00 PM 7:00-9:00 PM					
Description of Activities				Material Quantities				
<input checked="" type="checkbox"/> Checking/cleaning the breaker panel, and contactor panel from dirt. <input checked="" type="checkbox"/> Voltage measuring/reading <input type="checkbox"/> Replacement of new photocell/selector switch <input checked="" type="checkbox"/> Tightening of loose contact breaker <input type="checkbox"/> Troubleshooting, wiring & repairing (breaker,panel, lamp) <input checked="" type="checkbox"/> Grease and anti rust application <input type="checkbox"/> Manual Operation of circuit breaker/Control panel <input type="checkbox"/> Lamp/ driver installation <input type="checkbox"/> Receive emergency call from station 1 during streetlight trouble <input checked="" type="checkbox"/> Checking/inspection of non functional streetlight <input type="checkbox"/> Rewiring, cable pulling, cable termination <input type="checkbox"/> Assist damaged streetlight pole cause by car accident <input type="checkbox"/> _____				Lamp installed				
				<input type="checkbox"/> ___ SODIUM <input type="checkbox"/> LED <input type="checkbox"/> ___ MERCURY <input type="checkbox"/> ___ HPS				
				Size of copper wires & cable installed (roll,meters)				
				<input type="checkbox"/> 35 mm ² <input type="checkbox"/> 50 mm ² <input type="checkbox"/> 70 mm ² <input type="checkbox"/> 2.5 mm ²				
				Spareparts & others				
				<input type="checkbox"/> Photocell <input type="checkbox"/> <input type="checkbox"/> Selector switch <input type="checkbox"/> <input type="checkbox"/> contactor <input type="checkbox"/> <input type="checkbox"/> breaker <input type="checkbox"/> <input type="checkbox"/> 4A fuse <input type="checkbox"/> <input type="checkbox"/> driver/ballast <input type="checkbox"/>				
				Other works				
				<input type="checkbox"/> <input type="checkbox"/>				
				Manpower				
				Quantity	Engineer	Supervisor	Safety	Elec/Technician
	1	1		6	1			9
Equipment				SAFETY EQUIPMENT & DEVICES				
<input type="checkbox"/> JCB/LOADER <input checked="" type="checkbox"/> MANLIFT <input type="checkbox"/> BOBCAT <input type="checkbox"/> Hedge trimmer <input type="checkbox"/> BOOM TRUCK <input type="checkbox"/> Mower Grass <input type="checkbox"/> SWEEPER <input type="checkbox"/> GARBAGE COMPACTOR <input checked="" type="checkbox"/> PICK UP <input type="checkbox"/> _____ <input type="checkbox"/> HAULING TRUCK/DYNA <input type="checkbox"/> _____				<input checked="" type="checkbox"/> traffic cone <input type="checkbox"/> sign board <input type="checkbox"/> blinker light <input type="checkbox"/> _____ <input type="checkbox"/> hard barricade <input type="checkbox"/> _____ <input type="checkbox"/> warning tape <input type="checkbox"/> _____ <input type="checkbox"/> fire extinguisher <input type="checkbox"/> _____ <input checked="" type="checkbox"/> PPE <input type="checkbox"/> _____				
Supervisor's Remarks:		All job completed. Logs closed				Supervisor's Name: Alamin		
General Notes:		Proceed to the next activities						



Document routing:	Supervisors	→ Service chief/Engr	→ Document Controller
-------------------	-------------	----------------------	-----------------------