

NISREEN FACTORY FOR SPECIAL AND SAFETY WORKS BALLISTICS PERFORMANCE TEST REPORT

SCOPE OF WORK

NIJ STANDARD 0108.01 BALLISTIC TESTING ON STEEL DOOR ASSEMBLY

REPORT NUMBER

Q6529.01-119-12 R0

TEST DATE

12/08/23

ISSUE DATE

01/03/24


PAGES

14

DOCUMENT CONTROL NUMBER

RT-R-AMER-TEST-2788 (05/26/23)

© 2017 INTERTEK

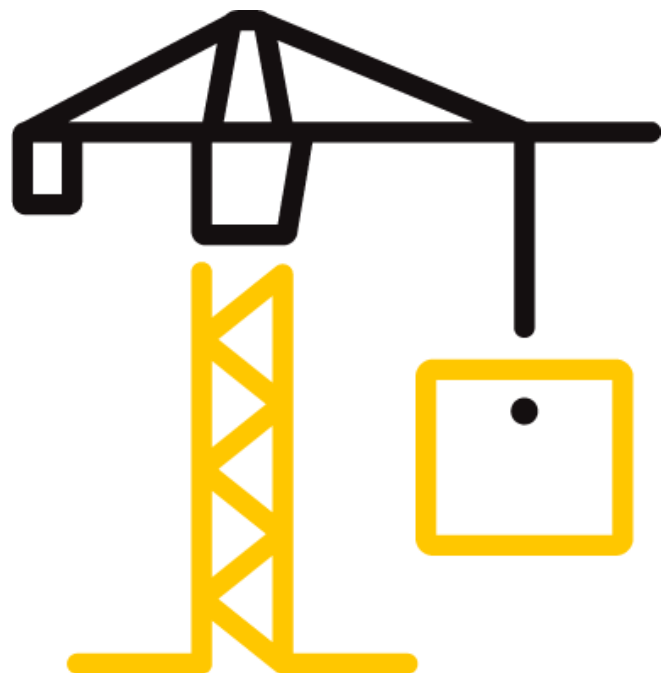

TEST REPORT FOR NISREEN FACTORY FOR SPECIAL AND SAFETY WORKS

Report No.: Q6529.01-119-12 R0

Date: 01/03/24

REPORT ISSUED TO

NISREEN FACTORY FOR SPECIAL AND SAFETY WORKS

P.O. Box 1995

Al Defa'a Area - Kharj Road

Riyadh 11441

Kingdom of Saudi Arabia

SECTION 1

SCOPE

Architectural Testing, Inc. (an Intertek company) dba Intertek Building & Construction (B&C) was contracted by Nisreen Factory for Special and Safety Works to perform ballistics resistance testing in accordance with NIJ Standard 0108.01 on their steel door assembly. This report is in conjunction with Intertek Report No. G1389055, which includes sampling information. Results obtained are tested values and were secured by using the designated test method. Testing was conducted at the Intertek B&C test facility in York, Pennsylvania. Intertek B&C in York, Pennsylvania has demonstrated compliance with ISO/IEC International Standard 17025 and is consequently accredited as a Testing Laboratory (TL-144) by International Accreditation Service, Inc. (IAS).

This report does not constitute certification of this product nor an opinion or endorsement by this laboratory. Unless differently required, Intertek reports apply the "Simple Acceptance" rule, also called "Shared Risk approach," of ILAC-G8:09/2019, Guidelines on Decision Rules and Statements of Conformity. Intertek will service this report for the entire test record retention period. The test record retention period ends four years after the test date. Test records, such as detailed drawings, datasheets, representative samples of test specimens, or other pertinent project documentation, will be retained for the entire test record retention period.

For INTERTEK B&C:

COMPLETED BY:	Scott T. Gladfelter
TITLE:	Senior Project Engineer
SIGNATURE:	 Digitally Signed by: Scott Gladfelter
DATE:	01/03/24

REVIEWED BY:	Travis A. Hoover
TITLE:	Senior Manager
SIGNATURE:	 Digitally Signed by: Travis Hoover
DATE:	01/03/24

STG:tah/aas

This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample(s) tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.

TEST REPORT FOR NISREEN FACTORY FOR SPECIAL AND SAFETY WORKS

Report No.: Q6529.01-119-12 R0

Date: 01/03/24

SECTION 2

SUMMARY OF TEST RESULTS

Product Type: Steel Door Assembly

TITLE	TEST SPECIMEN #1
Ballistic Resistance Level	Type III
Ballistic Resistance Test Result	Pass

SECTION 3

TEST METHOD

Each test specimen was evaluated in accordance with the following:

NIJ Standard 0108.01, *Ballistic Resistant Protective Materials*, National Institute of Justice, September 1985

SECTION 4

MATERIAL SOURCE/INSTALLATION

The test specimen was provided by the client in good condition. The specimen was selected by Intertek B&C personnel. The specimen was tagged prior to shipment on 10/03/23, (Reference Intertek B&C Test Specimen Selection Report No. G1389055, dated 10/03/23).

Installation: Test specimen arrived pre-installed in a steel buck to simulate steel or concrete anchorage for installation

SECTION 5

EQUIPMENT

ASSET #	DESCRIPTION	CAL DUE DATE
65208	H&S Precision Universal Receiver (UR-01)	N/A
INT02767	Oehler Model 57 Infrared Ballistic Screens	02/28/24
INT02233	Mini IR Thermometer	06/29/24
65081	Lab Temperature and Humidity Reader	03/17/24
INT03020	Tape Measure Verifier	N/A

TEST REPORT FOR NISREEN FACTORY FOR SPECIAL AND SAFETY WORKS

Report No.: Q6529.01-119-12 R0

Date: 01/03/24

SECTION 6

LIST OF OFFICIAL OBSERVERS

NAME	COMPANY
Travis A. Hoover	Intertek B&C
Adam Cataldi	Intertek B&C

SECTION 7

TEST SPECIMEN DESCRIPTION

PRODUCT TYPE	Single side-hinged steel door assembly
OVERALL SIZE	39 in wide by 85 in high
FIXED DAY LITE OPENING	18-3/4 in wide by 18-3/4 in high
FRAME CONSTRUCTION	35-1/4 in wide by 82-1/2 in tall door frame comprised of steel with mitered corners welded together
DOOR CONSTRUCTION	30-3/4 in wide by 80 in tall door fabricated from steel sheet metal and filled with Rockwool (35 kg/m ³); window set in from protected side and secured with steel plate and fasteners
LOCK	Kale Multipoint Lock 252R

SECTION 8

TEST PROCEDURE

The sample was rigidly mounted for ballistics resistance testing. The muzzle of the test firearm was set at 49 feet from the sample at zero degree ($\pm 3^\circ$) obliquity. Ballistic screens were set at 6.5 feet and at 3.5 feet from the muzzle of the firearm. Per NIJ Standard 0108.01, Section 5.2.10, a 0.020" thick sheet of 2024-T3 aluminum alloy was positioned 6" from the protected side of the specimen. Test ammunition was 7.62 mm, 150 grain, FMJ (2700-2800 fps), and was reloaded to conform to NIJ, Table 1 requirements.

TEST REPORT FOR NISREEN FACTORY FOR SPECIAL AND SAFETY WORKS

Report No.: Q6529.01-119-12 R0

Date: 01/03/24

SECTION 9

TEST RESULTS

Test Date: 12/08/23

Ambient Temperature: 68°F

Relative Humidity: 30%

The results are tabulated as follows:

Glazing Temperature: 68°F

SHOT NO.	SHOT LOCATIONS	TEMP. (°F)	VELOCITY (fps)	RESULTS	PASS/ FAIL
1	Glass - Top Left	68	2780	No penetration	Pass
2	Glass - Top Right	68	2792	No penetration	Pass
3	Glass - Bottom Right	68	2780	Spalling on witness panel, did not penetrate witness panel	Pass
4	Glass - Bottom Left	68	2766	Spalling on witness panel, did not penetrate witness panel	Pass
5	Glass - Center	69	2782	Spalling on witness panel, did not penetrate witness panel	Pass
6	Door - Top Left Corner	66	2762	No penetration	Pass
7	Door - Top Right Corner	66	2778	No penetration	Pass
8	Door - Bottom Right	66	2757	No penetration	Pass
9	Door - Bottom Left	66	2764	No penetration	Pass
10	Door - Center	66	2775	No penetration	Pass
11	Hinge ¹	65	2790	No penetration	Pass
12	Door/Frame Gap	65	2764	No penetration	Pass
13	Door Handle	66	2771	No penetration	Pass
14	Lock	66	2750	Spalling on witness panel, did not penetrate witness panel	Pass
15	Ballistic Stop Plate Gap	66	2757	No penetration	Pass
16	Vision Lite Screw	68	2780	No penetration	Pass
17	Hinge - Retest	66	2785	No penetration	Pass

¹ Shot No.7 on the hinge was not on target. Refer to retest of Shot No. 17.

TEST REPORT FOR NISREEN FACTORY FOR SPECIAL AND SAFETY WORKS

Report No.: Q6529.01-119-12 R0

Date: 01/03/24

SECTION 10**CONCLUSION**

The test specimen achieved a Ballistic Resistance Type III based on NIJ Standard 0108.01.

SECTION 11**PHOTOGRAPHS**

Photo No. 1
Pre-Test Exterior

TEST REPORT FOR NISREEN FACTORY FOR SPECIAL AND SAFETY WORKS

Report No.: Q6529.01-119-12 R0

Date: 01/03/24



Photo No. 2
Post-Test Exterior

TEST REPORT FOR NISREEN FACTORY FOR SPECIAL AND SAFETY WORKS

Report No.: Q6529.01-119-12 R0

Date: 01/03/24



Photo No. 3
Post-Test Interior

TEST REPORT FOR NISREEN FACTORY FOR SPECIAL AND SAFETY WORKS

Report No.: Q6529.01-119-12 R0

Date: 01/03/24



Photo No. 4
Post-Test Interior

TEST REPORT FOR NISREEN FACTORY FOR SPECIAL AND SAFETY WORKS

Report No.: Q6529.01-119-12 R0

Date: 01/03/24



Photo No. 5
Witness Foil

SECTION 12
DRAWINGS

The test specimen drawings, which follow, have been reviewed by Intertek B&C and are representative of the test specimen reported herein. Test specimen construction was verified by Intertek B&C per the drawings included in this report. Any deviations are documented herein or on the drawings.

Date 12/22/23 Tech STG



Total Quality. Assured.

130 Derry Court
York, Pennsylvania 17406

Telephone: 717-764-7700
Facsimile: 717-764-4129
www.intertek.com/building


TEST REPORT FOR NISREEN FACTORY FOR SPECIAL AND SAFETY WORKS

Report No.: Q6529.01-119-12 R0

Date: 01/03/24

SECTION 13

SHOT LOCATION DRAWINGS

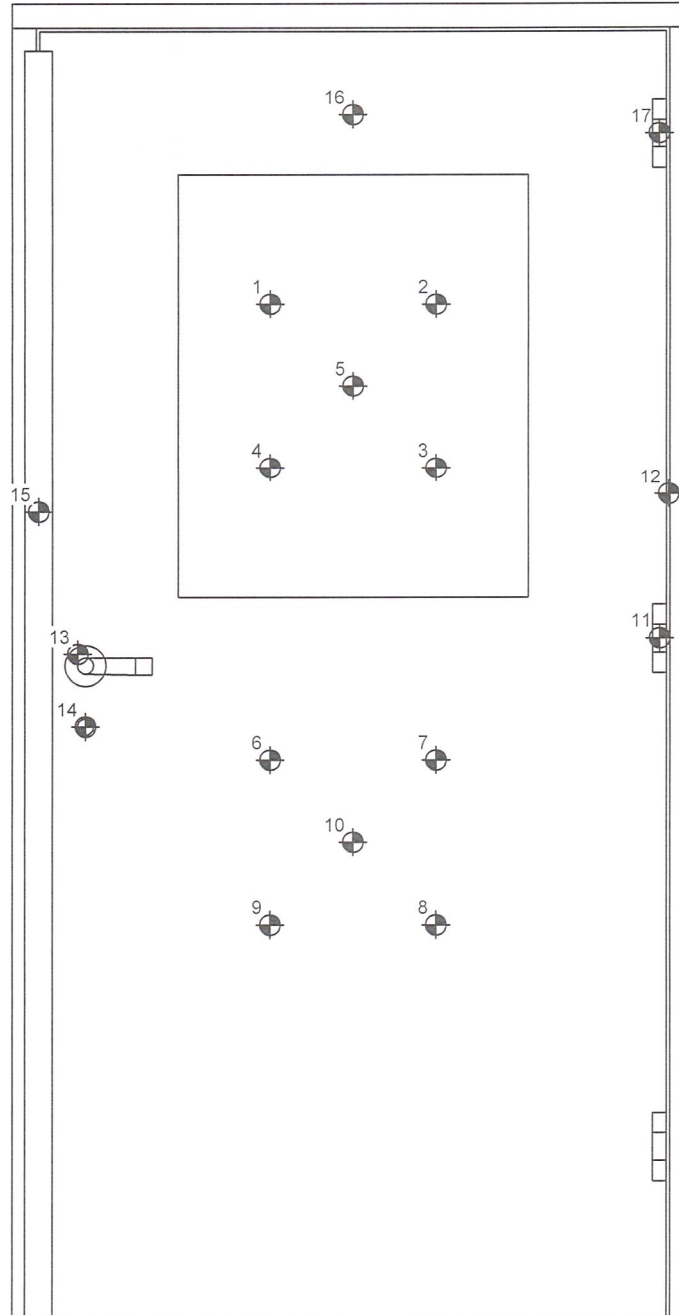

JOB NO. Q6529.01-119-12
CLIENT: Nisreen Factory for Special and Safety Works



DRAWING:
SHOT LOCATIONS

DRAWING BY:
VTM
DATE:
12/22/23

SHEET
1
OF
1



Total Quality. Assured.

130 Derry Court
York, Pennsylvania 17406

Telephone: 717-764-7700
Facsimile: 717-764-4129
www.intertek.com/building

TEST REPORT FOR NISREEN FACTORY FOR SPECIAL AND SAFETY WORKS

Report No.: Q6529.01-119-12 R0

Date: 01/03/24

SECTION 14

REVISION LOG

REVISION #	DATE	PAGES	REVISION
0	01/03/24	N/A	Original Report Issue