BATCH AND OPERATOR COMMANDS

0001.0 R005 — Order 1 of 56

Order volume	100 L
Mixing time	60 s
Recipe % (Prd_1/2/3)	50 / 25 / 25 %
Recipe approved	YES
Last recipe produced	unknown

BATCH VOLUME (SETPOINT)

100 L

Integer, 40 to 100 L. Editable only when the tank is Stopped or Waiting.

Locked: process running

Start (cmdMarcha) | Normal Stop (cmdParo) | Emergency Stop (cmdParoEmerg) | Reset (cmdRearme) | Cancel batch (cmdCancelaLote)

DOSING, DISCHARGE AND SCRAP

Product	Recipe %	Planned (L)	Delivered (L)	Progress
Prd_1 · IN_P1	50 %	50.0	50.0	
Prd_2 · IN_P2	25 %	25.0	25.0	
Prd_3 · IN_P3	25 %	25.0	0.0	

DISCHARGED TO OUT_NORMAL: 0.0 L

SCRAP, THIS BATCH: 0.0 L

SCRAP, RUNNING TOTAL: 0.0 L

ALARM

0 — No alarm

Process normal

5 · Partial batch | 6 · Batch not allowed

—

BATCHES OK	ABORTED	SKIPPED	CLEANINGS	LAST CYCLE	NOT PRODUCED
0	0	0	0	—	0.0 L

PROCESS VIEW · 100 L TANK

Filling_OP

Dosing Prd_3

Step time 10.4 s

LEVEL


80.2 L

80 % of 100 L (1 L = 1 %)

Setpoint	100 L
Tank	Clean
Cleaning reason	—
Report record	#1

Normal Stop requested

Repeat pending | LIST COMPLETE

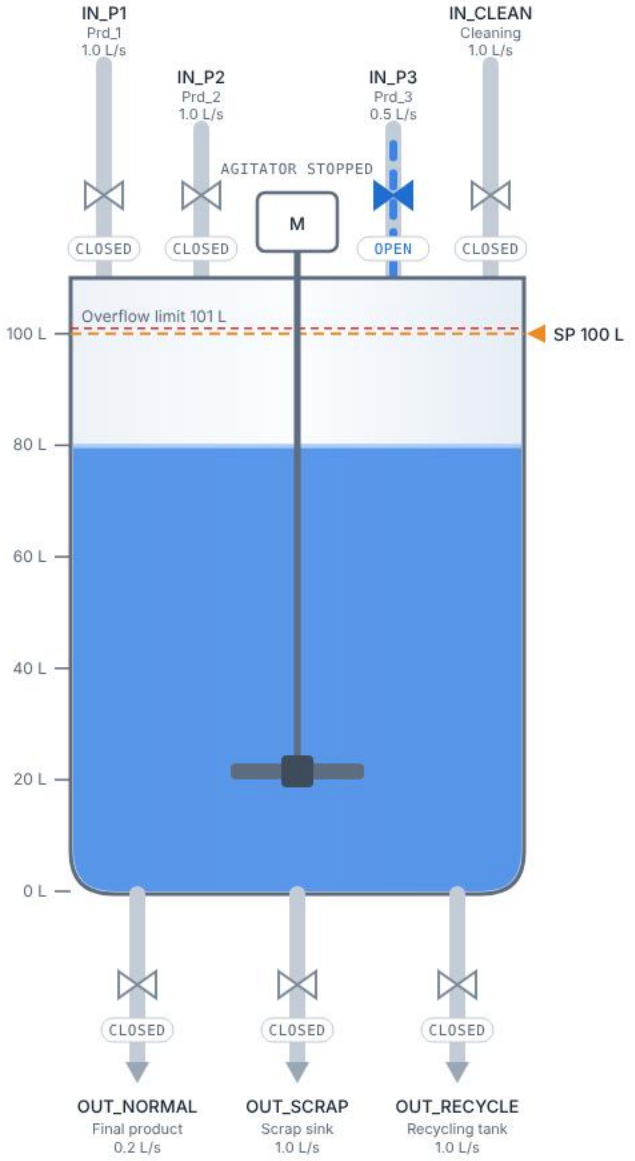

EVENTS

06:31:19	STEP	0001.0 · Dosing Prd_3: pla...
06:31:19	STATE	0001.0 · T5: next product ...
06:31:19	STEP	0001.0 · Prd_2 delivered 2...
06:30:54	STEP	0001.0 · Dosing Prd_2: pla...
06:30:54	STATE	0001.0 · T5: next product ...
06:30:54	STEP	0001.0 · Prd_1 delivered 50...
06:30:04	STEP	0001.0 · Dosing Prd_1: plan...
06:30:04	STATE	0001.0 · T1: Stopped → Fill...
06:30:04	CMD	0001.0 · cmdMarcha vol=1...
06:30:00	INFO	0001.0 · Pending batch 00...
06:30:00	INFO	Order list loaded: 56 batch...

LEGEND

- Product in the tank or pipe
- Cleaning liquid
- Valve OPEN
- Valve CLOSED
- Batch volume setpoint (40 L during cleaning)

© del Maestro IVÁ

Batch Mixing Tank

VC_ARG_04 · 100 L batch mixing tank · Simulated data, replay of the 5 s readings

Mixing_OP

Play | Speed 60× | Next alarm

06:32:30
01.11.2026 · CET · simulated clock

BATCH AND OPERATOR COMMANDS

0001.0 R005 — Order 1 of 56

Order volume	100 L
Mixing time	60 s
Recipe % (Prd_1/2/3)	50 / 25 / 25 %
Recipe approved	YES
Last recipe produced	unknown

BATCH VOLUME (SETPOINT)

100 L

Integer, 40 to 100 L. Editable only when the tank is Stopped or Waiting.

Locked: process running

Start (cmdMarcha) | Normal Stop (cmdParo) | Emergency Stop (cmdParoEmerg) | Reset (cmdRearme) | Cancel batch (cmdCancelaLote)

DOSING, DISCHARGE AND SCRAP

Product	Recipe %	Planned (L)	Delivered (L)	Progress
Prd_1 · IN_P1	50 %	50.0	50.0	
Prd_2 · IN_P2	25 %	25.0	25.0	
Prd_3 · IN_P3	25 %	25.0	25.0	

DISCHARGED TO OUT_NORMAL: 0.0 L

SCRAP, THIS BATCH: 0.0 L

SCRAP, RUNNING TOTAL: 0.0 L

ALARM

0 — No alarm

Process normal

5 · Partial batch | 6 · Batch not allowed

—

BATCHES OK	ABORTED	SKIPPED	CLEANINGS	LAST CYCLE	NOT PRODUCED
0	0	0	0	—	0.0 L

PROCESS VIEW · 100 L TANK

Mixing_OP

—

Step time 20.4 s

LEVEL


100.0 L

100 % of 100 L (1 L = 1 %)

Setpoint	100 L
Tank	Clean
Cleaning reason	—
Report record	#1

Normal Stop requested

Repeat pending | LIST COMPLETE

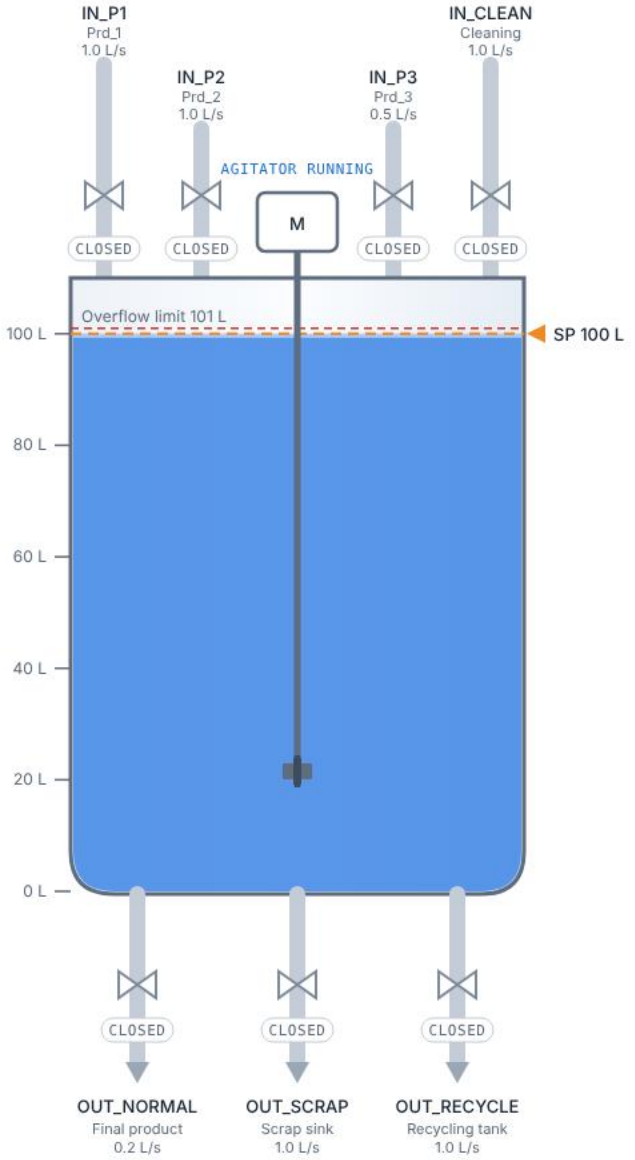

EVENTS

06:32:09	STATE	0001.0 · T6: Filling_OP → ...
06:32:09	STEP	0001.0 · Prd_3 delivered 2...
06:31:19	STEP	0001.0 · Dosing Prd_3: pla...
06:31:19	STATE	0001.0 · T5: next product ...
06:31:19	STEP	0001.0 · Prd_2 delivered 2...
06:30:54	STEP	0001.0 · Dosing Prd_2: pla...
06:30:54	STATE	0001.0 · T5: next product ...
06:30:54	STEP	0001.0 · Prd_1 delivered 50...
06:30:04	STEP	0001.0 · Dosing Prd_1: plan...
06:30:04	STATE	0001.0 · T1: Stopped → Fill...
06:30:04	CMD	0001.0 · cmdMarcha vol=1...
06:30:00	INFO	0001.0 · Pending batch 00...

LEGEND

- Product in the tank or pipe
- Cleaning liquid
- Valve OPEN
- Valve CLOSED
- Batch volume setpoint (40 L during cleaning)

BATCH AND OPERATOR COMMANDS

0001.0 R005 — Order 1 of 56

Order volume	100 L
Mixing time	60 s
Recipe % (Prd_1/2/3)	50 / 25 / 25 %
Recipe approved	YES
Last recipe produced	unknown

BATCH VOLUME (SETPOINT)

100 L

Integer, 40 to 100 L. Editable only when the tank is Stopped or Waiting.

Locked: process running

Start (cmdMarcha) | Normal Stop (cmdParo) | Emergency Stop (cmdParoEmerg) | Reset (cmdRearme) | Cancel batch (cmdCancelaLote)

DOSING, DISCHARGE AND SCRAP

Product	Recipe %	Planned (L)	Delivered (L)	Progress
Prd_1 · IN_P1	50 %	50.0	50.0	
Prd_2 · IN_P2	25 %	25.0	25.0	
Prd_3 · IN_P3	25 %	25.0	25.0	

DISCHARGED TO OUT_NORMAL: 42.1 L

SCRAP, THIS BATCH: 0.0 L

SCRAP, RUNNING TOTAL: 0.0 L

ALARM

0 — No alarm

Process normal

5 · Partial batch | 6 · Batch not allowed

—

BATCHES OK	ABORTED	SKIPPED	CLEANINGS	LAST CYCLE	NOT PRODUCED
0	0	0	0	—	0.0 L

PROCESS VIEW · 100 L TANK

Empty_OP

—

Step time 210.4 s

LEVEL


57.9 L

58 % of 100 L (1 L = 1 %)

Setpoint	100 L
Tank	Clean
Cleaning reason	—
Report record	#1

Normal Stop requested

Repeat pending | LIST COMPLETE

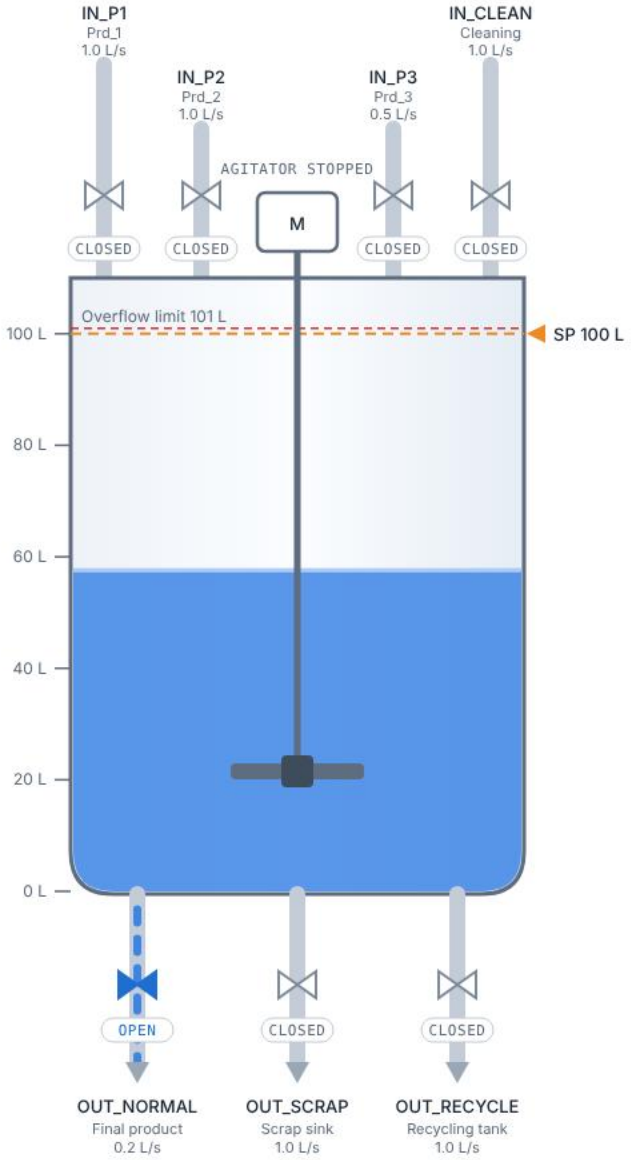

EVENTS

06:33:09	STATE	0001.0 · T7: Mixing_OP → ...
06:32:09	STATE	0001.0 · T6: Filling_OP → ...
06:32:09	STEP	0001.0 · Prd_3 delivered 2...
06:31:19	STEP	0001.0 · Dosing Prd_3: pla...
06:31:19	STATE	0001.0 · T5: next product ...
06:31:19	STEP	0001.0 · Prd_2 delivered 2...
06:30:54	STEP	0001.0 · Dosing Prd_2: pla...
06:30:54	STATE	0001.0 · T5: next product ...
06:30:54	STEP	0001.0 · Prd_1 delivered 50...
06:30:04	STEP	0001.0 · Dosing Prd_1: plan...
06:30:04	STATE	0001.0 · T1: Stopped → Fill...
06:30:04	CMD	0001.0 · cmdMarcha vol=1...

LEGEND

- Product in the tank or pipe
- Cleaning liquid
- Valve OPEN
- Valve CLOSED
- Batch volume setpoint (40 L during cleaning)

© del Maestro IvÁ

Batch Mixing Tank

VC_ARG_04 · 100 L batch mixing tank · Simulated data, replay of the 5 s readings

Cleaning_OP

Play | Speed 60× | Next alarm

07:02:00
01.11.2026 · CET · simulated clock

BATCH AND OPERATOR COMMANDS

0004.0 R004 — Order 4 of 56

Order volume	70 L
Mixing time	150 s
Recipe % (Prd_1/2/3)	40 / 0 / 60 %
Recipe approved	YES
Last recipe produced	R005

BATCH VOLUME (SETPOINT)

70 L

Integer, 40 to 100 L. Editable only when the tank is Stopped or Waiting.

Locked: process running

Start (cmdMarcha) | Normal Stop (cmdParo) | Emergency Stop (cmdParoEmerg) | Reset (cmdRearme) | Cancel batch (cmdCancelaLote)

DOSING, DISCHARGE AND SCRAP

Product	Recipe %	Planned (L)	Delivered (L)	Progress
Prd_1 · IN_P1	40 %	28.0	0.0	
Prd_2 · IN_P2	0 %	—	—	
Prd_3 · IN_P3	60 %	42.0	0.0	

DISCHARGED TO OUT_NORMAL	SCRAP, THIS BATCH	SCRAP, RUNNING TOTAL
0.0 L	0.0 L	0.0 L

ALARM

0 — No alarm — Process normal

5 · Partial batch | 6 · Batch not allowed

—

BATCHES OK	ABORTED	SKIPPED	CLEANINGS	LAST CYCLE	NOT PRODUCED
3	0	0	0	372.4 s	0.0 L

PROCESS VIEW · 100 L TANK

Cleaning_OP

Sub-step 3 · mix

Step time 113.6 s

LEVEL


40.0 L

40 % of 100 L (1 L = 1 %)

Setpoint	40 L (cleaning)
Tank	Dirty
Cleaning reason	Pre-batch
Report record	#4

Normal Stop requested

Repeat pending | LIST COMPLETE

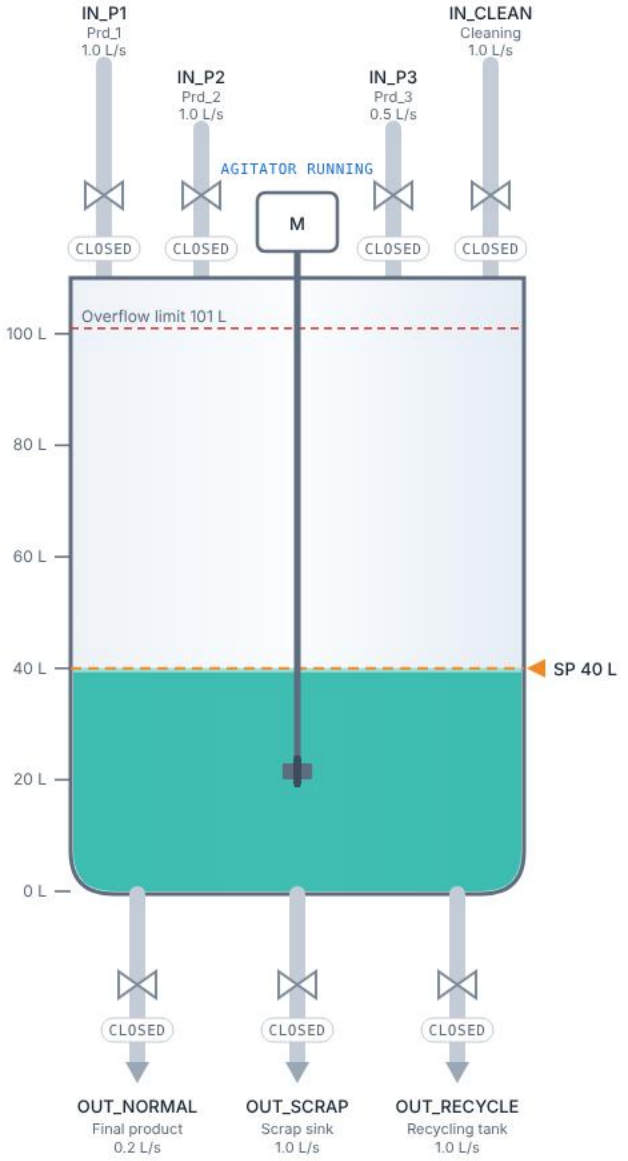

EVENTS

07:00:06	STEP	0004.0 · Cleaning sub-ste...
06:59:26	STEP	0004.0 · Cleaning sub-ste...
06:59:26	STATE	0004.0 · T4: Waiting → Cl...
06:59:26	CMD	0004.0 · cmdMarcha vol=70
06:59:20	INFO	0004.0 · Pending batch 0...
06:59:20	STATE	0003.0 · T8: Empty_OP → ...
06:55:10	STATE	0003.0 · T7: Mixing_OP → ...
06:54:10	STATE	0003.0 · T6: Filling_OP → ...
06:54:10	STEP	0003.0 · Prd_3 delivered 1...
06:53:45	STEP	0003.0 · Dosing Prd_3: pla...
06:53:45	STATE	0003.0 · T5: next product ...
06:53:45	STEP	0003.0 · Prd_2 delivered 1...

LEGEND

- Product in the tank or pipe
- Cleaning liquid
- Valve OPEN
- Valve CLOSED
- Batch volume setpoint (40 L during cleaning)

© del Maestro IVÁ

Batch Mixing Tank

VC_ARG_04 · 100 L batch mixing tank · Simulated data, replay of the 5 s readings

Cleaning_OP

Play | Speed 60× | Next alarm

08:22:30
01.11.2026 · CET · simulated clock

BATCH AND OPERATOR COMMANDS

0007.0 R001 — Order 9 of 56

Order volume	100 L
Mixing time	150 s
Recipe % (Prd_1/2/3)	30 / 30 / 40 %
Recipe approved	YES
Last recipe produced	unknown

BATCH VOLUME (SETPOINT)

100 L

Integer, 40 to 100 L. Editable only when the tank is Stopped or Waiting.

Locked: process running

Start (cmdMarcha) | Normal Stop (cmdParo) | Emergency Stop (cmdParoEmerg) | Reset (cmdRearme) | Cancel batch (cmdCancelaLote)

DOSING, DISCHARGE AND SCRAP

Product	Recipe %	Planned (L)	Delivered (L)	Progress
Prd_1 · IN_P1	30 %	—	—	
Prd_2 · IN_P2	30 %	—	—	
Prd_3 · IN_P3	40 %	—	—	

DISCHARGED TO OUT_NORMAL	SCRAP, THIS BATCH	SCRAP, RUNNING TOTAL
0.0 L	26.4 L	26.4 L

ALARM

3 Fill deviation

Controlled · scrap, clean, repeat · origin machine

5 · Partial batch | 6 · Batch not allowed

Prd_1 delivered 33.0 L, planned 30.0 L

BATCHES OK	ABORTED	SKIPPED	CLEANINGS	LAST CYCLE	NOT PRODUCED
8	1	0	4	413.9 s	0.0 L

PROCESS VIEW · 100 L TANK

Cleaning_OP

Sub-step 1 · scrap to OUT_SCRAP

Step time 26.4 s

LEVEL


6.6 L

7 % of 100 L (1 L = 1 %)

Setpoint	100 L
Tank	Clean
Cleaning reason	After alarm
Report record	#57

Normal Stop requested

Repeat pending | LIST COMPLETE

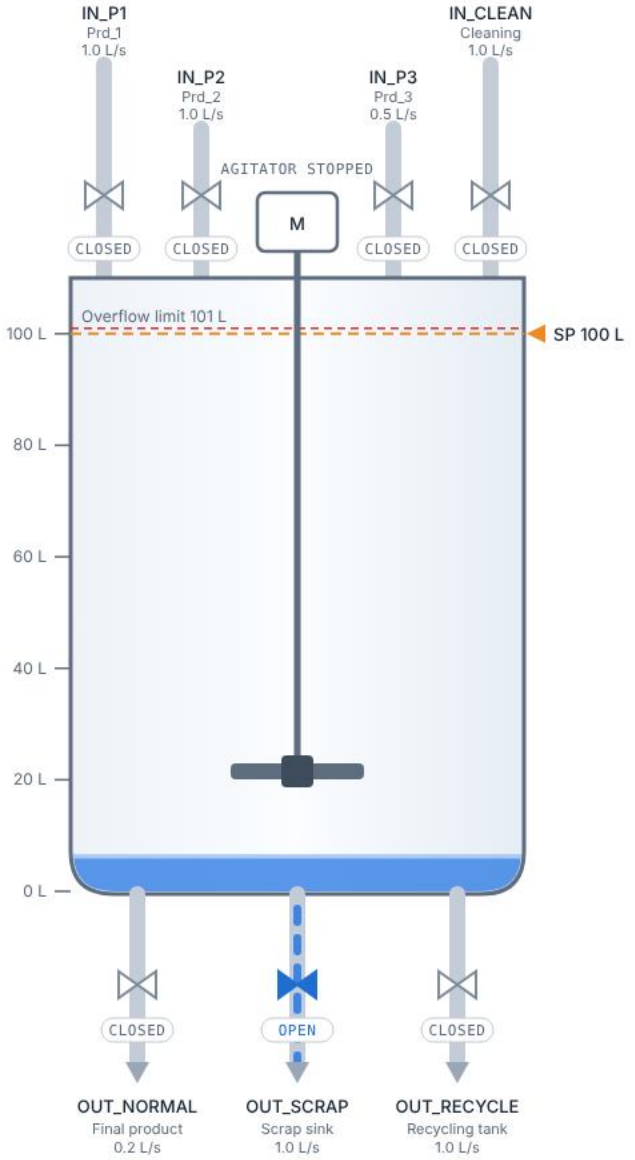

EVENTS

08:22:03	FAULT	0007.0 · F3 cleared
08:22:03	STEP	0007.0 · Cleaning sub-ste...
08:22:03	STATE	0007.0 · T15: Filling_OP → ...
08:22:03	ALARM	0007.0 · 3 – Fill deviation: ...
08:22:03	STEP	0007.0 · Prd_1 delivered 33...
08:21:33	FAULT	0007.0 · F3 active: IN_P1 fl...
08:21:33	STEP	0007.0 · Dosing Prd_1: pla...
08:21:33	STATE	0007.0 · T13: Cleaning_OP ...
08:20:53	STEP	0007.0 · Cleaning sub-ste...
08:15:53	STEP	0007.0 · Cleaning sub-ste...
08:15:13	STEP	0007.0 · Cleaning sub-ste...
08:15:13	STATE	0007.0 · T4: Waiting → Cle...

LEGEND

- Product in the tank or pipe
- Cleaning liquid
- Valve OPEN
- Valve CLOSED
- Batch volume setpoint (40 L during cleaning)

© del Maestro IVÁ

Batch Mixing Tank

VC_ARG_04 · 100 L batch mixing tank · Simulated data, replay of the 5 s readings

Waiting

Play | Speed 60× | Next alarm

09:22:00
01.11.2026 · CET · simulated clock

BATCH AND OPERATOR COMMANDS

0011.0 R002 — Order 13 of 56

Order volume	100 L
Mixing time	80 s
Recipe % (Prd_1/2/3)	60 / 20 / 20 %
Recipe approved	NO

BATCH VOLUME (SETPOINT)

100 L

Integer, 40 to 100 L. Editable only when the tank is Stopped or Waiting.

BATCH NOT ALLOWED · Cancel batch to continue

Start (cmdMarcha) | Normal Stop (cmdParo) | Emergency Stop (cmdParoEmerg) | Reset (cmdRearme) | Cancel batch (cmdCancelaLote)

DOSING, DISCHARGE AND SCRAP

Product	Recipe %	Planned (L)	Delivered (L)	Progress
Prd_1 · IN_P1	60 %	—	—	
Prd_2 · IN_P2	20 %	—	—	
Prd_3 · IN_P3	20 %	—	—	

DISCHARGED TO OUT_NORMAL	SCRAP, THIS BATCH	SCRAP, RUNNING TOTAL
100.0 L	0.0 L	33.0 L

ALARM

6 Batch not allowed

Warning · blocks Start · origin machine

5 · Partial batch | 6 · Batch not allowed

Recipe R002 not approved

BATCHES OK	ABORTED	SKIPPED	CLEANINGS	LAST CYCLE	NOT PRODUCED
12	1	0	5	789.9 s	0.0 L

PROCESS VIEW · 100 L TANK

Waiting

Empty, tank dirty, between batches

Step time 502.5 s


LEVEL

0.0 L

0 % of 100 L (1 L = 1 %)

Setpoint	100 L
Tank	Dirty
Cleaning reason	—
Report record	#13

Normal Stop requested | Repeat pending | LIST COMPLETE

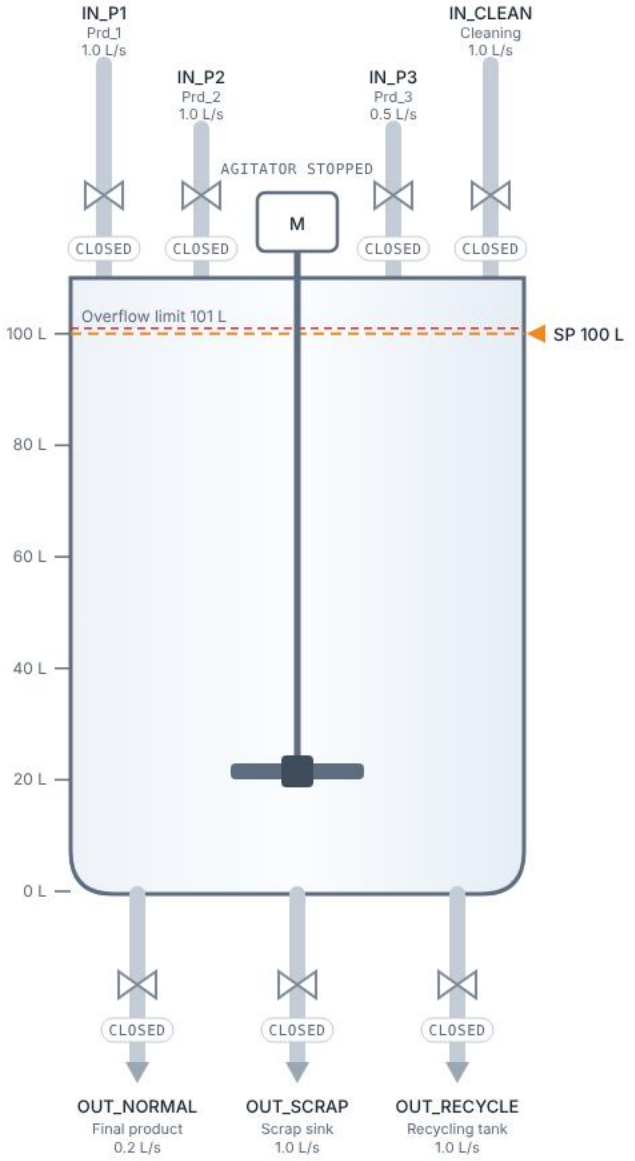

EVENTS

09:21:57	STATE	0011.0 · T19: alarm 6 raise...
09:21:57	ALARM	0011.0 · 6 – Batch not allo...
09:21:57	INFO	0011.0 · Pending batch 00...
09:21:57	STATE	0010.0 · T8: Empty_OP → ...
09:13:37	STATE	0010.0 · T7: Mixing_OP → ...
09:11:07	STATE	0010.0 · T6: Filling_OP → ...
09:11:07	STEP	0010.0 · Prd_3 delivered 4...
09:09:47	STEP	0010.0 · Dosing Prd_3: pla...
09:09:47	STATE	0010.0 · T5: next product ...
09:09:47	STEP	0010.0 · Prd_2 delivered 3...
09:09:17	STEP	0010.0 · Dosing Prd_2: pla...
09:09:17	STATE	0010.0 · T5: next product ...

LEGEND

- Product in the tank or pipe
- Cleaning liquid
- Valve OPEN
- Valve CLOSED
- Batch volume setpoint (40 L during cleaning)

© del Maestro IvÁ

Batch Mixing Tank

VC_ARG_04 · 100 L batch mixing tank · Simulated data, replay of the 5 s readings

Alarm Stop

Play | Speed 60× | Next alarm

09:37:55
01.11.2026 · CET · simulated clock

BATCH AND OPERATOR COMMANDS

0013.0 R001 — Order 16 of 56

Order volume	100 L
Mixing time	150 s
Recipe % (Prd_1/2/3)	30 / 30 / 40 %
Recipe approved	YES
Last recipe produced	R001

BATCH VOLUME (SETPOINT)

100 L

Integer, 40 to 100 L. Editable only when the tank is Stopped or Waiting.

Locked: process running

Start (cmdMarcha) | Normal Stop (cmdParo) | Emergency Stop (cmdParoEmerg) | Reset (cmdRearme) | Cancel batch (cmdCancelaLote)

DOSING, DISCHARGE AND SCRAP

Product	Recipe %	Planned (L)	Delivered (L)	Progress
Prd_1 · IN_P1	30 %	—	—	
Prd_2 · IN_P2	30 %	—	—	
Prd_3 · IN_P3	40 %	—	—	

DISCHARGED TO OUT_NORMAL	SCRAP, THIS BATCH	SCRAP, RUNNING TOTAL
0.0 L	0.0 L	33.0 L

ALARM

1 Overflow

Emergency · Alarm Stop · origin machine

5 · Partial batch | 6 · Batch not allowed

level 101.04 L above 101 L with inlet open

BATCHES OK	ABORTED	SKIPPED	CLEANINGS	LAST CYCLE	NOT PRODUCED
13	2	2	5	789.9 s	180.0 L

PROCESS VIEW · 100 L TANK

Alarm Stop

All outputs off, level frozen

Step time 70.1 s

LEVEL


101.0 L

101 % of 100 L (1 L = 1 %)

Setpoint	100 L
Tank	Dirty
Cleaning reason	—
Report record	#58

Normal Stop requested

Repeat pending | LIST COMPLETE

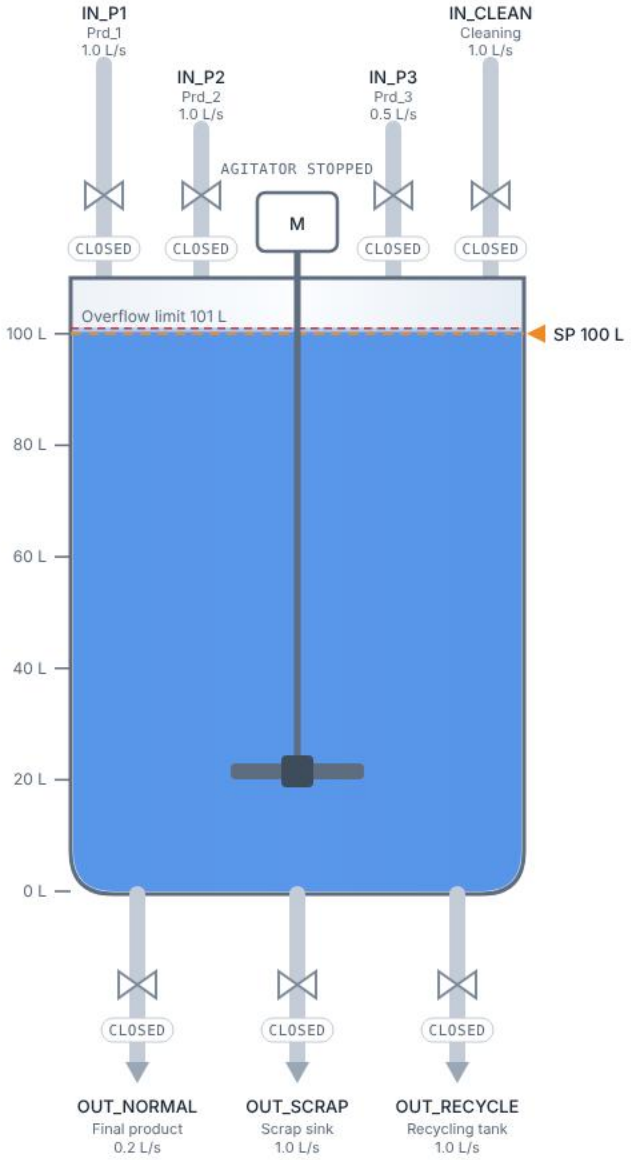

EVENTS

09:37:53	FAULT	0013.0 · F4 cleared
09:37:53	STATE	0013.0 · T16: Filling_OP → ...
09:37:53	ALARM	0013.0 · 1 – Overflow: level...
09:36:45	FAULT	0013.0 · F4 active: IN_P3 f...
09:36:44	STEP	0013.0 · Dosing Prd_3: pla...
09:36:44	STATE	0013.0 · T5: next product ...
09:36:44	STEP	0013.0 · Prd_2 delivered 3...
09:36:14	STEP	0013.0 · Dosing Prd_2: pla...
09:36:14	STATE	0013.0 · T5: next product ...
09:36:14	STEP	0013.0 · Prd_1 delivered 30...
09:35:45	STEP	0013.0 · Dosing Prd_1: plan...
09:35:45	STATE	0013.0 · T3: Waiting → Filli...

LEGEND

- Product in the tank or pipe
- Cleaning liquid
- Valve OPEN
- Valve CLOSED
- Batch volume setpoint (40 L during cleaning)

© del Maestro IVÁ

Batch Mixing Tank

VC_ARG_04 · 100 L batch mixing tank · Simulated data, replay of the 5 s readings

Alarm Stop

Play | Speed 60× | Next alarm

12:42:20
01.11.2026 · CET · simulated clock

BATCH AND OPERATOR COMMANDS

0020.0 R001 — Order 29 of 56

Order volume	100 L
Mixing time	150 s
Recipe % (Prd_1/2/3)	30 / 30 / 40 %
Recipe approved	YES
Last recipe produced	R003

BATCH VOLUME (SETPOINT)

100 L

Integer, 40 to 100 L. Editable only when the tank is Stopped or Waiting.

Locked: process running

Start (cmdMarcha) | Normal Stop (cmdParo) | Emergency Stop (cmdParoEmerg) | Reset (cmdRearme) | Cancel batch (cmdCancelaLote)

DOSING, DISCHARGE AND SCRAP

Product	Recipe %	Planned (L)	Delivered (L)	Progress
Prd_1 · IN_P1	30 %	—	—	
Prd_2 · IN_P2	30 %	—	—	
Prd_3 · IN_P3	40 %	—	—	

DISCHARGED TO OUT_NORMAL	SCRAP, THIS BATCH	SCRAP, RUNNING TOTAL
0.0 L	0.0 L	134.0 L

ALARM

4 Step timeout / no progress

Emergency · Alarm Stop · origin machine

5 · Partial batch | 6 · Batch not allowed

no progress: 0.0 L in 15 s, expected 15.0 L

Message: Reset refused: cause of alarm 4 still present

BATCHES OK	ABORTED	SKIPPED	CLEANINGS	LAST CYCLE	NOT PRODUCED
26	3	2	10	375.9 s	180.0 L

PROCESS VIEW · 100 L TANK

Alarm Stop

All outputs off, level frozen

Step time 24.5 s

LEVEL


30.0 L

30 % of 100 L (1 L = 1 %)

Setpoint	100 L
Tank	Clean
Cleaning reason	—
Report record	#59

Normal Stop requested

Repeat pending | LIST COMPLETE

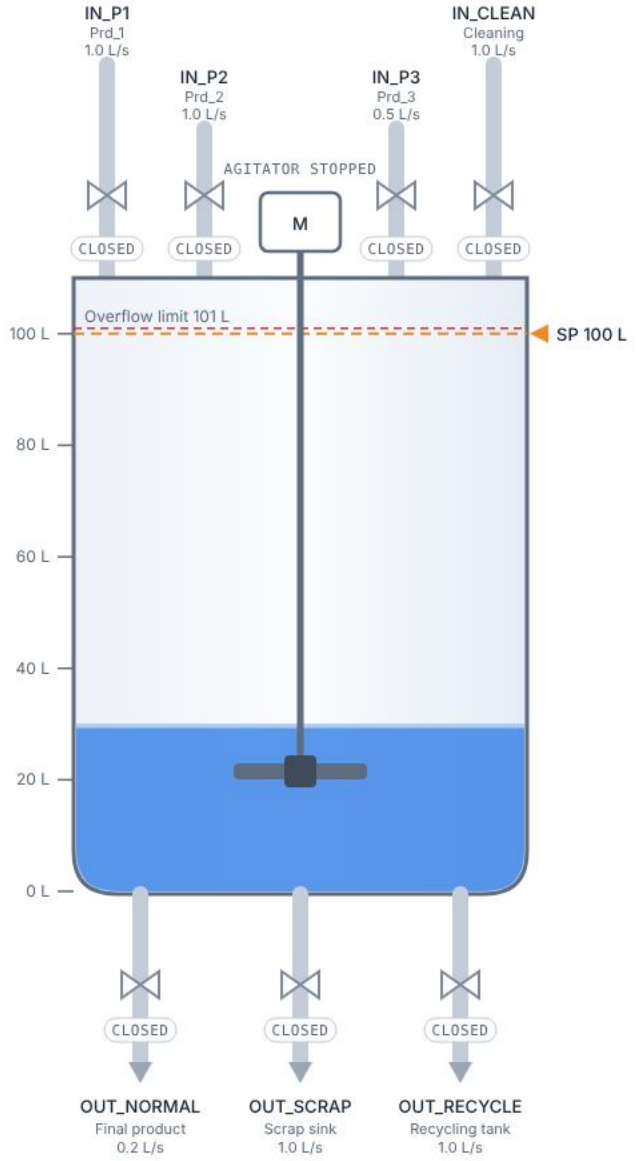

EVENTS

12:42:15	REFUSAL	0020.0 · Reset refused: ca...
12:42:15	CMD	0020.0 · cmdRearme
12:42:10	STATE	0020.0 · T16: Filling_OP → ...
12:42:10	ALARM	0020.0 · 4 – Step timeout: ...
12:41:55	FAULT	0020.0 · F5 active: IN_P2 ...
12:41:55	STEP	0020.0 · Dosing Prd_2: pla...
12:41:55	STATE	0020.0 · T5: next product ...
12:41:55	STEP	0020.0 · Prd_1 delivered 3...
12:41:25	STEP	0020.0 · Dosing Prd_1: pla...
12:41:25	STATE	0020.0 · T13: Cleaning_OP...
12:40:45	STEP	0020.0 · Cleaning sub-ste...
12:35:45	STEP	0020.0 · Cleaning sub-ste...

LEGEND

- Product in the tank or pipe
- Cleaning liquid
- Valve OPEN
- Valve CLOSED
- Batch volume setpoint (40 L during cleaning)

© del Maestro IVÁ

Batch Mixing Tank

VC_ARG_04 · 100 L batch mixing tank · Simulated data, replay of the 5 s readings

Alarm Stop

Play | Speed 60× | Next alarm

15:30:35
01.11.2026 · CET · simulated clock

BATCH AND OPERATOR COMMANDS

0026.1 R001 — Order 39 of 56

Order volume	100 L
Mixing time	150 s
Recipe % (Prd_1/2/3)	30 / 30 / 40 %
Recipe approved	YES
Last recipe produced	R001

BATCH VOLUME (SETPOINT)

100 L

Integer, 40 to 100 L. Editable only when the tank is Stopped or Waiting.

Locked: process running

Start (cmdMarcha) | Normal Stop (cmdParo) | Emergency Stop (cmdParoEmerg) | Reset (cmdRearme) | Cancel batch (cmdCancelaLote)

DOSING, DISCHARGE AND SCRAP

Product	Recipe %	Planned (L)	Delivered (L)	Progress
Prd_1 · IN_P1	30 %	—	—	
Prd_2 · IN_P2	30 %	—	—	
Prd_3 · IN_P3	40 %	—	—	

DISCHARGED TO OUT_NORMAL	SCRAP, THIS BATCH	SCRAP, RUNNING TOTAL
50.0 L	0.0 L	204.0 L

ALARM

2 Emergency Stop

Emergency · Alarm Stop · origin operator

5 · Partial batch | 6 · Batch not allowed

Emergency Stop pressed by operator

BATCHES OK	ABORTED	SKIPPED	CLEANINGS	LAST CYCLE	NOT PRODUCED
36	4	2	16	790.0 s	180.0 L

PROCESS VIEW · 100 L TANK

Alarm Stop

All outputs off, level frozen

Step time 252.6 s

LEVEL


50.0 L

50 % of 100 L (1 L = 1 %)

Setpoint	100 L
Tank	Dirty
Cleaning reason	—
Report record	#60

Normal Stop requested

Repeat pending | LIST COMPLETE

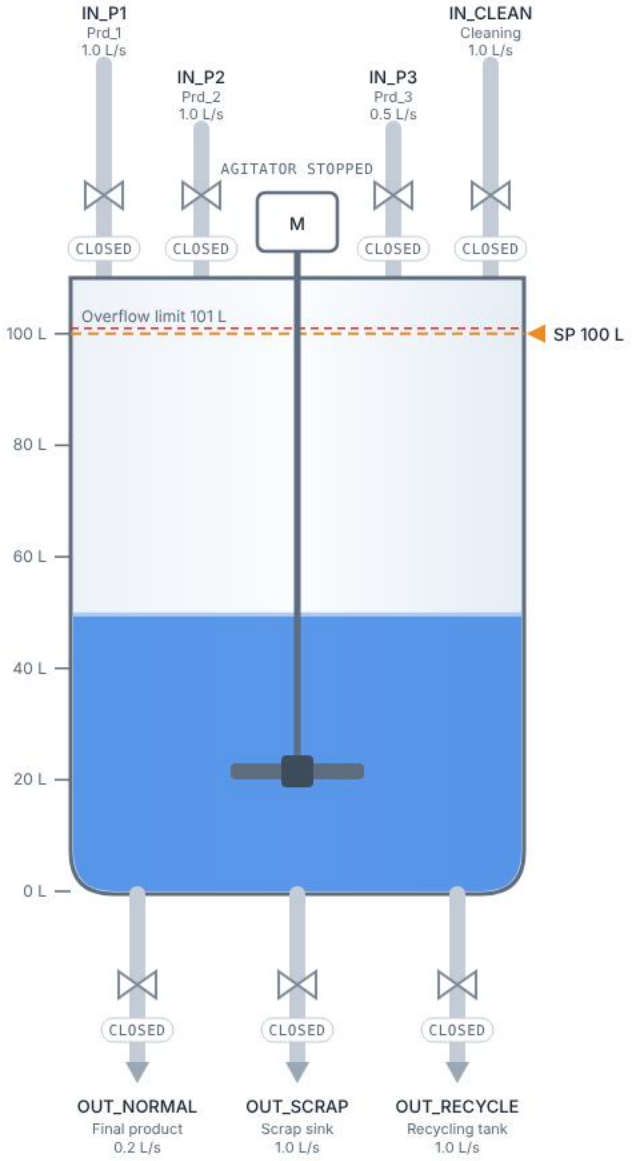

EVENTS

15:30:32	STATE	0026.1 · T16: Empty_OP → ...
15:30:32	ALARM	0026.1 · 5 – Partial batch (...
15:30:32	ALARM	0026.1 · 2 – Emergency St...
15:30:32	CMD	0026.1 · cmdParoEmerg
15:30:32	FAULT	0026.1 · F7 injected: opera...
15:26:22	STATE	0026.1 · T7: Mixing_OP → ...
15:23:52	STATE	0026.1 · T6: Filling_OP → ...
15:23:52	STEP	0026.1 · Prd_3 delivered 4...
15:22:32	STEP	0026.1 · Dosing Prd_3: pla...
15:22:32	STATE	0026.1 · T5: next product ...
15:22:32	STEP	0026.1 · Prd_2 delivered 3...
15:22:02	STEP	0026.1 · Dosing Prd_2: pla...

LEGEND

- Product in the tank or pipe
- Cleaning liquid
- Valve OPEN
- Valve CLOSED
- Batch volume setpoint (40 L during cleaning)

© del Maestro IvÁ

Batch Mixing Tank

VC_ARG_04 · 100 L batch mixing tank · Simulated data, replay of the 5 s readings

Alarm Stop

Play | Speed 60× | Next alarm

13:22:40
01.11.2026 · CET · simulated clock

BATCH AND OPERATOR COMMANDS

0022.0 R004 — Order 31 of 56

Order volume	100 L
Mixing time	150 s
Recipe % (Prd_1/2/3)	40 / 0 / 60 %
Recipe approved	YES
Last recipe produced	R001

BATCH VOLUME (SETPOINT)

100 L

Integer, 40 to 100 L. Editable only when the tank is Stopped or Waiting.

Locked: process running

Start (cmdMarcha) | Normal Stop (cmdParo) | Emergency Stop (cmdParoEmerg) | Reset (cmdRearme) | Cancel batch (cmdCancelaLote)

DOSING, DISCHARGE AND SCRAP

Product	Recipe %	Planned (L)	Delivered (L)	Progress
Prd_1 · IN_P1	40 %	—	—	
Prd_2 · IN_P2	0 %	—	—	
Prd_3 · IN_P3	60 %	—	—	

DISCHARGED TO OUT_NORMAL	SCRAP, THIS BATCH	SCRAP, RUNNING TOTAL
0.0 L	0.0 L	164.0 L

ALARM

4 Step timeout / no progress

Emergency · Alarm Stop · origin machine

5 · Partial batch | 6 · Batch not allowed

no progress: 0.0 L in 15 s, expected -15.0 L

BATCHES OK	ABORTED	SKIPPED	CLEANINGS	LAST CYCLE	NOT PRODUCED
28	3	2	11	789.9 s	180.0 L

PROCESS VIEW · 100 L TANK

Alarm Stop

All outputs off, level frozen

Step time 16.7 s


LEVEL

40.0 L

40 % of 100 L (1 L = 1 %)

Setpoint	100 L
Tank	Dirty
Cleaning reason	—
Report record	#31

Normal Stop requested | Repeat pending | LIST COMPLETE

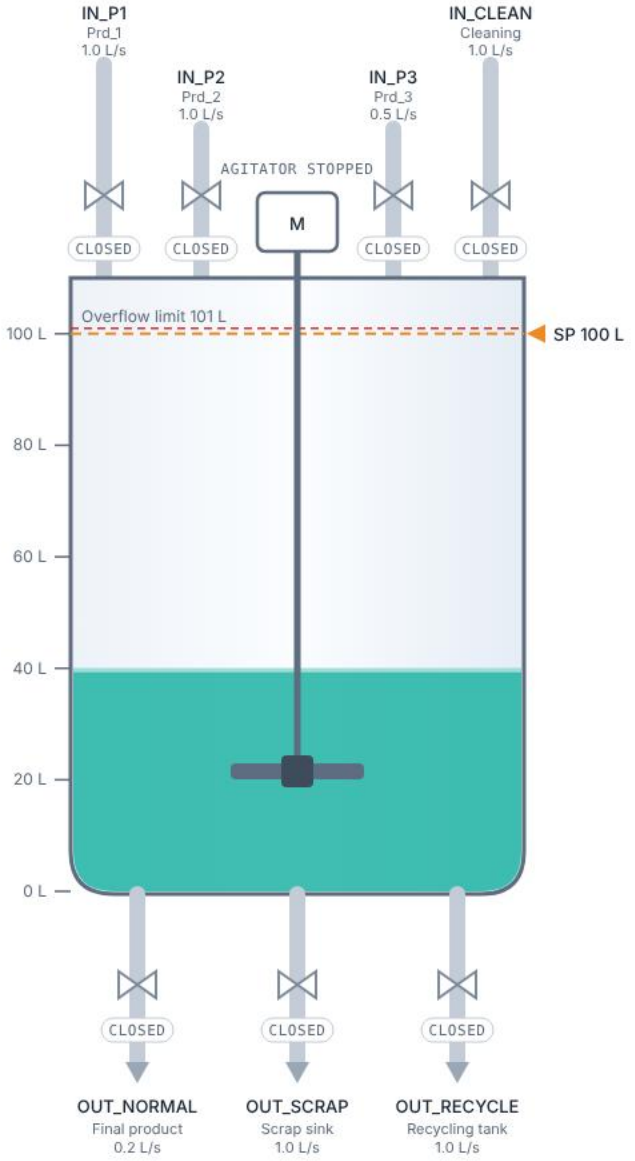

EVENTS

13:22:38	FAULT	0022.0 · F6 cleared: IN_CL...
13:22:38	STATE	0022.0 · T16: Cleaning_OP...
13:22:38	ALARM	0022.0 · 4 – Step timeout: ...
13:22:23	FAULT	0022.0 · F6 active: IN_CLE...
13:22:23	STEP	0022.0 · Cleaning sub-ste...
13:17:23	STEP	0022.0 · Cleaning sub-ste...
13:16:43	STEP	0022.0 · Cleaning sub-ste...
13:16:43	STATE	0022.0 · T4: Waiting → Cl...
13:16:43	CMD	0022.0 · cmdMarcha vol=1...
13:16:36	FAULT	0022.0 · F6 armed: IN_CL...
13:16:36	INFO	0022.0 · Pending batch 0...
13:16:36	STATE	0021.0 · T8: Empty_OP → ...

LEGEND

- Product in the tank or pipe
- Cleaning liquid
- Valve OPEN
- Valve CLOSED
- Batch volume setpoint (40 L during cleaning)

© del Maestro IvÁ

Batch Mixing Tank

VC_ARG_04 · 100 L batch mixing tank · Simulated data, replay of the 5 s readings

Waiting

Play | Speed 60× | Next alarm

19:47:35
01.11.2026 · CET · simulated clock

BATCH AND OPERATOR COMMANDS

— —

56 orders

Order volume	—
Mixing time	—
Recipe % (Prd_1/2/3)	—
Recipe approved	—

BATCH VOLUME (SETPOINT)

100 L

Integer, 40 to 100 L. Editable only when the tank is Stopped or Waiting.

LIST COMPLETE · use Normal Stop for the final cleaning

Start (cmdMarcha) | Normal Stop (cmdParo) | Emergency Stop (cmdParoEmerg) | Reset (cmdRearme) | Cancel batch (cmdCancelaLote)

DOSING, DISCHARGE AND SCRAP

Product	Recipe %	Planned (L)	Delivered (L)	Progress
Prd_1 · IN_P1	—	—	—	
Prd_2 · IN_P2	—	—	—	
Prd_3 · IN_P3	—	—	—	

DISCHARGED TO OUT_NORMAL	SCRAP, THIS BATCH	SCRAP, RUNNING TOTAL
50.0 L	0.0 L	254.0 L

ALARM

0 — No alarm
Process normal

5 · Partial batch | 6 · Batch not allowed

—

Message: Start refused: LIST COMPLETE

BATCHES OK	ABORTED	SKIPPED	CLEANINGS	LAST CYCLE	NOT PRODUCED
53	4	3	24	459.9 s	200.0 L

PROCESS VIEW · 100 L TANK

Waiting

Empty, tank dirty, between batches
Step time 256.4 s


LEVEL

0.0 L

0 % of 100 L (1 L = 1 %)

Setpoint	—
Tank	Dirty
Cleaning reason	—
Report record	—

Normal Stop requested | Repeat pending | LIST COMPLETE

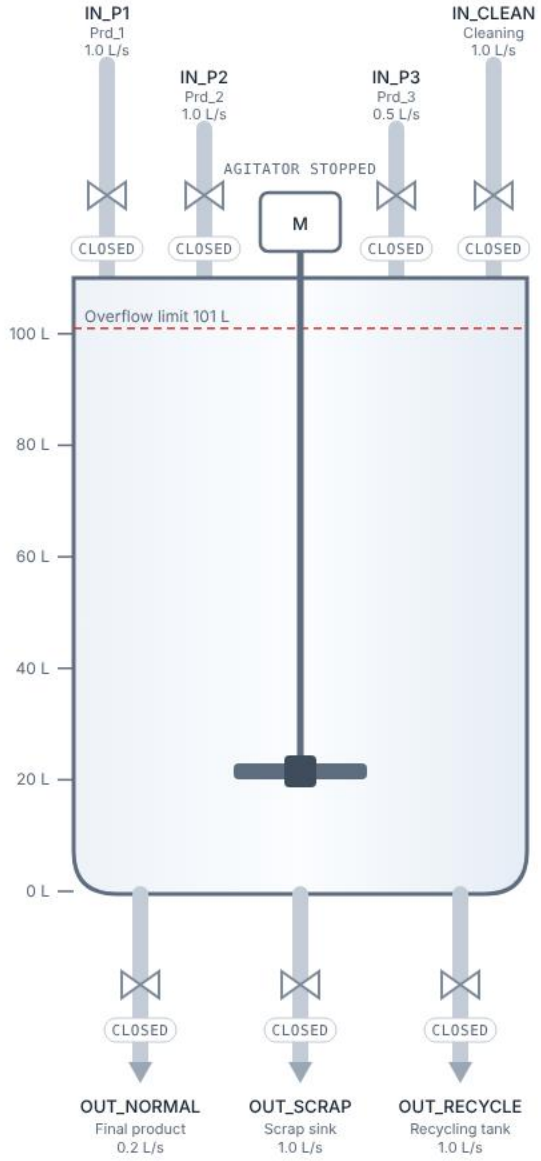

EVENTS

19:47:33	REFUSAL	Start refused: LIST COMP...
19:47:33	CMD	cmdMarcha vol=100
19:47:28	STATE	0034.1 · T8: Empty_OP → ...
19:43:18	STATE	0034.1 · T7: Mixing_OP → ...
19:40:48	STATE	0034.1 · T6: Filling_OP → ...
19:40:48	STEP	0034.1 · Prd_3 delivered 10...
19:40:28	STEP	0034.1 · Dosing Prd_3: pla...
19:40:28	STATE	0034.1 · T5: next product ...
19:40:28	STEP	0034.1 · Prd_2 delivered 2...
19:40:08	STEP	0034.1 · Dosing Prd_2: pla...
19:40:08	STATE	0034.1 · T5: next product ...
19:40:08	STEP	0034.1 · Prd_1 delivered 20...

LEGEND

- Product in the tank or pipe
- Cleaning liquid
- Valve OPEN
- Valve CLOSED
- Batch volume setpoint (40 L during cleaning)

VC_ARG_04 · Batch mixing tank, production analytics

Simulated data

Simulated run from **01.11.2026 06:30** to **19:54**: **53** batches completed, **4** aborted by alarms and repeated in full, **3** cancelled after alarm 6. Good product took **76.5%** of the elapsed time.

Batches completed	Batches aborted	Batches skipped	Litres produced	Litres not produced	Scrap generated (L)	Cleanings finished	Alarms raised	Time making good product
53	4	3	4,645.0	200.0	254.04	25	10	76.5%

Tank level over time

5 s samples. Dashed line: overflow limit. Strip below: state. Circled numbers: alarm codes from the event log.



Time by activity

Hours in each state, from the state changes in the event log.




Alarms by type

Alarms raised, from the event log; includes alarms that have no report row.




Valve and motor on-time

Hours each output was on, counted from the 5 s samples.

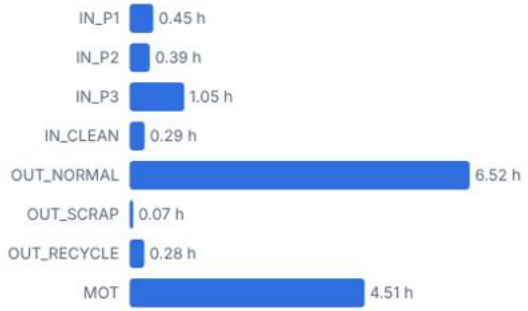


Cumulative litres produced and scrap

Produced: at the OUT of each completed batch. Scrap: running total from the log.

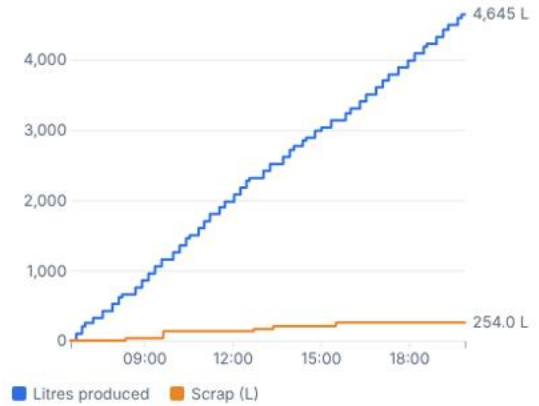

Litres per batch

One bar per report record (# on the axis). Outline: ordered volume. Letters mark status: C completed, A aborted (filled red at the ordered volume, nothing produced), S skipped (cancelled, nothing produced).

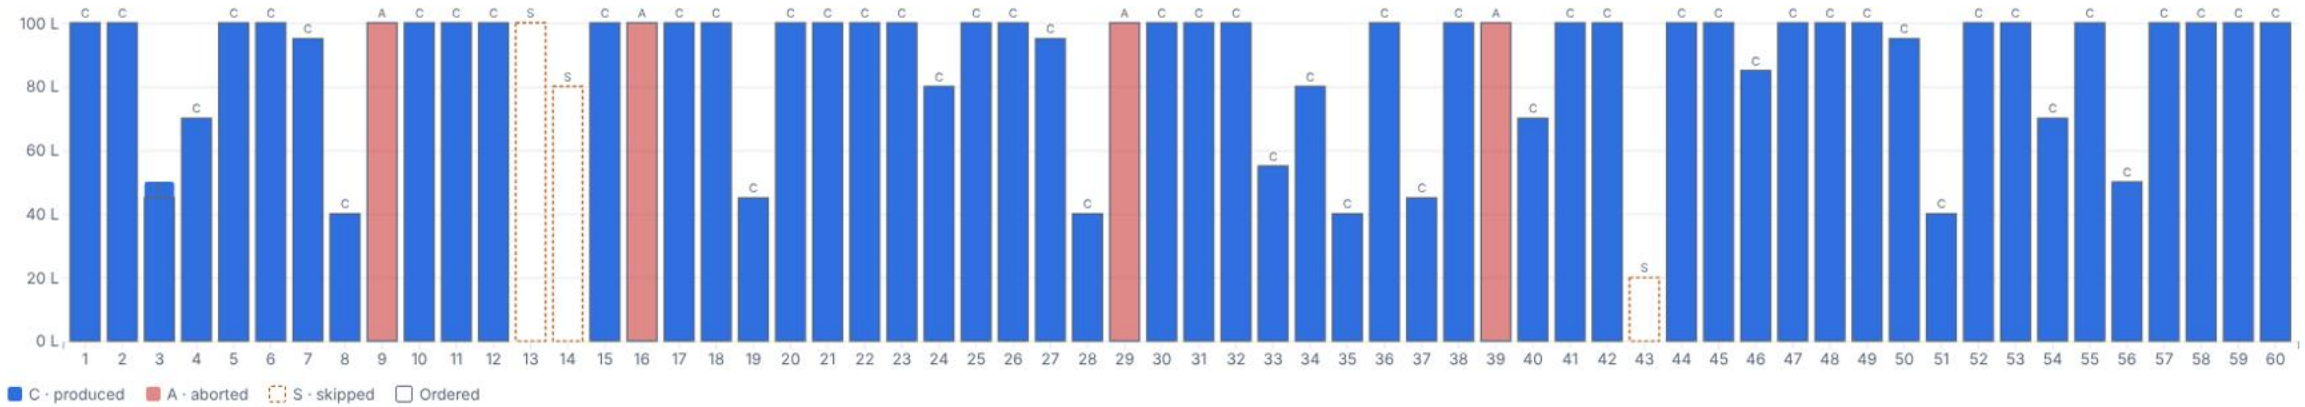

Alarm log

Every alarm in the event log, with its clock time.

Clock	Code	Batch ID	State	Detail
08:22:03	3	0007.0	Filling_OP	3 – Fill deviation: Prd_1 delivered 33.0 L, planned 30.0 L
09:21:57	6	0011.0	Waiting	6 – Batch not allowed: Recipe R002 not approved
09:22:11	6	0011.1	Waiting	6 – Batch not allowed: Recipe R002 not approved
09:37:53	1	0013.0	Filling_OP	1 – Overflow: level 101.04 L above 101 L with inlet open
12:42:10	4	0020.0	Filling_OP	4 – Step timeout: no progress: 0.0 L in 15 s, expected 15.0 L
13:22:38	4	0022.0	Cleaning_OP/drain	4 – Step timeout: no progress: 0.0 L in 15 s, expected -15.0 L
14:30:38	2	0024.0	Waiting	2 – Emergency Stop: Emergency Stop pressed by operator
15:30:32	2	0026.1	Empty_OP	2 – Emergency Stop: Emergency Stop pressed by operator
15:30:32	5	0026.1	Empty_OP	5 – Partial batch (cause alarm 2): 50.0 L discharged, 50.0 L left
16:32:58	6	0028.0	Waiting	6 – Batch not allowed: Volume 20 L below minimum 40 L

Production order report

One record per order; repeats appended at the end with "Retry of #m".

#	Batch ID	Recipe	Vol. order (L)	Vol. produced (L)	IN	OUT	Process (s)	Cleaning (s)	STATUS	ALARMS	Remarks
1	0001.0	R005	100	100.0	06:30:04	06:41:29	684.9		COMPLETED		
2	0002.0	R005	100	100.0	06:41:33	06:52:58	684.9		COMPLETED		
3	0003.0	R005	45	50.0	06:53:08	06:59:20	372.4		COMPLETED		Volume order 45 L, entered 50 L, confirmed by operator; Produced 50.0 L vs order 45 L
4	0004.0	R004	70	70.0	07:05:46	07:15:58	612.0	380.0	COMPLETED		
5	0005.0	R003	100	100.0	07:22:35	07:35:15	760.0	380.0	COMPLETED		
6	0006.0	R004	100	100.0	07:41:40	07:55:10	810.0	380.0	COMPLETED		
7	0006.1	R004	95	95.0	07:55:14	08:08:11	776.9		COMPLETED		
8	0006.2	R004	40	40.0	08:08:14	08:15:08	413.9		COMPLETED		
9	0007.0	R001	100		08:21:33	08:22:03	30.0	793.0	ABORTED (ALARM)	3 – Fill deviation	Alarm 3: Prd_1 delivered 33.0 L, planned 30.0 L; Cleaning pre-batch 380.0 s + post-alarm 413.0 s; Scrap 33.0 L
10	0008.0	R001	100	100.0	08:42:17	08:55:27	789.9		COMPLETED		
11	0009.0	R001	100	100.0	08:55:31	09:08:41	789.9		COMPLETED		
12	0010.0	R001	100	100.0	09:08:47	09:21:57	789.9		COMPLETED		
13	0011.0	R002	100						SKIPPED	6 – Batch not allowed	Recipe R002 not approved; ordered 100 L; Cancelled by operator
14	0011.1	R002	80						SKIPPED	6 – Batch not allowed	Recipe R002 not approved; ordered 80 L; Cancelled by operator