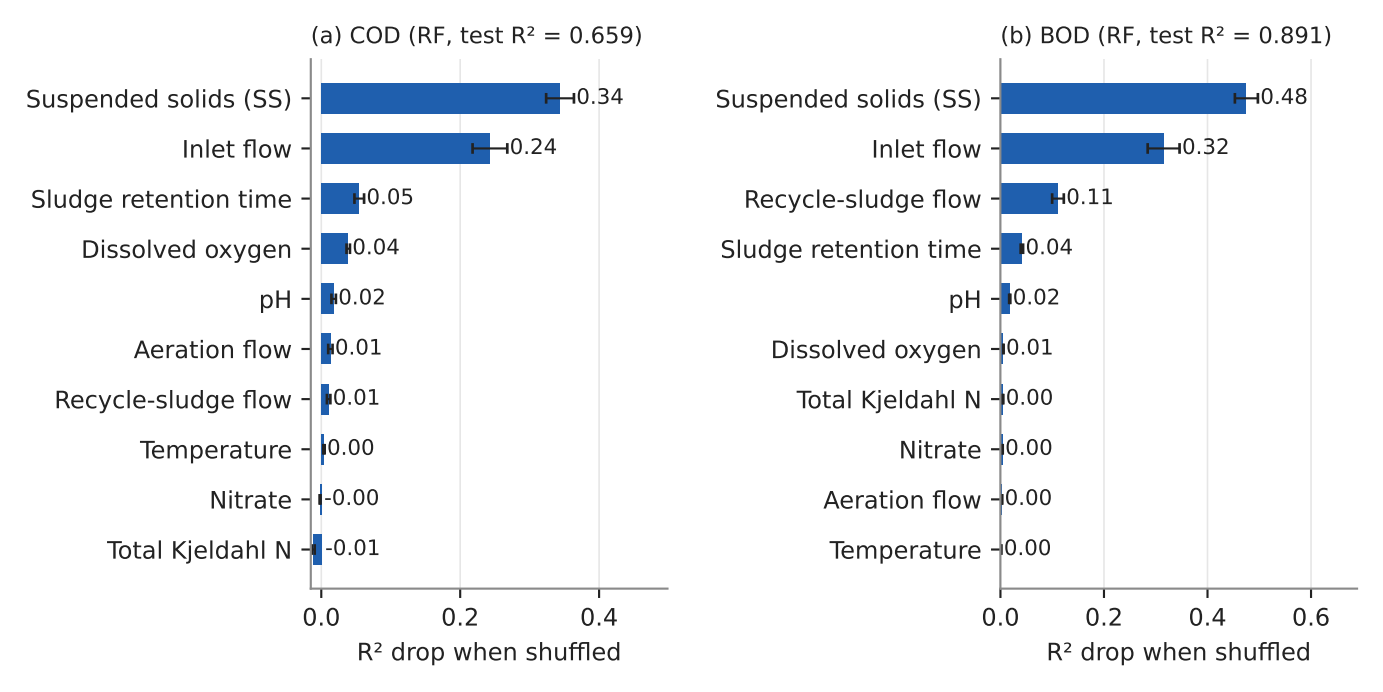
(a) COD (RF, test R² = 0.659)
Suspended solids (SS)
Inlet flow
Sludge retention time
Dissolved oxygen
pH
Aeration flow
Recycle-sludge flow
Temperature
Nitrate
Total Kjeldahl N
0.34
0.24
0.05
0.04
0.02
0.01
0.01
0.00
-0.00
-0.01
0.0
0.2
0.4
R² drop when shuffled
(b) BOD (RF, test R² = 0.891)
Suspended solids (SS)
Inlet flow
Recycle-sludge flow
Sludge retention time
pH
Dissolved oxygen
Total Kjeldahl N
Nitrate
Aeration flow
Temperature
0.48
0.32
0.11
0.04
0.02
0.01
0.00
0.00
0.00
0.00
0.0
0.2
0.4
0.6
R² drop when shuffled