


110 VAC 1 PH COLLATOR WITH HMI



BPA SCHEMATIC BUILD CONTENTS	
SHEET #	M
00	DRAWING INDEX AND PROJECT TITLE
01	SYSTEM LAYOUT
02	PANEL LAYOUT
03	3 PHASE POWER DISTRIBUTION
04	BLANK
05	VFD X 2
06	VFD X 1
07 - 13	BLANK
14	24VDC DISTRIBUTION
15	BLANK
16	SAFETY CIRCUIT
17 - 27	BLANK
28	PLC INPUTS
29 - 34	BLANK
35	PLC OUTPUTS
36 - 51	BLANK
52	MODBUS NETWORK
53 - 54	BLANK
55	TORQUE SPECIFICATIONS


PLC PROGRAM NAME
HMI PROGRAM NAME

- 01
01
- 02
02
- 02
03
- 02
04
- 02
05
- 02
06
- 02
07
- 02
08
- 02
09
- 02
10
- 02
11
- 02
12
- 02
13
- 02
14
- 02
15
- 02
16
- 02
17
- 02
18
- 02
19
- 02
20

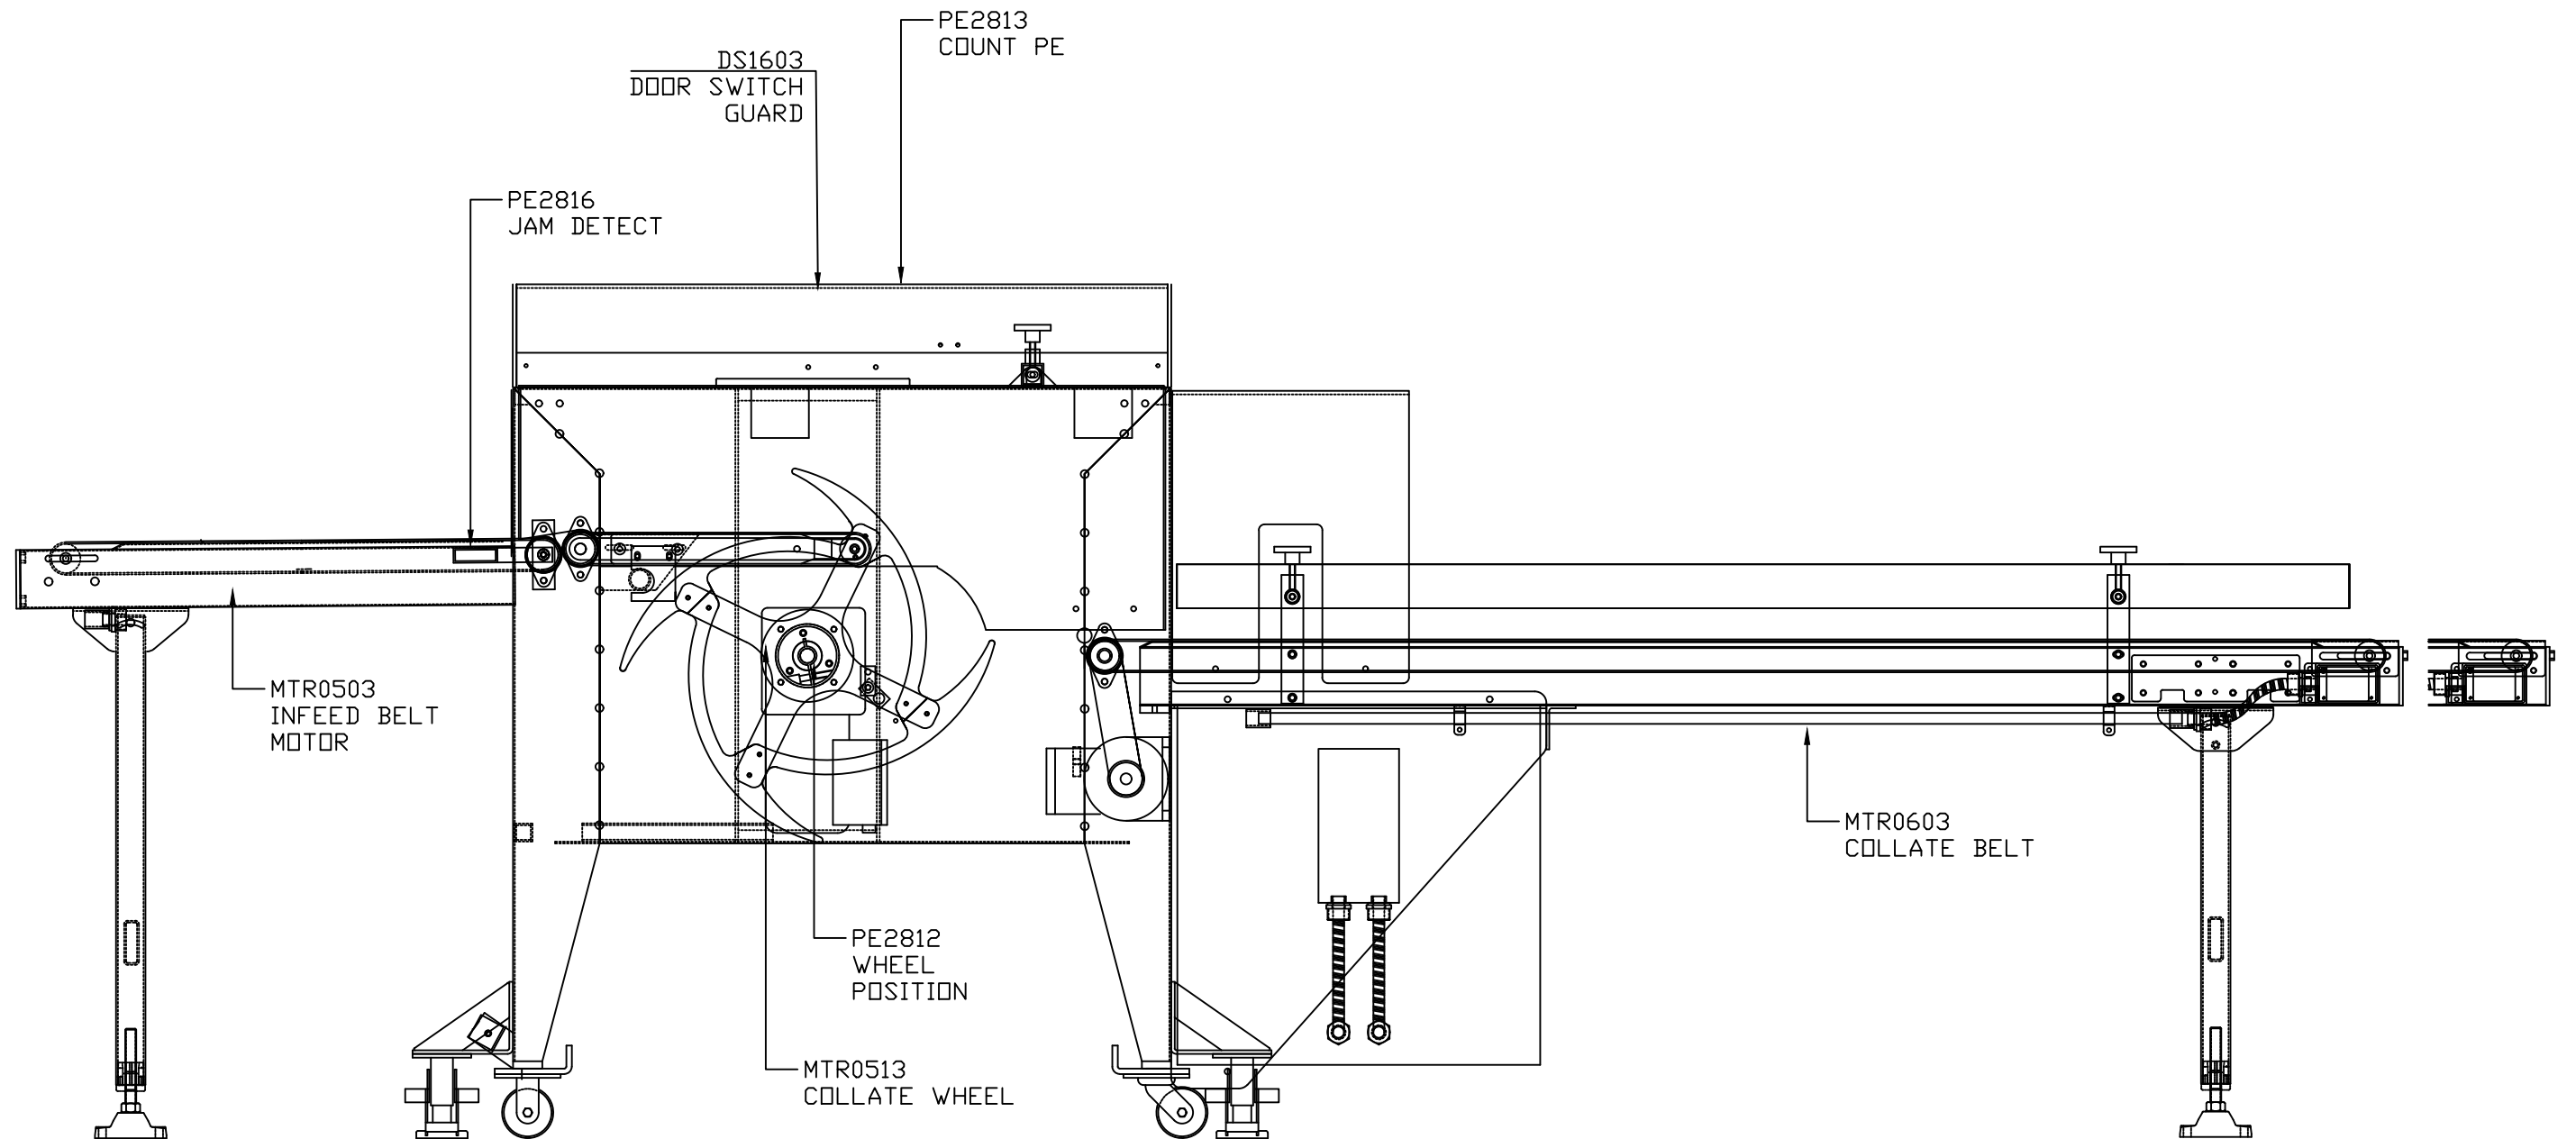

- 02 01
- 02 02
- 02 03
- 02 04
- 02 05
- 02 06
- 02 07
- 02 08
- 02 09
- 02 10
- 02 11
- 02 12
- 02 13
- 02 14
- 02 15
- 02 16
- 02 17
- 02 18
- 02 19
- 02 20

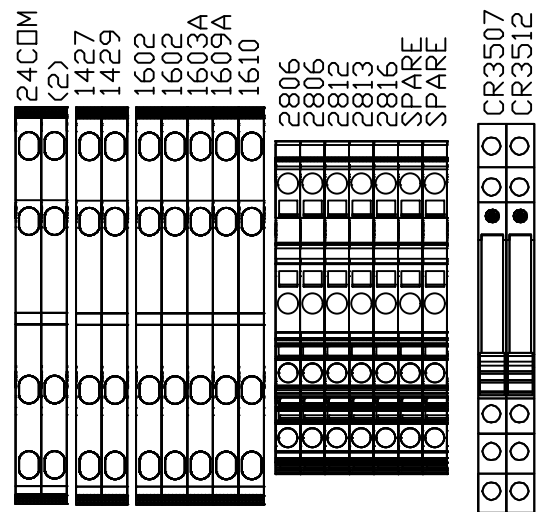

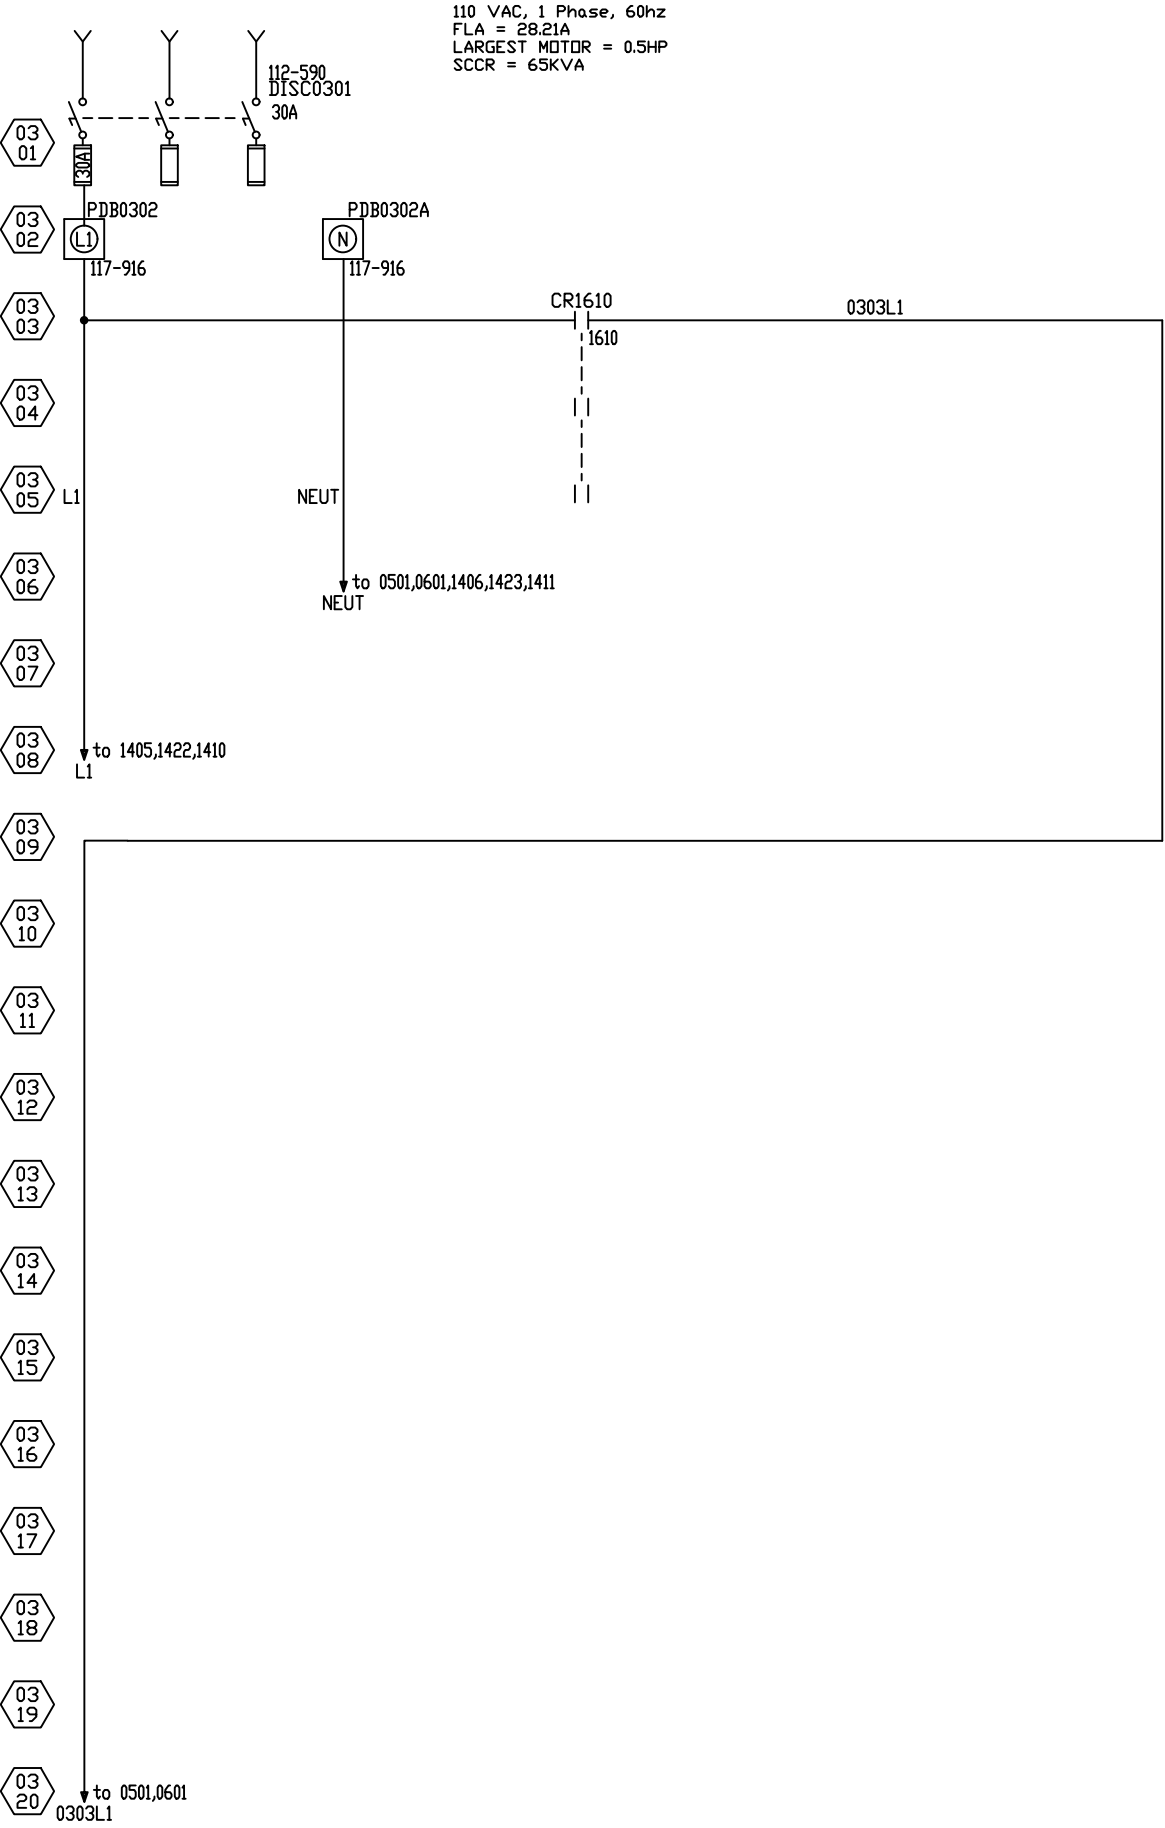

- 03 21
- 03 22
- 03 23
- 03 24
- 03 25
- 03 26
- 03 27
- 03 28
- 03 29
- 03 30
- 03 31
- 03 32
- 03 33
- 03 34
- 03 35
- 03 36
- 03 37
- 03 38
- 03 39
- 03 40

04
01

04
02

04
03

04
04

04
05

04
06

04
07

04
08

04
09

04
10

04
11

04
12

04
13

04
14

04
15

04
16

04
17

04
18

04
19

PAGE 04 INTENTIONALLY LEFT BLANK

04
20

04
21

04
22

04
23

04
24

04
25

04
26

04
27

04
28

04
29

04
30

04
31

04
32

04
33


04
34

04
35

04
36

04
37

04
38

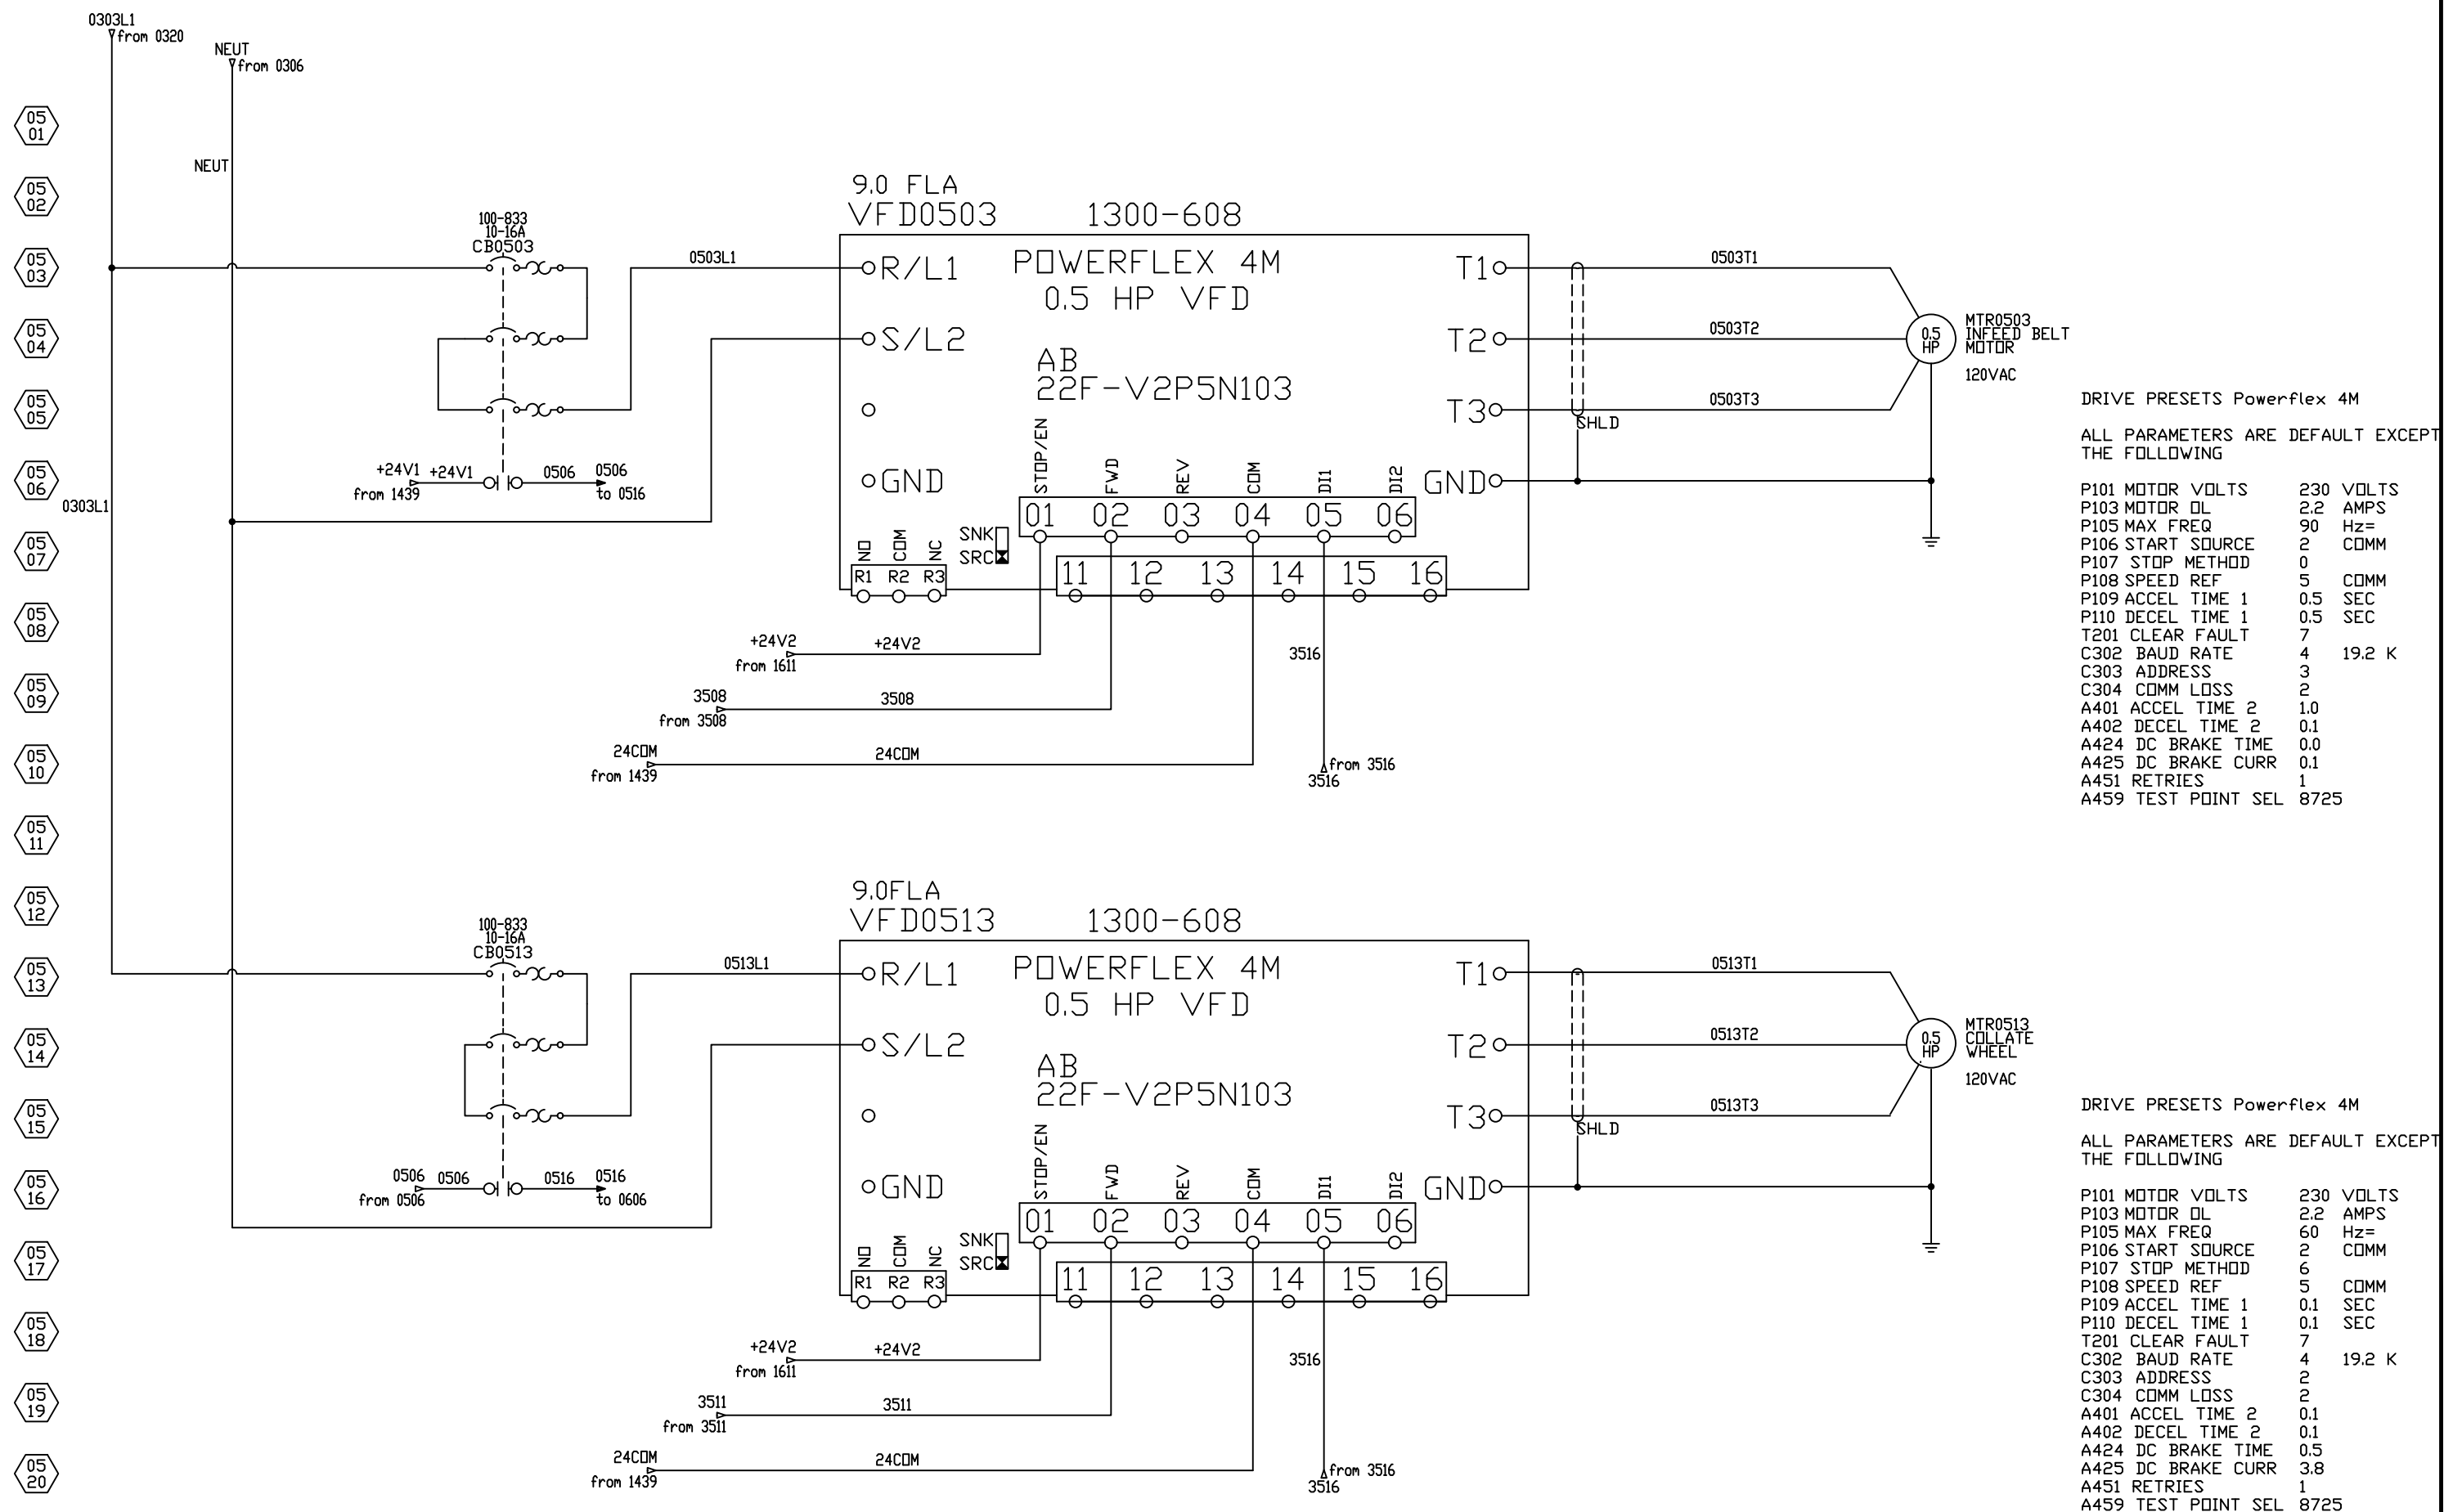

DRIVE PRESETS Powerflex 4M

ALL PARAMETERS ARE DEFAULT EXCEPT THE FOLLOWING

P101 MOTOR VOLTS	230	VOLTS
P103 MOTOR OL	2.2	AMPS
P105 MAX FREQ	90	Hz=
P106 START SOURCE	2	COMM
P107 STOP METHOD	0	
P108 SPEED REF	5	COMM
P109 ACCEL TIME 1	0.5	SEC
P110 DECEL TIME 1	0.5	SEC
T201 CLEAR FAULT	7	
C302 BAUD RATE	4	19.2 K
C303 ADDRESS	3	
C304 COMM LOSS	2	
A401 ACCEL TIME 2	1.0	
A402 DECEL TIME 2	0.1	
A424 DC BRAKE TIME	0.0	
A425 DC BRAKE CURR	0.1	
A451 RETRIES	1	
A459 TEST POINT SEL	8725	

DRIVE PRESETS Powerflex 4M

ALL PARAMETERS ARE DEFAULT EXCEPT THE FOLLOWING

P101 MOTOR VOLTS	230	VOLTS
P103 MOTOR OL	2.2	AMPS
P105 MAX FREQ	60	Hz=
P106 START SOURCE	2	COMM
P107 STOP METHOD	6	
P108 SPEED REF	5	COMM
P109 ACCEL TIME 1	0.1	SEC
P110 DECEL TIME 1	0.1	SEC
T201 CLEAR FAULT	7	
C302 BAUD RATE	4	19.2 K
C303 ADDRESS	2	
C304 COMM LOSS	2	
A401 ACCEL TIME 2	0.1	
A402 DECEL TIME 2	0.1	
A424 DC BRAKE TIME	0.5	
A425 DC BRAKE CURR	3.8	
A451 RETRIES	1	
A459 TEST POINT SEL	8725	

07
01

07
02

07
03

07
04

07
05

07
06

07
07

07
08

07
09

07
10

07
11

07
12

07
13

07
14

07
15

07
16

07
17

07
18

07
19

PAGE 07 INTENTIONALLY LEFT BLANK

07
20

07
21

07
22

07
23

07
24

07
25

07
26

07
27

07
28

07
29

07
30

07
31

07
32

07
33

07
34

07
35


07
36

07
37

07
38



PAGE 15 INTENTIONALLY LEFT BLANK

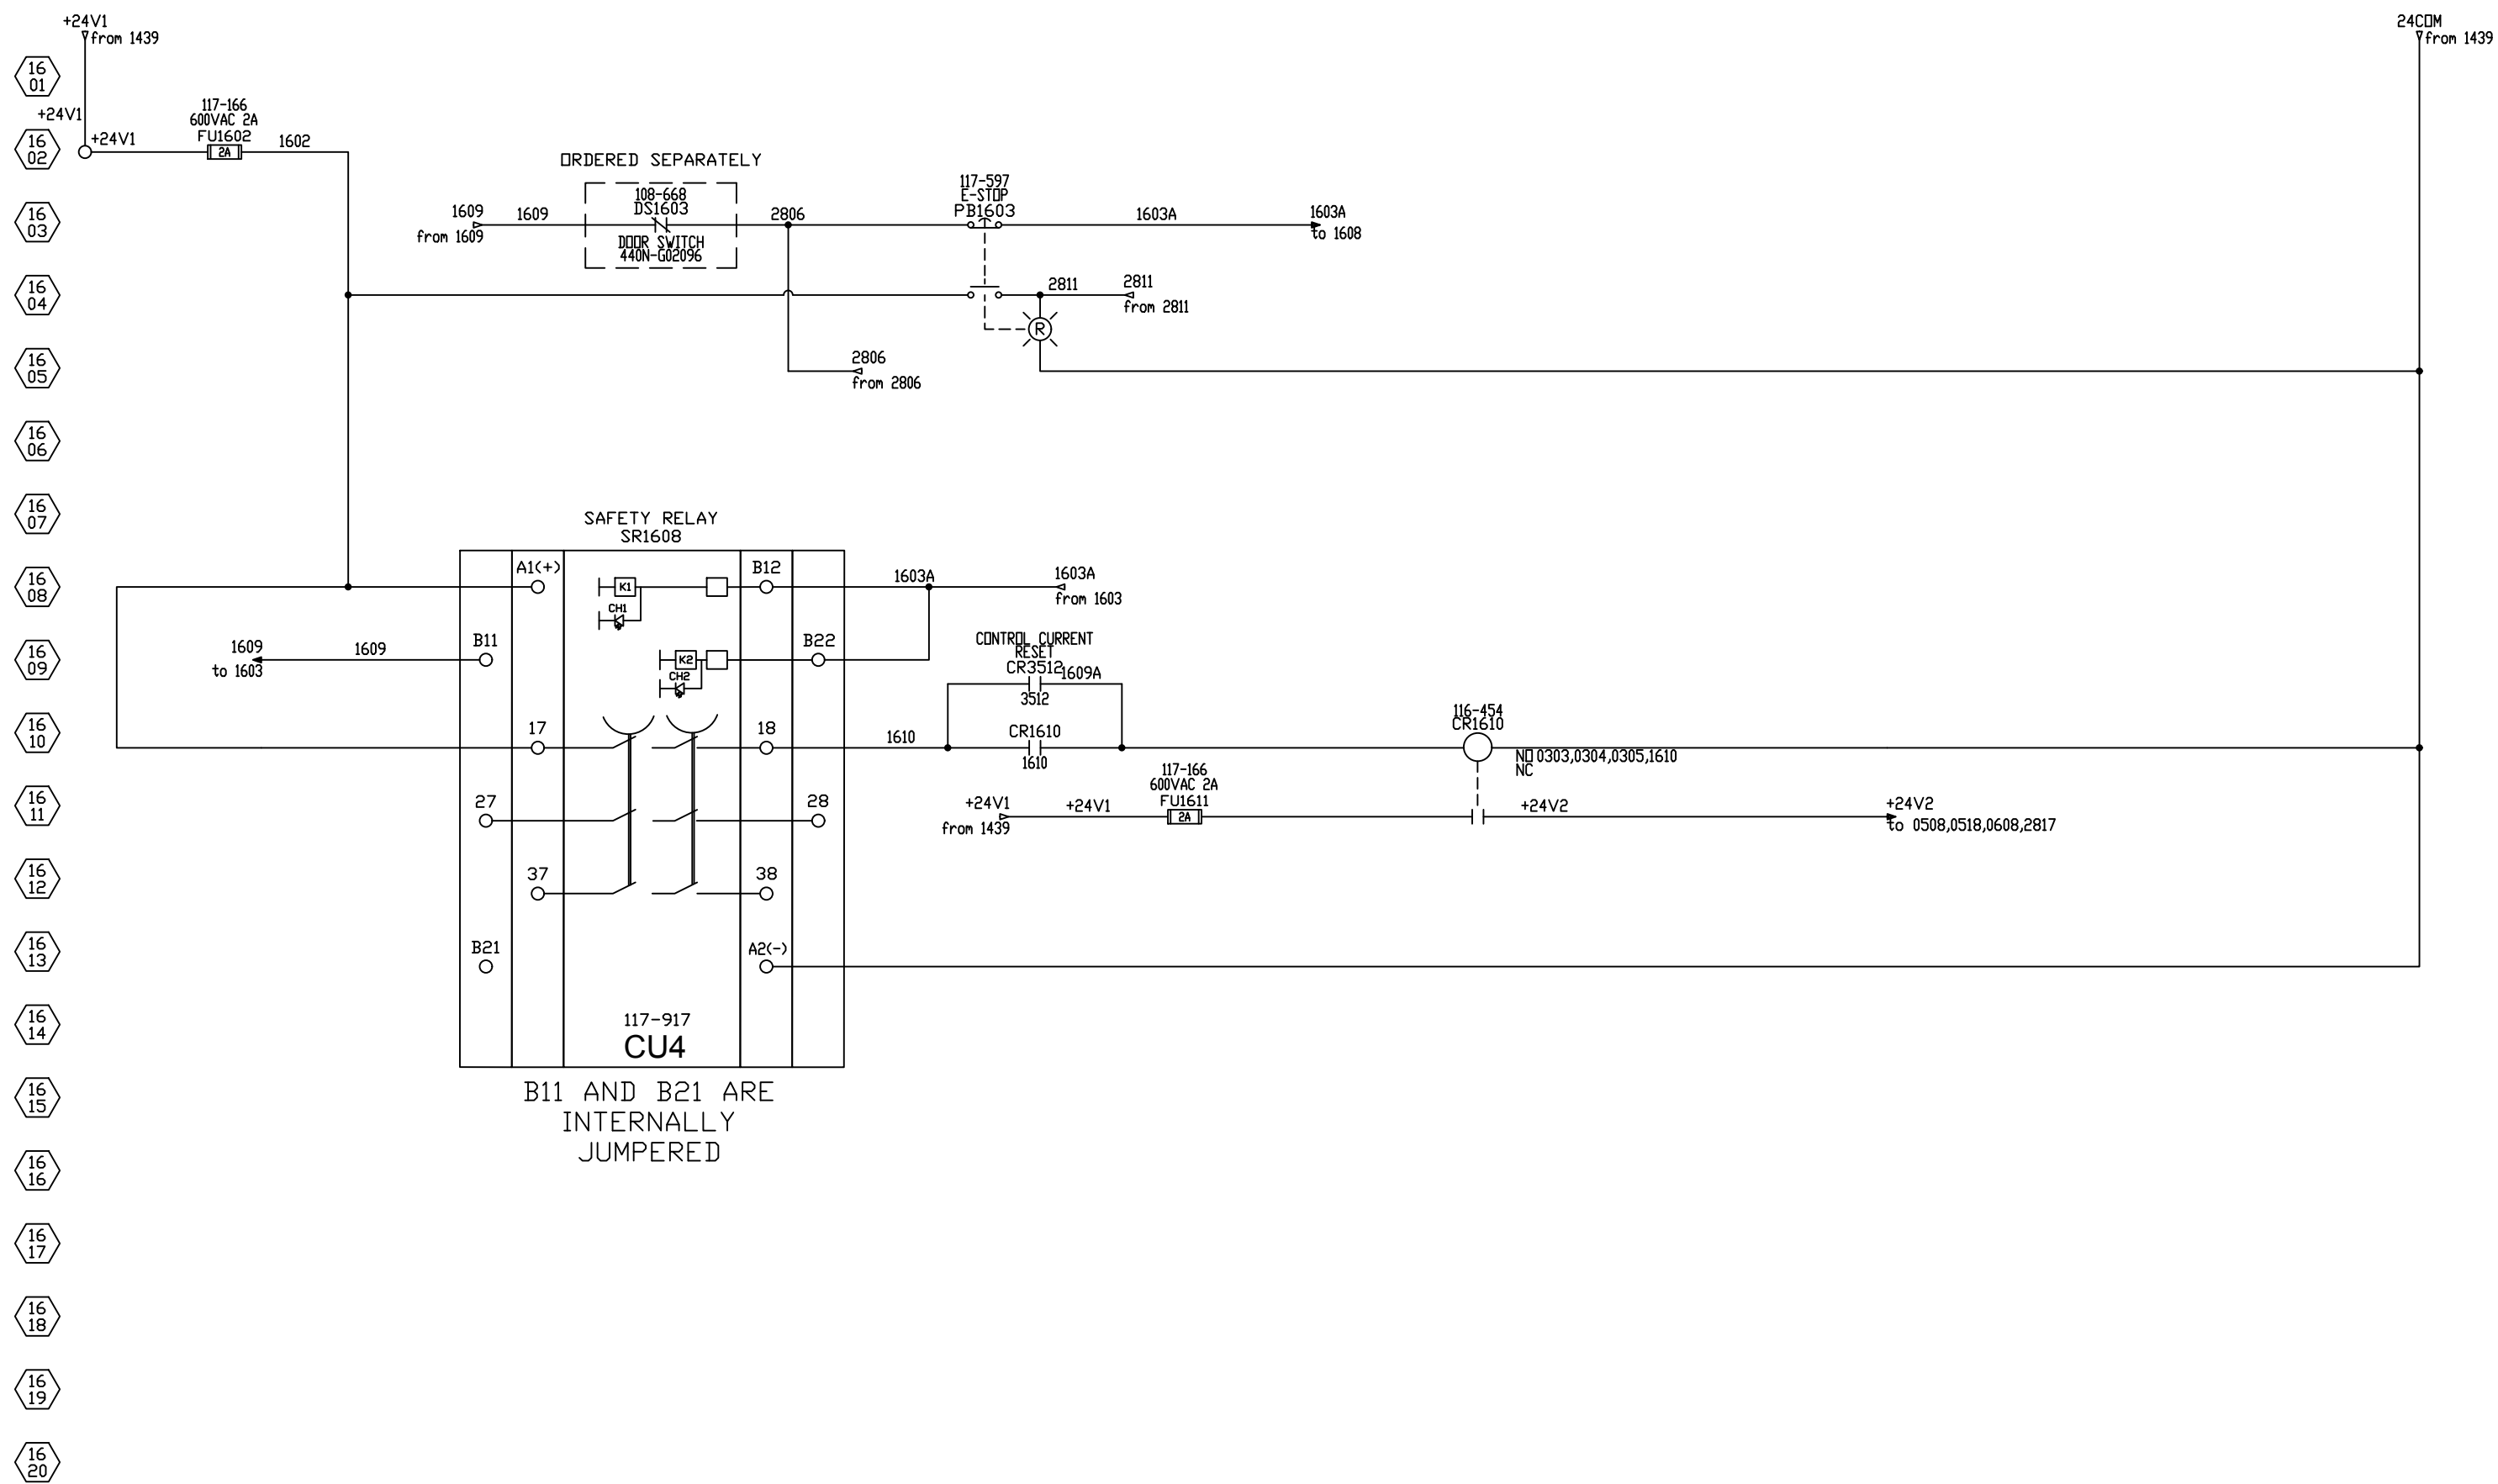

17
01

17
02

17
03

17
04

17
05

17
06

17
07

17
08

17
09

17
10

17
11

17
12

17
13

17
14

17
15

17
16


17
17

17
18

17
19

17
20

PAGES 17 - 27 WERE INTENTIONALLY LEFT BLANK

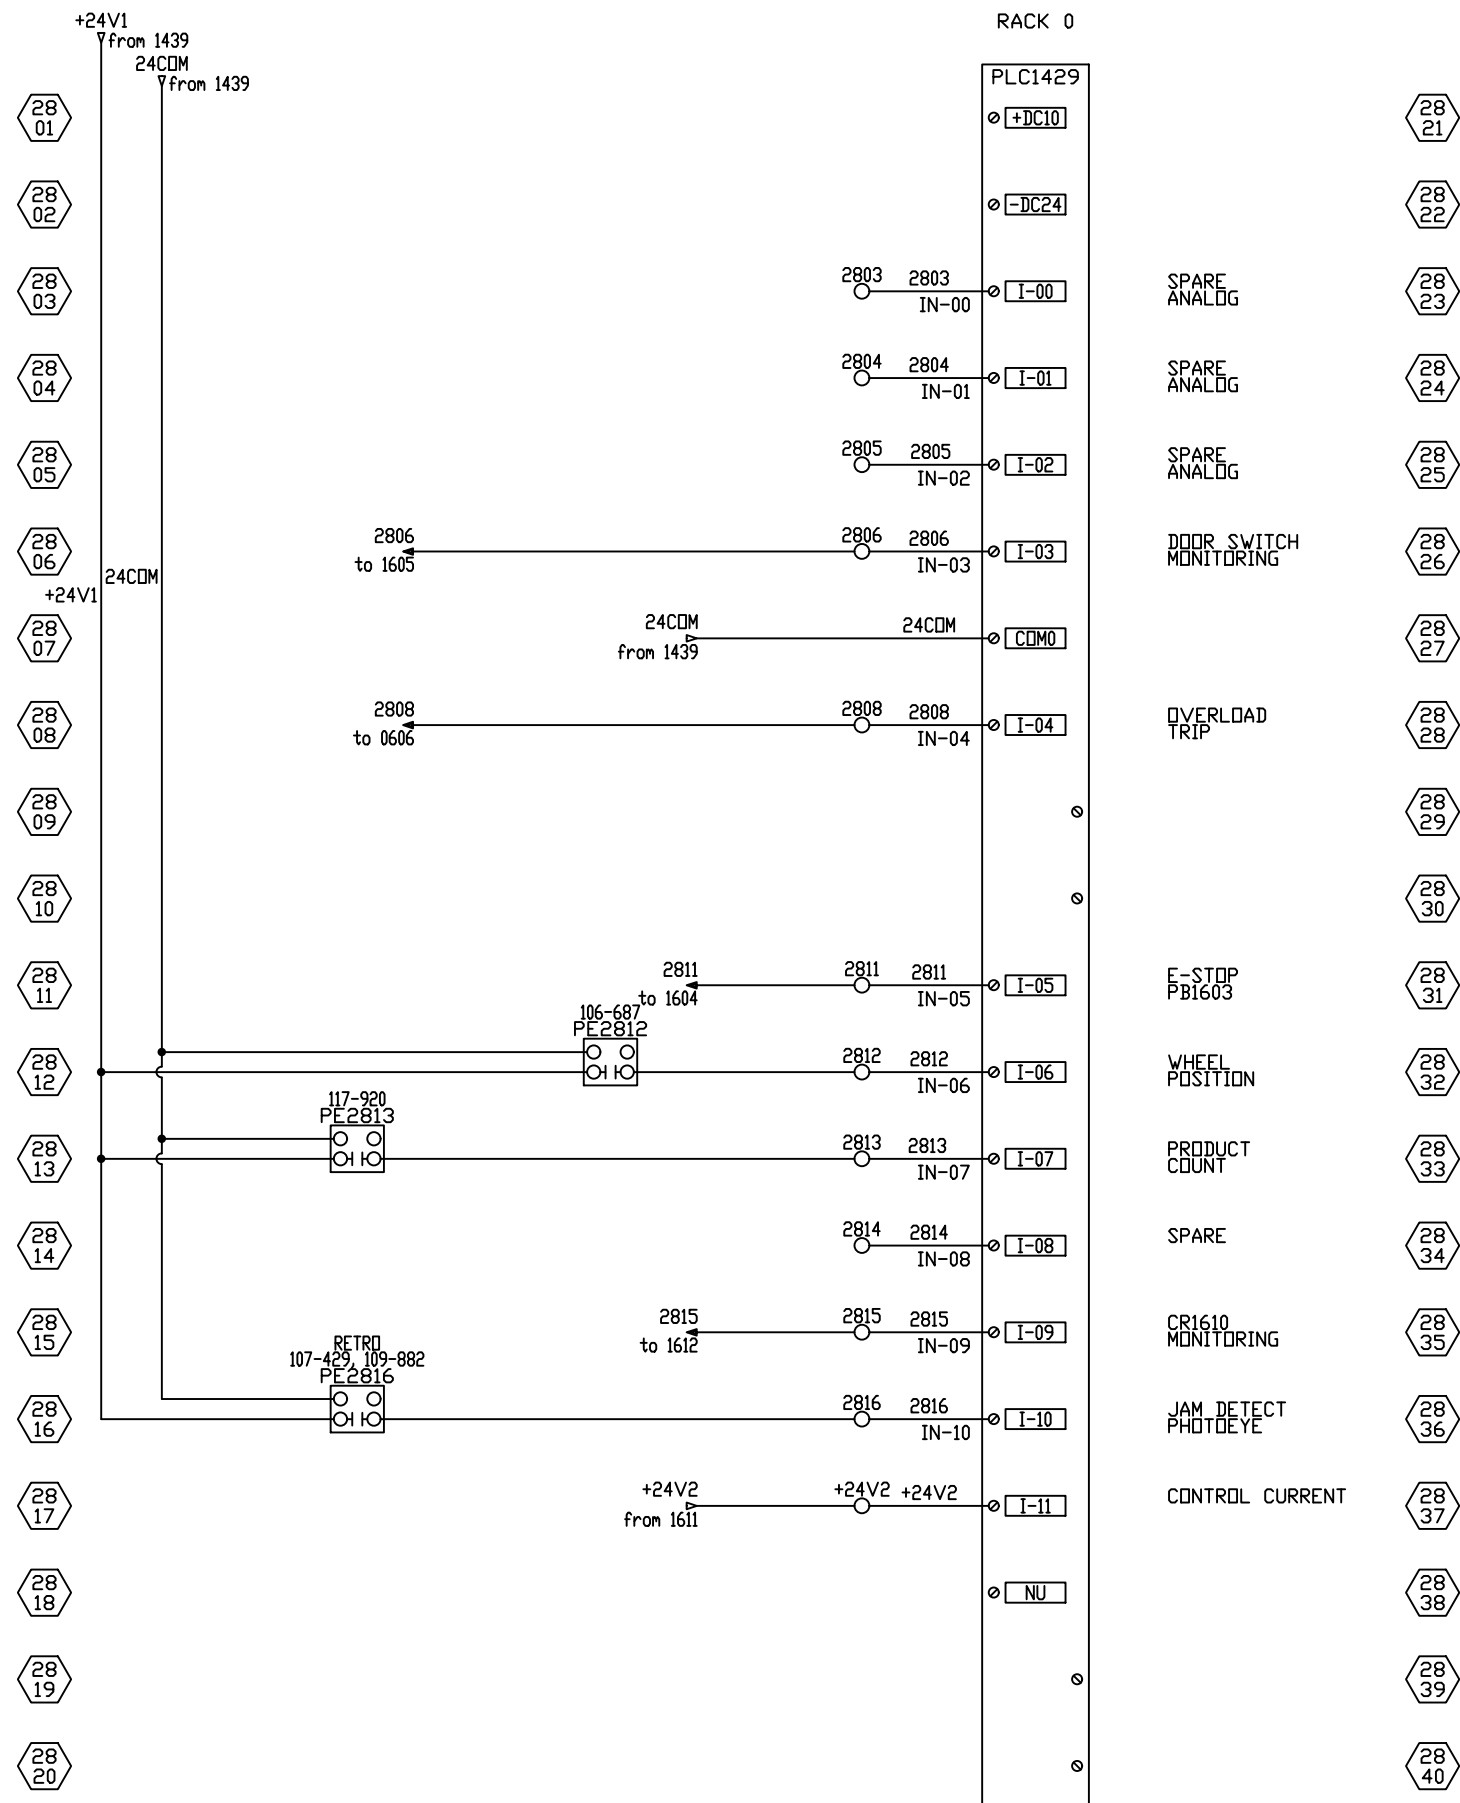

29
01

29
02

29
03

29
04

29
05

29
06

29
07

29
08

29
09

29
10

29
11

29
12

29
13

29
14

29
15

29
16

29
17

29
18

29
19

29
20

29
21

29
22

29
23

29
24

29
25

29
26

29
27

29
28

29
29

29
30

29
31

29
32

29
33

29
34

29
35

29
36


29
37

29
38

29
39

29
40

PAGES 29 - 34 WERE INTENTIONALLY LEFT BLANK



36
01

36
02

36
03

36
04

36
05

36
06

36
07

36
08

36
09

36
10

36
11

36
12

36
13

36
14

36
15

36
16

36
17

36
18

36
19

36
20

PAGES 36 - 51 INTENTIONALLY LEFT BLANK

36
21

36
22

36
23

36
24

36
25

36
26

36
27

36
28

36
29

36
30

36
31

36
32

36
33

36
34

36
35

36
36


36
37

36
38

36
39

36
40

Ethernet Network

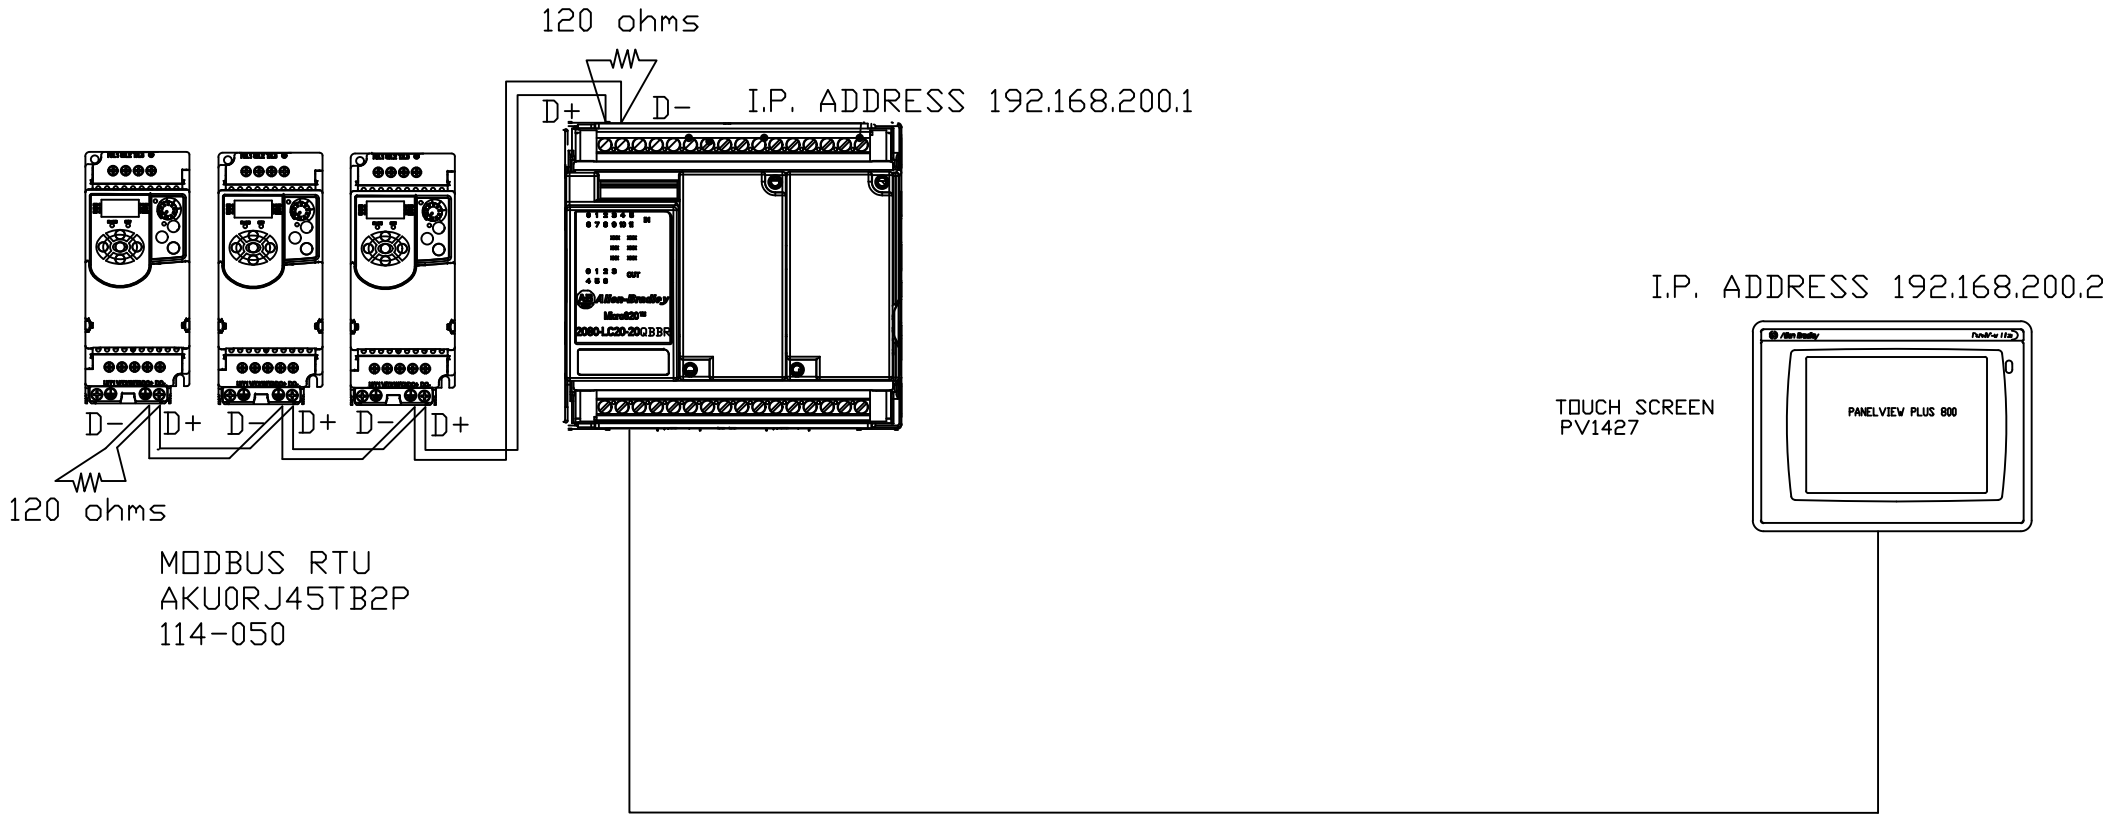

53
01

53
02

53
03

53
04

53
05

53
06

53
07

53
08

53
09

53
10

53
11

53
12

53
13

53
14

53
15

53
16

53
17

53
18

53
19

PAGES 53 - 54 INTENTIONALLY LEFT BLANK

53
20

53
21

53
22

53
23

53
24

53
25

53
26

53
27

53
28

53
29

53
30

53
31

53
32

53
33

53
34

53
35

53
36

53
37

53
38

Electrical Power Component Torque Specifications

Mfg	Mfg Number	Description	Torque (Nm)	Torque (lb-in)
AB	194RF-NC030R# 194RF-NJ030R# 194RF-NN030R# 194R-NA100P3 194R-NA200P3	Disconnect, Rotary, 30A	1.4Nm	12 lb-in
AB	194RF-NJ060R# 194RF-NN060R# 194RF-NA300P3	Disconnect, Rotary, 60A	4.0Nm	35lb-in
AB	100S-C30DJ22C	Contactor, Safety	1.5-3.5Nm	13-31lb-in
AB	1492-PD3C141	Distribution Block, 3 Phase	none provided	
AB	140MCWTE	Terminal, 3Phase Feeder	3.0-3.5Nm	27-31lb-in
AB	140MC2EB63	Motor Starter, 4.0-6.3A	2.0-2.5Nm	18-22lb-in
AB	140MC2EB25	Motor Starter, 1.6-2.5A	2.0-2.5Nm	18-22lb-in
AB	140MC2EB16	Motor Starter, 1.0-1.6A	2.0-2.5Nm	18-22lb-in
AB	140MC2EB10	Motor Starter, 0.63-1.0A	2.0-2.5Nm	18-22lb-in
AB	100C12UZJ10	Contactor, Motor	1.0-2.5Nm	8.9-22lb-in
Mennekes	20MS1A-M2	Disconnect, Rotary, Non-Fused, 25A	none provided	
AB	22AD2P3N104	Drive, Inverter, PowerFlex 4M	1.7-2.2Nm	14-20lb-in
AB	22BD2P3N104	Drive, Inverter, PowerFlex 525	1.7-2.2Nm	14-20lb-in
ACME	T-2A-53340-IS	Transformer, 3 Phase, 480/240	none provided	
AB	2094-BC01-M01-S	Drive, Servo, Kinetix 6000	2.26Nm	20lb-in
Micron	B750BTZ13JK	Transformer, 1 Phase,	none provided	
Weidmuller	991549	Receptacle	none provided	
Hoffman	T-FP41	Cooling Fan	none provided	
AB	1769-PA4	Power Supply, Compact Logix, 4A	1.27Nm	11.24lb-in
AB	1606-XL240E	Power Supply, 240VAC to 24VDC	0.8Nm	7.0lb-in
Mersen	USCC1I	Fuse Holder, 1 Pole, Class CC	1.7Nm	14lb-in
Mersen	USCC2I	Fuse Holder, 2 Pole, Class CC	1.7Nm	14lb-in
Mersen	USCC3I	Fuse Holder, 3 Pole, Class CC	1.7Nm	14lb-in