



ELECTRICAL POWER REQUIREMENTS:
VOLTAGE: 230VAC, 60hz, 3ø
MACHINE FULL LOAD AMPS: 14.42A
SHORT CIRCUIT CURRENT RATING: 65kA
MAIN OVERCURRENT PROTECTION
TO BE INSTALLED IN THE FIELD
USE ONLY COPPER WIRE MIN. RATING 75° C

FRAME GROUND MUST BE
BONDED TO EARTH GROUND

NOTE: ALL AC VOLTAGES ARE NOMINAL FOR THE PURPOSE OF CONVENIENTLY DESIGNATING THEIR VOLTAGE CLASSES. THE ACTUAL VOLTAGES CAN VARY WITHIN A RANGE OF +/- 10%.

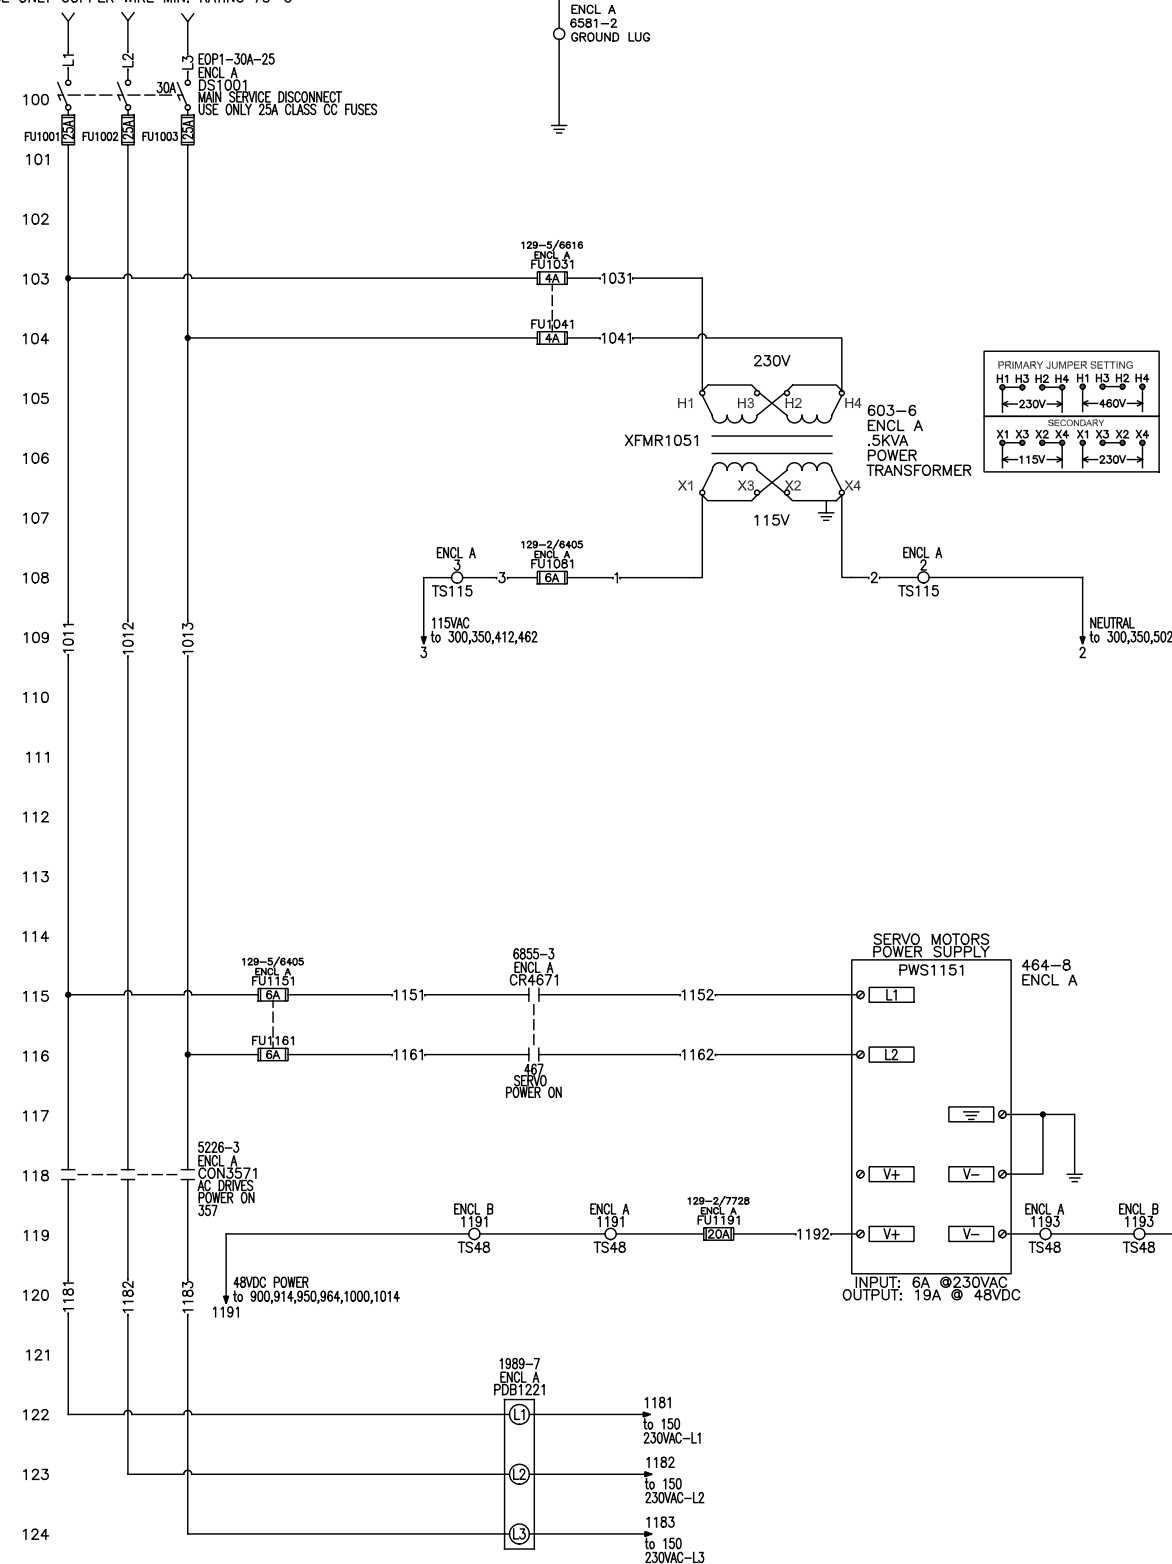

ARR-TECH P.O. BOX 9063 YAKIMA WA. 98909		DRAWING NO. \$CHEMATIC A17028		RE
TITLE GV38-40				
DRAWN JJ	DATE 12/11/17	SHEET 1 OF 12	SPECIAL	

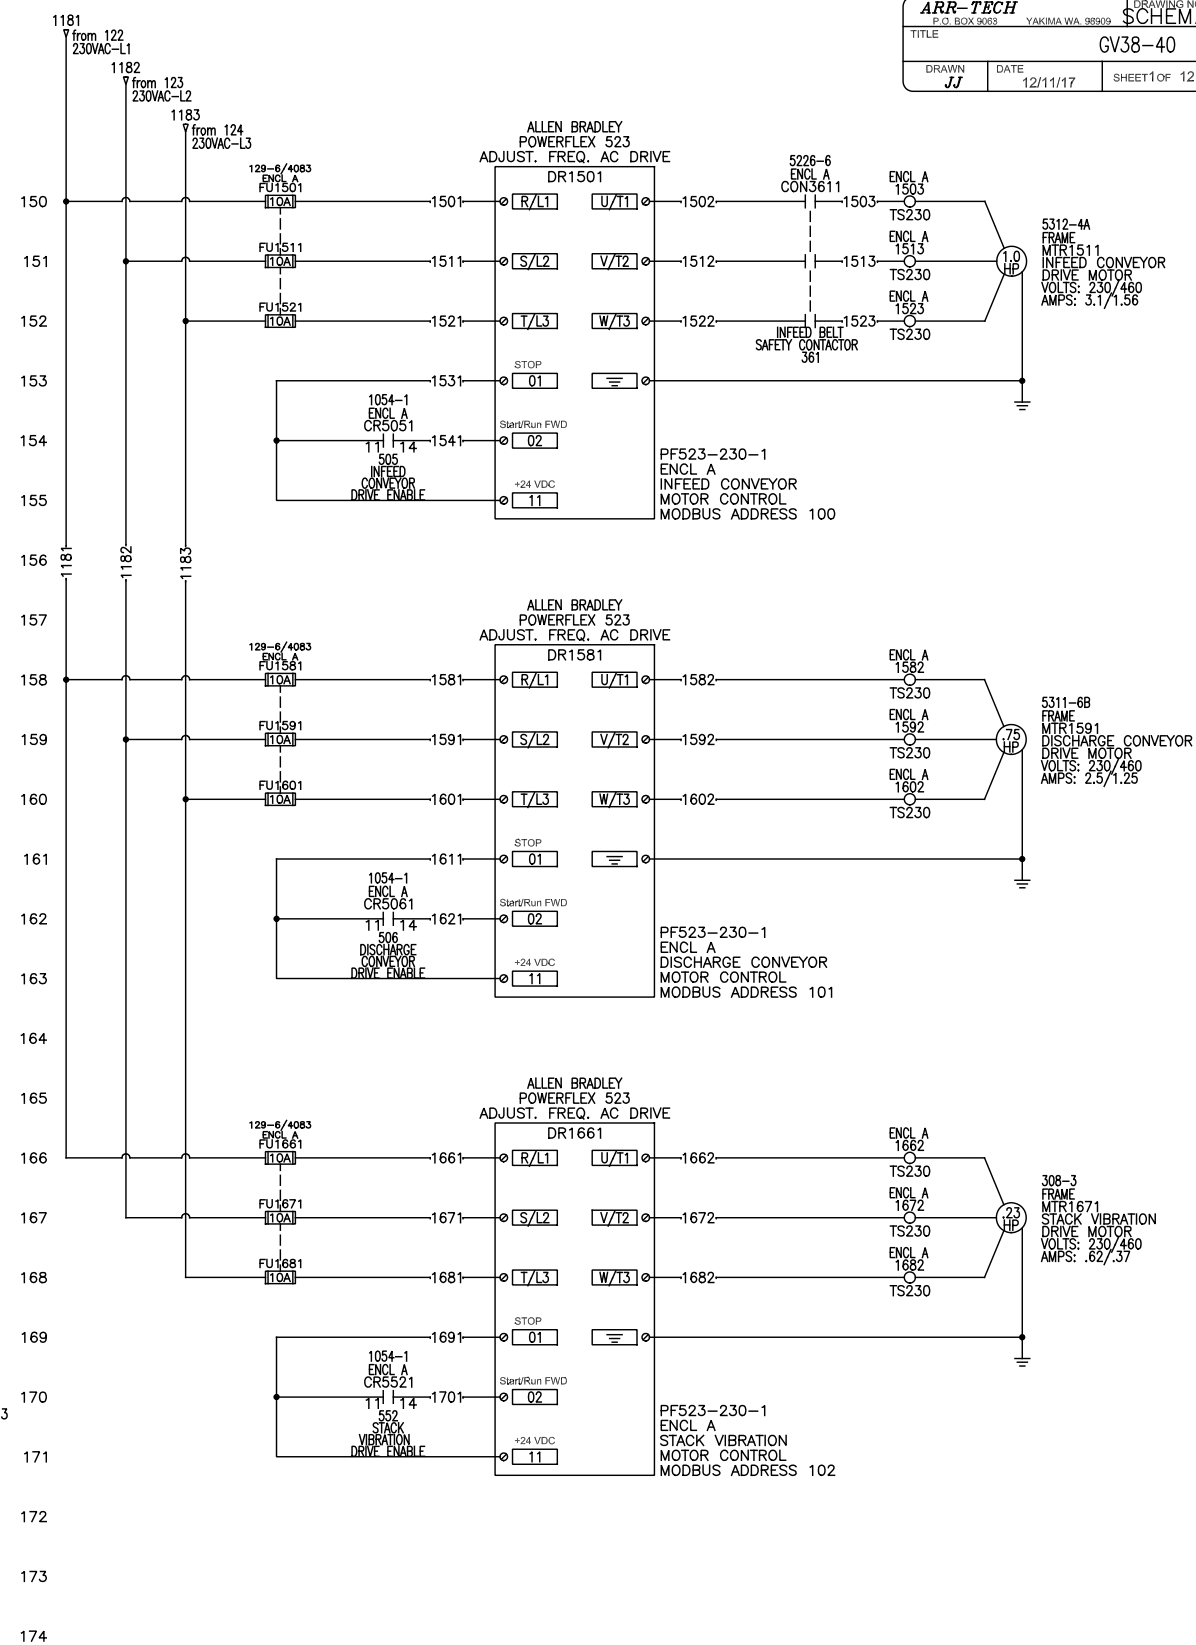

THIS PAGE LEFT BLANK FOR EXPANSION

ARR-TECH P.O. BOX 9053 YAKIMA WA. 98909		DRAWING NO. \$SCHEMATIC A17028		REV.
TITLE GV38-40				
DRAWN JJ	DATE 12/11/17	SHEET 2 OF 12	SPECIAL	

200

201

202

203

204

205

206

207

208

209

210

211

212

213

214

215

216

217

218

219

220

221

222

223

224

250

251

252

253

254

255

256

257

258

259

260

261

262

263

264

265

266

267

268

269


270



271



272



273


274

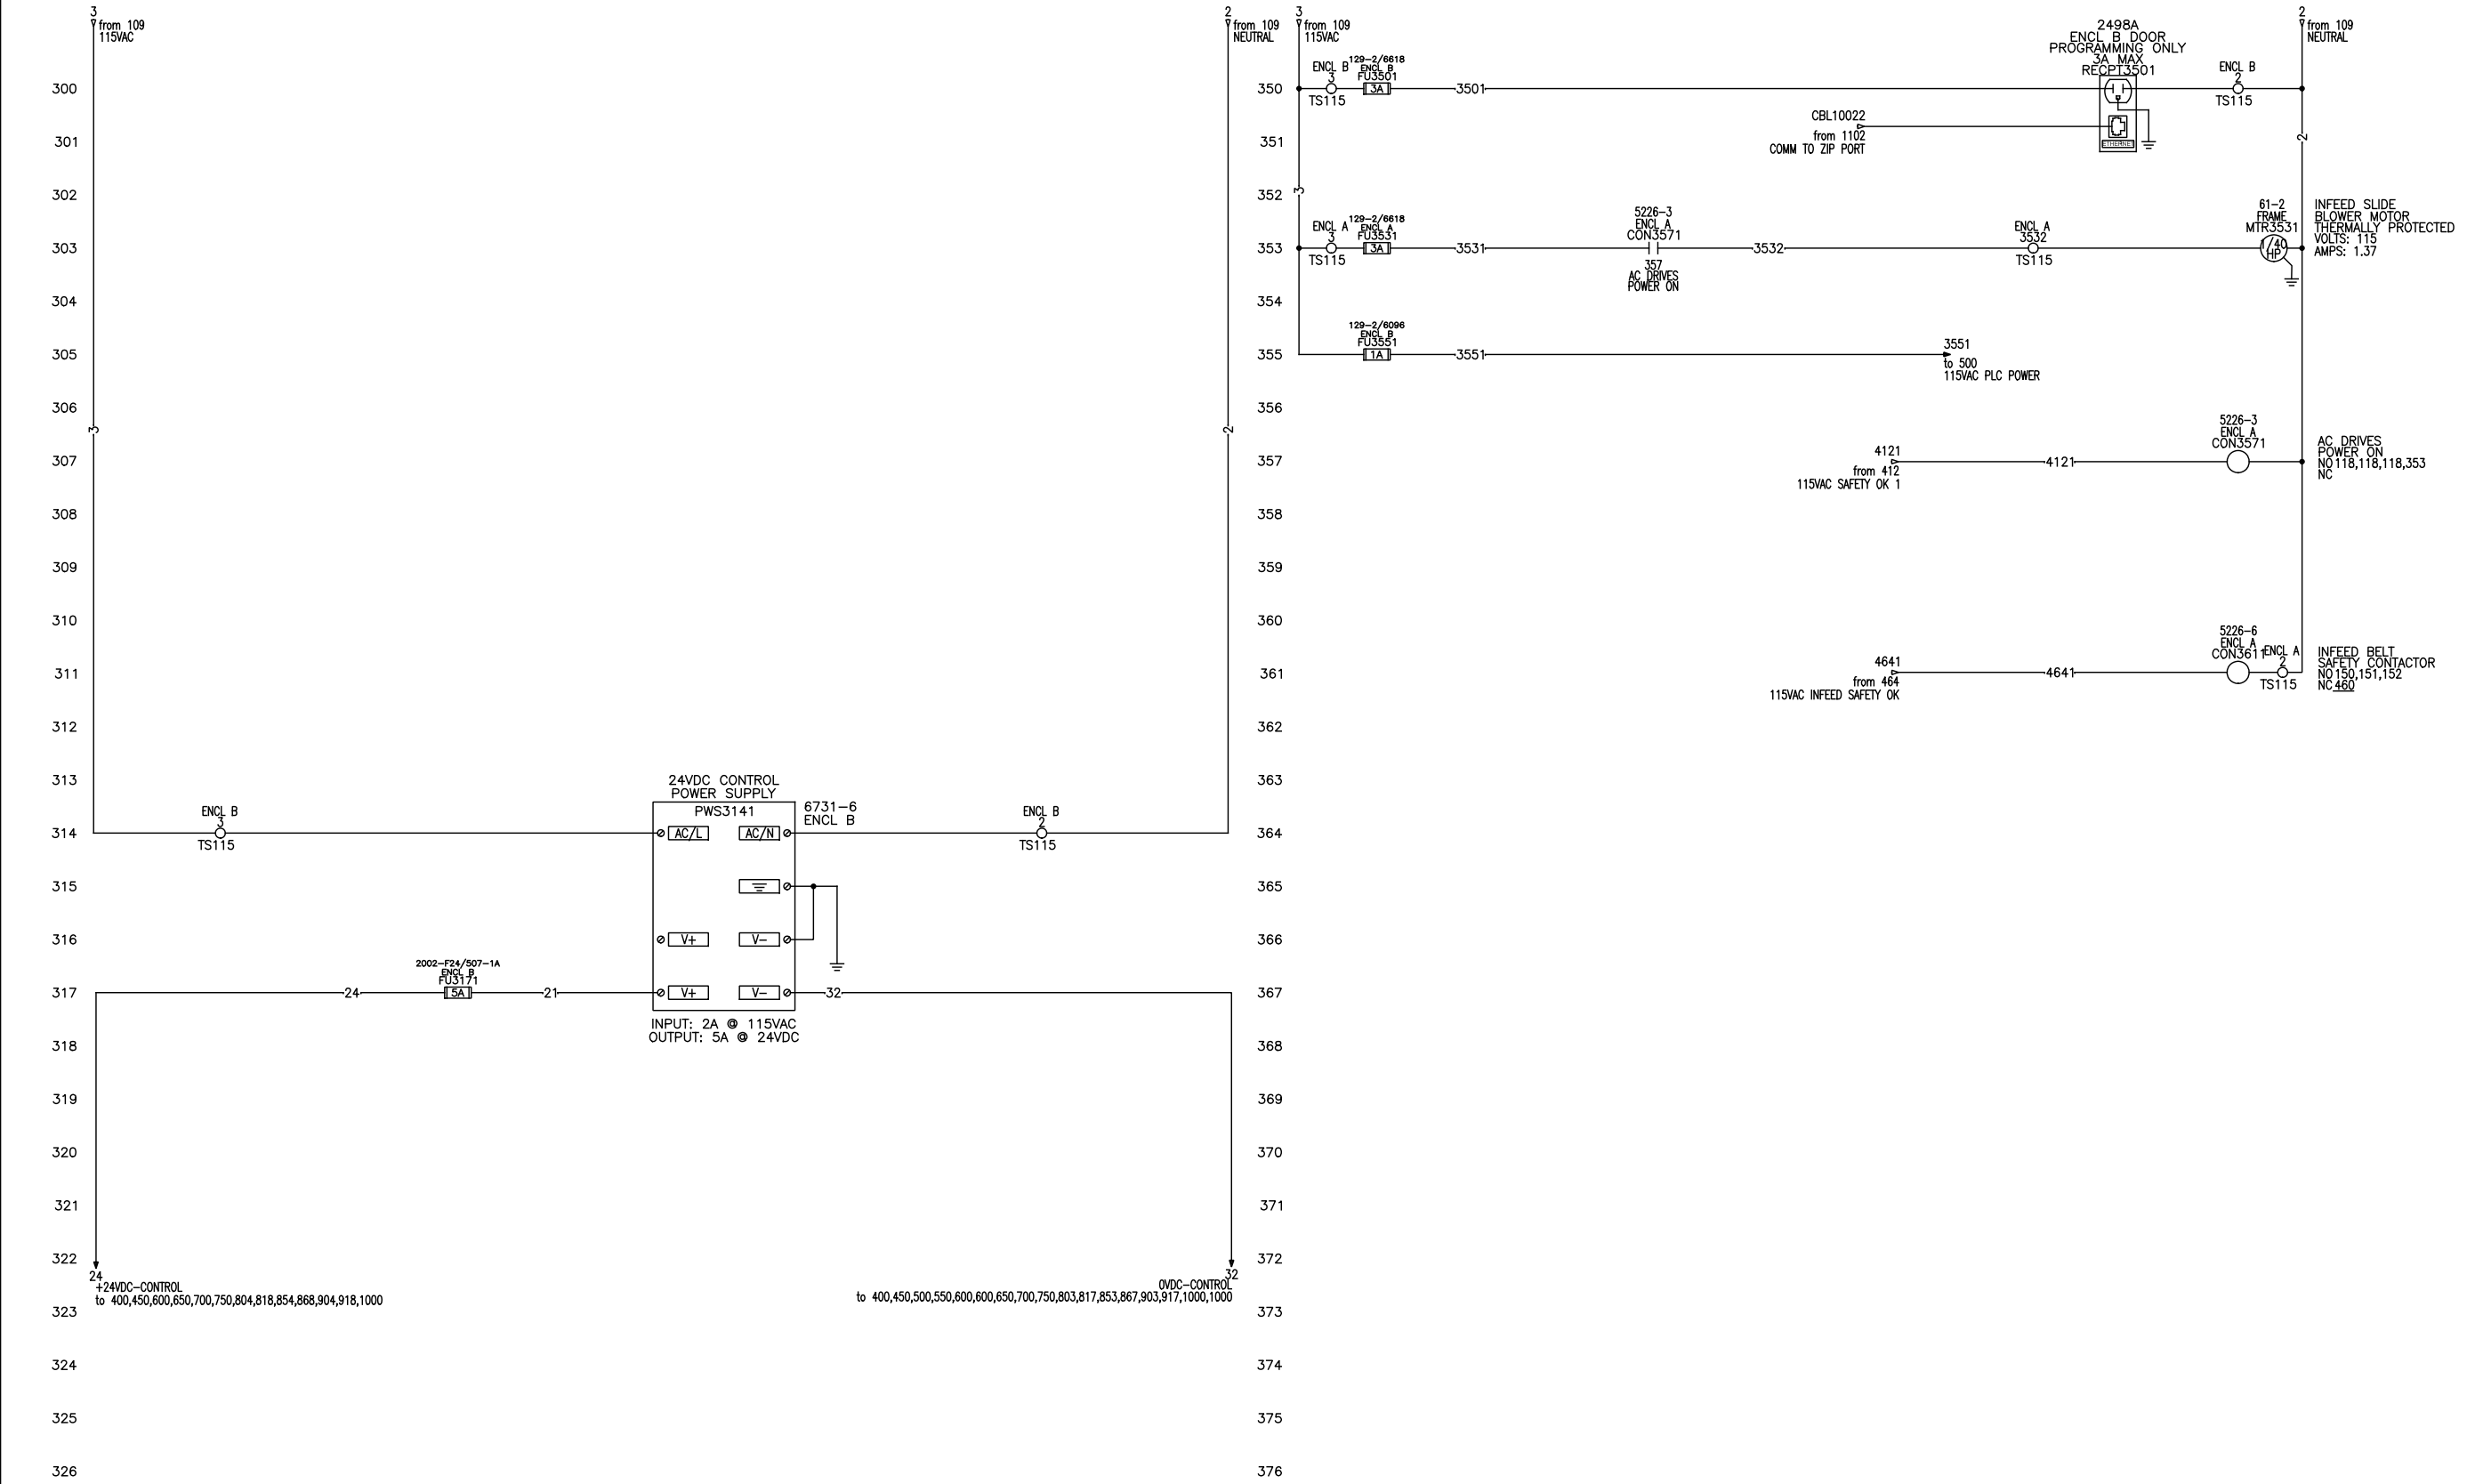



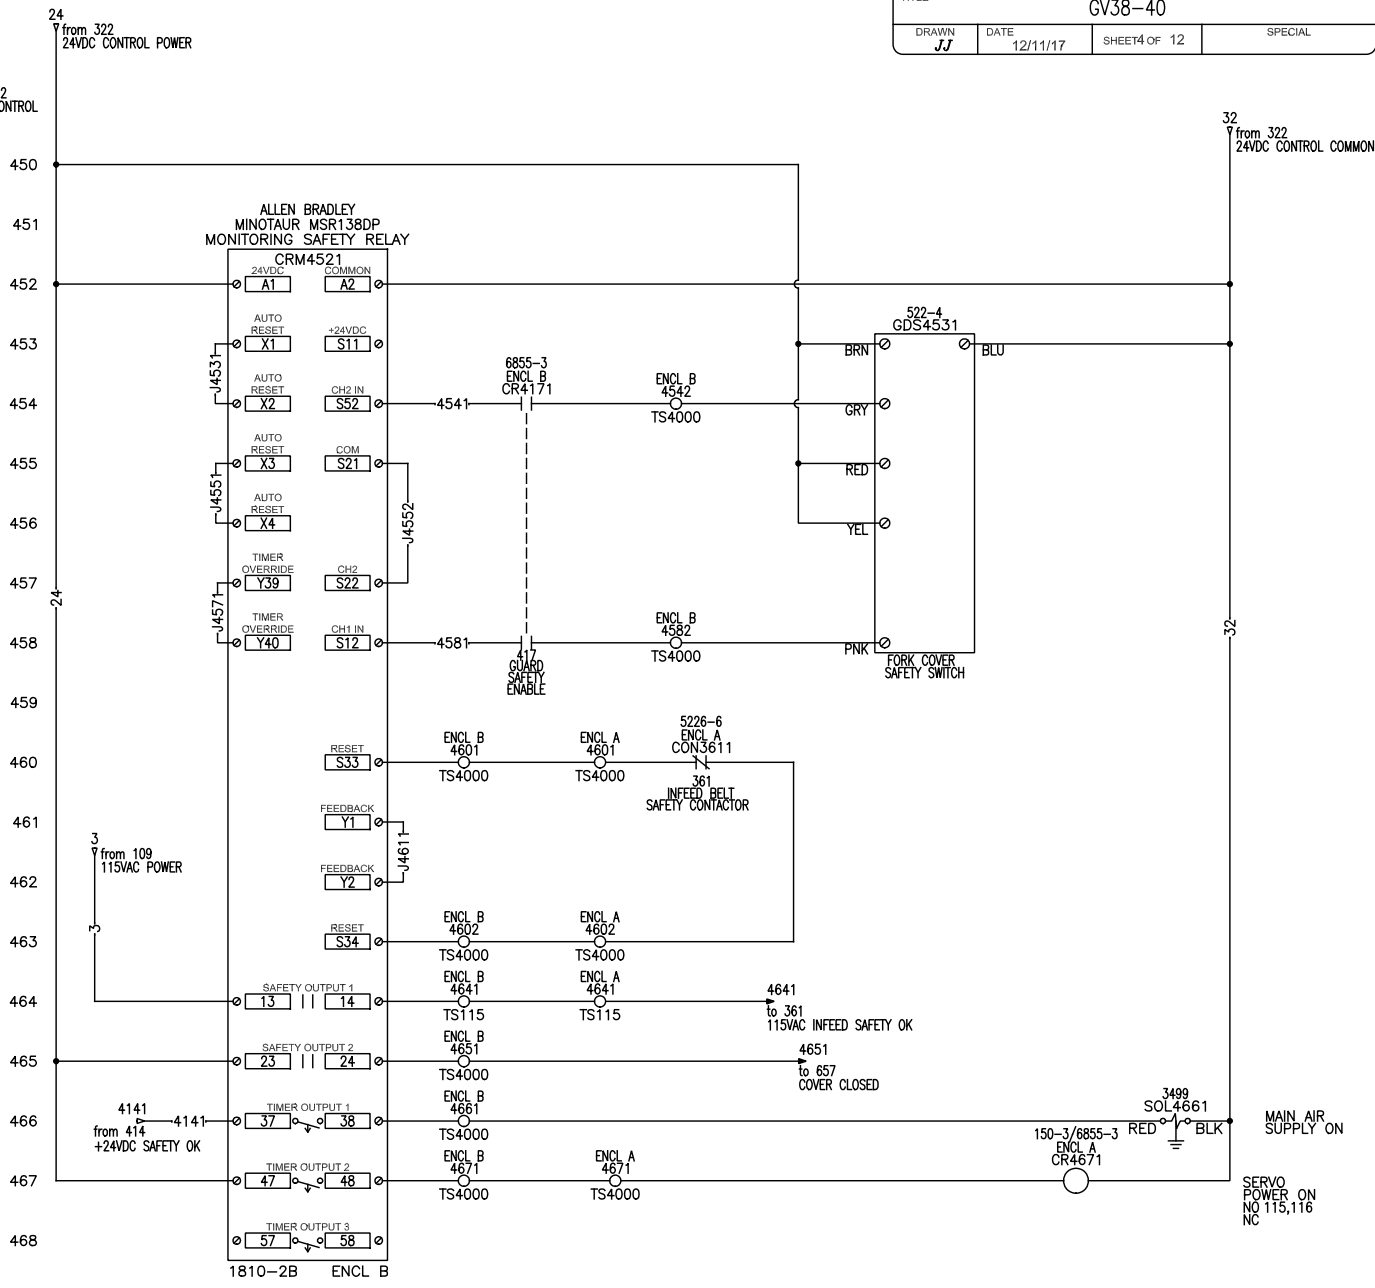
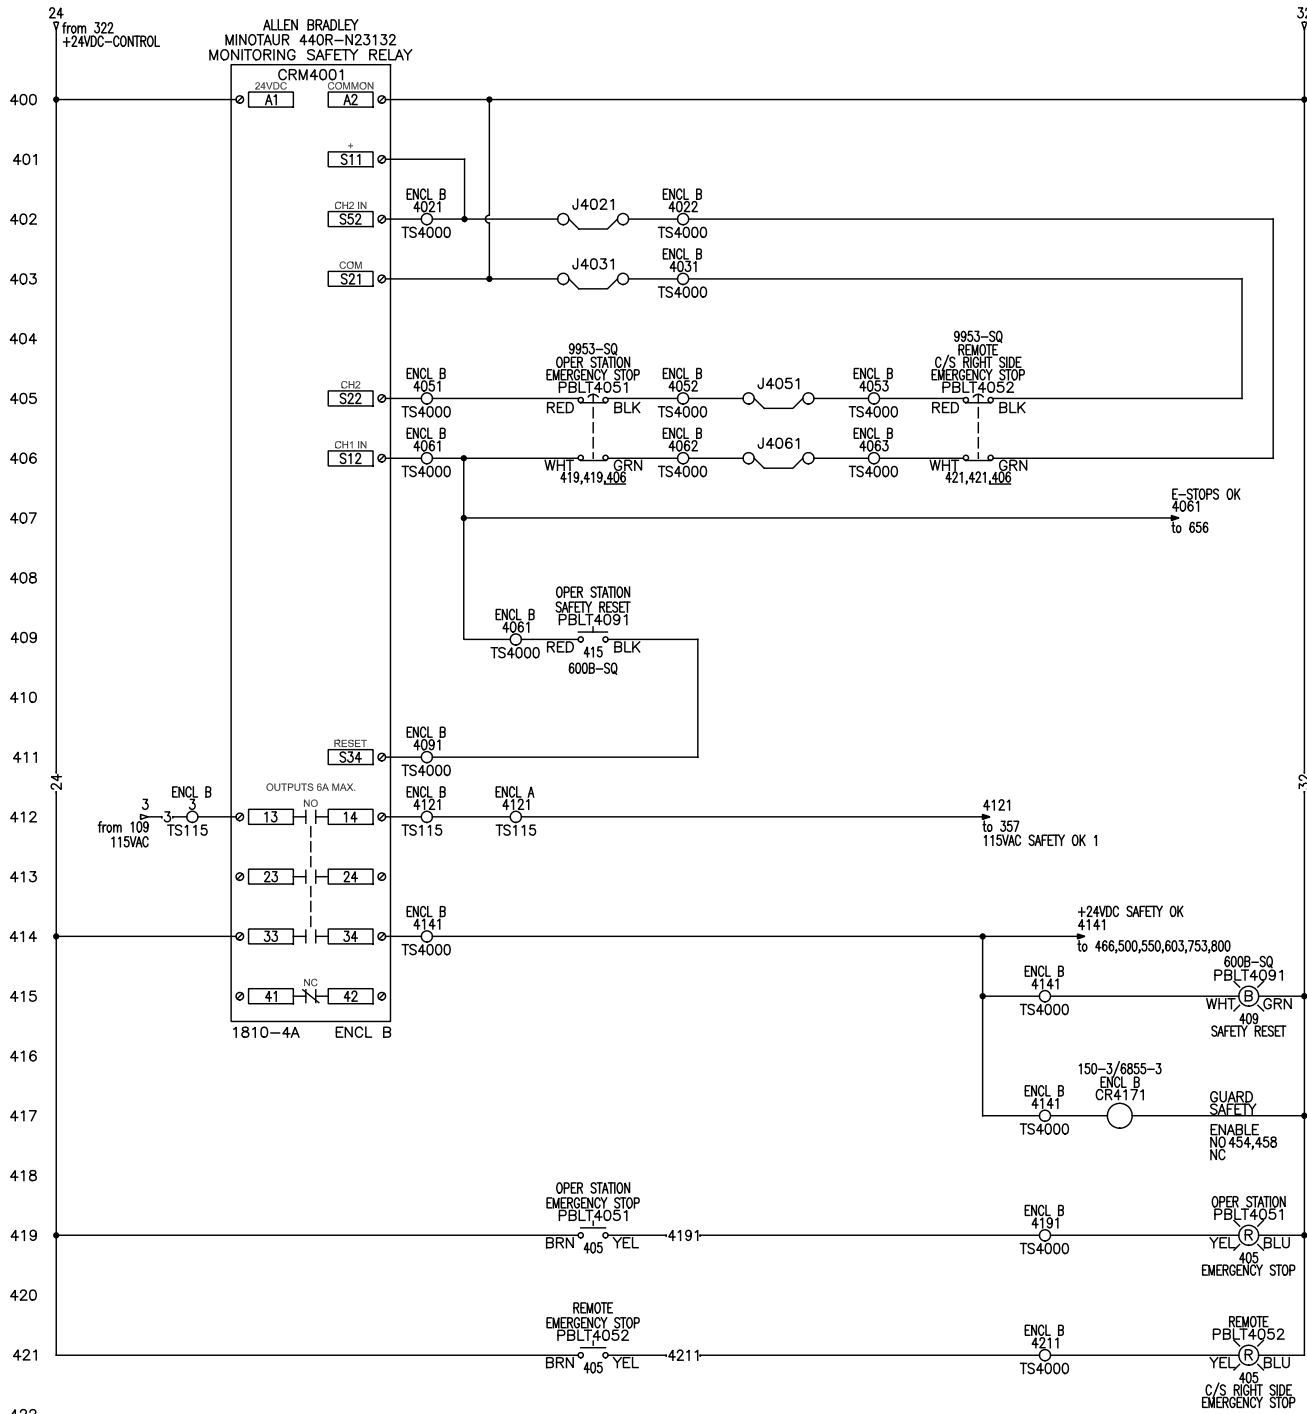


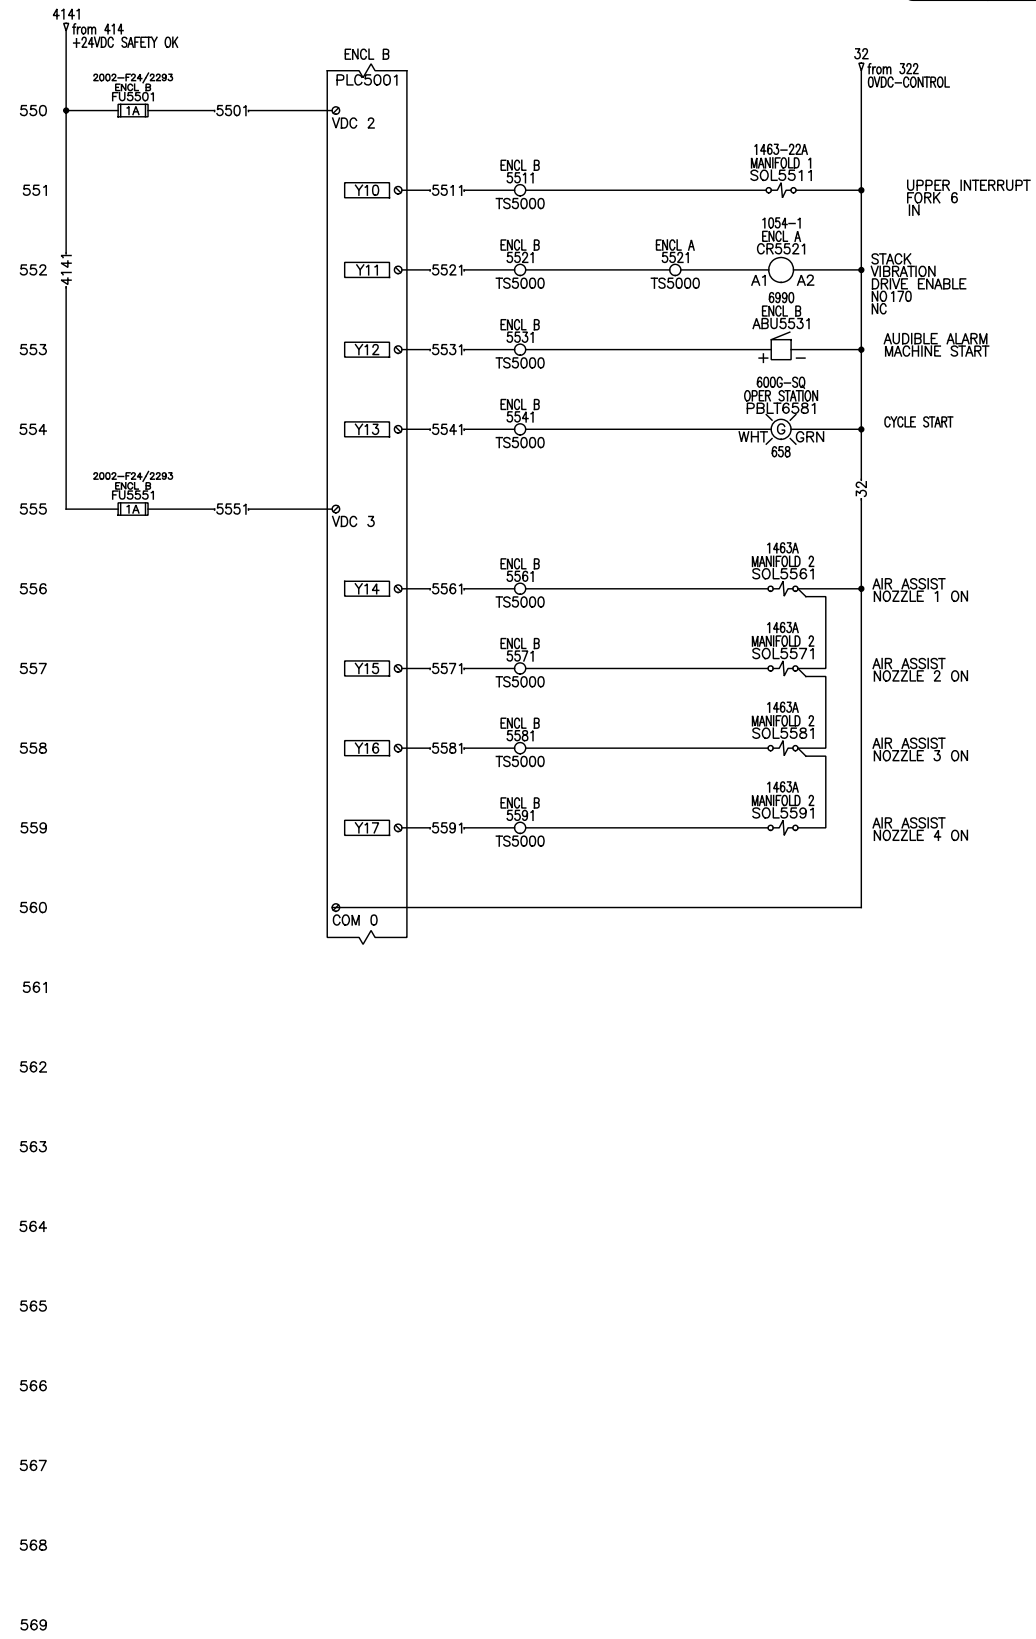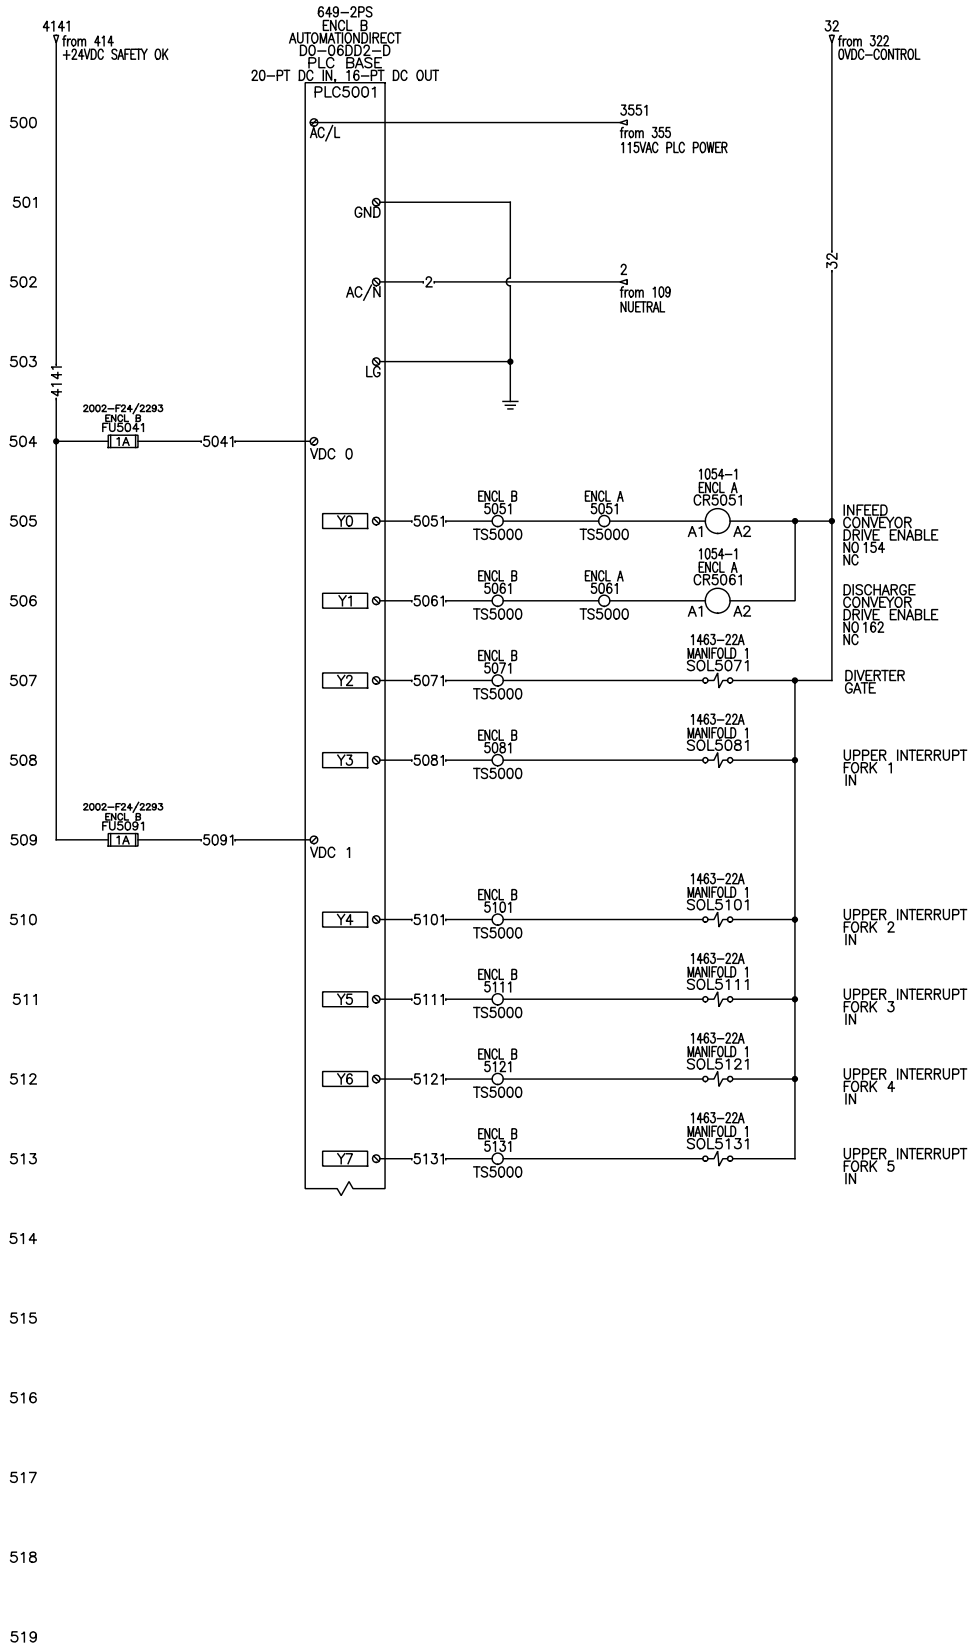

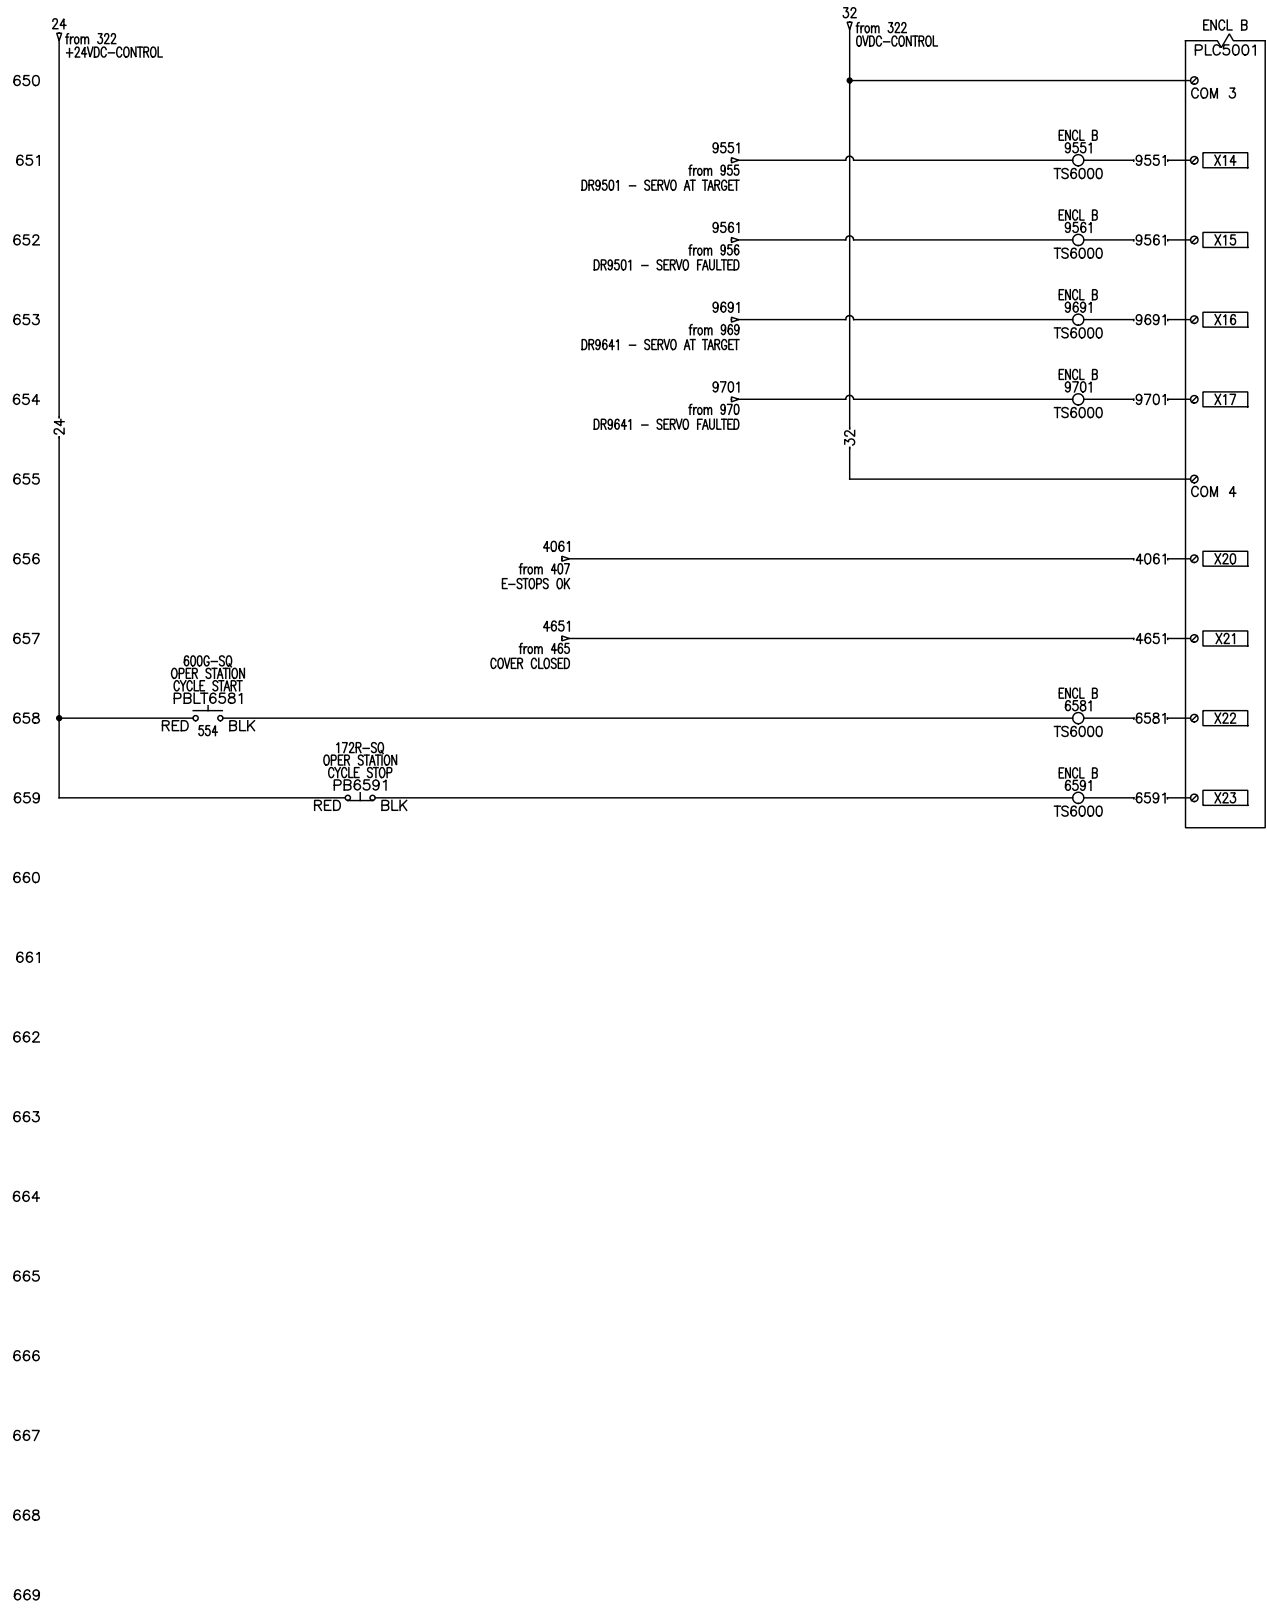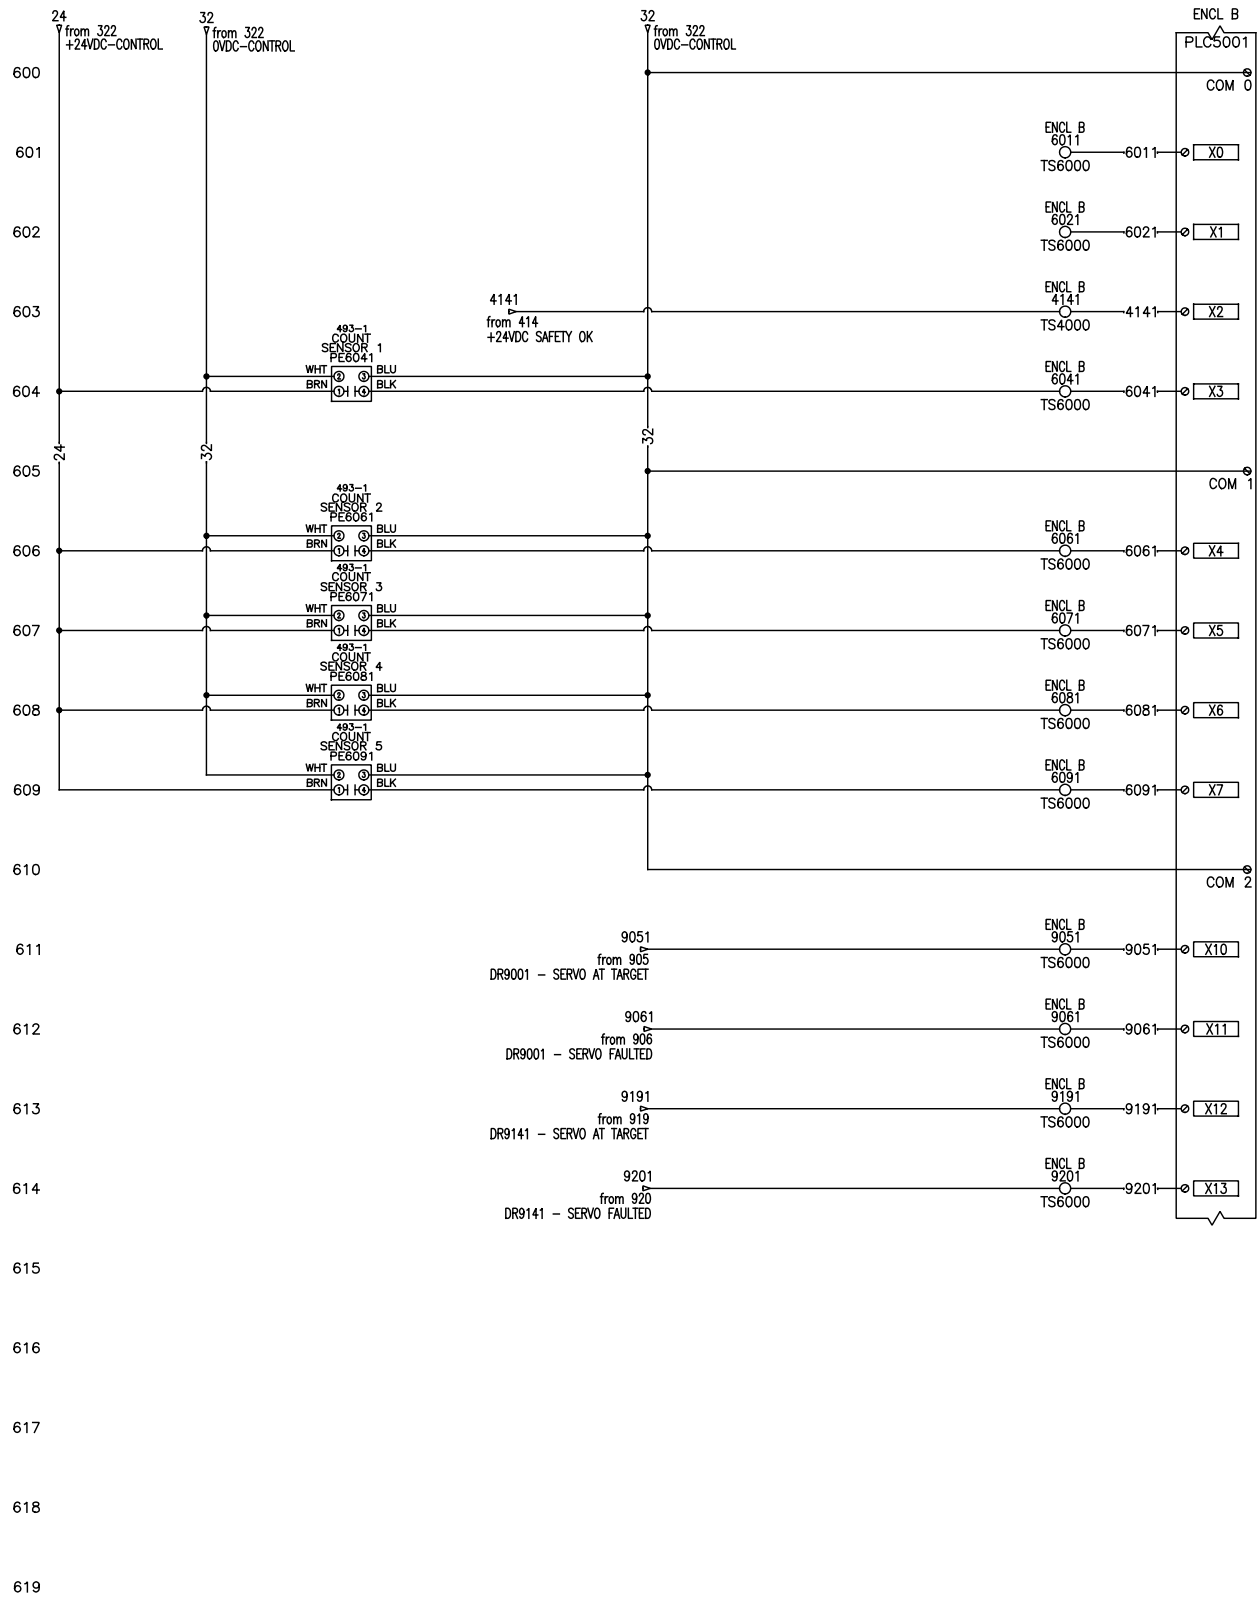


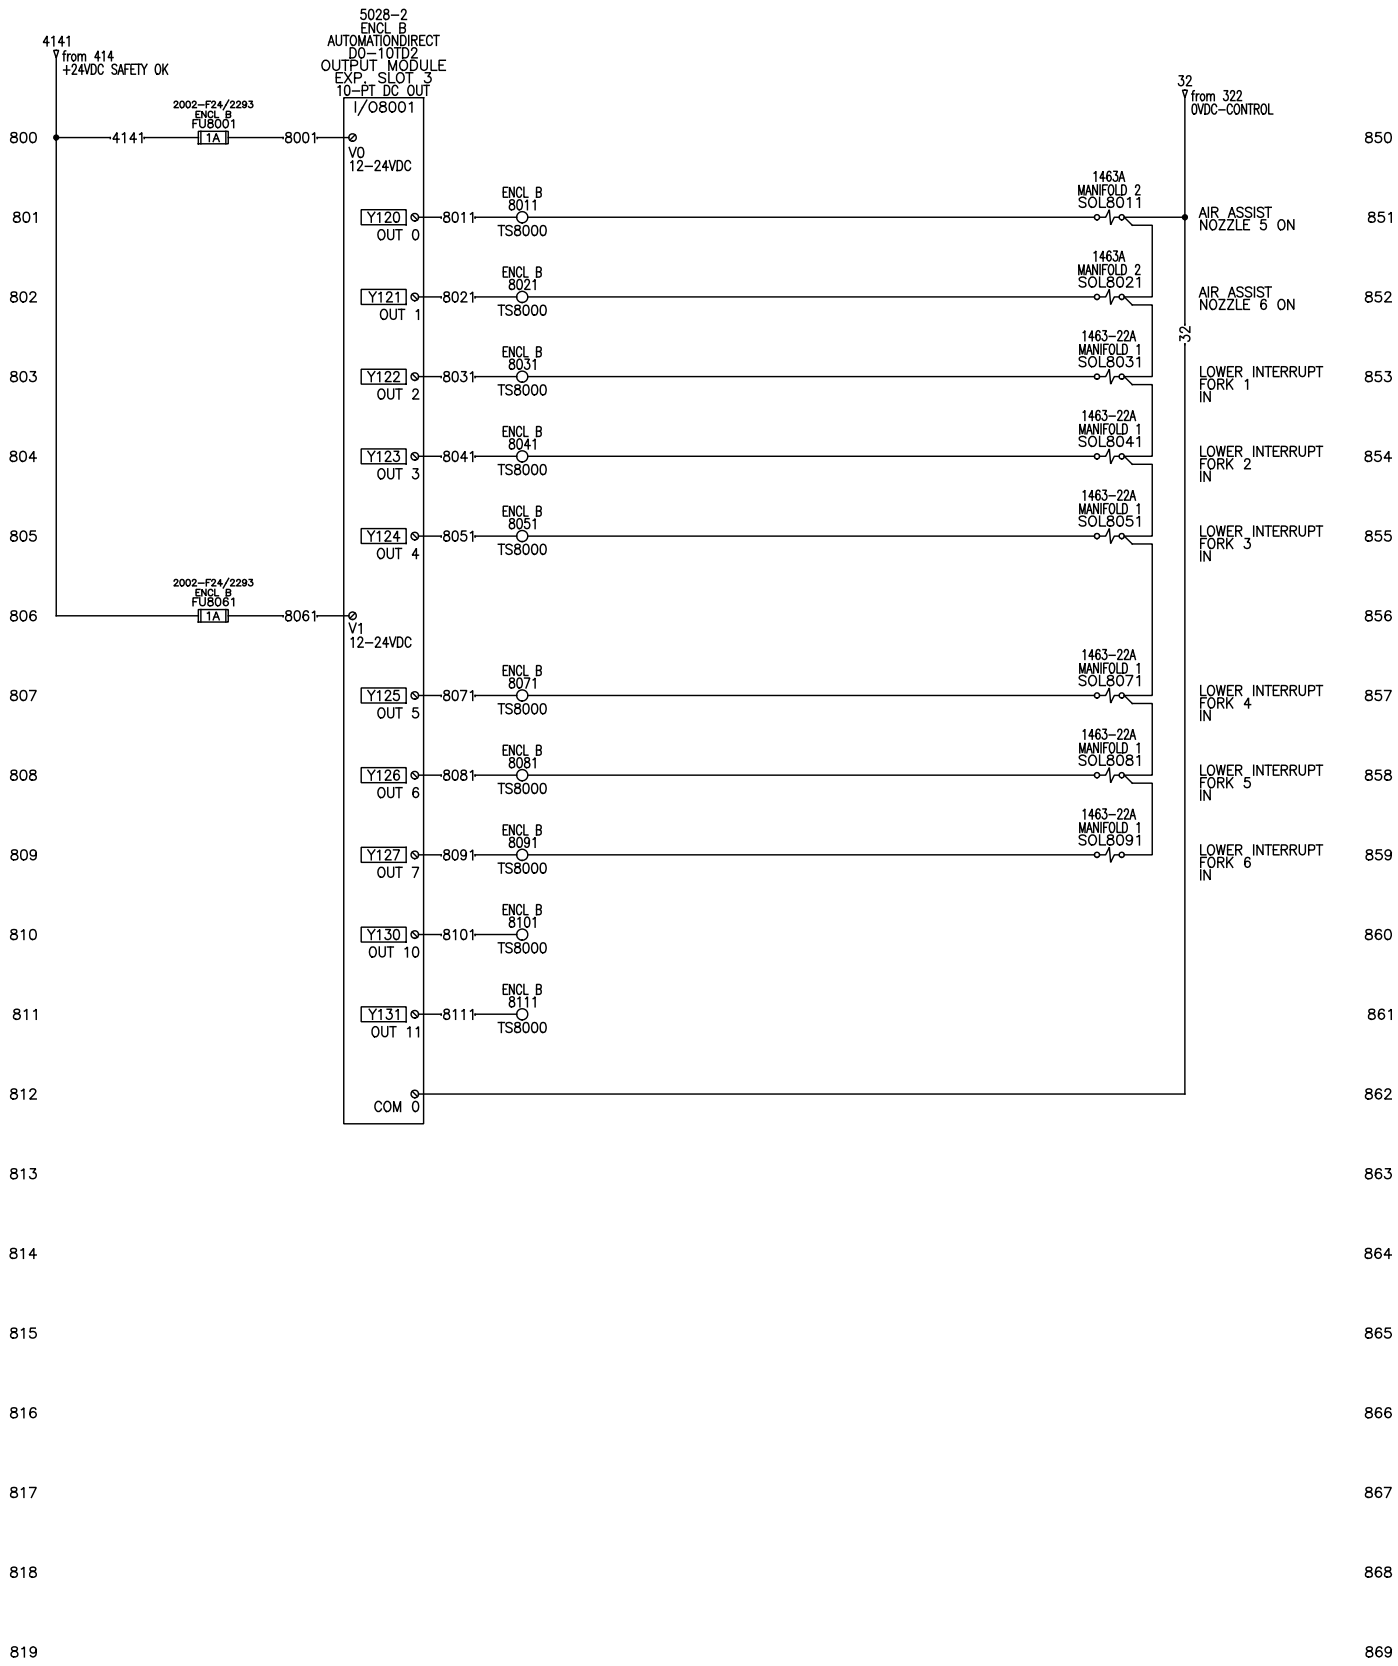

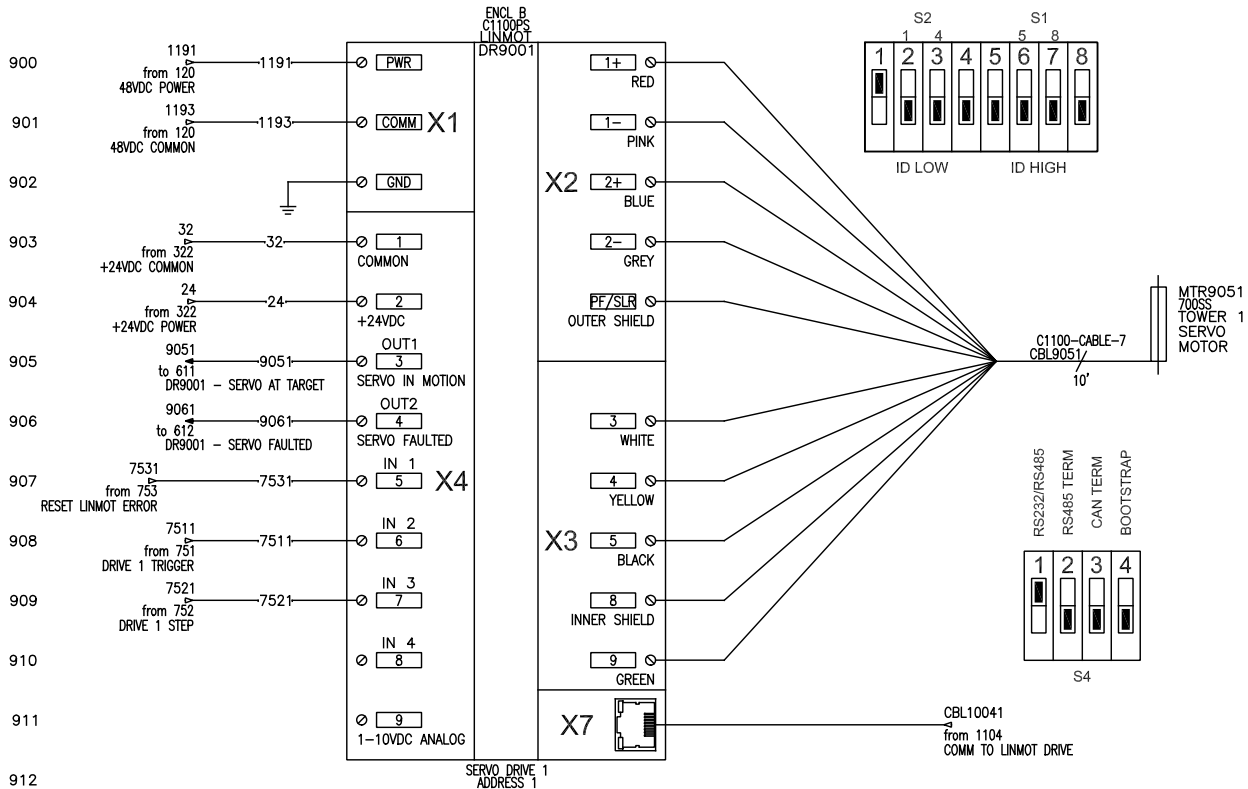

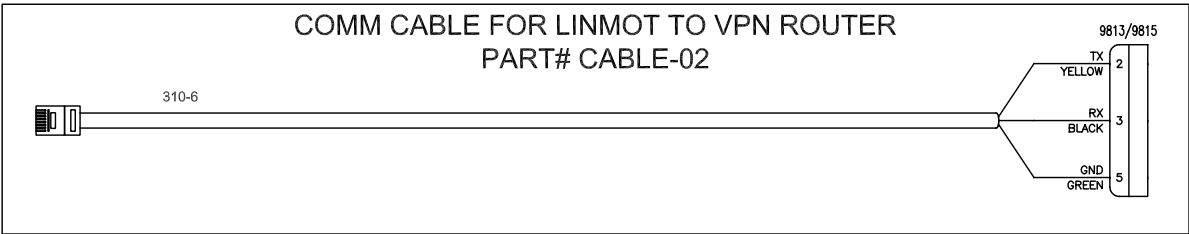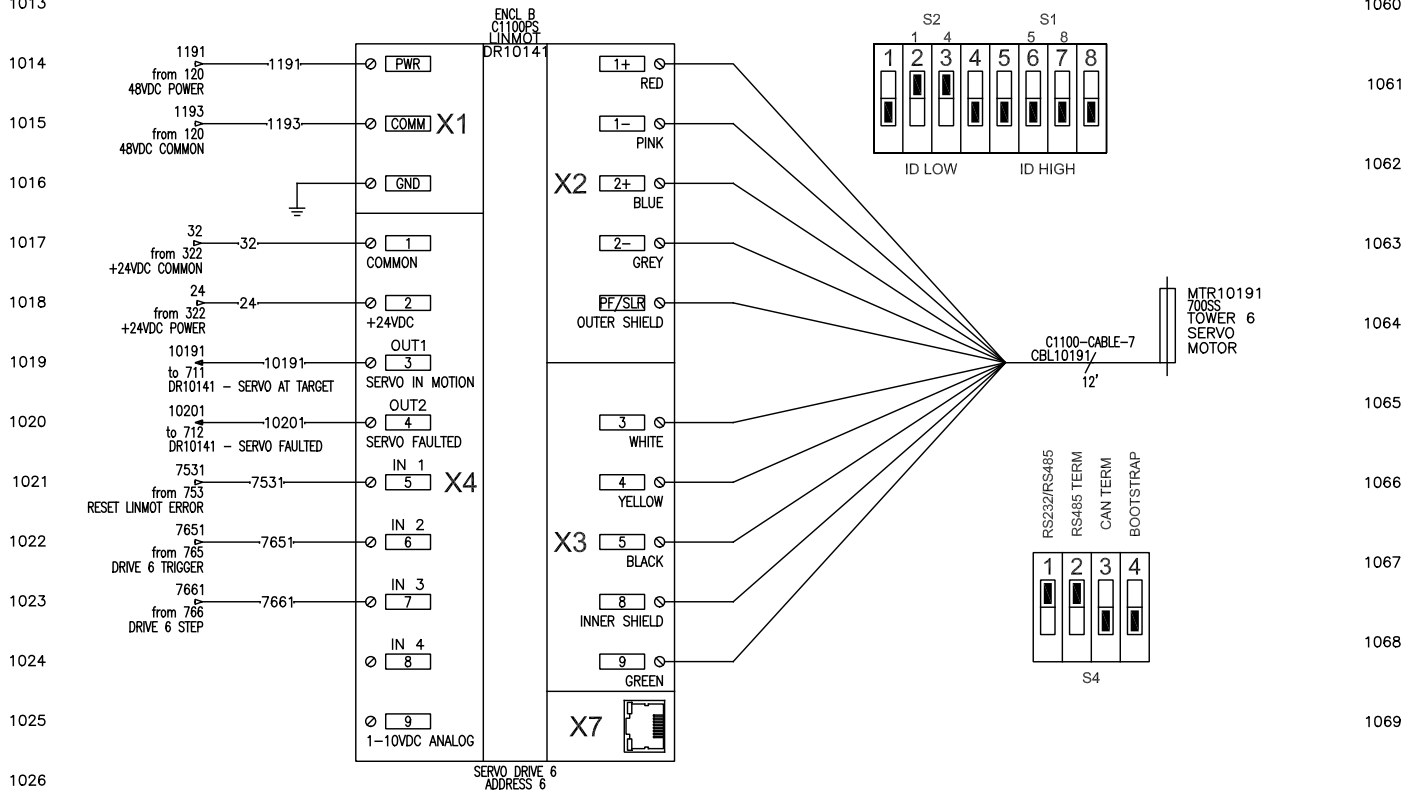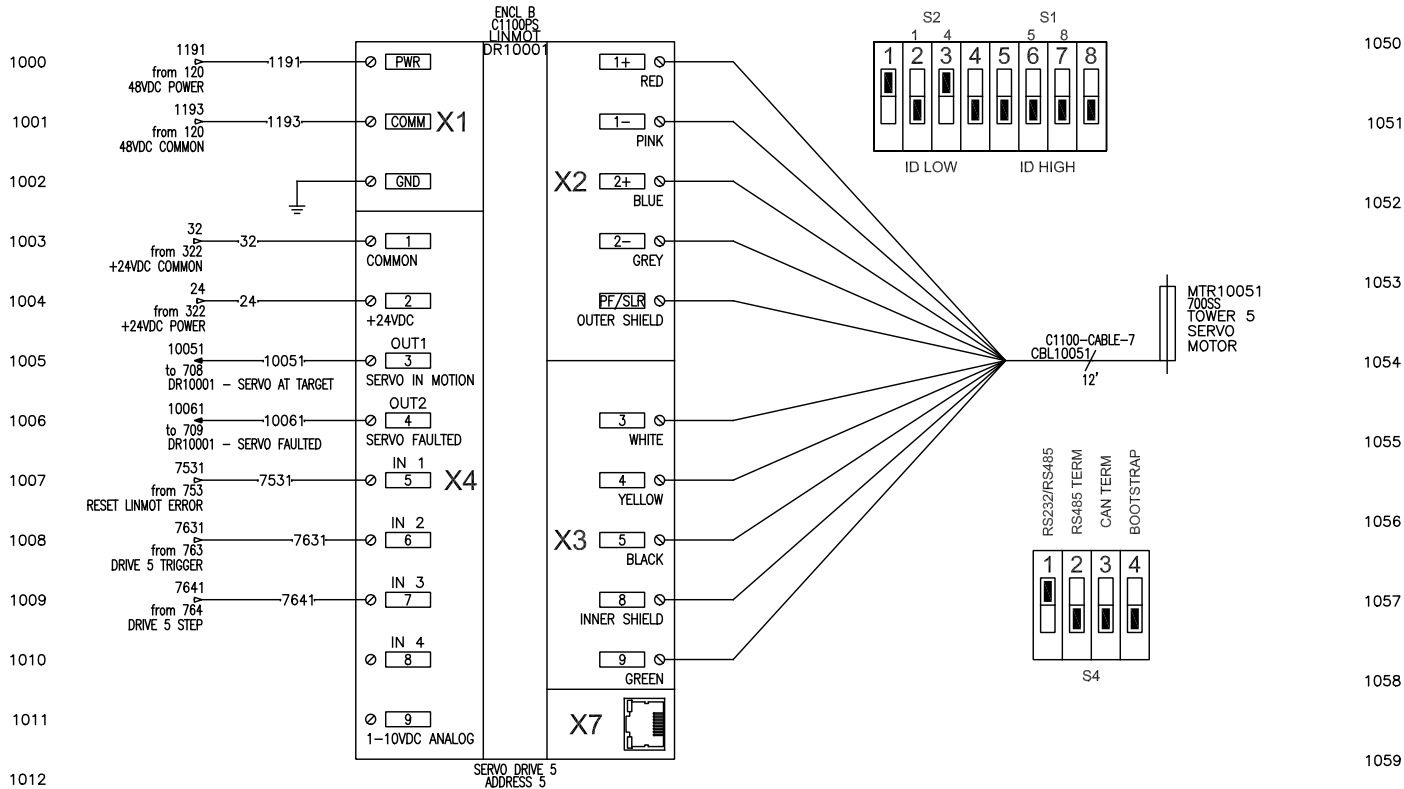

COMMUNICATION DIAGRAM

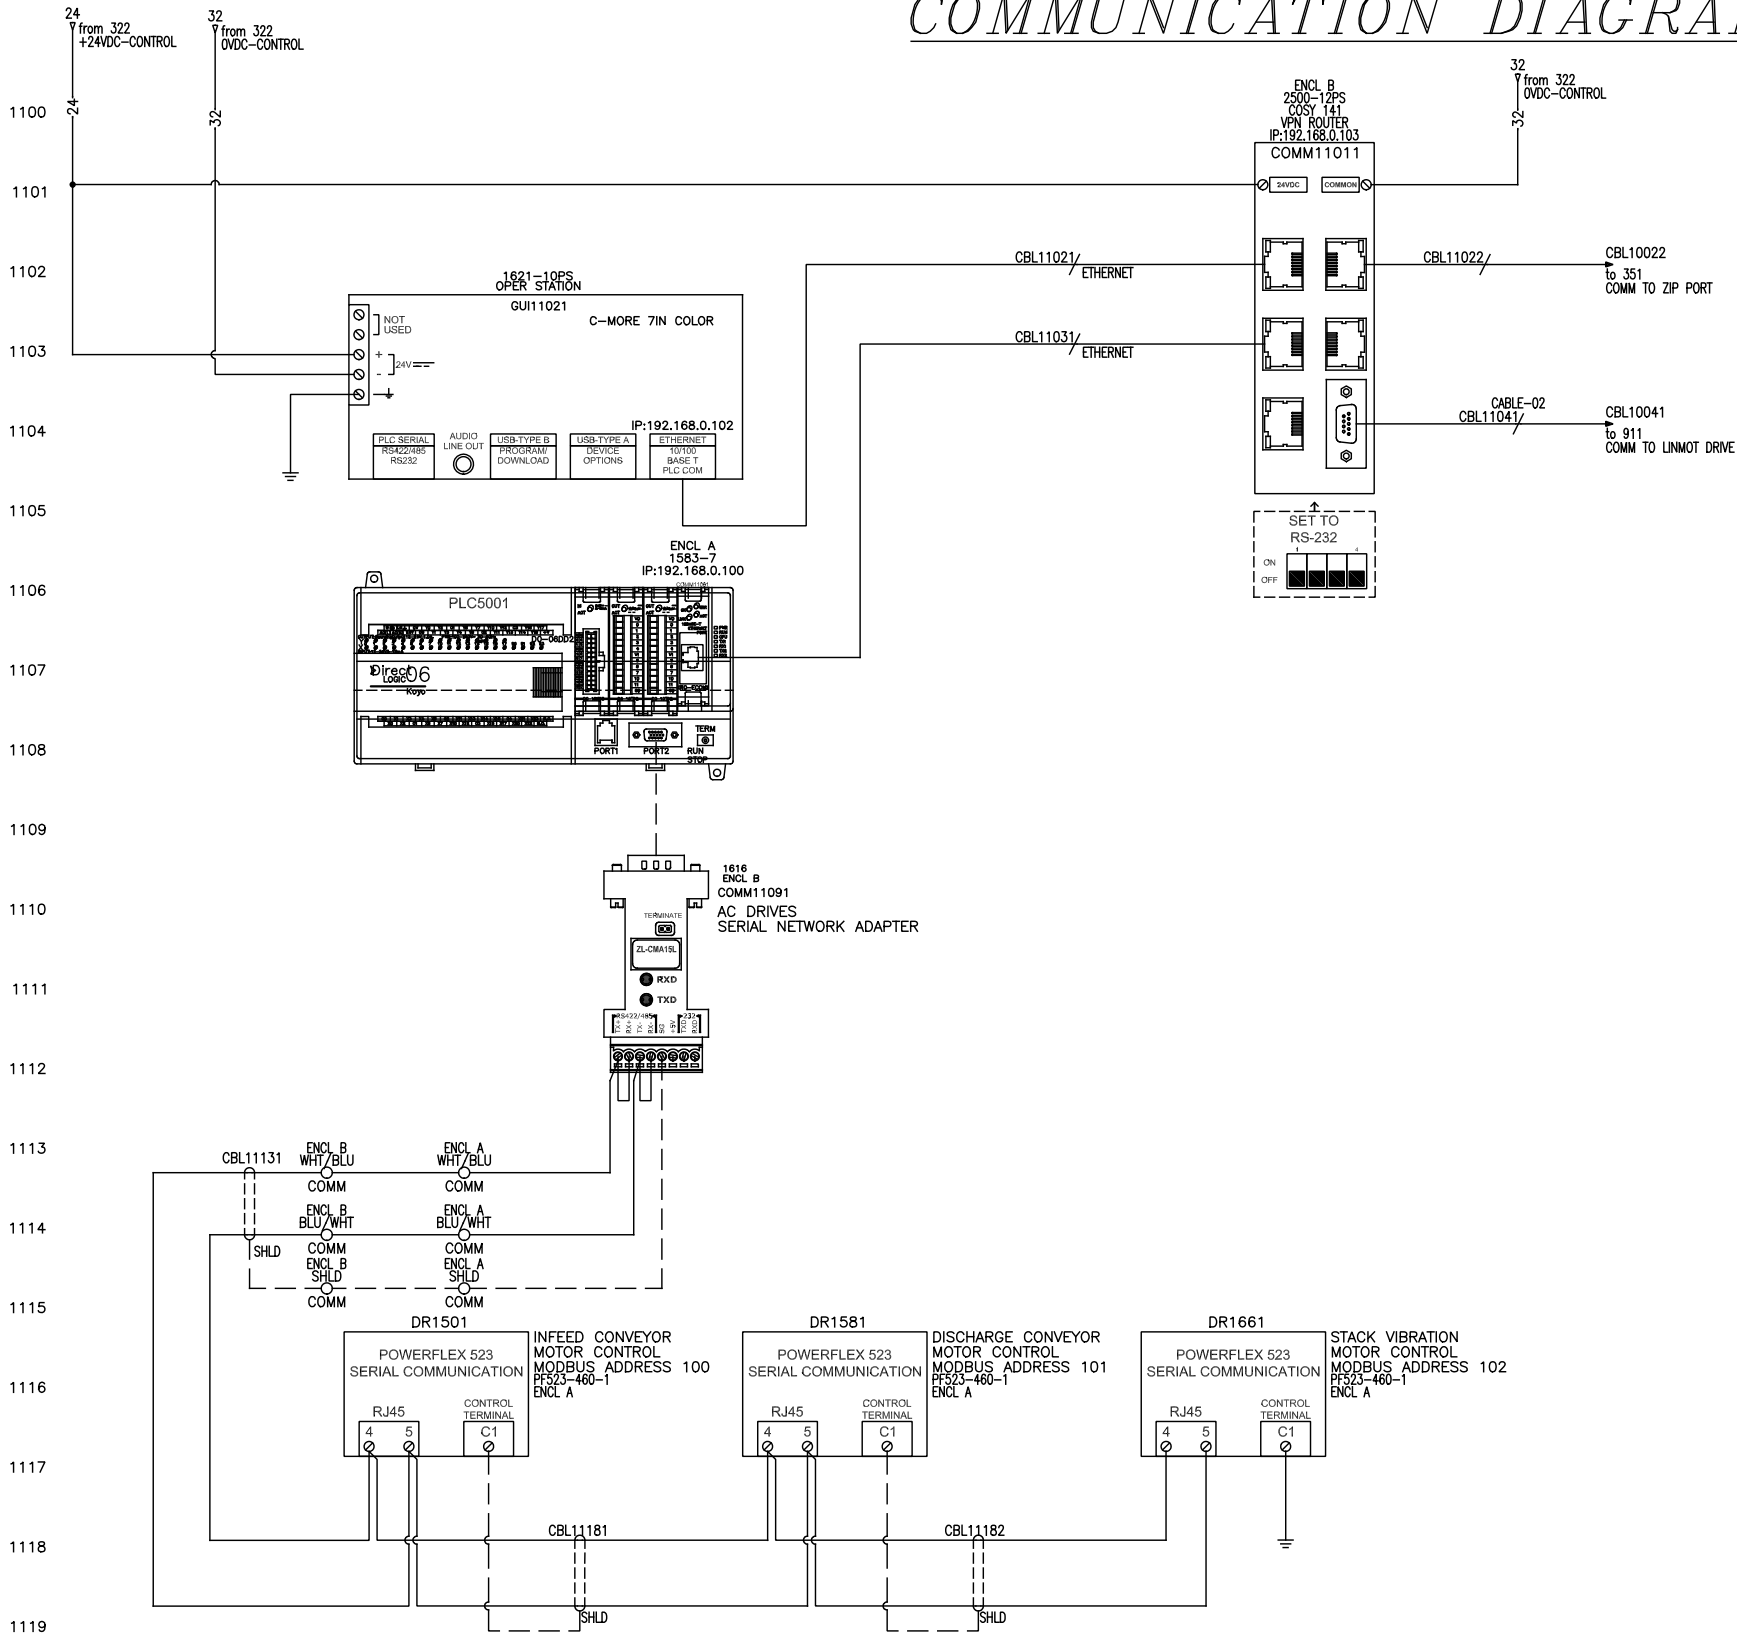

CABLE DIAGRAM

ARR-TECH P.O. BOX 9053 YAKIMA, WA. 98909		DRAWING NO. SCHEMATIC A17028		REV.
TITLE GV38-40				
DRAWN JJ	DATE 2/28/18	SHEET 12 OF 12	SPECIAL	

