


CAUTION: HAZARD OF ELECTRIC SHOCK
More than one disconnect switch may be required to disconnect all power.
Always turn off all Main Line Disconnect Switches when working on any electrical controls.

NOTE: Burner circuit wired as shown by solid line and factory tested.

---	WIRING FURNISHED
---	FIELD WIRING
•	OPTIONAL WIRING
•	WIRENUT OR SPLICE
(NF)	NOT FURNISHED
(NF)	(NF) UNLESS SPECIFIED

B	- Black	R	- Red
Bl	- Blue	T	- Tan
Br	- Brown	W	- White
LR	- Light Red	Y	- Yellow
O	- Orange	/	- Stripe
P	- Purple		

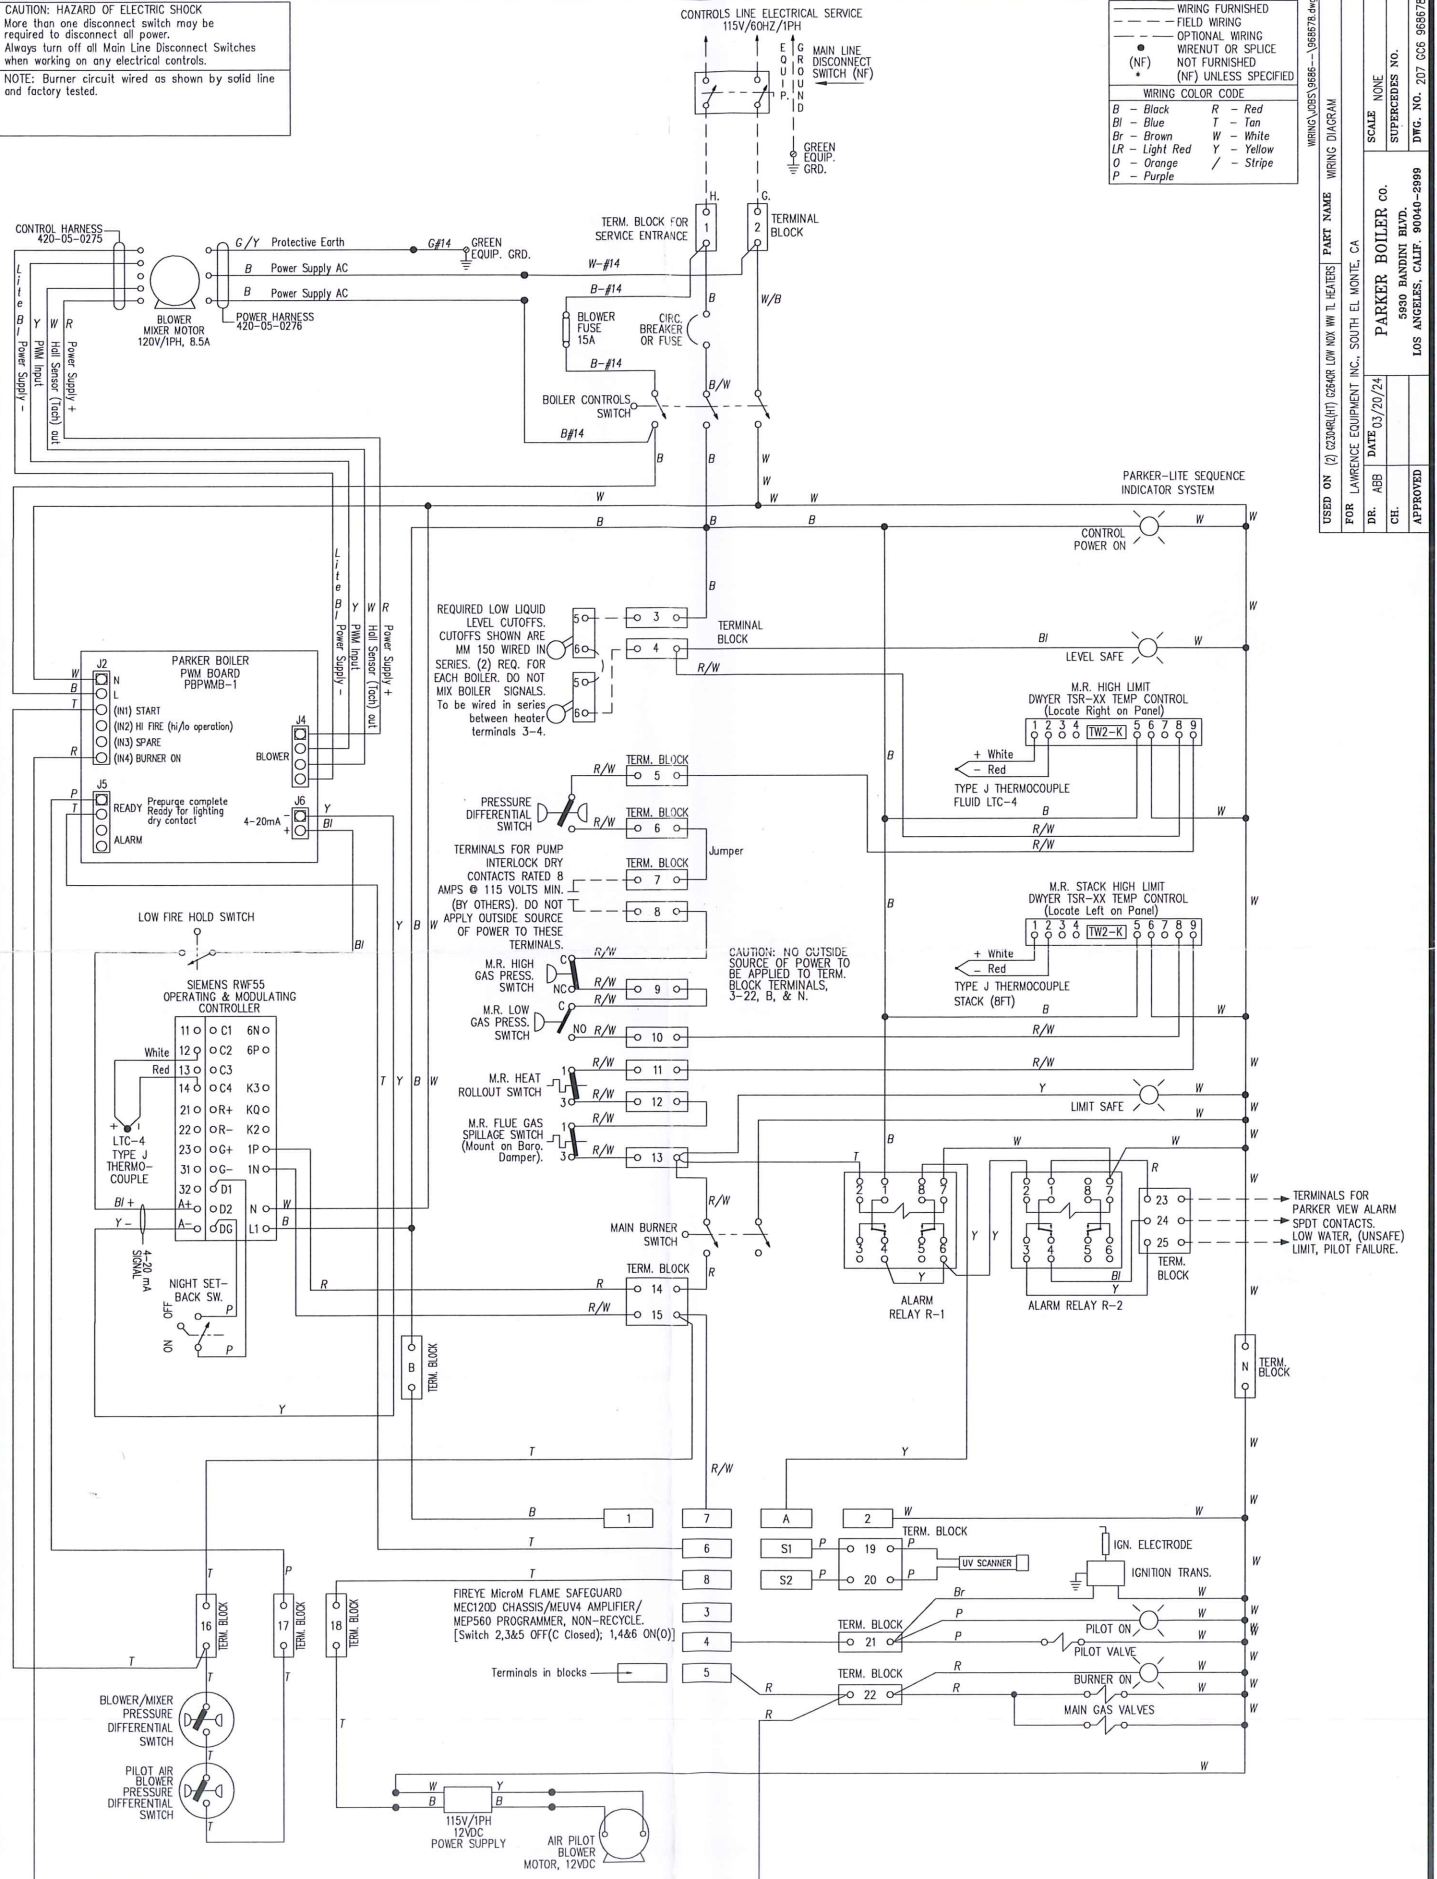

PARKER BOILER
PULSE WIDTH MODULATION CONTROL BOARD
PBPWMB - 1

PROGRAMMING SHEET:

DATE: 03/20/24

SO#

968678

BOILER MODEL:

G2304RL(HT)

BLOWER MODEL:

FASCO 70530211 GPM 7.0H

Parameter	Value	Unit	Notes:
Tach pulses/rev.	3		Range 1-6
Prepurge rpm	4000	RPM	Minimum Safe Prepurge RPM
Prepurge time Time to reach prepurge rpm	30	sec	Alarm will occur if fan does not achieve this speed in allotted time
Prepurge PWM	86	%	NR Actual RPM
Prepurge Time "n"	5	sec	Purge Time
Light off PWM	30	%	NR Actual RPM
Light off RPM	3500	RPM	Maximum Light off Speed
Time to reach light off speed	30	sec	Alarm will occur if fan does not achieve this speed in allotted time
Low Fire Hold PWM	34	%	NR Actual RPM. Hold after light off
Low Fire Hold Time	15	sec	General Settings: Steam: 10-20 sec, HW: 15-60sec.
Firing Mode Type: 1 - 4-20mA, Modulating 2 - Fixed(On/Off), 3 - Hi/Low (2 Stage)	1		
Fixed PWM	60	%	Used for on/off Boilers only N/A Actual RPM
Low Firing PWM	34	%	Low Fire Speed for 2 stage or modulating burners, not used for on/off NR Actual RPM
High Firing PWM	86	%	High Fire Speed for 2 stage or mod. Firing NR Actual RPM
Ramp Rate	10	sec	Rate of Acceleration or Deceleration of Blower from low to high fire
Post Purge Time	15	sec	

ELECTRICAL RATING

Power: 120V-1 phase-60 cycle: less than 1 Amp

Normal Operating Power: 0.50VA

RELAYS CONTACT RATING

120V-1phase-60cycle: 5 Amp