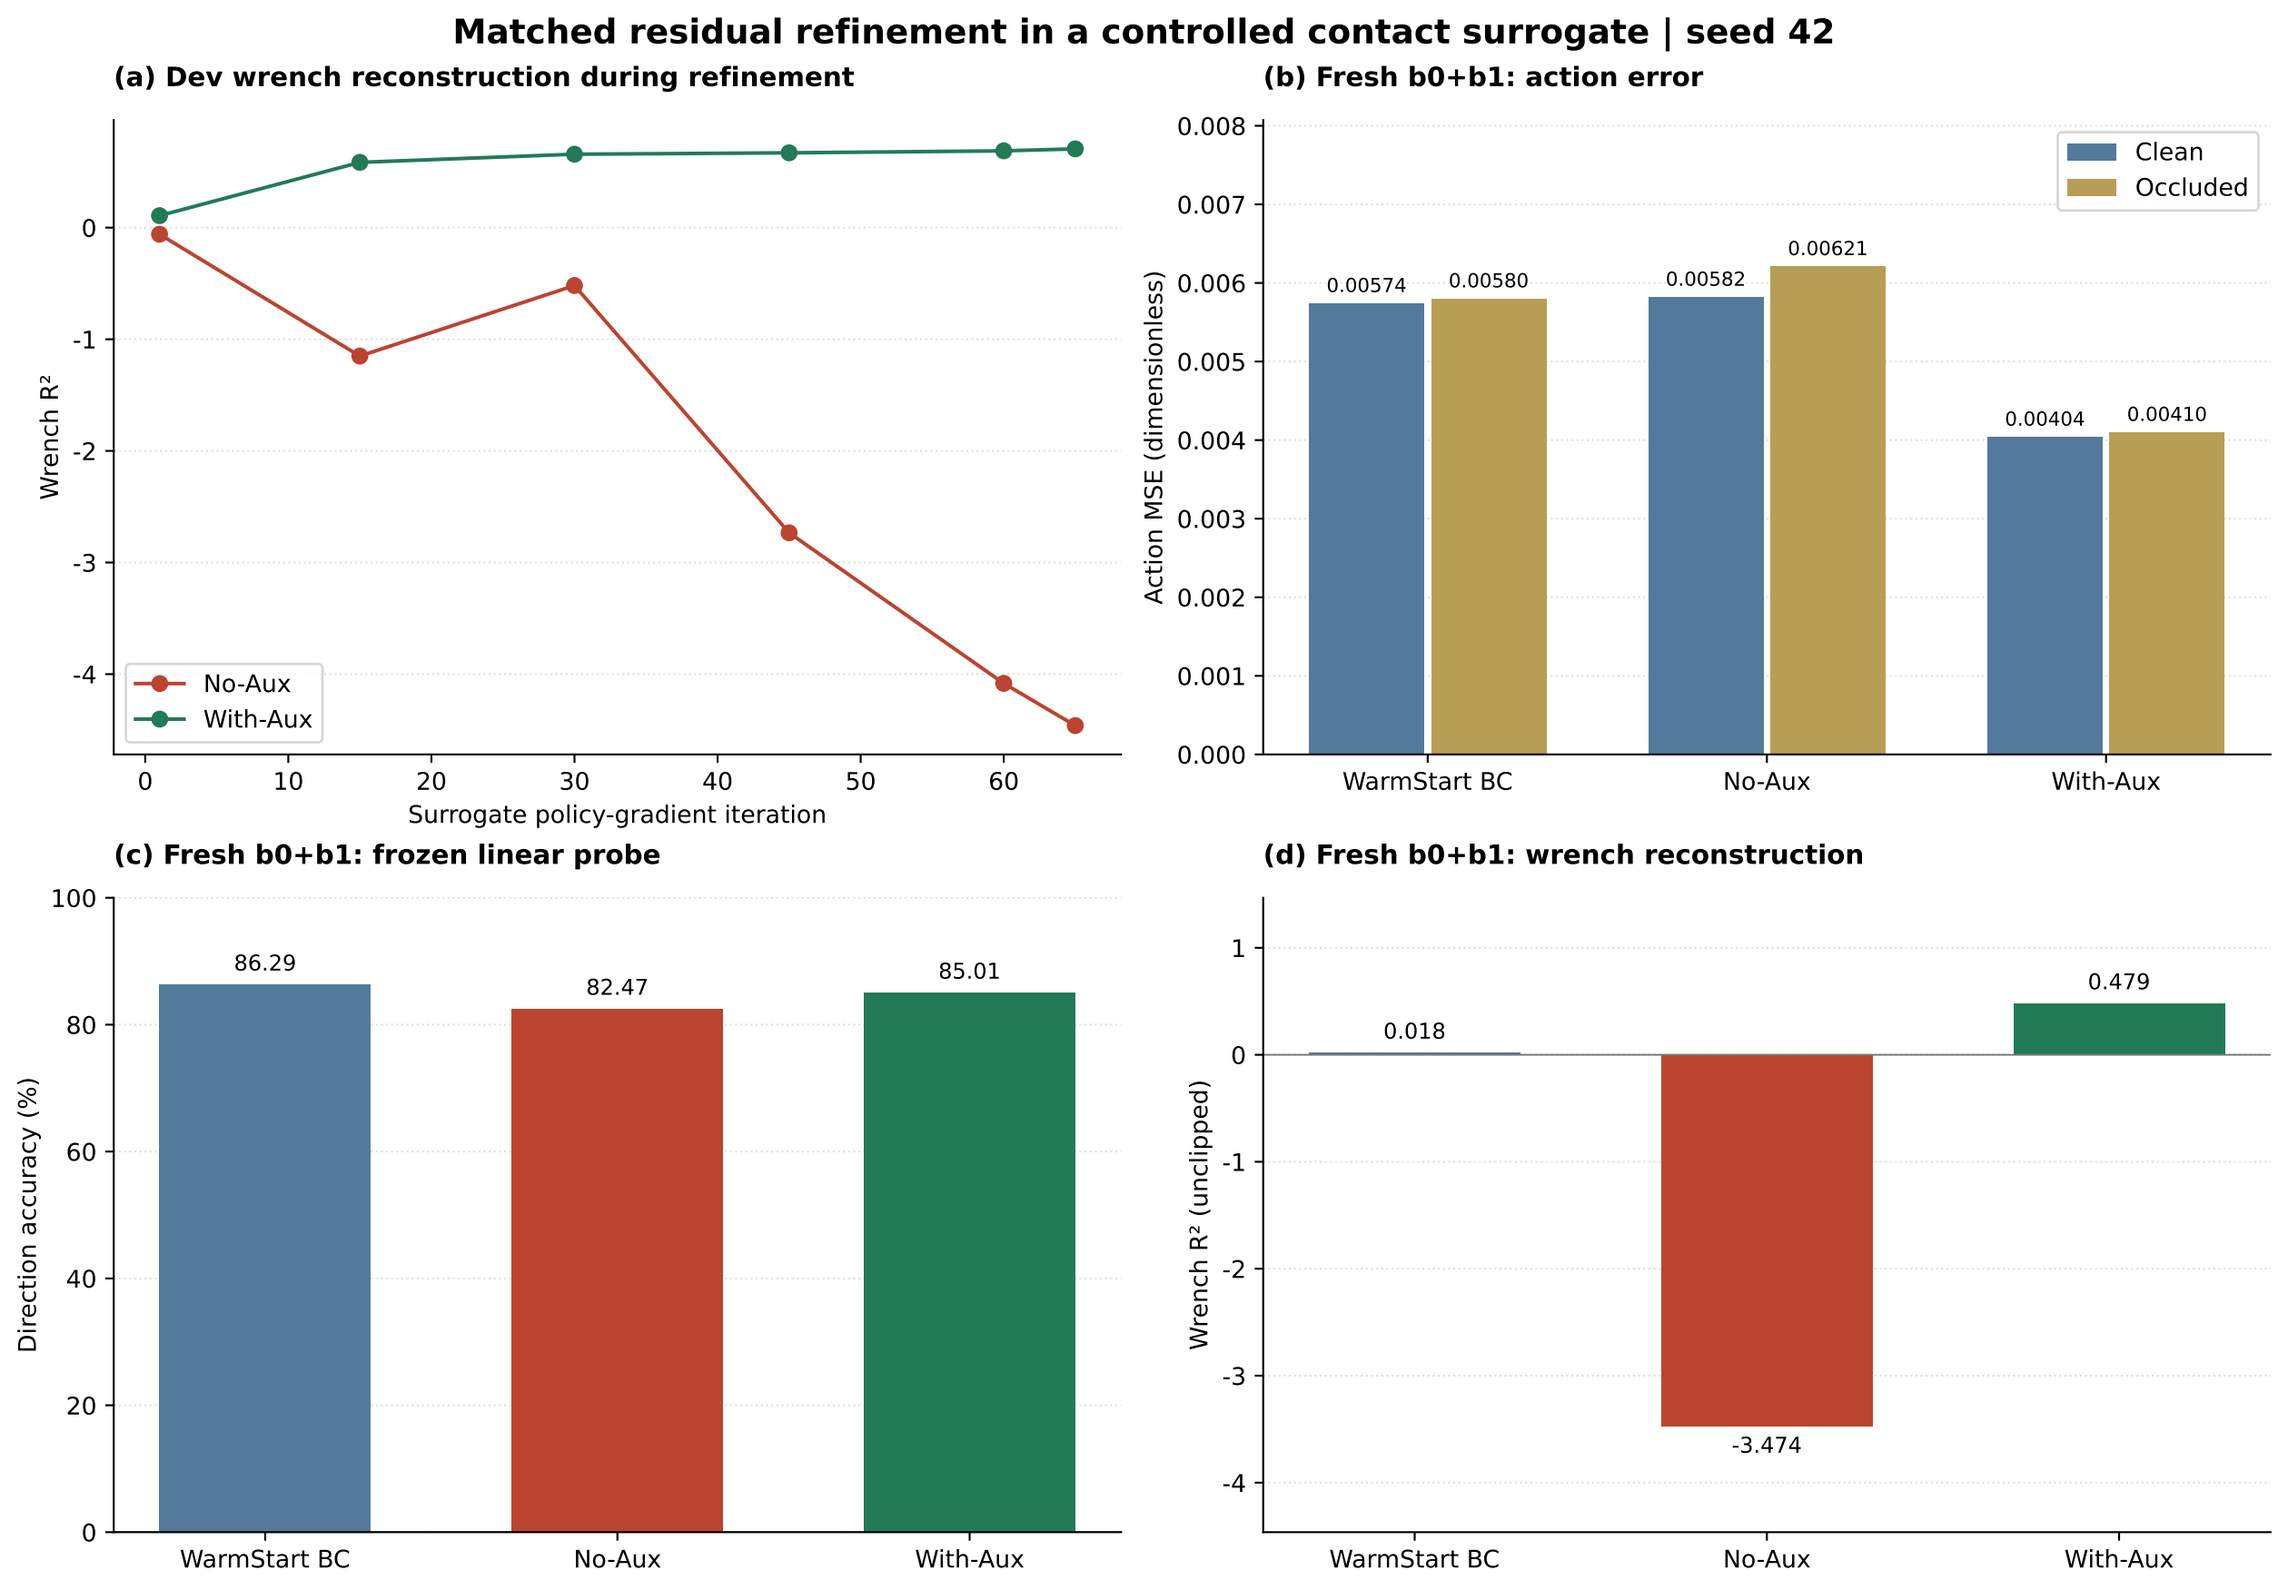
Matched residual refinement in a controlled contact surrogate | seed 42
(a) Dev wrench reconstruction during refinement
Wrench R²
Surrogate policy-gradient iteration
No-Aux
With-Aux
(b) Fresh b0+b1: action error
Action MSE (dimensionless)
Clean
Occluded
0.00574
0.00580
0.00582
0.00621
0.00404
0.00410
WarmStart BC
No-Aux
With-Aux
(c) Fresh b0+b1: frozen linear probe
Direction accuracy (%)
86.29
82.47
85.01
WarmStart BC
No-Aux
With-Aux
(d) Fresh b0+b1: wrench reconstruction
Wrench R² (unclipped)
0.018
-3.474
0.479
WarmStart BC
No-Aux
With-Aux