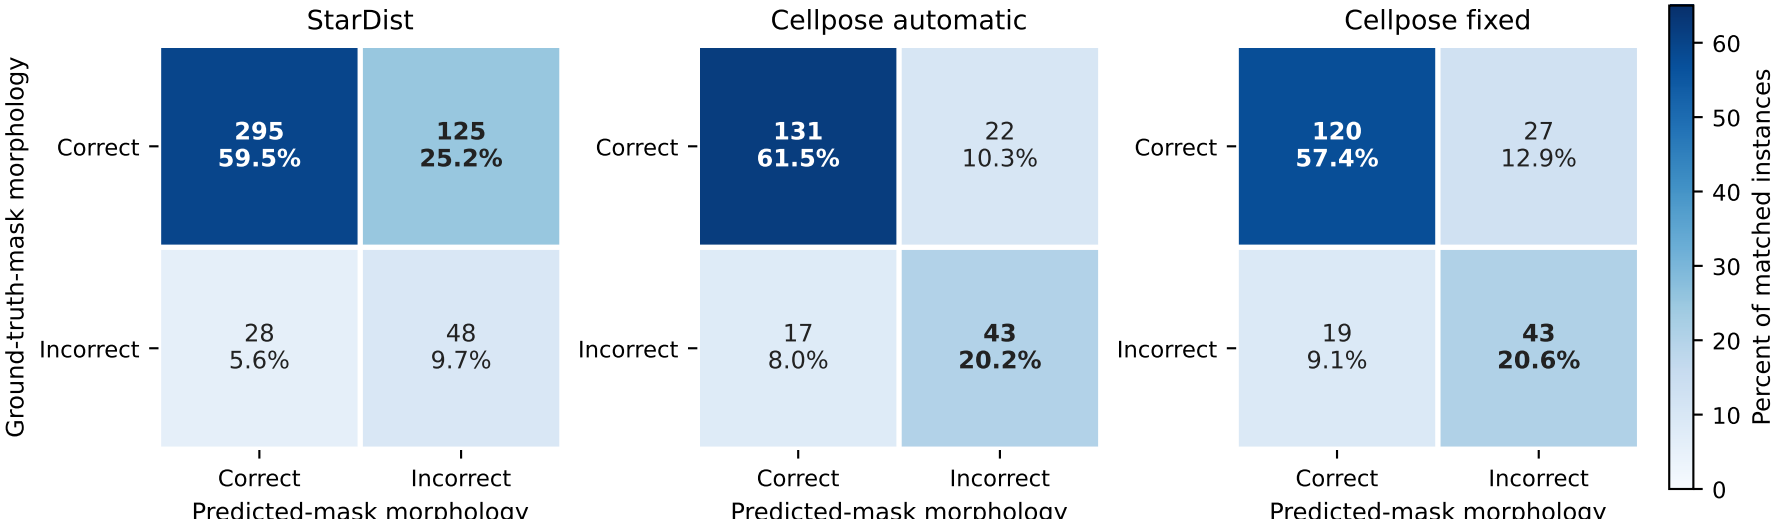
MI05 classification correctness transitions
StarDist
Cellpose automatic
Cellpose fixed
Ground-truth-mask morphology
Correct
Incorrect
295
59.5%
125
25.2%
28
5.6%
48
9.7%
131
61.5%
22
10.3%
17
8.0%
43
20.2%
120
57.4%
27
12.9%
19
9.1%
43
20.6%
Correct
Incorrect
Predicted-mask morphology
Percent of matched instances
0
10
20
30
40
50
60
Incorrect-to-correct cells are accidental classifier transitions from altered geometry, not beneficial biological effects.