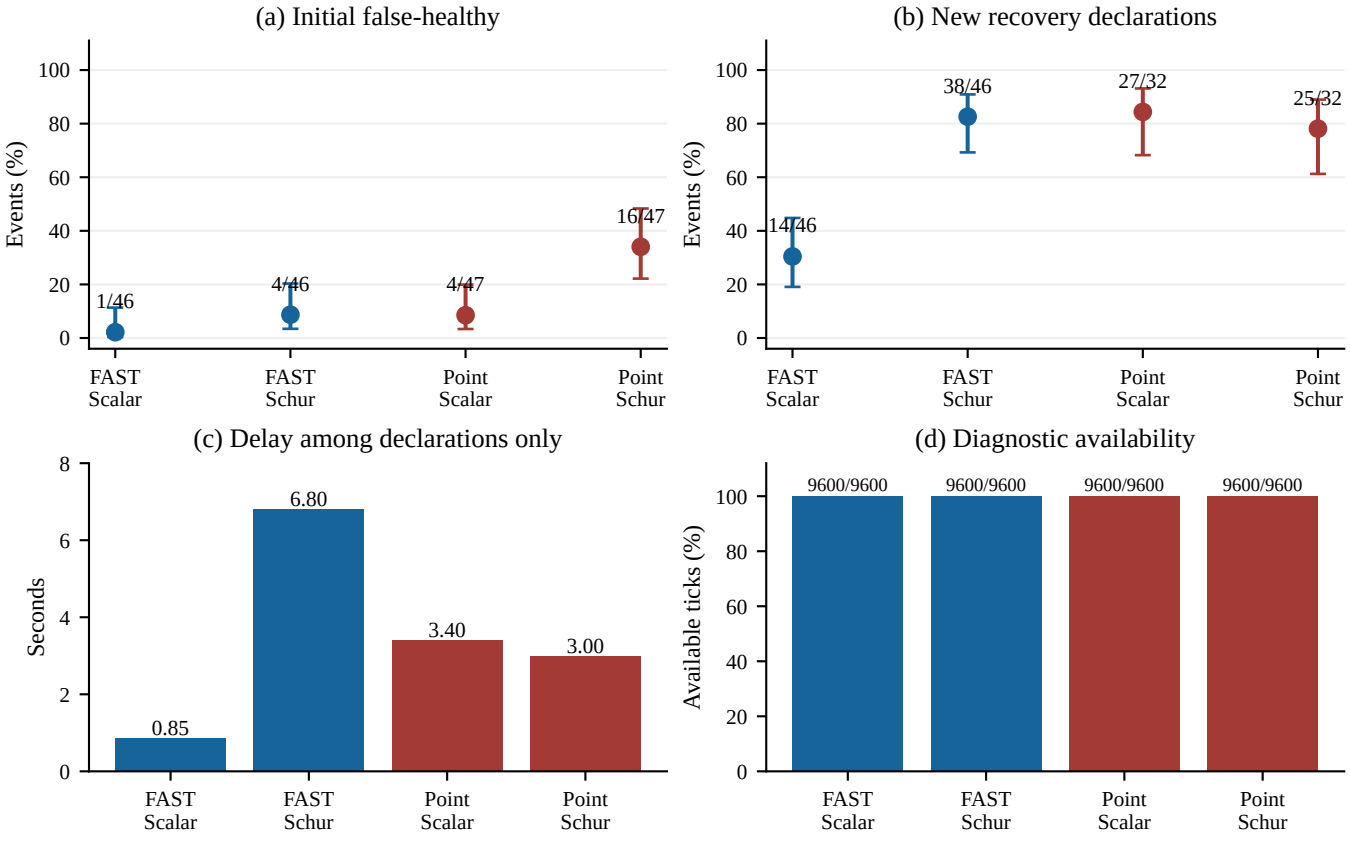
(a) Initial false-healthy
Events (%)
100
80
60
40
20
0
1/46
4/46
4/47
16/47
FAST Scalar
FAST Schur
Point Scalar
Point Schur
(b) New recovery declarations
Events (%)
14/46
38/46
27/32
25/32
FAST Scalar
FAST Schur
Point Scalar
Point Schur
(c) Delay among declarations only
Seconds
8
6
4
2
0
0.85
6.80
3.40
3.00
FAST Scalar
FAST Schur
Point Scalar
Point Schur
(d) Diagnostic availability
Available ticks (%)
9600/9600
9600/9600
9600/9600
9600/9600
FAST Scalar
FAST Schur
Point Scalar
Point Schur