



RSLogix Micro Project Report




Program File List

Name	Number	Type	Rungs	Debug	Bytes
[SYSTEM]	0	SYS	0	No	0
	1	SYS	0	No	0
MAIN	2	LADDER	3	No	21
IO/MEMORY	3	LADDER	2	No	74
CONTROLS	4	LADDER	4	No	322

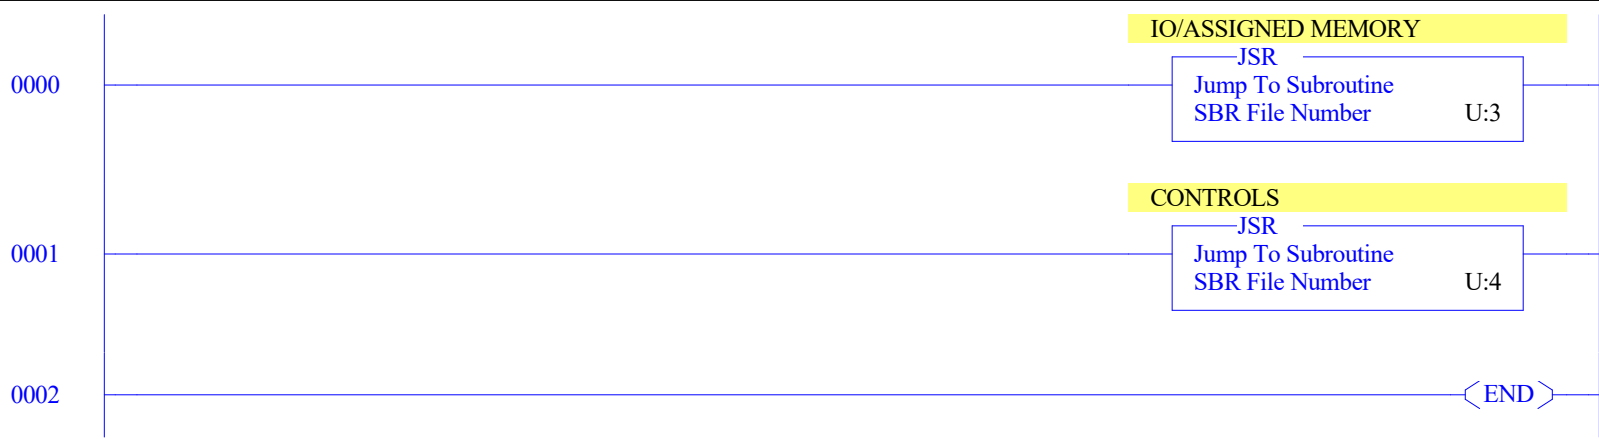

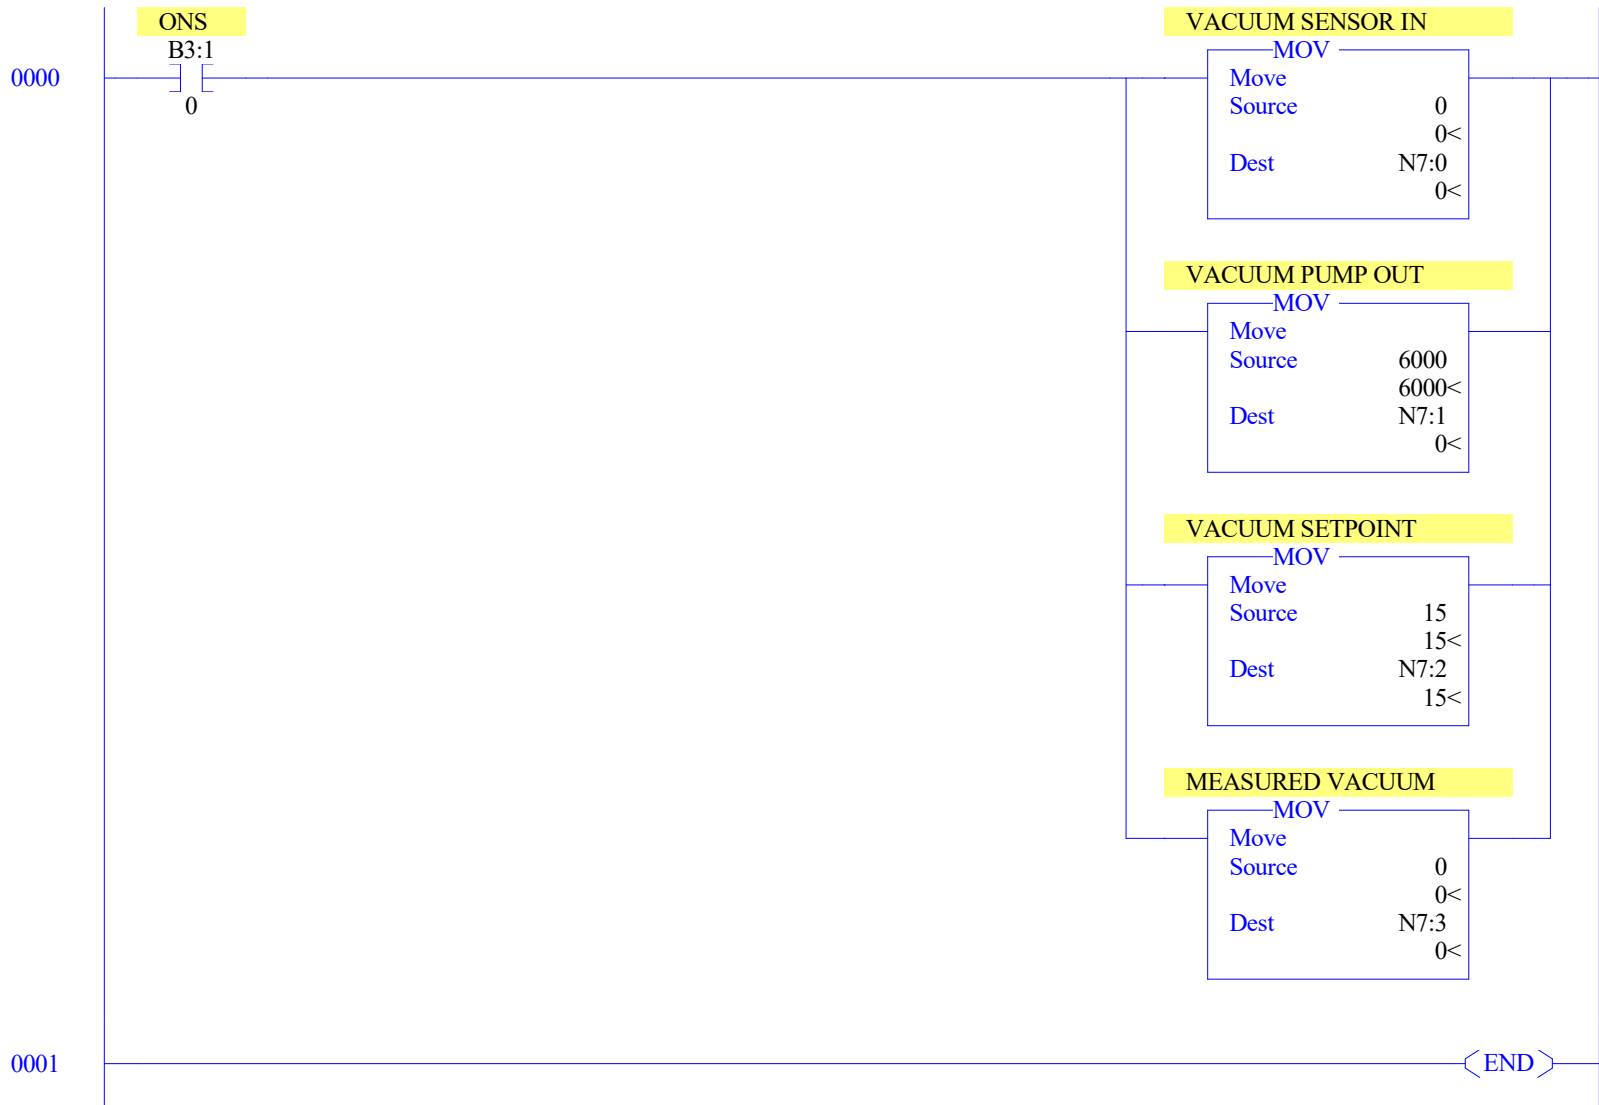

0000

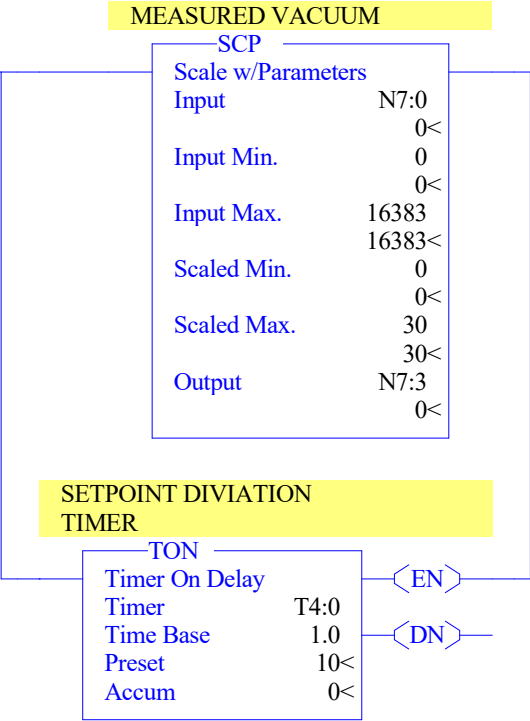

0001

SETPOINT DIVIATION
TIMERT4:0
DN

MEASURED VACUUM

LIM

Limit Test

Low Lim

12.75

12.75<

Test

N7:3

0<

High Lim

14.4

14.4<

VACUUM PUMP OUT

SUB

Subtract

Source A

N7:1

0<

Source B

20

20<

Dest

N7:1

0<

MEASURED VACUUM

LIM

Limit Test

Low Lim

15.6

15.6<

Test

N7:3

0<

High Lim

17.25

17.25<

VACUUM PUMP OUT

ADD

Add

Source A

N7:1

0<

Source B

20

20<

Dest

N7:1

0<

MEASURED VACUUM

LIM

Limit Test

Low Lim

10.5

10.5<

Test

N7:3

0<

High Lim

12.75

12.75<

VACUUM PUMP OUT

SUB

Subtract

Source A

N7:1

0<

Source B

60

60<

Dest

N7:1

0<

MEASURED VACUUM

LIM

Limit Test

Low Lim

17.25

17.25<

Test

N7:3

0<

High Lim

19.5

19.5<

VACUUM PUMP OUT

ADD

Add

Source A

N7:1

0<

Source B

60

60<

Dest

N7:1

0<

MEASURED VACUUM

LIM

Limit Test

Low Lim

0.0

0.0<

Test

N7:3

0<

High Lim

10.5

10.5<

VACUUM PUMP OUT

SUB

Subtract

Source A

N7:1

0<

Source B

100

100<

Dest

N7:1

0<

MEASURED VACUUM

LIM

Limit Test

Low Lim

19.5

19.5<

Test

N7:3

0<

High Lim

30.0

30.0<

VACUUM PUMP OUT

ADD

Add

Source A

N7:1

0<

Source B

100

100<

Dest

N7:1

0<

