

Results of the audit:

Gender:

Gender	Frequency	Percentage
Male	71	71.7%
Female	28	28.3%
Total	99	100%

Chart 1: distribution of gender

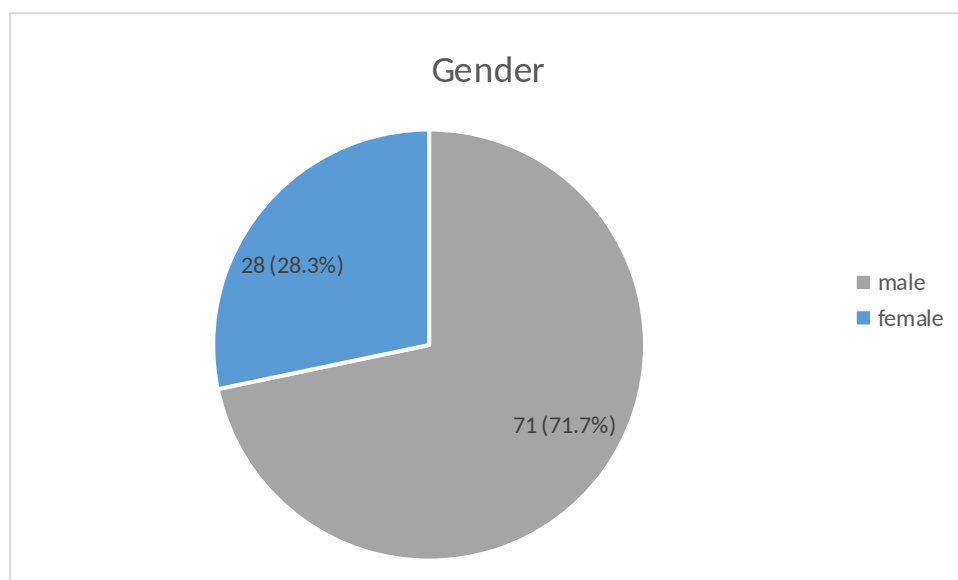


Table 1 distribution for physical and lab monitoring as per the recommended guidelines at baseline

	Weight/BMI	CBC	LFT	coagulation	Pregnancy test	Total
Done	39 (39.4%)	30 (30.3%)	31 (31.3%)	97 (98.0%)	21 (75.0%)	218 (51.4%)
Not done	60 (60.6%)	69 (69.7%)	68 (68.7%)	2 (2.0%)	7 (25.0%)	206 (48.6%)
Total	99	99	99	99	28	424 (100%)

Chart for total

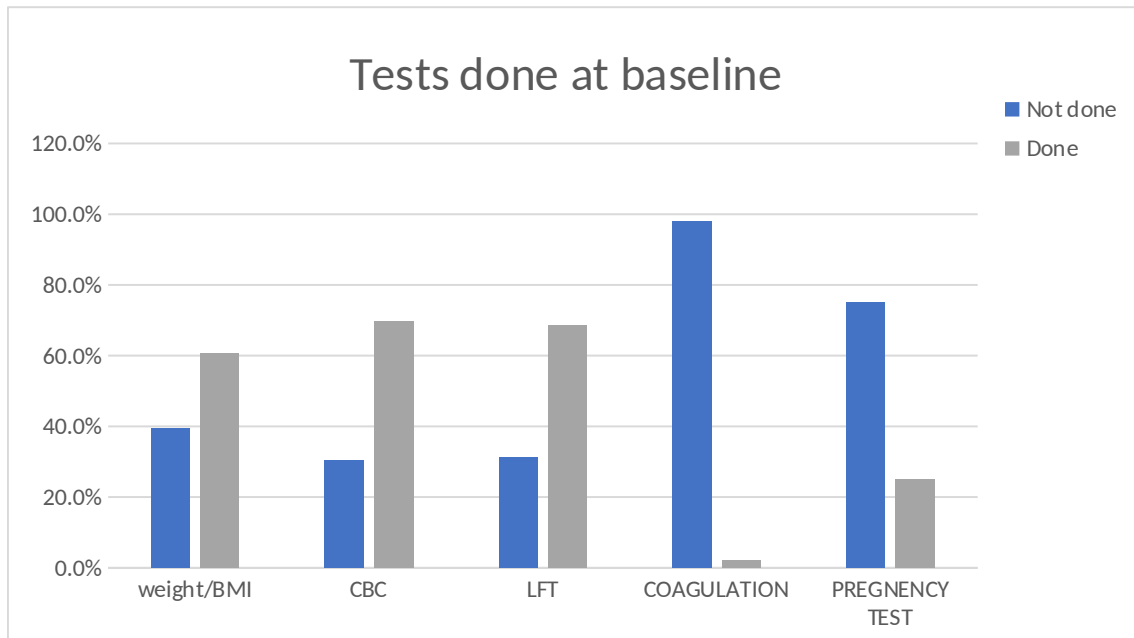
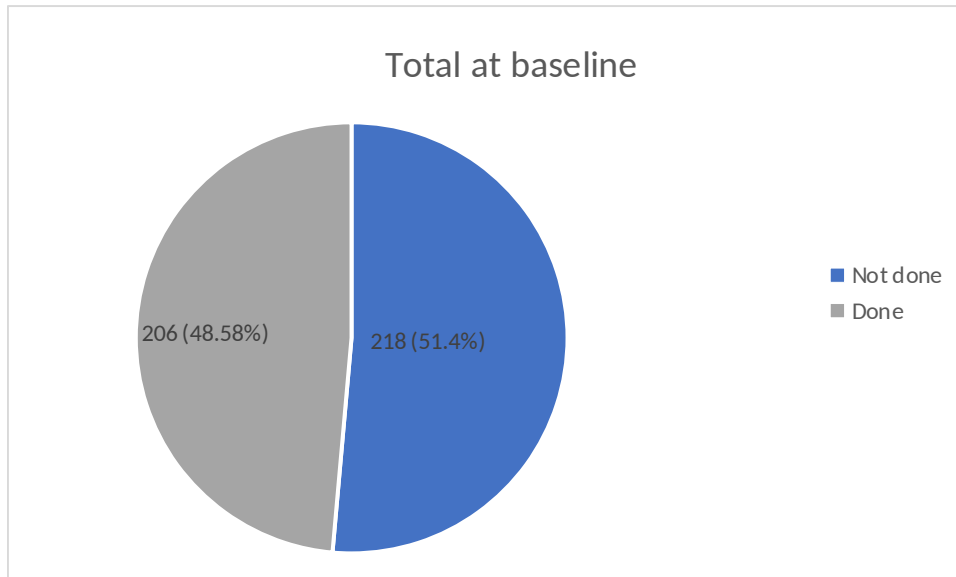


Table2 distribution for physical and lab monitoring as per the recommended guidelines at 6 monthly

	vitals	BMI	cbc	LFT	Total
Done	38 (38.4%)	68 (68.7%)	82 (82.8%)	82 (82.8%)	270 (68.2%)
Not done	61 (61.6%)	31 (31.3%)	17 (17.2%)	17 (17.2%)	126 (31.8%)

Total	99 (100.0%)	99 (100.0%)	99 (100.0%)	99 (100.0%)	396 (100.0%)
-------	-------------	-------------	-------------	-------------	--------------

Chart for total


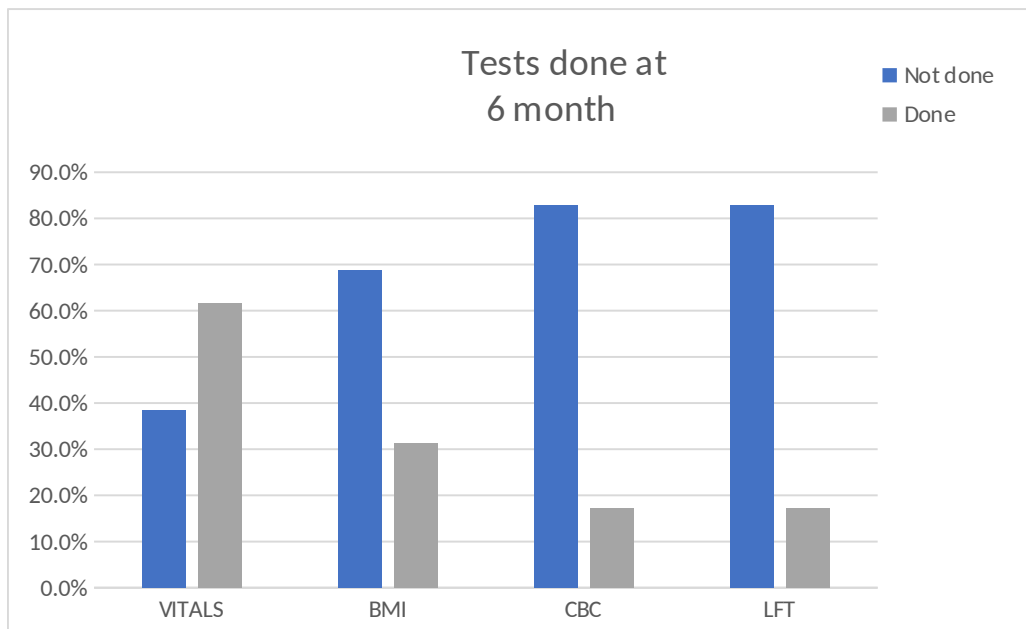


Table 3 distribution for physical and lab monitoring as per the recommended guidelines annually

	BMI	CBC	LFT	Total
Done	65 (65.7%)	70 (70.7%)	70 (70.7%)	205 (69.0%)
Not Done	34 (34.3%)	29 (29.3%)	29 (29.3%)	92 (31.0%)
Total	99 (100.0%)	99 (100.0%)	99 (100.0%)	297 (100.0%)

Chart for total

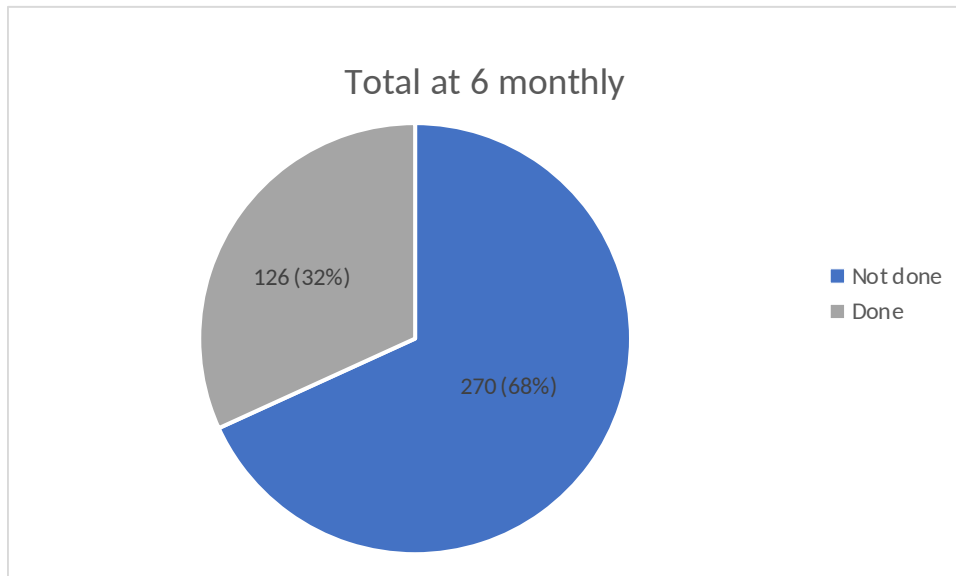