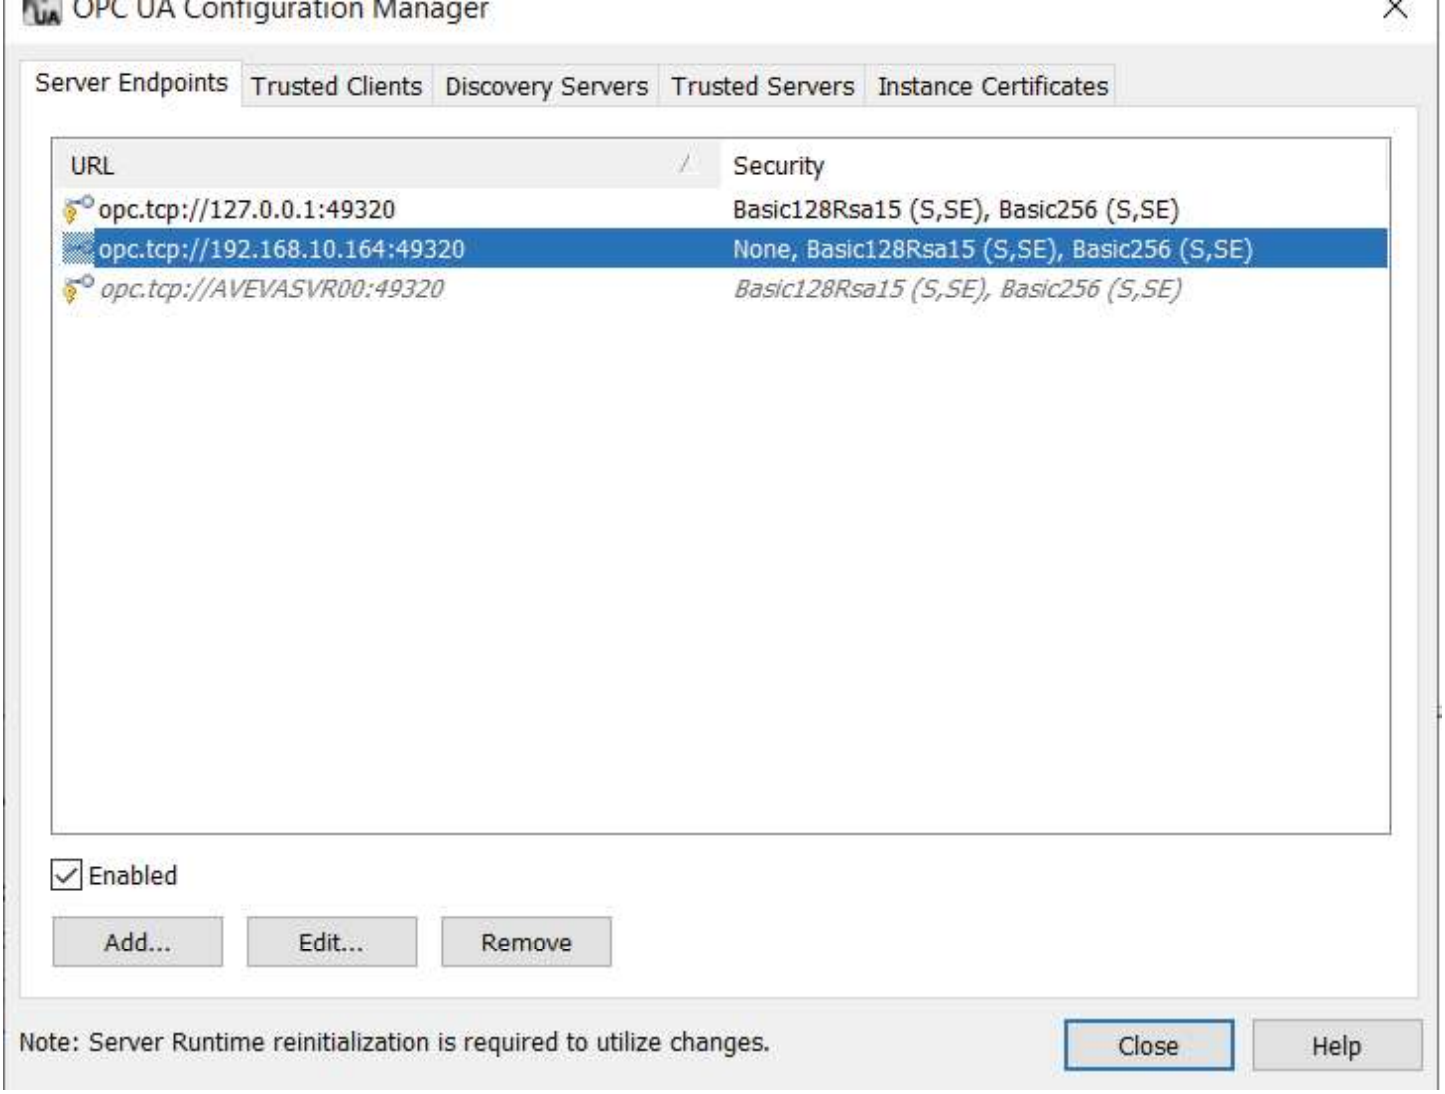
KEPServerEX 6 Configuration [Connected to Runtime]

File Edit View Tools Runtime Help

- Project
  - Connectivity
    - siemens
      - s71200
  - Aliases
  - Advanced Tags
  - Alarms & Events
    - Add Area...
  - Data Logger
    - Add Log Group...
  - EFM Exporter
    - Add Poll Group...
  - IDF for Splunk
    - Add Splunk Connection...
  - IoT Gateway
    - Add Agent...
  - Local Historian
    - Add Datastore...
  - Scheduler
    - Add Schedule...

Tag Name	Address	Data Type	Scan Rate	Scaling	Description
MARCHA	MX10.0	Boolean	100	None	
NIVEL_TK1	MD28	Float	100	None	
NIVEL_TK2	MD32	Float	100	None	
PARO	MX10.1	Boolean	100	None	
SP_TK1	MD20	Float	100	None	
SP_TK2	MD24	Float	100	None	
ST_B1	MX10.2	Boolean	100	None	
ST_B2	MX10.3	Boolean	100	None	


OPC UA Configuration Manager
Server Endpoints
Trusted Clients
Discovery Servers
Trusted Servers
Instance Certificates
URL
Security
opc.tcp://127.0.0.1:49320
Basic128Rsa15 (S,SE), Basic256 (S,SE)
opc.tcp://192.168.10.164:49320
None, Basic128Rsa15 (S,SE), Basic256 (S,SE)
opc.tcp://AVEVASVR00:49320
Basic128Rsa15 (S,SE), Basic256 (S,SE)
Enabled
Add...
Edit...
Remove
Note: Server Runtime reinitialization is required to utilize changes.
Close
Help