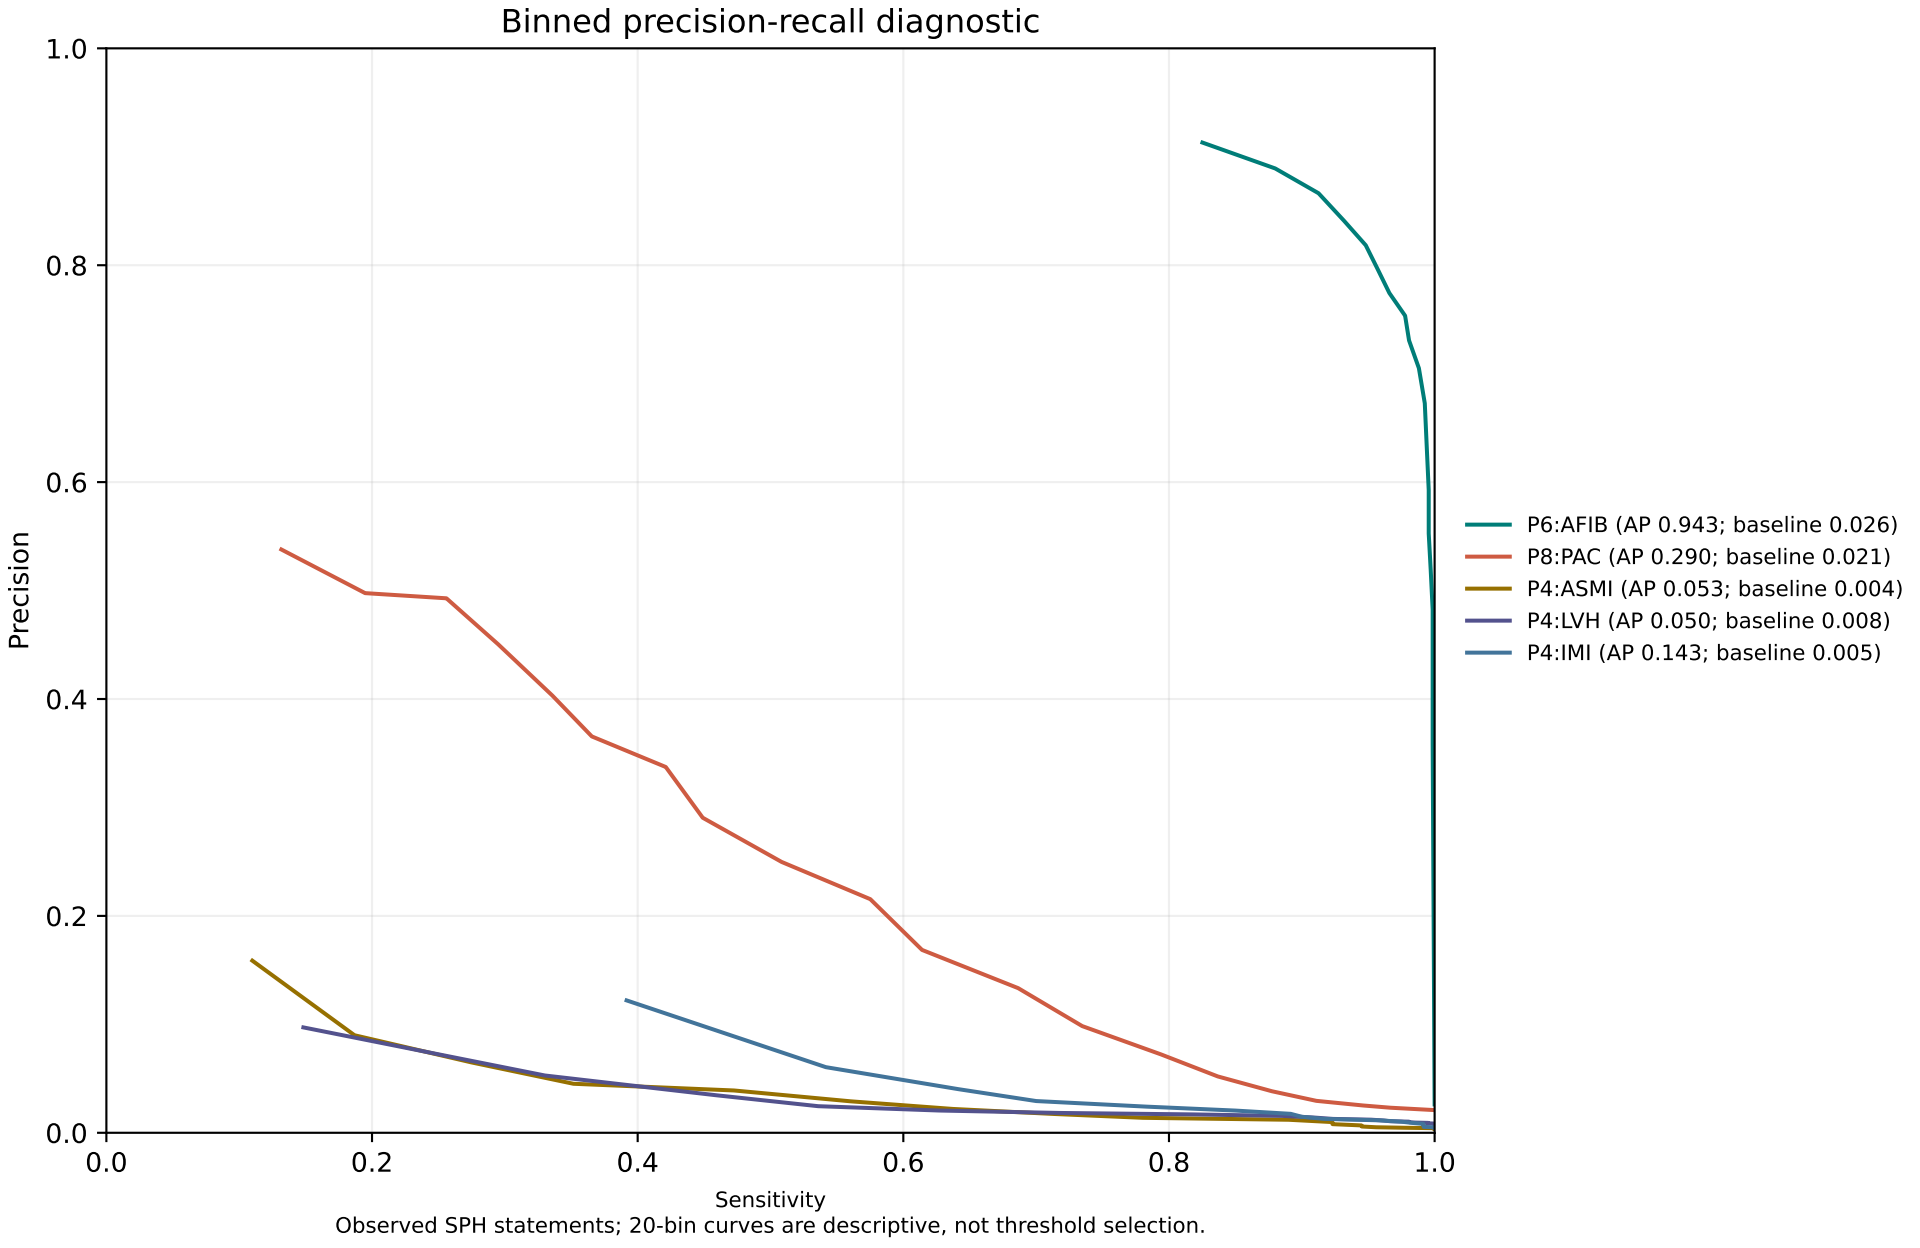
Binned precision-recall diagnostic
Precision
Sensitivity
1.0
0.8
0.6
0.4
0.2
0.0
0.0
0.2
0.4
0.6
0.8
1.0
P6:AFIB (AP 0.943; baseline 0.026)
P8:PAC (AP 0.290; baseline 0.021)
P4:ASMI (AP 0.053; baseline 0.004)
P4:LVH (AP 0.050; baseline 0.008)
P4:IMI (AP 0.143; baseline 0.005)
Observed SPH statements; 20-bin curves are descriptive, not threshold selection.