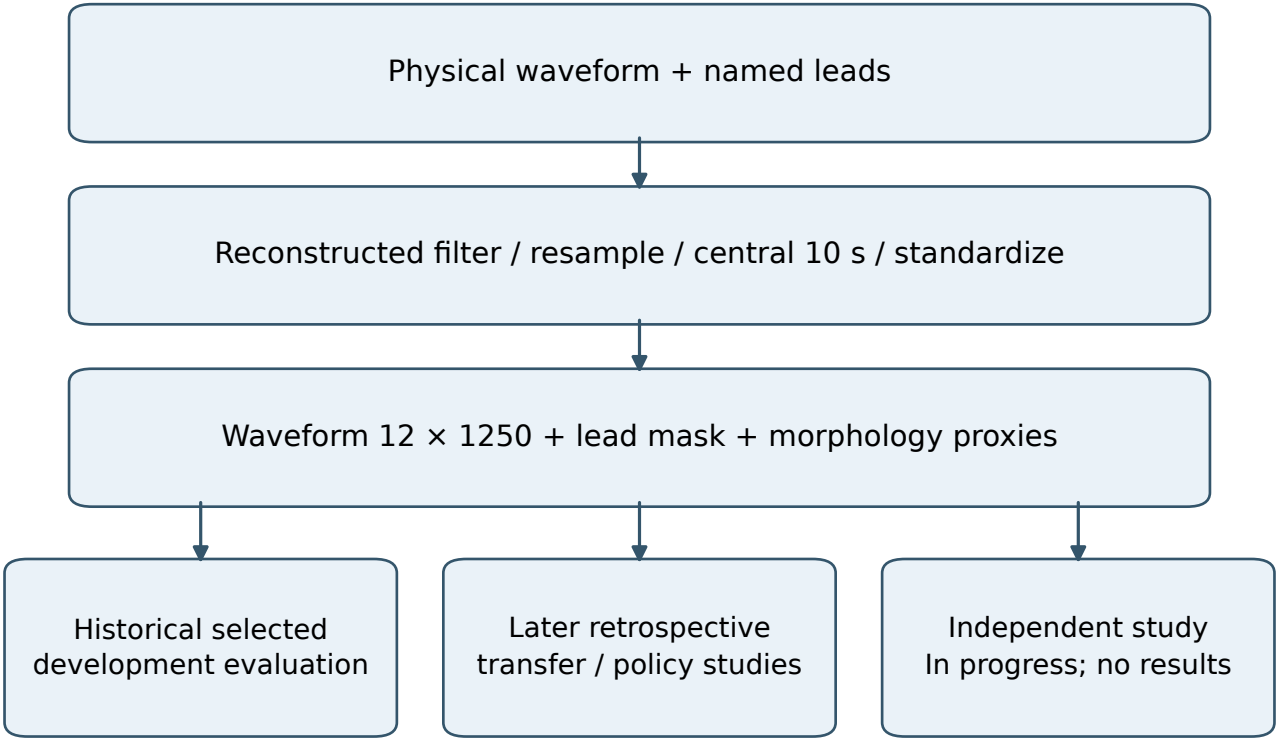
Physical waveform + named leads
Reconstructed filter / resample / central 10 s / standardize
Waveform 12 × 1250 + lead mask + morphology proxies
Historical selected development evaluation
Later retrospective transfer / policy studies
Independent study In progress; no results