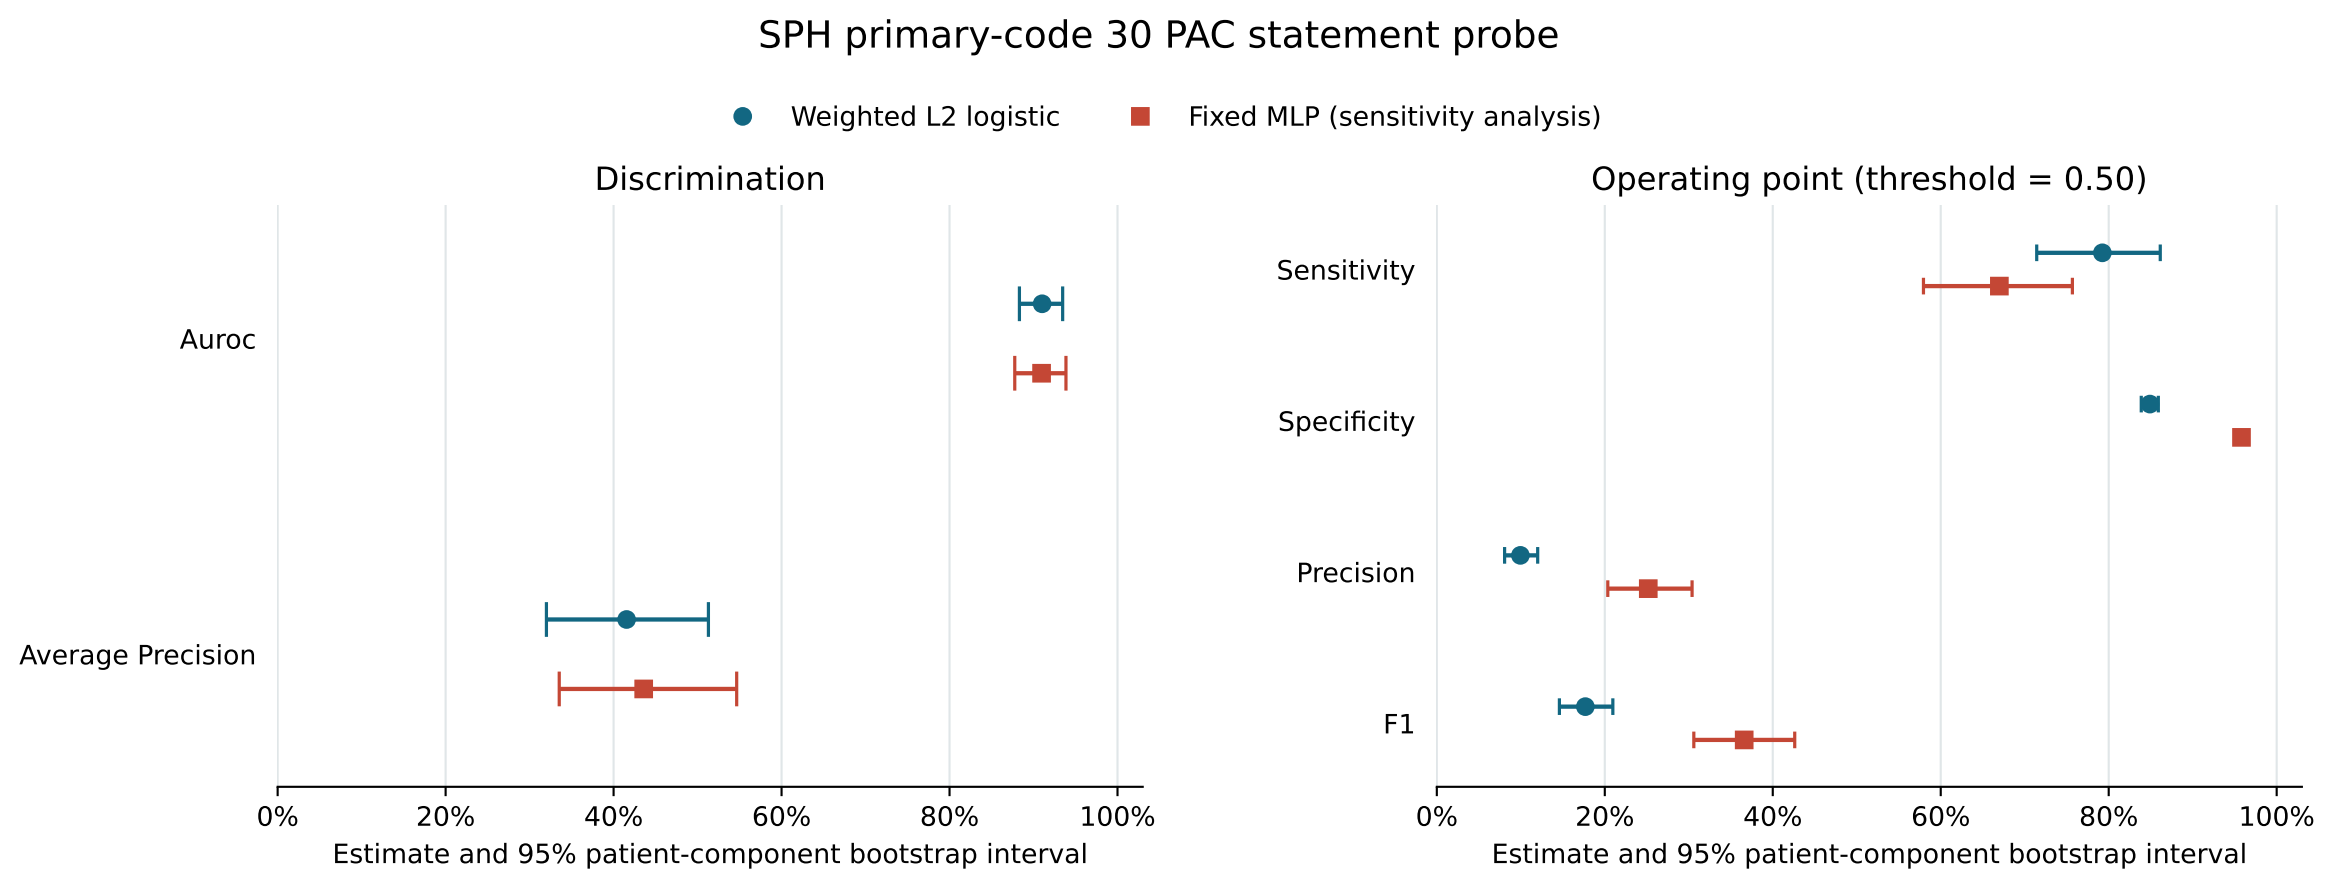


Exploratory holdout: n=5,143 ECG statements; 106 positive, 5,037 negative

Not clinical adjudication or independent external validation; PAC target was previously inspected.