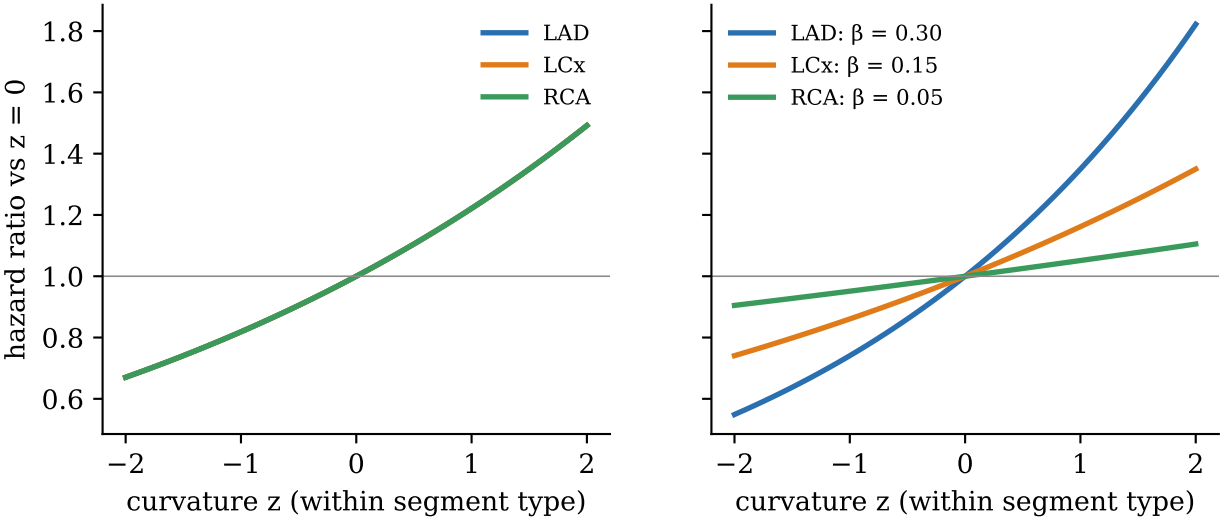
Primary: one shared slope (β = 0.20)
hazard ratio vs z = 0
1.8
1.6
1.4
1.2
1.0
0.8
0.6
LAD
LCx
RCA
−2
−1
0
1
2
curvature z (within segment type)
Secondary test: a slope per artery
LAD: β = 0.30
LCx: β = 0.15
RCA: β = 0.05
−2
−1
0
1
2
curvature z (within segment type)