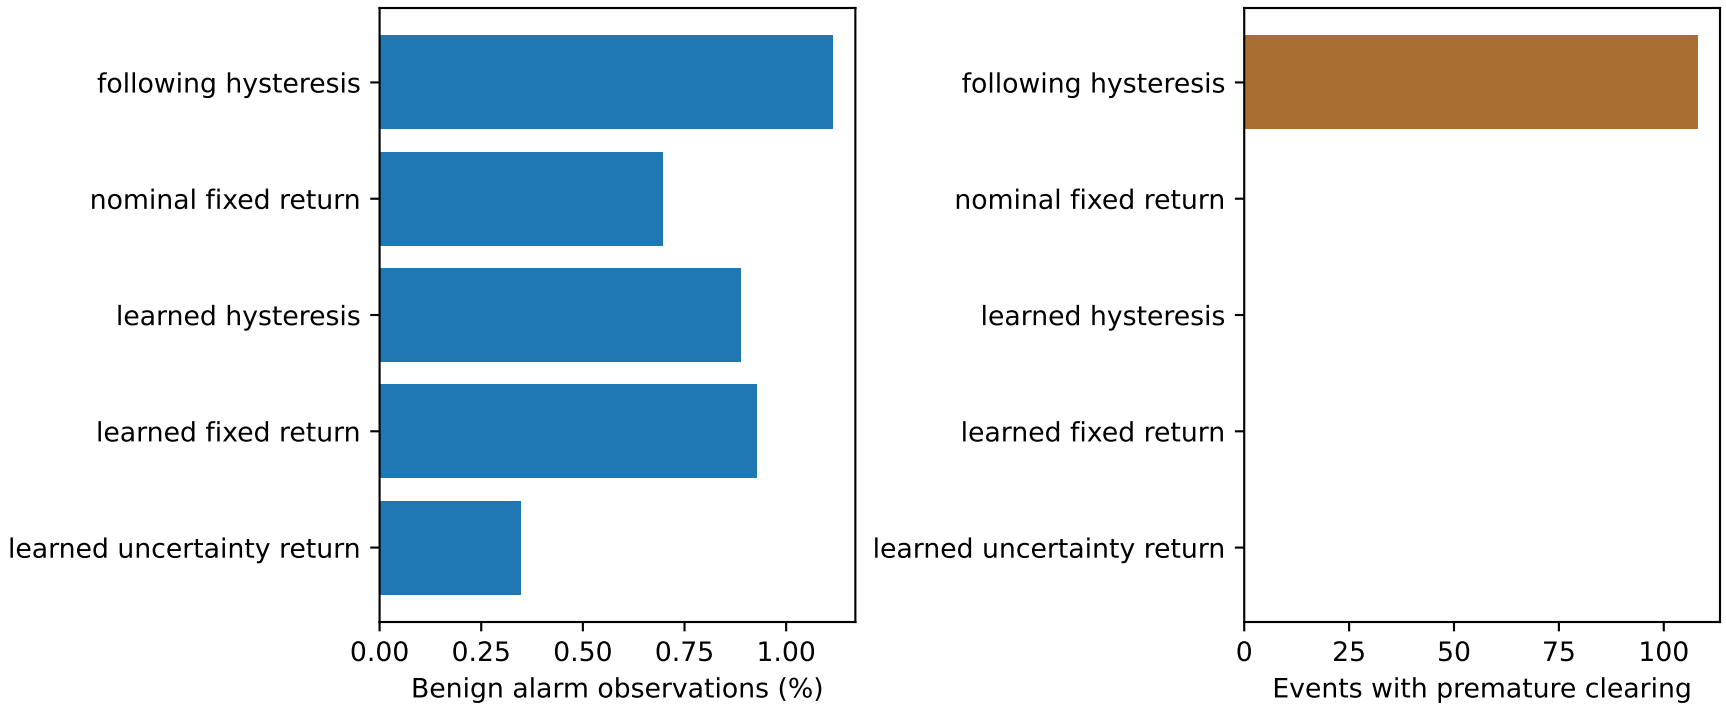
following hysteresis
nominal fixed return
learned hysteresis
learned fixed return
learned uncertainty return
0.00
0.25
0.50
0.75
1.00
Benign alarm observations (%)
following hysteresis
nominal fixed return
learned hysteresis
learned fixed return
learned uncertainty return
0
25
50
75
100
Events with premature clearing