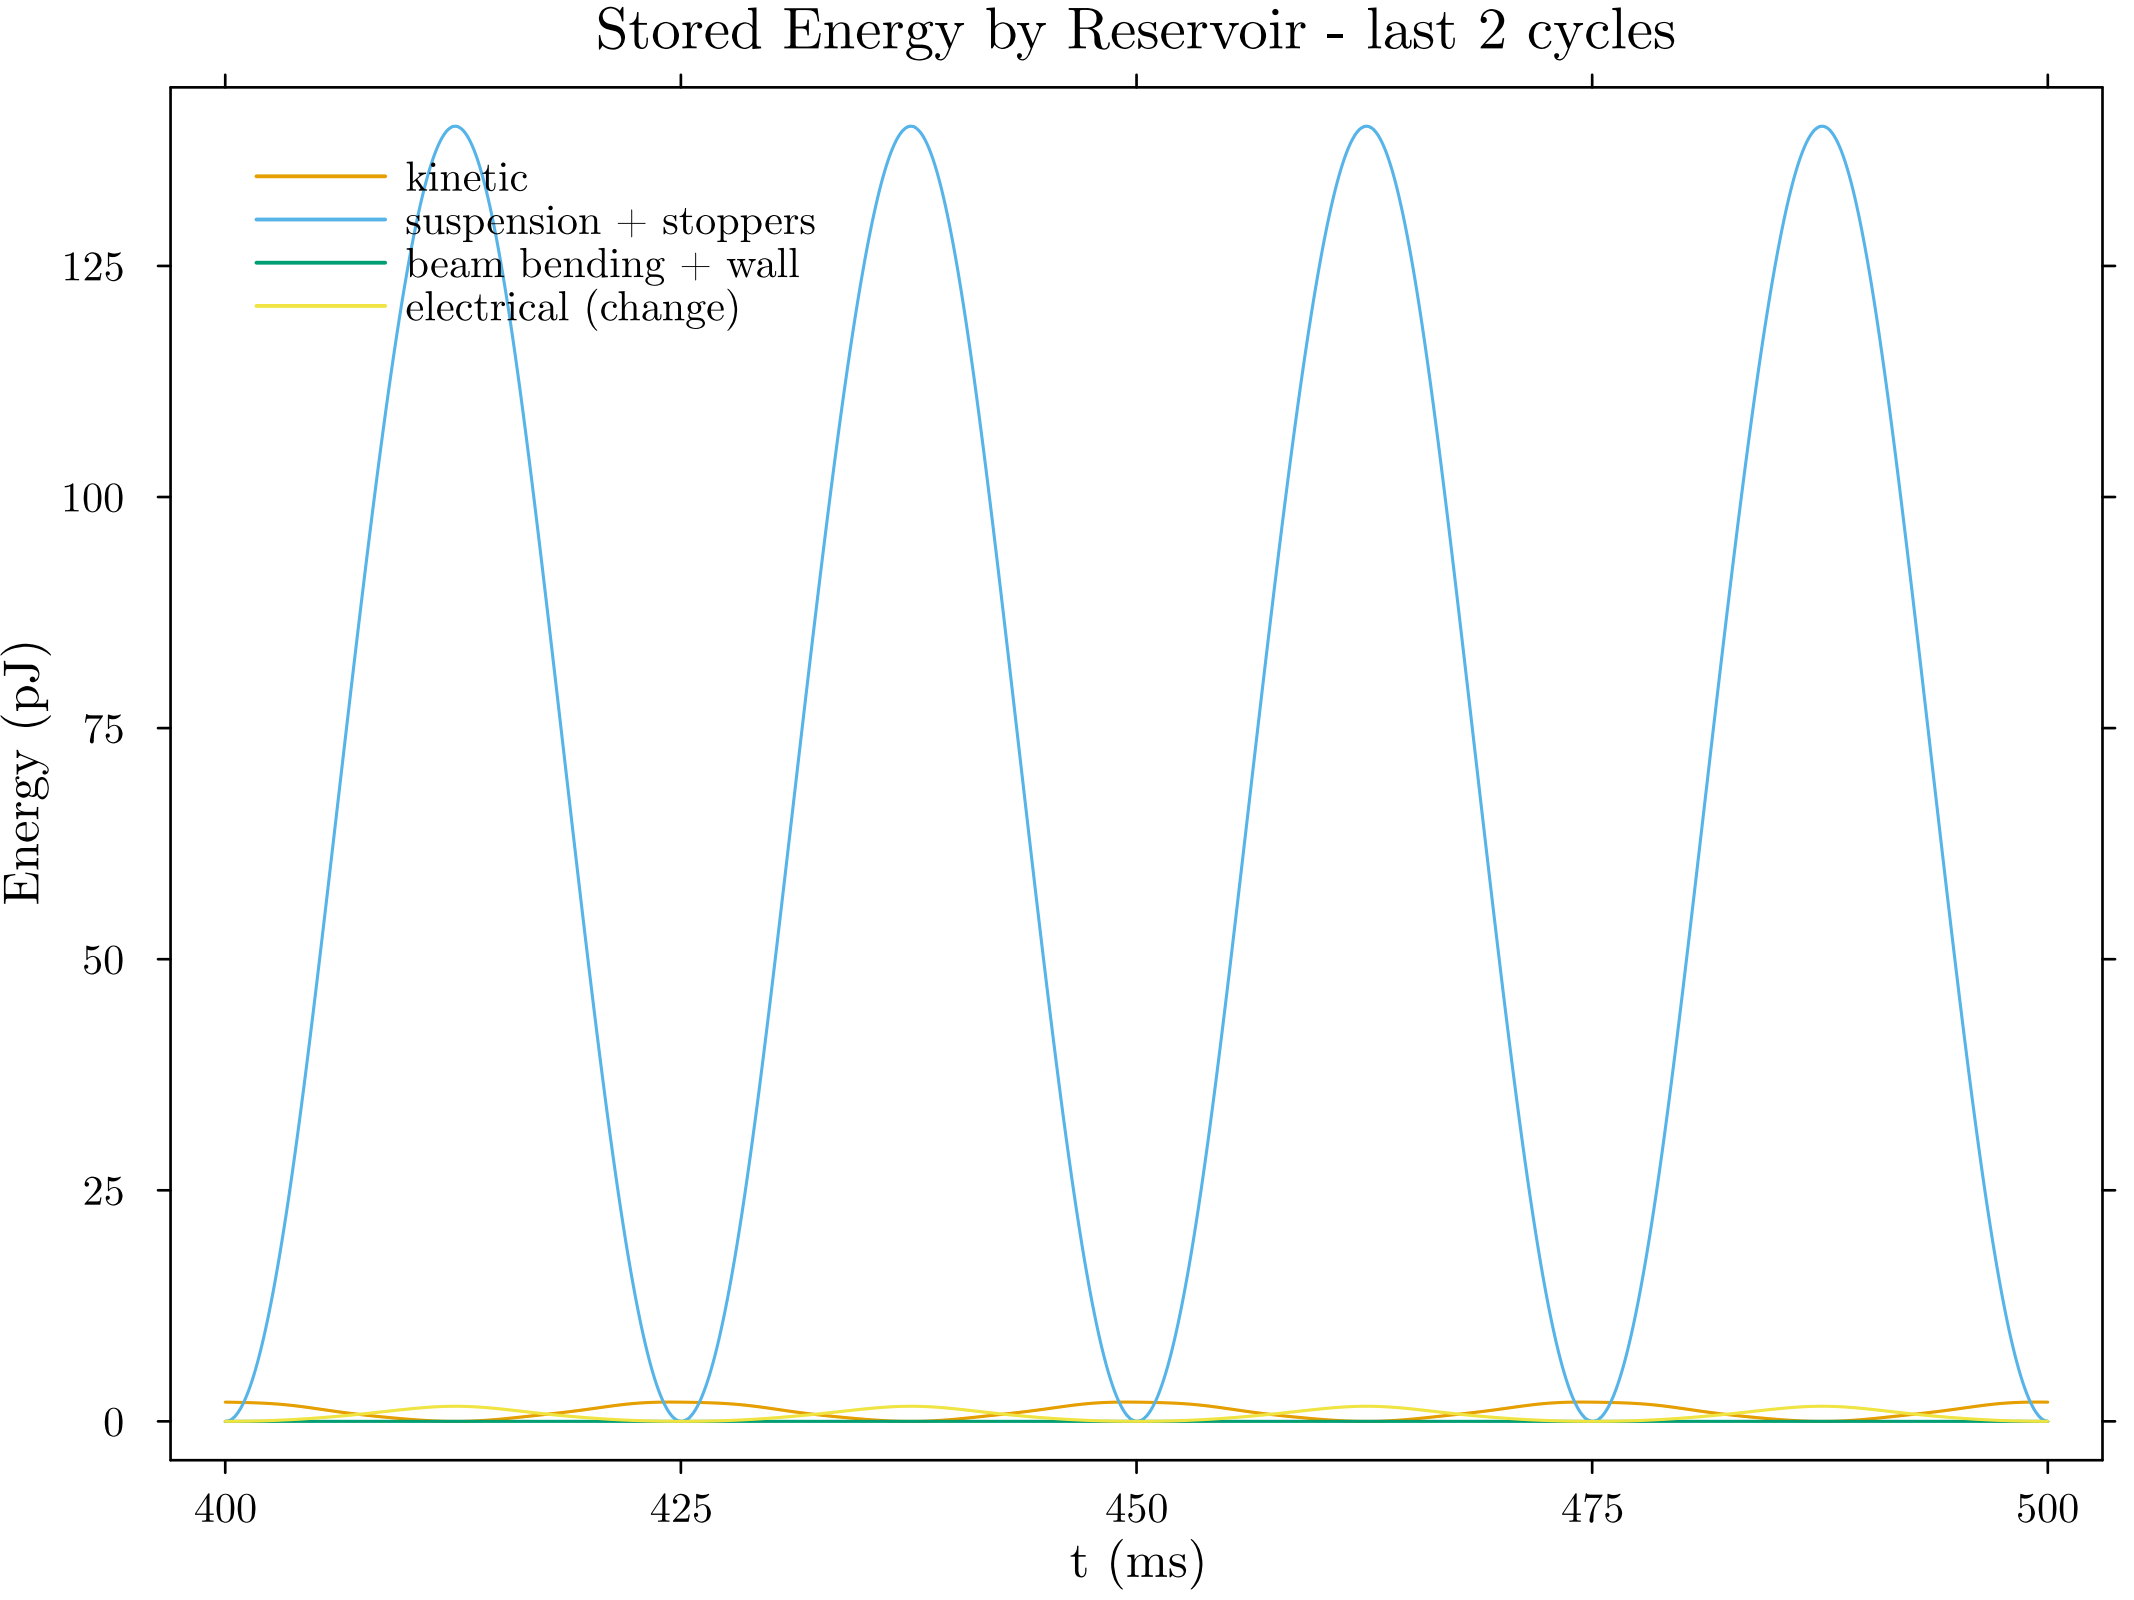

Stored Energy by Reservoir - last 2 cycles
kinetic
suspension + stoppers
beam bending + wall
electrical (change)
Energy (pJ)
0
25
50
75
100
125
400
425
450
475
500
t (ms)