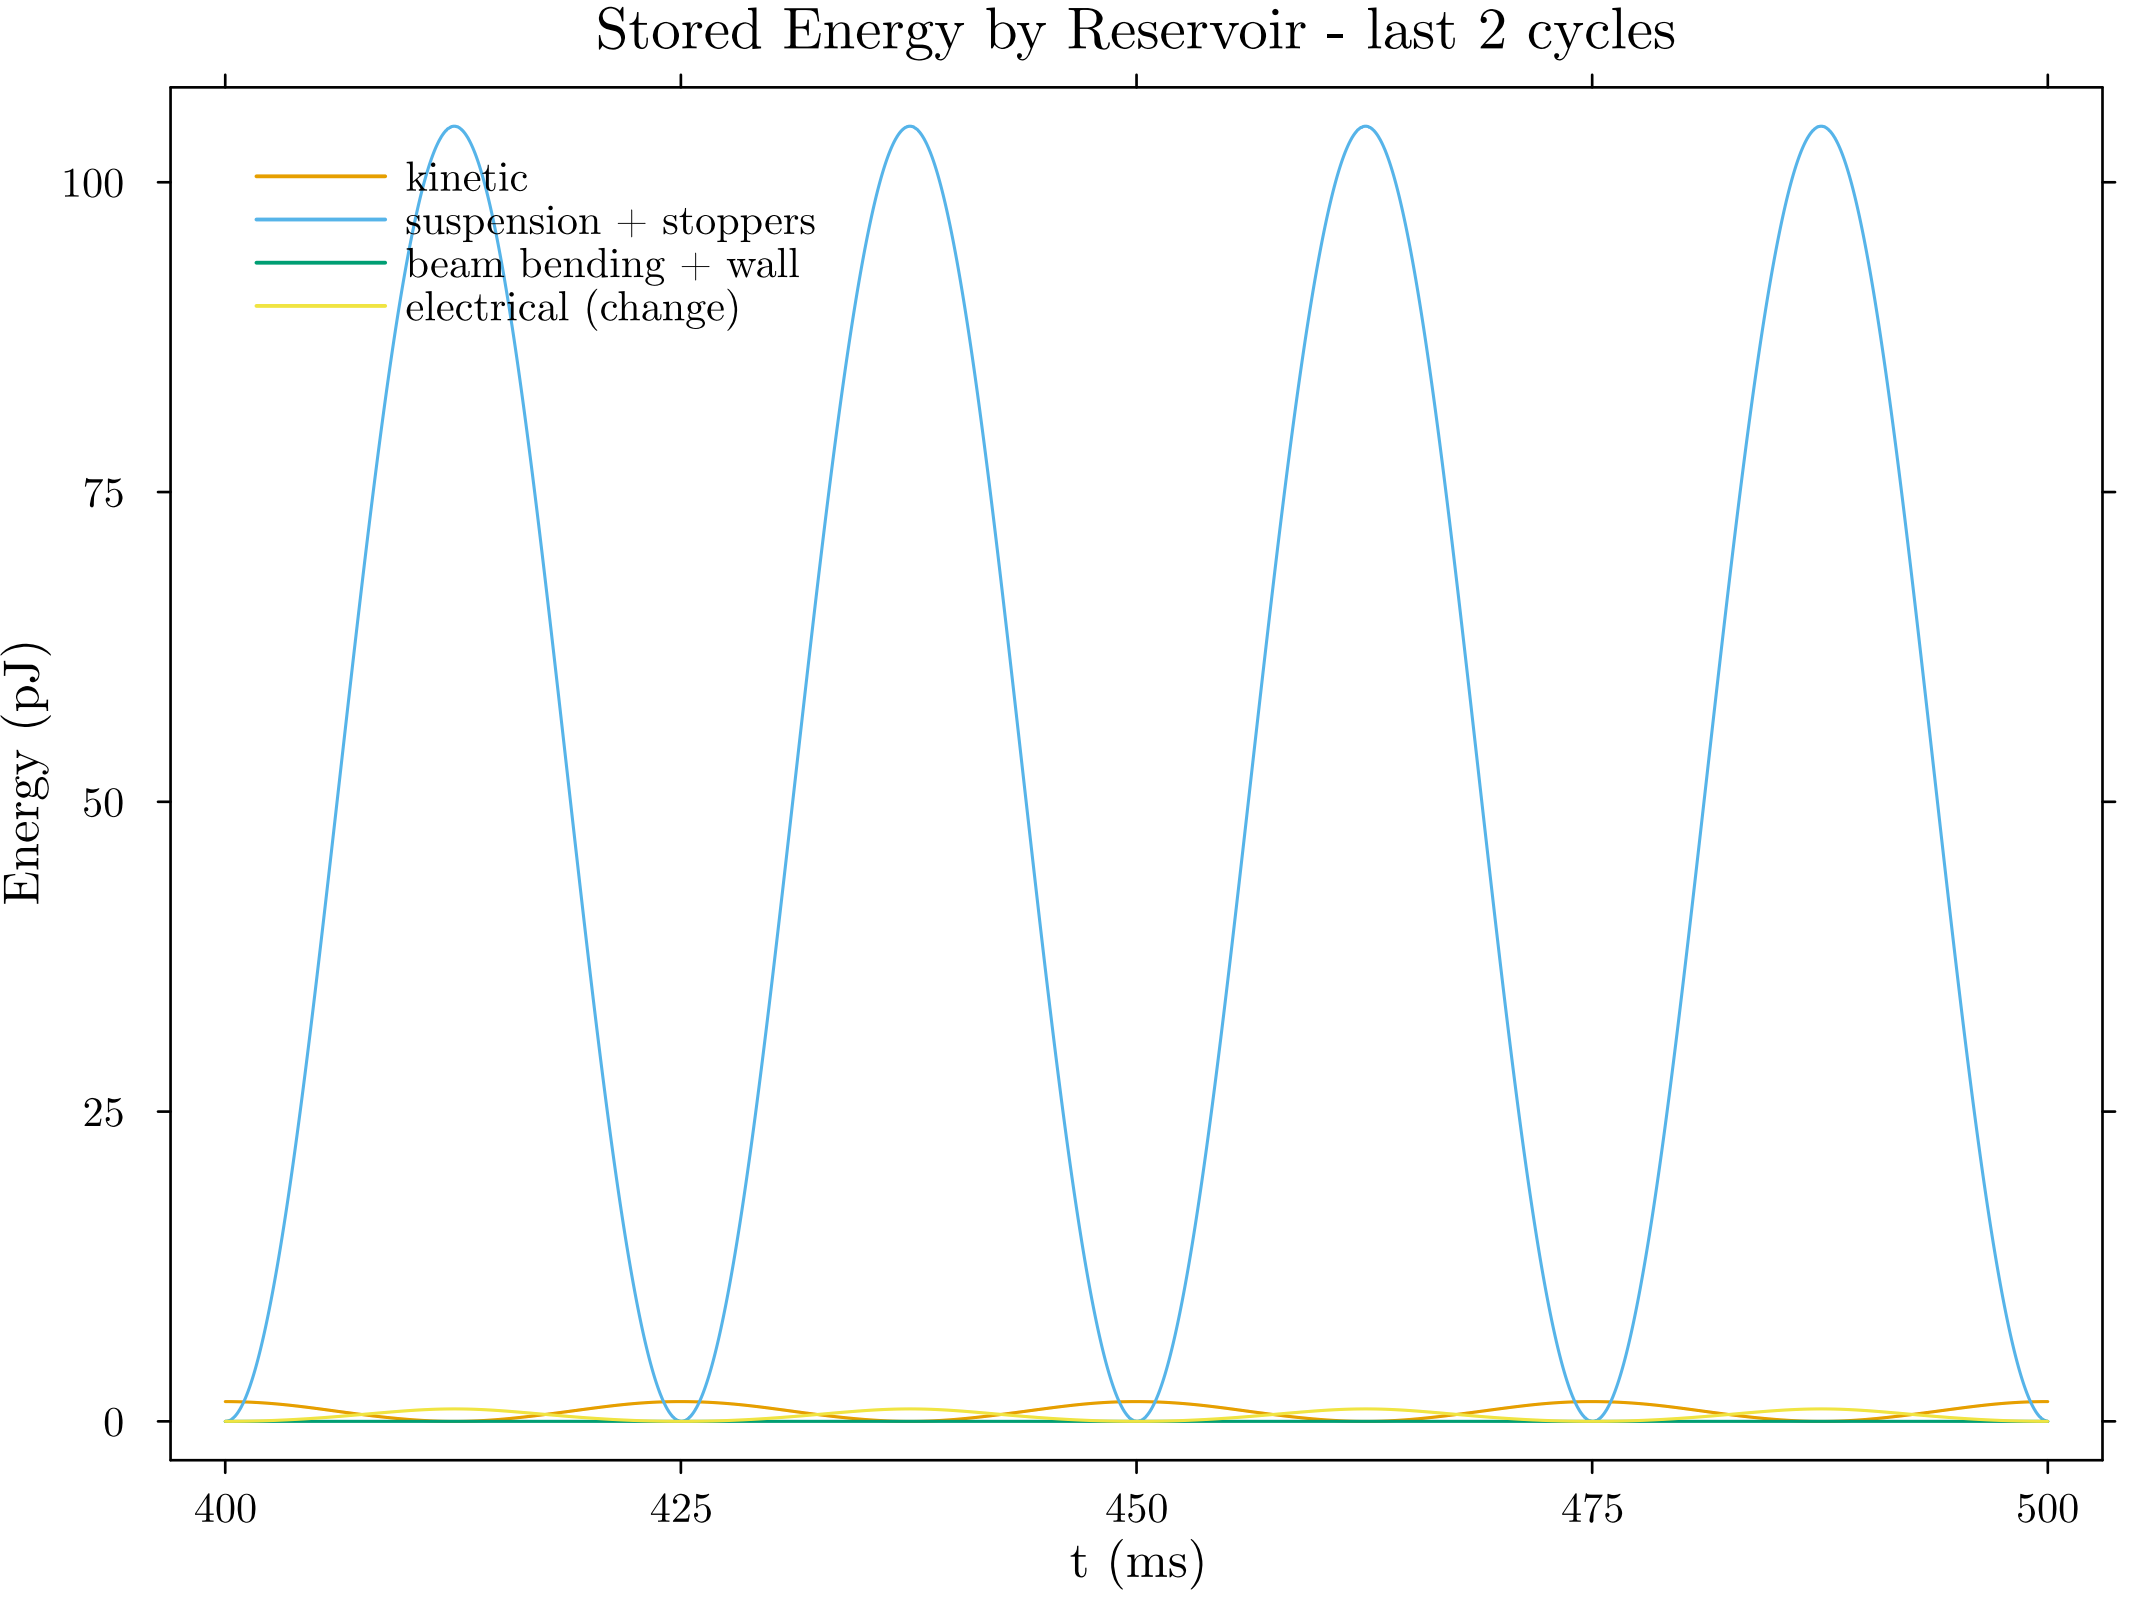

Stored Energy by Reservoir - last 2 cycles
kinetic
suspension + stoppers
beam bending + wall
electrical (change)
100
75
50
25
0
Energy (pJ)
400
425
450
475
500
t (ms)