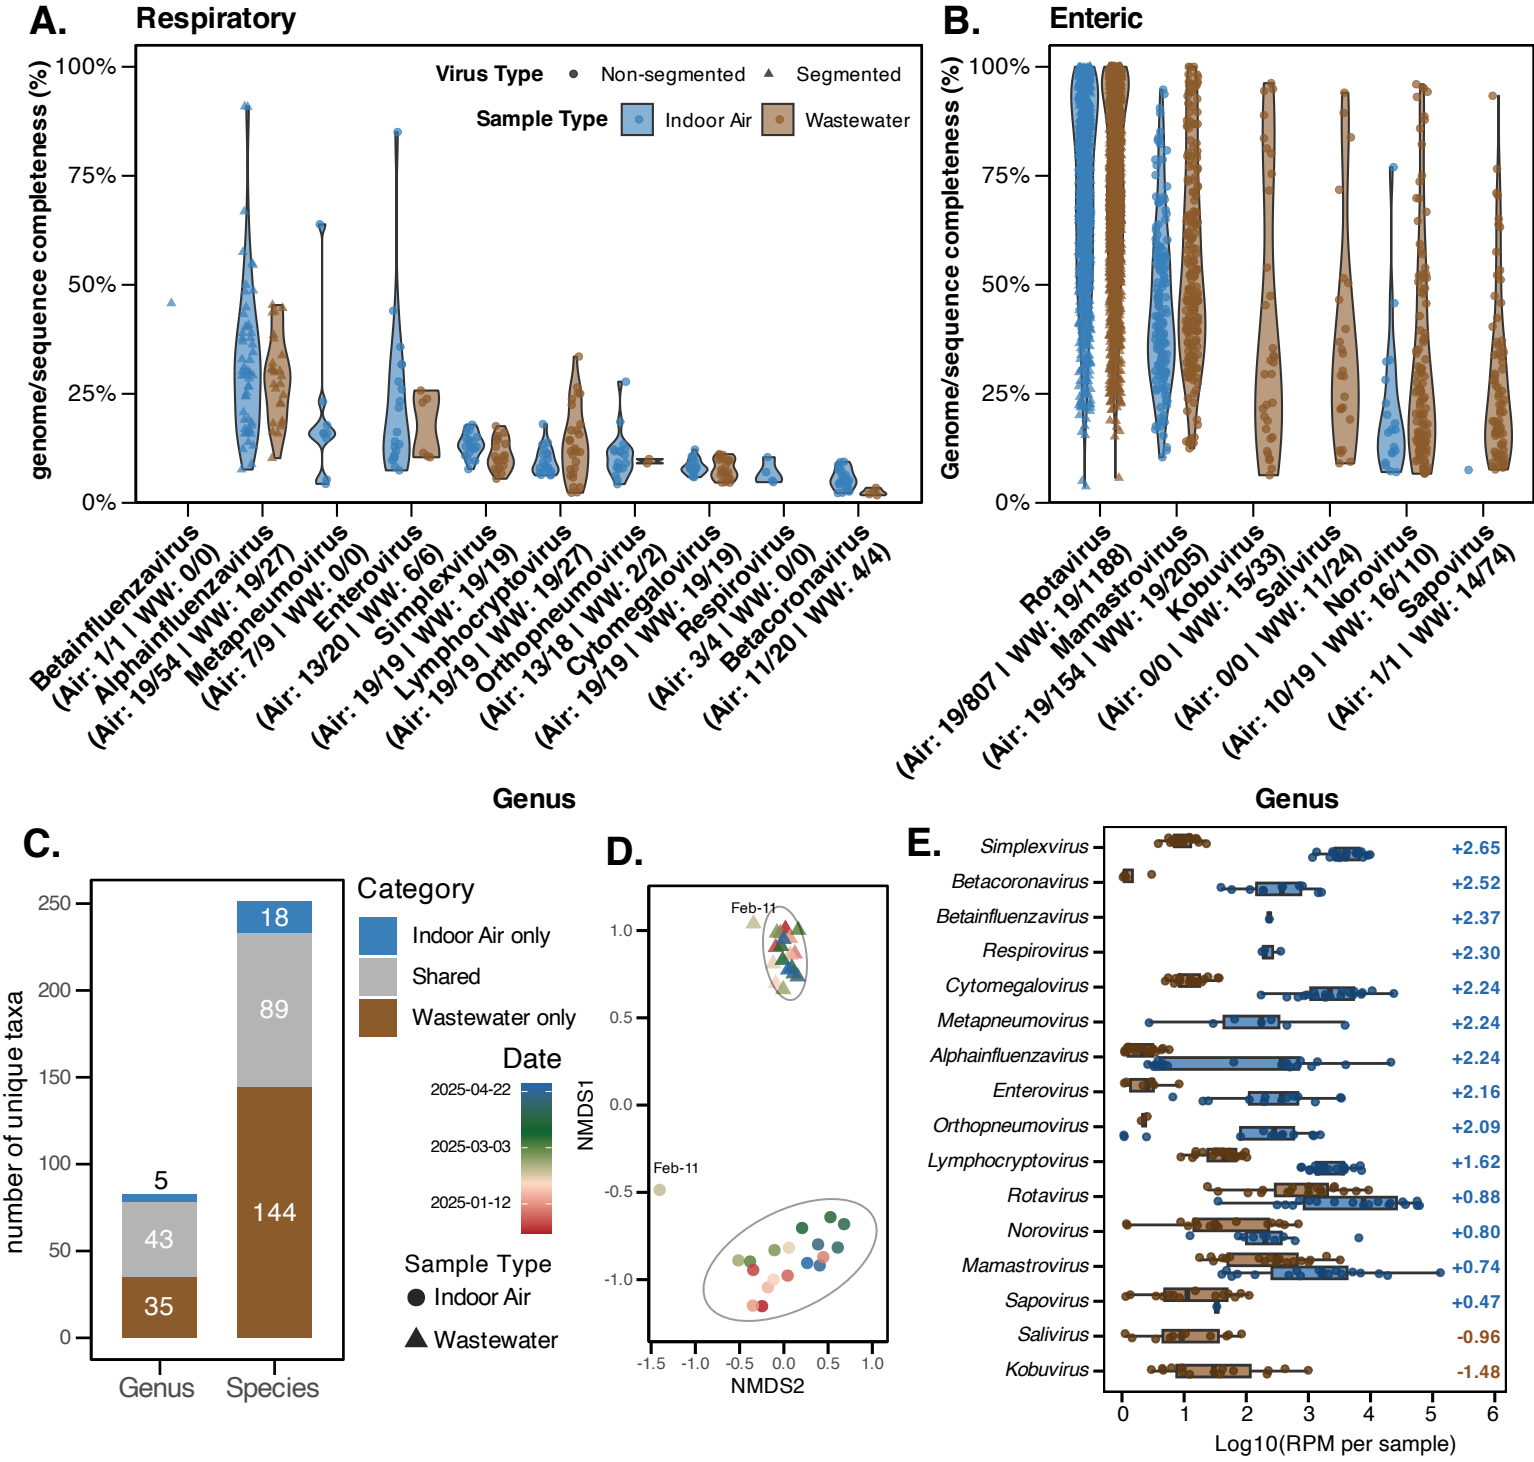
A.
Respiratory
Virus Type
Non-segmented
Segmented
Sample Type
Indoor Air
Wastewater
genome/sequence completeness (%)
100%
75%
50%
25%
0%
Betainfluenzavirus (Air: 1/1 | WW: 0/0)
Alphainfluenzavirus (Air: 19/54 | WW: 19/27)
Metapneumovirus (Air: 7/9 | WW: 0/0)
Enterovirus (Air: 13/20 | WW: 6/6)
Simplexvirus (Air: 19/19 | WW: 19/19)
Lymphocryptovirus (Air: 19/19 | WW: 19/27)
Orthopneumovirus (Air: 13/18 | WW: 2/2)
Cytomegalovirus (Air: 19/19 | WW: 19/19)
Respirovirus (Air: 3/4 | WW: 0/0)
Betacoronavirus (Air: 11/20 | WW: 4/4)
B.
Enteric
Genome/sequence completeness (%)
Rotavirus (Air: 19/807 | WW: 19/1188)
Mamastrovirus (Air: 19/154 | WW: 19/205)
Kobuvirus (Air: 0/0 | WW: 15/33)
Salivirus (Air: 0/0 | WW: 11/24)
Norovirus (Air: 10/19 | WW: 16/110)
Sapovirus (Air: 1/1 | WW: 14/74)
Genus
C.
number of unique taxa
250
200
150
100
50
0
18
89
144
5
43
35
Genus
Species
Category
Indoor Air only
Shared
Wastewater only
Date
2025-04-22
2025-03-03
2025-01-12
Sample Type
Indoor Air
Wastewater
D.
Feb-11
Feb-11
NMDS1
NMDS2
1.0
0.5
0.0
-0.5
-1.0
-1.5
E.
Genus
Simplexvirus +2.65
Betacoronavirus +2.52
Betainfluenzavirus +2.37
Respirovirus +2.30
Cytomegalovirus +2.24
Metapneumovirus +2.24
Alphainfluenzavirus +2.24
Enterovirus +2.16
Orthopneumovirus +2.09
Lymphocryptovirus +1.62
Rotavirus +0.88
Norovirus +0.80
Mamastrovirus +0.74
Sapovirus +0.47
Salivirus -0.96
Kobuvirus -1.48
0
1
2
3
4
5
6
Log10(RPM per sample)