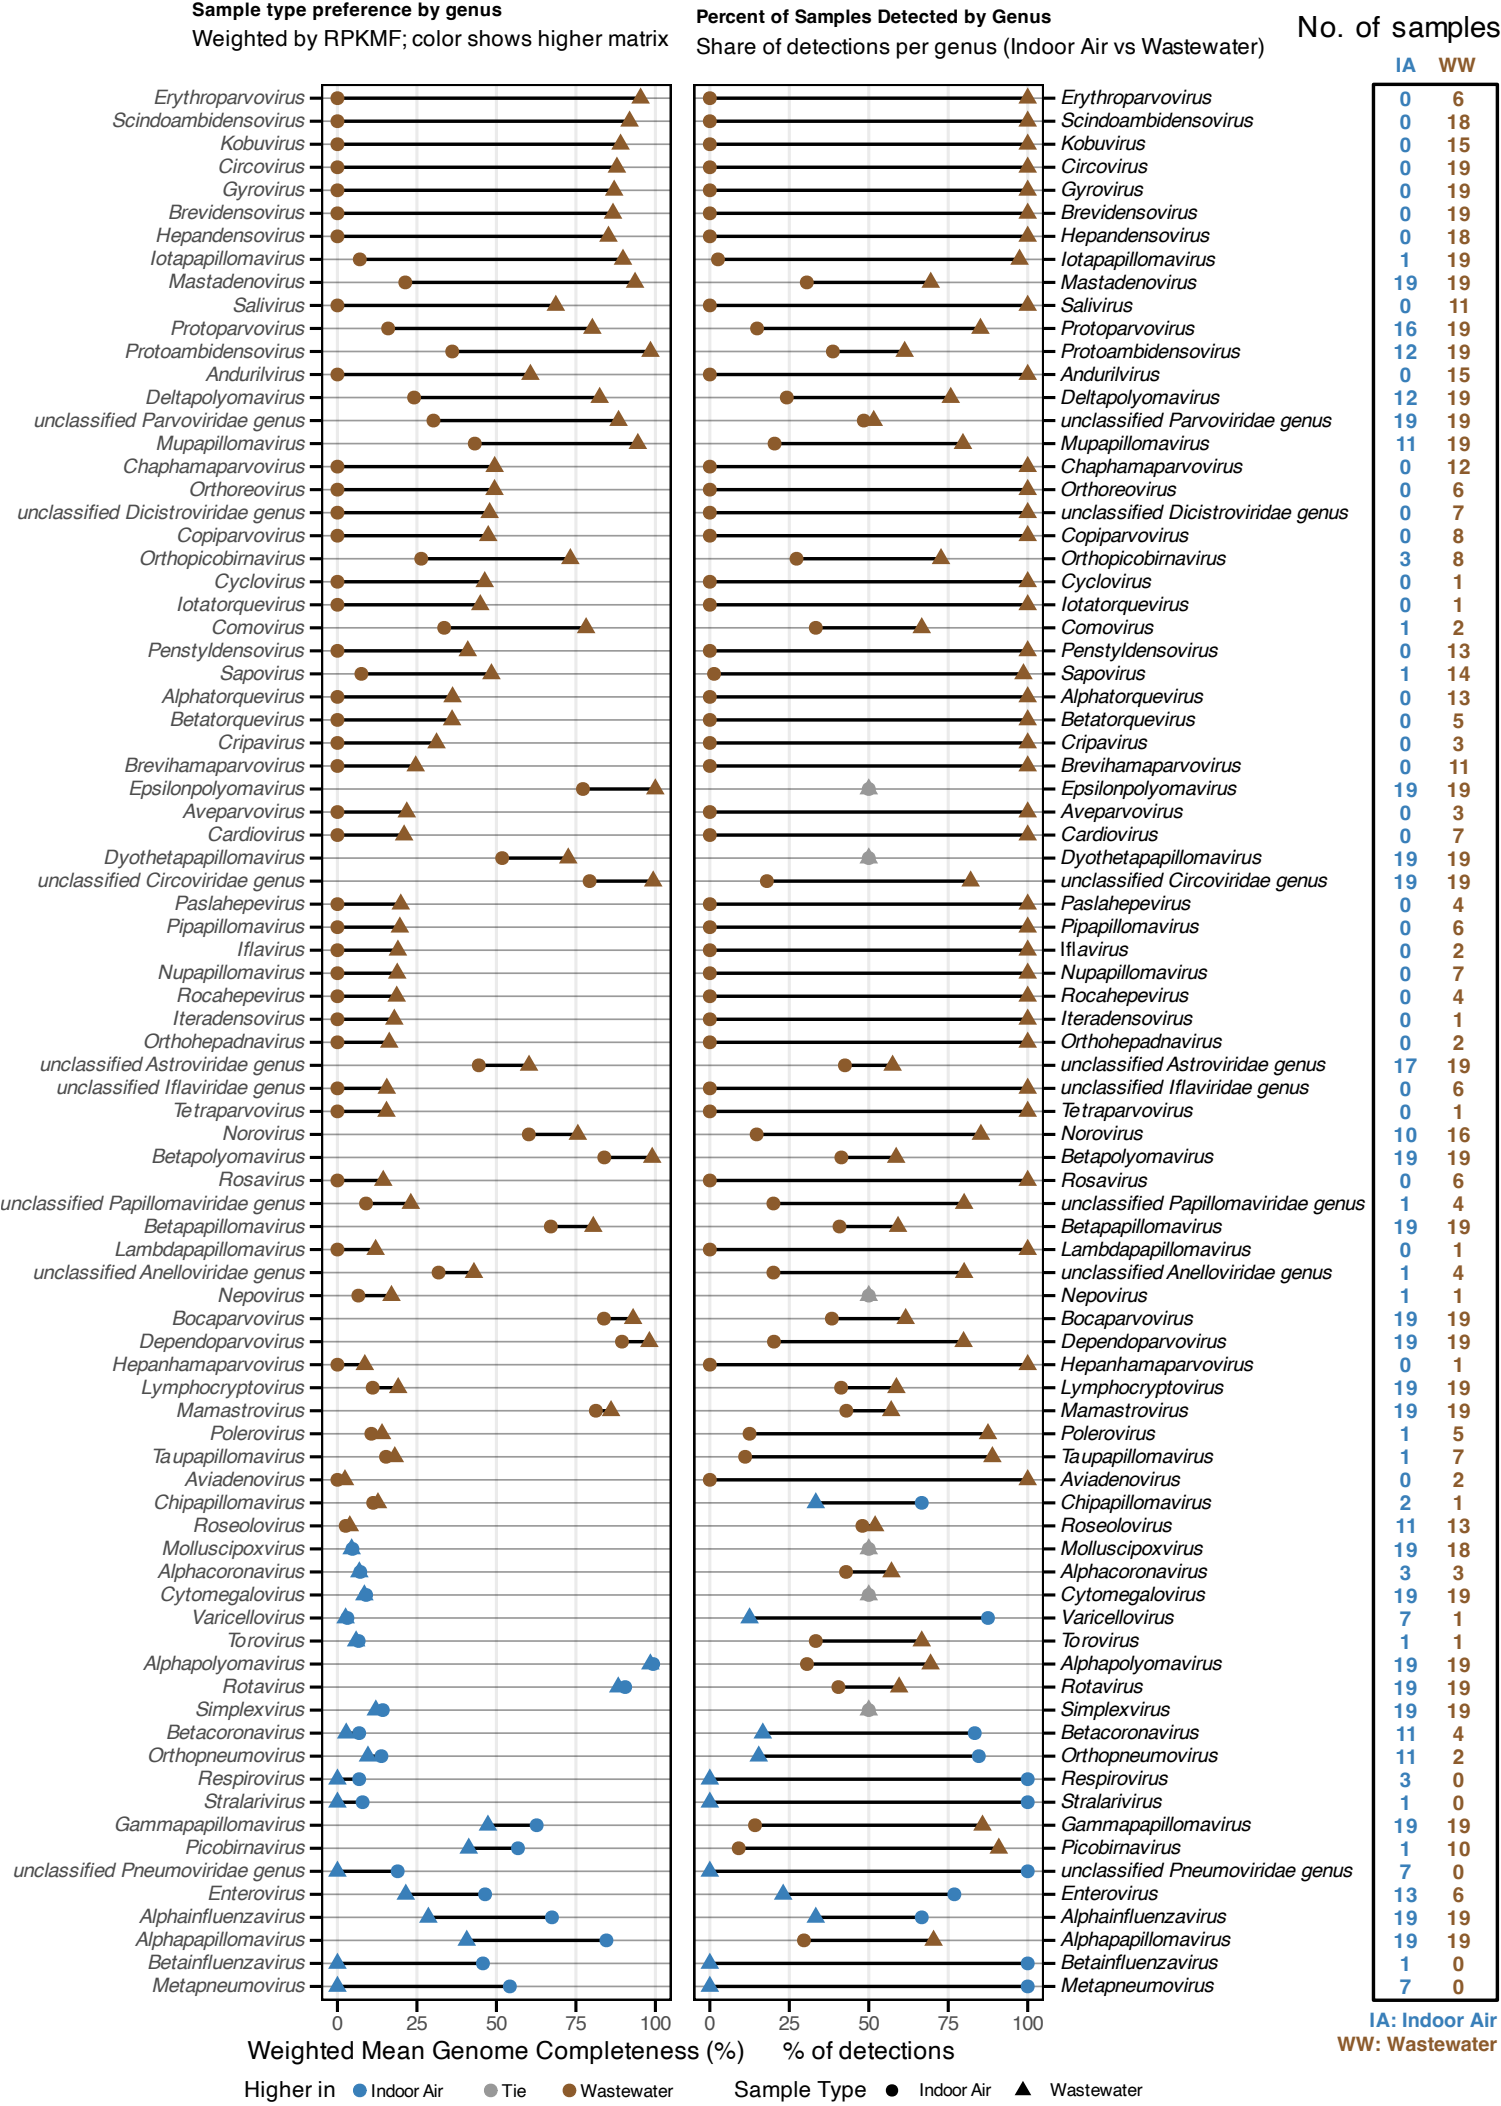
Sample type preference by genus
Weighted by RPKMF; color shows higher matrix
Percent of Samples Detected by Genus
Share of detections per genus (Indoor Air vs Wastewater)
No. of samples
IA
WW
Erythroparvovirus 0 6
Scindoambidensovirus 0 18
Kobuvirus 0 15
Circovirus 0 19
Gyrovirus 0 19
Brevidensovirus 0 19
Hepandensovirus 0 18
Iotapapillomavirus 1 19
Mastadenovirus 19 19
Salivirus 0 11
Protoparvovirus 16 19
Protoambidensovirus 12 19
Andurilvirus 0 15
Deltapolyomavirus 12 19
unclassified Parvoviridae genus 19 19
Mupapillomavirus 11 19
Chaphamaparvovirus 0 12
Orthoreovirus 0 6
unclassified Dicistroviridae genus 0 7
Copiparvovirus 0 8
Orthopicobirnavirus 3 8
Cyclovirus 0 1
Iotatorquevirus 0 1
Comovirus 1 2
Penstyldensovirus 0 13
Sapovirus 1 14
Alphatorquevirus 0 13
Betatorquevirus 0 5
Cripavirus 0 3
Brevihamaparvovirus 0 11
Epsilonpolyomavirus 19 19
Aveparvovirus 0 3
Cardiovirus 0 7
Dyothetapapillomavirus 19 19
unclassified Circoviridae genus 19 19
Paslahepevirus 0 4
Pipapillomavirus 0 6
Iflavirus 0 2
Nupapillomavirus 0 7
Rocahepevirus 0 4
Iteradensovirus 0 1
Orthohepadnavirus 0 2
unclassified Astroviridae genus 17 19
unclassified Iflaviridae genus 0 6
Tetraparvovirus 0 1
Norovirus 10 16
Betapolyomavirus 19 19
Rosavirus 0 6
unclassified Papillomaviridae genus 1 4
Betapapillomavirus 19 19
Lambdapapillomavirus 0 1
unclassified Anelloviridae genus 1 4
Nepovirus 1 1
Bocaparvovirus 19 19
Dependoparvovirus 19 19
Hepanhamaparvovirus 0 1
Lymphocryptovirus 19 19
Mamastrovirus 19 19
Polerovirus 1 5
Taupapillomavirus 1 7
Aviadenovirus 0 2
Chipapillomavirus 2 1
Roseolovirus 11 13
Molluscipoxvirus 19 18
Alphacoronavirus 3 3
Cytomegalovirus 19 19
Varicellovirus 7 1
Torovirus 1 1
Alphapolyomavirus 19 19
Rotavirus 19 19
Simplexvirus 19 19
Betacoronavirus 11 4
Orthopneumovirus 11 2
Respirovirus 3 0
Stralarivirus 1 0
Gammapapillomavirus 19 19
Picobirnavirus 1 10
unclassified Pneumoviridae genus 7 0
Enterovirus 13 6
Alphainfluenzavirus 19 19
Alphapapillomavirus 19 19
Betainfluenzavirus 1 0
Metapneumovirus 7 0
0 25 50 75 100
Weighted Mean Genome Completeness (%)
% of detections
IA: Indoor Air
WW: Wastewater
Higher in
Indoor Air
Tie
Wastewater
Sample Type
Indoor Air
Wastewater