




**LR for PH01-00 using uncalibrated
pressure values**

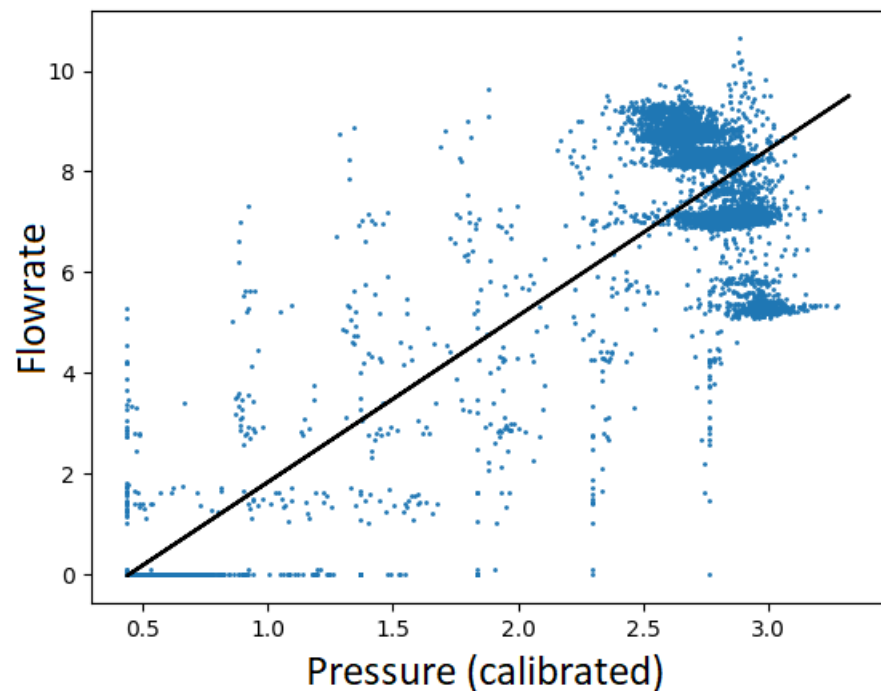

**LR for PH01-00 using calibrated
pressure values**

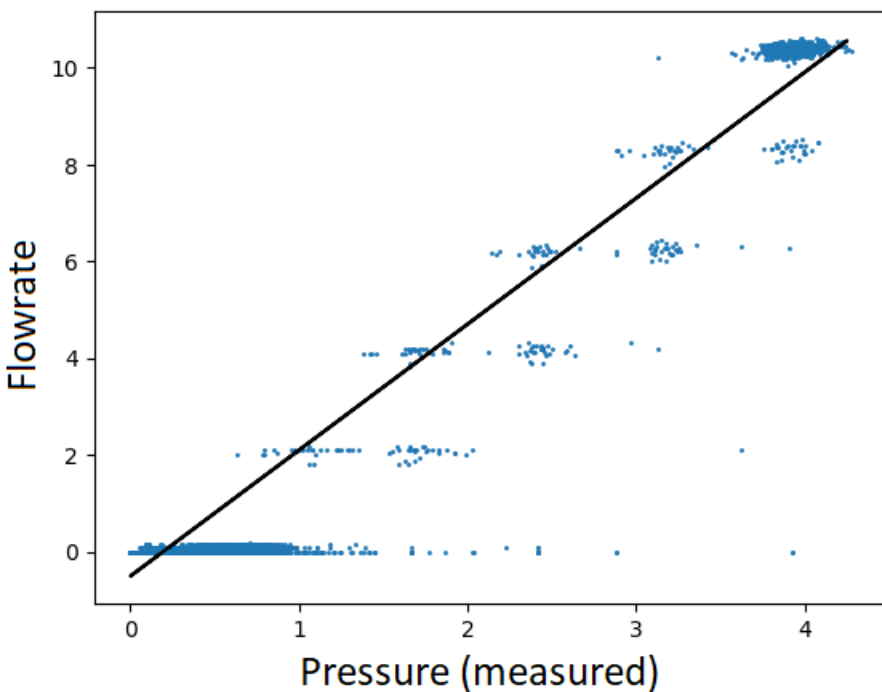

**LR for PH03-02 using uncalibrated
pressure values**

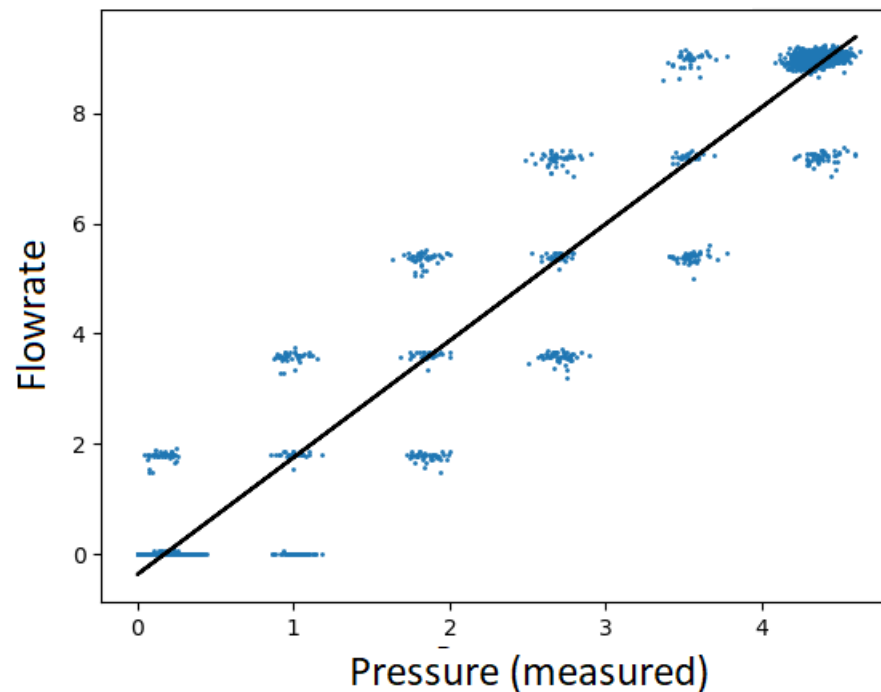

**LR for PH03-03 using uncalibrated
pressure values**