PTC - Avenida D. Manuel I
Zona Industrial de Ovar
3880-109 OVAR

YAZAKI
PORTO TECHNICAL CENTRE

APPLICATOR VALIDATION REPORT

(Spec. YEL-RP-02-0004)

Applicator Serial Nº
A1700929

TOOLS MANAGEMENT INFORMATION ---> TOOL Nº 7004-5626 G1 SEQUENCE Nº 9








Validation Terminal Nº	Accessory	Applicator Type	Purchasing Order Nº	Project / Model
7004-5626-02	*	**ADB**	**YSD-4514127913**	*

Applicable Terminals for this Tool:

7004-5626-02							

Anvil		Wire Crimper		Insulation Crimper	
7004-5626-Z0DA	(N)	7004-5626-Z0DW	(N)	NA	
CW (c)	*CW (i)*	*CW*		*CW*	


1 - VISUAL / MEASURED CHECK ITEMS

			Spec. (*)	Value (**)	O - ok X - ng NA - not aplicable		
	The two sides of the insulation grips are in the correct position.	**NA**	0~2.00mm 0~2.00mm	0.64 0.28		The Bell Mouth is within the spec.**(*)**	**O**
	Not found any Bell Mouth in the insulation area.	**NA**	NA	-		The dimension of the cutting carrier is within the spec.**(*)**	**NA**
	The lance height and shape are not deformed.	**NA**	3º 3º	- 1.1		Bend up and Bend down are within the criteria**(*)**	**O**
	Not found any burr in the cutting carrier.	**NA**	0~2.00mm	1.20		The exposed conductor is within the spec.(*)	**O**
	Not found any crack in the terminal.	**O**	3º	0.1		The terminal is not bent sideway, look-king from the top**(*)**	**O**
	The wire barrel is free from major burrs.	**O**	NA	-		The body of the terminal is not twisted**(*)**	**O**

(*) - Specified on Crimping Spec. **(**)** - Measured Value(From Lower Wire Kind&Size Sample)

LOWER WIRE KIND & SIZE	**UPPER** WIRE KIND & SIZE

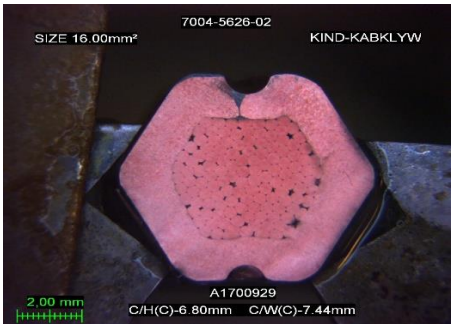2 - MICRO CUT SAMPLES



3 - CRIMPING HEIGHT STABILITY

	NOMINAL	AVERAGE	Cmk
mm	6,8	6,82	7,36
	+/-0.2		

	NOMINAL	AVERAGE	Cmk
mm	NA		
	+/-NA		

REMARKS:

Aplicable wire range-16.00~16.00mm²

EVALUATION DECISION

SUITABLE [X]
NOT SUITABLE [ ]
FOR USE IN PRODUCTION

APPROVED (Section Chief) 3485	CHECKED (Operator) 44	PREPARED (Operator) nº 2624
Date: 2025/jan/03	Date: 2025/jan/03	Date: 2024/dez/23

YAZAKI
PORTO TECHNICAL CENTRE

APPLICATOR VALIDATION REPORT

Applicator Serial Nº
A1700929

LOWER WIRE KIND & SIZE

Wire kind: KABFLYW

Wire size: 16 mm²

Nominal Cr. Height:	6,8	NA	mm
+/-	0,2	NA	mm

Sample number	Crimp height WIRE (mm)	Crimp height INSULATION (mm)
1	6,820	
2	6,824	
3	6,828	
4	6,823	
5	6,825	
6	6,829	
7	6,833	
8	6,831	
9	6,828	
10	6,825	
11	6,832	
12	6,835	
13	6,844	
14	6,836	
15	6,846	
16	6,839	
17	6,831	
18	6,826	
19	6,824	
20	6,825	
21	6,824	
22	6,819	
23	6,820	
24	6,835	
25	6,835	
26	6,830	
27	6,821	
28	6,819	
29	6,821	
30	6,823	
31	6,829	
32	6,831	
33	6,821	
34	6,817	
35	6,813	
36	6,817	
37	6,825	
38	6,829	
39	6,822	
40	6,817	
41	6,813	
42	6,814	
43	6,820	
44	6,824	
45	6,815	
46	6,813	
47	6,811	
48	6,816	
49	6,822	
50	6,825	
Average	6,82	
Cmk	7,36	

UPPER WIRE KIND & SIZE

Wire kind: NA + NA

Wire size: NA + NA mm²

Nominal Cr. Height:	NA	NA	mm
+/-	NA	NA	mm


Sample number	Crimp height WIRE (mm)	Crimp height INSULATION (mm)
1		
2		
3		
4		
5		
6		
7		
8		
9		
10		
11		
12		
13		
14		
15		
16		
17		
18		
19		
20		
21		
22		
23		
24		
25		
26		
27		
28		
29		
30		
31		
32		
33		
34		
35		
36		
37		
38		
39		
40		
41		
42		
43		
44		
45		
46		
47		
48		
49		
50		
Average		
Cmk		

Acceptance criteria: Cmk>= 2,0

END

APP 90 HAND FEED CONSUMABLE PART LIST

A1700929	7004-5626G1

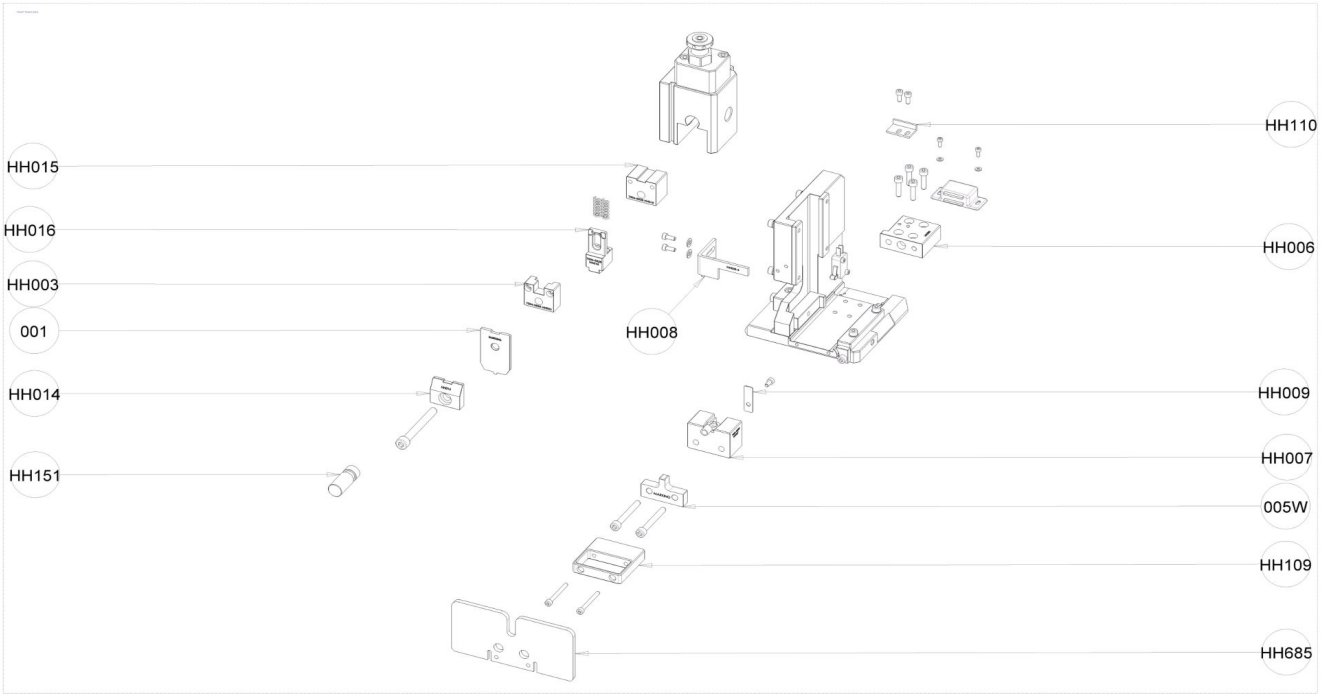

NUMBER	PARTS NUMBER	PARTS NAME	QUANTITY
001	***7004-5626-Z0BW***	WIRE CRIMPER	1
005W	***7004-5626-Z0BA***	WIRE ANVIL	1
HH003	7004-5626 HH003	SPACER A	1
HH006	HH006	ANVIL SUPPORTER	1
HH007	7004-5626 HH007	TERMINAL HOLDER	1
HH008	HH008-3	STRIPPER	1
HH009	7004-5626 HH009	TERMINAL GUIDE	1
HH014	HH014	CRIMPER HOLDER	1
HH015	7004-5626 HH015	SPACER B	1
HH016	7004-5626 HH016	HOLD DOWN	1
HH109	HH109	LEVER	1
HH110	HH110	SWITCH LEVER	1
HH151	HH151	INSULATION ADJUSTER DIAL	1
HH685	HH685	SAFETY COVER FC143685	1