PTC - Avenida D. Manuel I
Zona Industrial de Ovar
3880-109 OVAR

YAZAKI
PORTO TECHNICAL CENTRE

APPLICATOR VALIDATION REPORT

(Spec. YEL-RP-02-0004)

Applicator Serial Nº
A1700943

TOOLS MANAGEMENT INFORMATION ---> TOOL Nº 7004-5670 G1 SEQUENCE Nº 9







Validation Terminal Nº	Accessory	Applicator Type	Purchasing Order Nº	Project / Model
7004-5670-02	*	**ADB**	**YSD 4514155668**	**ILER TRUCK BEV**

Applicable Terminals for this Tool:

7004-5670-02				

Anvil			Wire Crimper			Insulation Crimper		
7004-5670-Z0DA		(N)	7004-5670-Z0DW		(N)	NA		
CW (c)	*CW (i)*		*CW*			*CW*		

1 - VISUAL / MEASURED CHECK ITEMS

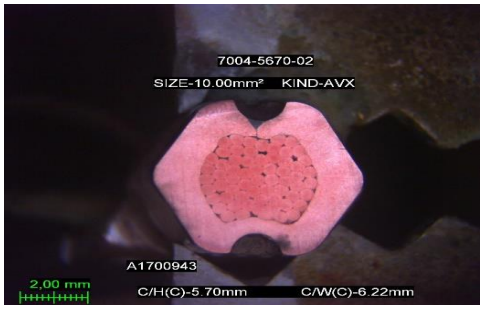
			Spec. (*)	Value (**)			
	The two sides of the insulation grips are in the correct position.	**O**	0.00~2.00mm 0.00~2.00mm	0.30 0.56		The Bell Mouth is within the spec.**(*)**	**O**
	Not found any Bell Mouth in the insulation area.	**O**				The dimension of the cutting carrier is within the spec.**(*)**	**NA**
	The lance height and shape are not deformed.	**O**	3º 3º	0.4 --		Bend up and Bend down are within the criteria**(*)**	**O**
	Not found any burr in the cutting carrier.	**O**	0.00~2.00mm	0.52		The exposed conductor is within the spec.(*)	**O**
	Not found any crack in the terminal.	**O**	3º	0.4		The terminal is not bent sideway, look-king from the top**(*)**	**O**
	The wire barrel is free from major burrs.	**O**	2º	0.2		The body of the terminal is not twisted**(*)**	**O**

(*) - Specified on Crimping Spec.

(**) - Measured Value(From Lower Wire Kind&Size Sample)

LOWER WIRE KIND & SIZE	**UPPER** WIRE KIND & SIZE

2 - MICRO CUT SAMPLES



3 - CRIMPING HEIGHT STABILITY

	NOMINAL	AVERAGE	Cmk
mm	5,7	5,70	14,54
	+/-0.2		

	NOMINAL	AVERAGE	Cmk
mm	NA		
	+/-NA		

REMARKS:

Aplicable wire range 10.00mm²

EVALUATION DECISION

SUITABLE [X]
NOT SUITABLE [ ]

FOR USE IN PRODUCTION

APPROVED (Section Chief) 3485	CHECKED (Operator) 44	PREPARED (Operator) nº 18388
Date: 2025/fev/12	Date: 2025/fev/12	Date: 2025/fev/05

YAZAKI
PORTO TECHNICAL CENTRE

APPLICATOR VALIDATION REPORT

Applicator Serial Nº
A1700943

LOWER WIRE KIND & SIZE

Wire kind:	AVX		
Wire size:	10		mm^2
Nominal Cr. Height:	5,7	NA	mm
+/-	0,2	NA	mm

Sample number	Crimp height WIRE (mm)	Crimp height INSULATION (mm)
1	5,708	
2	5,707	
3	5,706	
4	5,699	
5	5,706	
6	5,698	
7	5,708	
8	5,696	
9	5,708	
10	5,706	
11	5,703	
12	5,706	
13	5,698	
14	5,703	
15	5,708	
16	5,706	
17	5,707	
18	5,698	
19	5,706	
20	5,708	
21	5,697	
22	5,708	
23	5,708	
24	5,696	
25	5,708	
26	5,708	
27	5,697	
28	5,706	
29	5,708	
30	5,698	
31	5,699	
32	5,708	
33	5,708	
34	5,708	
35	5,706	
36	5,707	
37	5,708	
38	5,708	
39	5,699	
40	5,706	
41	5,708	
42	5,696	
43	5,697	
44	5,706	
45	5,708	
46	5,703	
47	5,707	
48	5,708	
49	5,697	
50	5,708	
Average	5,70	
Cmk	14,54	

UPPER WIRE KIND & SIZE

Wire kind:	NA	+	NA	
Wire size:	NA	+	NA	mm^2
Nominal Cr. Height:	NA		NA	mm
+/-	NA		NA	mm

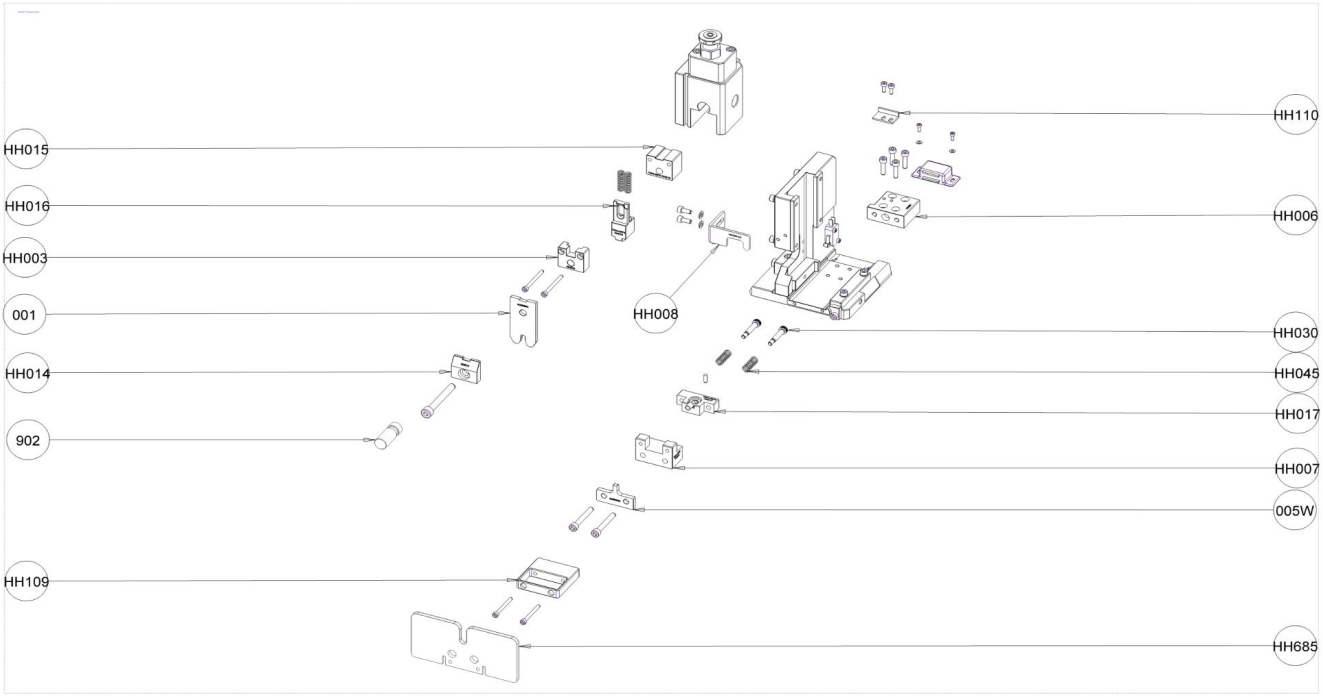
Sample number	Crimp height WIRE (mm)	Crimp height INSULATION (mm)
1		
2		
3		
4		
5		
6		
7		
8		
9		
10		
11		
12		
13		
14		
15		
16		
17		
18		
19		
20		
21		
22		
23		
24		
25		
26		
27		
28		
29		
30		
31		
32		
33		
34		
35		
36		
37		
38		
39		
40		
41		
42		
43		
44		
45		
46		
47		
48		
49		
50		
Average		
Cmk		

Acceptance criteria: Cmk>= 2,0

END

APP 90 HAND FEED CONSUMABLE PART LIST

A1700943 | **7004-5670G1**



NUMBER	PARTS NUMBER	PARTS NAME	QUANTITY
001	***7004-5670-Z0DW***	WIRE CRIMPER	1
005W	***7004-5670-Z0DA***	WIRE ANVIL	1
HH003	HH003	SPACER A	1
HH006	HH006	ANVIL SUPPORTER	1
HH007	7004-5670 HH007	TERMINAL HOLDER	1
HH008	HH008-3U	STRIPPER	1
HH014	HH014	CRIMPER HOLDER	1
HH015	7004-5670 HH015	SPACER B	1
HH016	7004-5670 HH016	HOLD DOWN	1
HH017	7004-5670 HH017	TERMINAL HOLDER COVER	1
HH030	Ø6 x 25 (ISO 7379)	SHOULDER SCREW	2
HH045	48A013010	SPRING	2
HH109	HH109	LEVER	1
HH110	HH110	SWITCH LEVER	1
HH151	HP81-0009A	INSULATION ADJUSTER DIAL	1
HH685	HH685	SAFETY COVER FC143685	1