PTC - Avenida D. Manuel I
Zona Industrial de Ovar
3880-109 OVAR

YAZAKI
PORTO TECHNICAL CENTRE

APPLICATOR VALIDATION REPORT

(Spec. YEL-RP-02-0004)

Applicator Serial Nº
A0201415

TOOLS MANAGEMENT INFORMATION ---> TOOL Nº 70032908 SEQUENCE Nº 9

Terminal Nº	Rubber Seal	Applicator Type	Purchasing Order Nº	Project / Model
7003-2908-02	*	**BATTERY CABLE**	**YSD-3500134748**	*






Anvil		
7003-2908BAN/7003-2908BAP		(N/N)
CW (c) 14.45	*CW (i)* 16.55	


Wire Crimper	
7003-2908BW	(N)
CW 14.45	

Insulation Crimper	
7003-2908BI	(N)
CW 16.55	

1 - VISUAL CHECK ITEMS

O - ok **X** - ng **NA** - not aplicable

	The two sides of the insulation grips are in the correct position.	O
	Not found any Bell Mouth in the insulation area.	O
	The lance height and shape are not deformed.	NA
	Not found any burr in the cutting carrier.	NA
	Not found any crack in the terminal.	O
	The wire barrel is free from major burrs.	O

	The Bell Mouth is within the spec.**(*)**	O
	The dimension of the cutting carrier is within the spec.**(*)**	NA
	Bend up and Bend down are within the criteria**(*)**	O
	The exposed conductor is within the spec.(*)	O
	The terminal is not bent sideway, look-king from the top**(*)**	O
	The body of the terminal is not twisted**(*)**	O

LOWER WIRE KIND & SIZE	**UPPER** WIRE KIND & SIZE

2 - MICRO CUT SAMPLES





3 - CRIMPING HEIGHT STABILITY

	NOMINAL	AVERAGE	Cmk
mm	9	9.05	6.51
	+/-0.2		



	NOMINAL	AVERAGE	Cmk
mm	10.1	10.14	5.94
	+/-0.2		

REMARKS:

Aplicable wire range-35.0mm²~50.0mm².
Wire 35.0mm² C/W(I)-16.42mm
Wire 50.0mm² C/W(I)-16.90mm

EVALUATION DECISION

SUITABLE [X]
NOT SUITABLE [ ]
FOR USE IN PRODUCTION

APPROVED (Section Chief) 3485	CHECKED (Operator) 44	PREPARED (Operator) nº 5061
		
Date: 2019-ago-30	Date: 2019-ago-26	Date: 2019-ago-26

YAZAKI
PORTO TECHNICAL CENTRE

APPLICATOR VALIDATION REPORT

Applicator Serial Nº
A0201415

LOWER WIRE KIND & SIZE

Wire kind: FCF4

Wire size: 35 mm²

Nominal Cr. Height:	9	14.6	mm
+/-	0.2	0.2	mm

Sample number	Crimp height WIRE (mm)	Crimp height INSULATION (mm)
1	9.065	14.629
2	9.056	14.636
3	9.070	14.625
4	9.073	14.606
5	9.063	14.633
6	9.052	14.646
7	9.062	14.617
8	9.064	14.603
9	9.053	14.647
10	9.046	14.610
11	9.042	14.629
12	9.040	14.618
13	9.056	14.605
14	9.050	14.631
15	9.046	14.660
16	9.045	14.640
17	9.056	14.636
18	9.064	14.648
19	9.059	14.631
20	9.058	14.616
21	9.061	14.642
22	9.048	14.639
23	9.044	14.647
24	9.053	14.624
25	9.043	14.616
26	9.051	14.648
27	9.051	14.623
28	9.053	14.618
29	9.042	14.631
30	9.048	14.618
31	9.053	14.610
32	9.057	14.648
33	9.047	14.627
34	9.043	14.646
35	9.055	14.623
36	9.058	14.640
37	9.047	14.617
38	9.045	14.631
39	9.044	14.612
40	9.051	14.610
41	9.049	14.623
42	9.046	14.649
43	9.055	14.654
44	9.055	14.623
45	9.048	14.647
46	9.059	14.652
47	9.047	14.623
48	9.054	14.649
49	9.048	14.624
50	9.055	14.641
Average	9.05	14.63
Cmk	6.51	3.84

UPPER WIRE KIND & SIZE

Wire kind: A42X

Wire size: 50 mm²

Nominal Cr. Height:	10.1	16.9	mm
+/-	0.2	0.2	mm

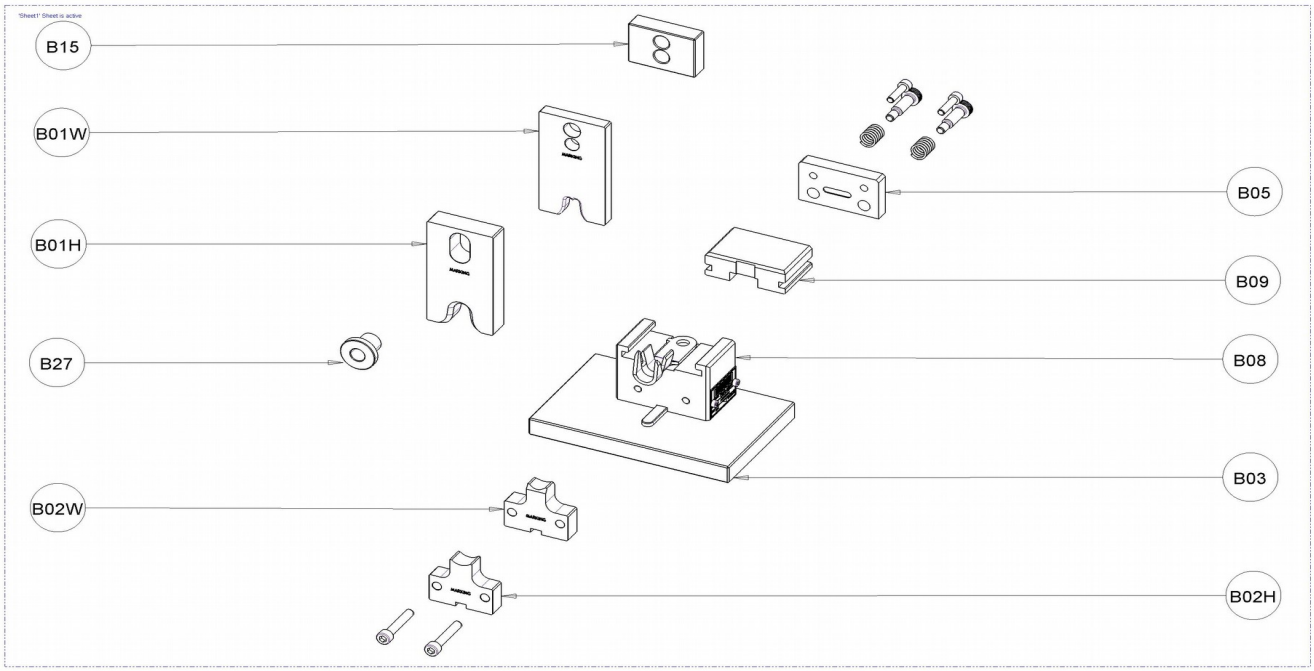
Sample number	Crimp height WIRE (mm)	Crimp height INSULATION (mm)
1	10.133	16.941
2	10.138	16.927
3	10.141	16.920
4	10.142	16.933
5	10.145	16.948
6	10.135	16.926
7	10.143	16.917
8	10.141	16.939
9	10.133	16.938
10	10.143	16.914
11	10.132	16.946
12	10.125	16.937
13	10.138	16.919
14	10.141	16.948
15	10.148	16.921
16	10.140	16.916
17	10.134	16.944
18	10.142	16.919
19	10.152	16.915
20	10.154	16.948
21	10.144	16.954
22	10.143	16.916
23	10.148	16.940
24	10.160	16.942
25	10.146	16.952
26	10.138	16.934
27	10.126	16.952
28	10.124	16.930
29	10.139	16.922
30	10.150	16.927
31	10.156	16.918
32	10.138	16.905
33	10.128	16.941
34	10.153	16.914
35	10.134	16.902
36	10.127	16.949
37	10.155	16.921
38	10.134	16.913
39	10.133	16.952
40	10.144	16.921
41	10.146	16.914
42	10.126	16.940
43	10.135	16.920
44	10.140	16.911
45	10.128	16.911
46	10.131	16.940
47	10.144	16.932
48	10.149	16.920
49	10.156	16.916
50	10.139	16.932
Average	10.14	16.93
Cmk	5.94	4.01

Acceptance criteria: Cmk>= 2.0

END

APP BATTERY CABLE CONSUMABLE PART LIST

A0201415	7003-2908



NUMBER	PARTS NUMBER	PARTS NAME	QUANTITY
B01H	*7003-2908BI*	INSULATION CRIMPER	1
B01W	*7003-2908BW*	WIRE CRIMPER	1
B02H	*7003-2908BAP*	INSULATION ANVIL	1
B02W	*7003-2908BAN*	WIRE ANVIL	1
B03	7003-2908 B03	DIE BASE	1
B05	7003-2908 B05	STOPPER PLATE	1
B08	7003-2908 B08	MAIN BLOCK	1
B09	7003-2908 B09	SLIDER	1
B15	7003-2908 B15	FRAME SPACER	1
B27	*7003-2908BYC*	BUSH	1