PTC - Avenida D. Manuel I
Zona Industrial de Ovar
3880-109 OVAR

YAZAKI
PORTO TECHNICAL CENTRE

APPLICATOR VALIDATION REPORT

(Spec. YEL-RP-02-0004)

Applicator Serial Nº
1903E085

TOOLS MANAGEMENT INFORMATION ---> TOOL Nº 72961294 SEQUENCE Nº 9

Terminal Nº	Rubber Seal	Applicator Type	Purchasing Order Nº	Project / Model
7296-1294-02	**7158-3038-70**	**04 SIDE FEED**	**YSD-3500116806**	*







Anvil		
7296-1294XAD		(N)
CW (c) 1,64	*CW (i)* 3,20	




Wire Crimper	
7296-1294XW	(N)
CW 1,62	

Insulation Crimper	
7296-1294XID	(N)
CW 3,20	

1 - VISUAL CHECK ITEMS

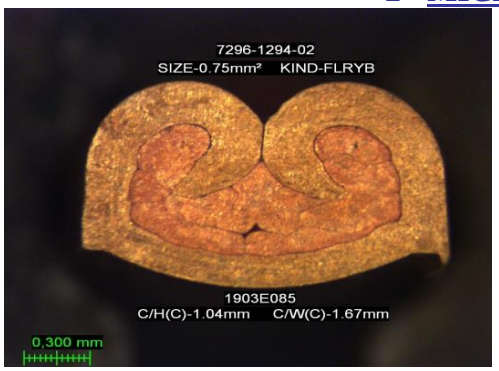
O - ok **X** - ng **NA** - not aplicable

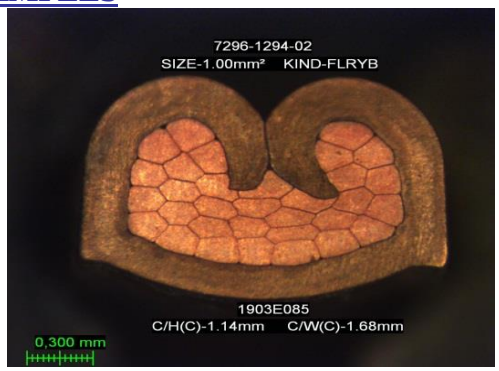
	The two sides of the insulation grips are in the correct position.	O
	Not found any Bell Mouth in the insulation area.	O
	The lance height and shape are not deformed.	O
	Not found any burr in the cutting carrier.	O
	Not found any crack in the terminal.	O
	The wire barrel is free from major burrs.	O

	The Bell Mouth is within the spec.**(*)**	O
	The dimension of the cutting carrier is within the spec.**(*)**	O
	Bend up and Bend down are within the criteria**(*)**	O
	The exposed conductor is within the spec.(*)	O
	The terminal is not bent sideway, look-king from the top**(*)**	O
	The body of the terminal is not twisted**(*)**	O

LOWER WIRE KIND & SIZE	**UPPER** WIRE KIND & SIZE

2 - MICRO CUT SAMPLES





3 - CRIMPING HEIGHT STABILITY

	NOMINAL	AVERAGE	Cmk
mm	1,04	1,04	3,21
	+/-0.03		

	NOMINAL	AVERAGE	Cmk
mm	1,14	1,15	2,01
	+/-0.03		

REMARKS:

Aplicable wire range 0.75mm²~1.00mm².
Size 0.75mm² C/W(I)-3.19mm
Size 1.00mm² C/W(I)-3.23mm

EVALUATION DECISION

SUITABLE [X]
NOT SUITABLE [ ]
FOR USE IN PRODUCTION

APPROVED (Section Chief) 3485	CHECKED (Operator) 44	PREPARED (Operator) nº 2988
		Jitor Hugo
Date: 2019-abr-08	Date: 2019-abr-05	Date: 2019-abr-05

YAZAKI
PORTO TECHNICAL CENTRE

APPLICATOR VALIDATION REPORT

Applicator Serial Nº
1903E085

LOWER WIRE KIND & SIZE

Wire kind: FLRYB

Wire size: 0,75 mm²

Nominal Cr. Height:	1,04	3	mm
+/-	0,03	0,1	mm

Sample number	Crimp height WIRE (mm)	Crimp height INSULATION (mm)
1	1,048	3,009
2	1,043	3,005
3	1,043	3,010
4	1,047	3,002
5	1,041	3,012
6	1,041	3,007
7	1,045	3,011
8	1,042	3,010
9	1,039	3,000
10	1,044	3,004
11	1,040	3,008
12	1,044	3,000
13	1,046	3,002
14	1,042	3,008
15	1,046	3,003
16	1,044	2,999
17	1,042	3,006
18	1,043	3,002
19	1,040	2,997
20	1,044	3,005
21	1,045	2,997
22	1,038	3,002
23	1,041	3,005
24	1,042	3,007
25	1,043	2,999
26	1,045	3,008
27	1,045	3,009
28	1,038	3,000
29	1,043	3,008
30	1,046	3,000
31	1,039	2,997
32	1,043	2,995
33	1,046	3,003
34	1,045	3,001
35	1,046	2,998
36	1,041	3,007
37	1,049	3,004
38	1,040	2,995
39	1,038	3,005
40	1,045	3,006
41	1,047	3,008
42	1,044	2,998
43	1,045	3,010
44	1,045	3,011
45	1,047	3,001
46	1,041	3,008
47	1,047	3,001
48	1,046	3,001
49	1,041	3,000
50	1,045	3,006
Average	1,04	3,00
Cmk	3,21	7,02

UPPER WIRE KIND & SIZE

Wire kind: FLRYB

Wire size: 1 mm²

Nominal Cr. Height:	1,14	3,15	mm
+/-	0,03	0,1	mm

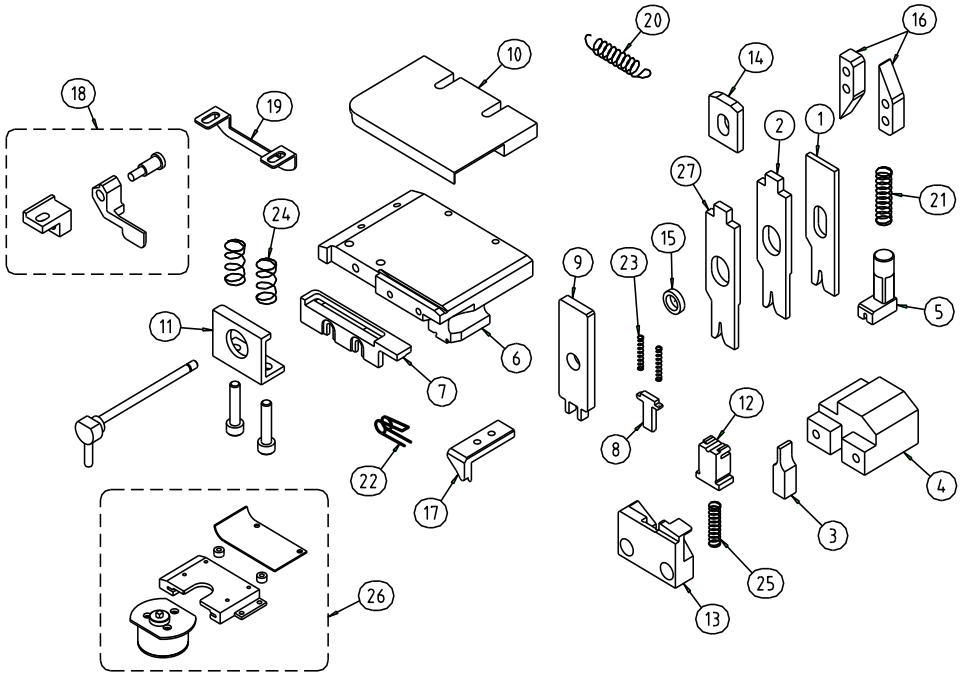
Sample number	Crimp height WIRE (mm)	Crimp height INSULATION (mm)
1	1,139	3,151
2	1,142	3,150
3	1,139	3,156
4	1,143	3,149
5	1,139	3,155
6	1,144	3,157
7	1,145	3,150
8	1,147	3,158
9	1,141	3,152
10	1,144	3,158
11	1,145	3,160
12	1,142	3,154
13	1,139	3,157
14	1,146	3,154
15	1,143	3,149
16	1,147	3,154
17	1,147	3,157
18	1,144	3,152
19	1,149	3,158
20	1,149	3,150
21	1,142	3,158
22	1,150	3,152
23	1,152	3,151
24	1,149	3,160
25	1,146	3,153
26	1,149	3,152
27	1,147	3,160
28	1,150	3,154
29	1,148	3,160
30	1,144	3,162
31	1,149	3,155
32	1,151	3,152
33	1,147	3,157
34	1,144	3,157
35	1,151	3,152
36	1,148	3,158
37	1,145	3,161
38	1,152	3,151
39	1,147	3,148
40	1,150	3,150
41	1,152	3,156
42	1,153	3,150
43	1,146	3,156
44	1,152	3,152
45	1,150	3,150
46	1,146	3,157
47	1,151	3,152
48	1,151	3,153
49	1,144	3,159
50	1,151	3,155
Average	1,15	3,15
Cmk	2,01	8,66

Acceptance criteria: Cmk>= 2,0

END

04 APPLICATOR CONSUMABLE PARTS LIST ／ 04 ｱﾌﾟﾘｹｰﾀｰ 消耗部品表

PRODUCT No. 製品番号	C0100-7117	TERMINAL No. 端子品番	7296-1294 ① DD
共通品番	– – – – – – – –		



No,	PARTS No, 部品番号	DRW No, 図番	PARTS NAME 部品名称	No,	PARTS No, 部品番号	DRW No, 図番	PARTS NAME 部品名称
1	7296-1294XW ①		WIRE CRIMPER ﾜｲﾔｰｸﾘﾝﾊﾟｰ	17	48A47013	-001	FEEDING CLAW 送り爪
2	7296-1294XID ①		INSULATION CRIMPER ｲﾝｼｭﾚｰｼｮﾝｸﾘﾝﾊﾟｰ	18	48A19100	-005	WIRE STOPPER Assy 電線ｽﾄｯﾊﾟｰ ｱｯｼｰ
3	7296-1294XAD ①		ANVIL ｱﾝﾋﾞﾙ	19	48A19047	-001	TERMINAL SCRAPER 端子掻き落とし
4	7296-1294XJE ①		ANVIL HOLDER ｱﾝﾋﾞﾙﾎﾙﾀﾞｰ	20	48A47031		RETURN SPRING 戻しｽﾌﾟﾘﾝｸﾞ
5	7296-1294XYY ①		SUPPORTING STOPPER ｻﾎﾟｰﾃｨﾝｸﾞｽﾄｯﾊﾟｰ	21	48A47032	-001	SUPPORTING STOPPER SPRING ｻﾎﾟｰﾃｨﾝｸﾞｽﾄｯﾊﾟｰｽﾌﾟﾘﾝｸﾞ
6	7296-1294XYB ①		BASE ﾍﾞｰｽ	22	48A19017	-003	FEEDING CLAW SPRING 送り爪ｽﾌﾟﾘﾝｸﾞ
7	7296-1294XYH ①		TERMINAL GUIDE PLATE B ﾀｰﾐﾅﾙｶﾞｲﾄﾞﾌﾟﾚｰﾄB	23	48A19023	-002	WIRE HOLDER SPRING 電線押さえｽﾌﾟﾘﾝｸﾞ
8	48A47016	-002	WIRE HOLDER 電線押さえ	24	48A19074		TERMINAL HOLDER SPRING ﾀｰﾐﾅﾙ押さえｽﾌﾟﾘﾝｸﾞ
9	48A47017	-003	CUTTING PUNCH & WIRE HOLDER 切断ﾎﾟﾝﾁ兼電線押さえﾎﾙﾀﾞｰ	25	48A19050		SHEARBLADE SPRING ｼｬｰﾌﾞﾚｰﾄﾞｽﾌﾟﾘﾝｸﾞ
10	48A47020	-A03	TERMINAL GUIDE PLATE A ﾀｰﾐﾅﾙｶﾞｲﾄﾞﾌﾟﾚｰﾄA	26	48A19999		TERMINAL OIL UNIT ﾀｰﾐﾅﾙ塗油ﾕﾆｯﾄ
11	48A47022	-001	TERMINAL HOLDER ﾀｰﾐﾅﾙ押さえ		7296-1294XKP ①		BRACKET ﾌﾞﾗｹｯﾄ
12	48A19049	-001	SHEARBLADE ｼｬｰﾌﾞﾚｰﾄﾞ	27	~~7296-1294XQ ①~~		~~STABILIZER CRIMPER ｽﾀﾋﾞﾗｲｻﾞｰｸﾘﾝﾊﾟｰ~~
13	48A47025	-003	OUTER SHEARBLADE ｱｳﾀｰｼｬｰﾌﾞﾚｰﾄﾞ	〈OPTION ｵﾌﾟｼｮﾝ〉			
14	48A19007	-020	INSULATION ADJUSTING PIECE ｲﾝｼｭﾚｰｼｮﾝ調整ｺﾏ	13	48A47025	-101	OUTER SHEARBLADE ｱｳﾀｰｼｬｰﾌﾞﾚｰﾄﾞ
15	48A19019	-032	BUSH ﾌﾞｯｼｭ	14	48A47042	-002	INSULATION ADJUSTING PIECE(MECAL) ｲﾝｼｭﾚｰｼｮﾝ調整ｺﾏ(ﾒｶﾙ)
16	48A47014	-001	FEEDING CAM 送りｶﾑ				

MARK 記号	DATE 日付	REVISION RECORD 改訂記録	No. 番号	CHECKED 点検	APPRICATION POST 申請部署		ISSUED 発行
					PTC		
					DESIGNED DATE 設計日		
					27-05-2017		
					APPROVED 承認	DESIGNED 設計	
①	09-10-2017	Change No.7216-5554-9 → 7296-1294	PTC	C.F.Almeida	H.Hasegawa	C.F.Almeida	
					27-05-2017	27-05-2017	