PTC - Avenida D. Manuel I
Zona Industrial de Ovar
3880-109 OVAR

YAZAKI
PORTO TECHNICAL CENTRE

APPLICATOR VALIDATION REPORT

(Spec. YEL-RP-02-0004)

Applicator Serial Nº
1301E077

TOOLS MANAGEMENT INFORMATION ---> TOOL Nº 7216-7793 * SEQUENCE Nº 9









Validation Terminal Nº	Accessory	Applicator Type	Purchasing Order Nº	Project / Model
7216-7793-02	*	**MXSR**	**YSD-4514078965**	**AIMLER TRUCK B**

Applicable Terminals for this Tool:

7216-7793-02	**7216-7793-06**			

Anvil		Wire Crimper		Insulation Crimper	
7216-7793XA	(N)	7216-7793XW	(1)	7216-7793XI	(1)
CW (c) 1,42	*CW (i)* 1,83	*CW* 1,40		*CW* 1,83	

1 - VISUAL / MEASURED CHECK ITEMS

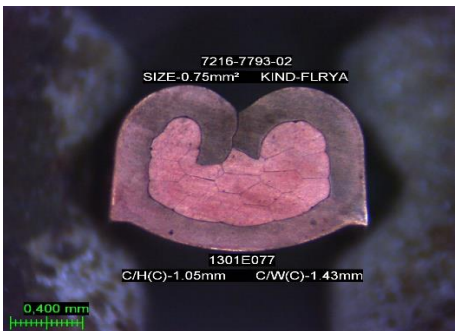
			Spec. (*)	Value (**)			
						O - ok X - ng NA - not aplicable	
	The two sides of the insulation grips are in the correct position.	O	0~0.35mm 0.15~0.35mm	0.14 0.32		The Bell Mouth is within the spec.(*)	O
	Not found any Bell Mouth in the insulation area.	O	0~0.30mm	0.28		The dimension of the cutting carrier is within the spec.(*)	O
	The lance height and shape are not deformed.	O	0~0.20mm 0~0.20mm	0.09 -		Bend up and Bend down are within the criteria(*)	O
	Not found any burr in the cutting carrier.	O	0.10~0.40mm	0.33		The exposed conductor is within the spec.(*)	O
	Not found any crack in the terminal.	O	5º	0.2		The terminal is not bent sideway, look-king from the top(*)	O
	The wire barrel is free from major burrs.	O	0~0.30mm	0.05		The body of the terminal is not twisted(*)	O

(*) - Specified on Crimping Spec. **(**)** - Measured Value(From Lower Wire Kind&Size Sample)

LOWER WIRE KIND & SIZE	**UPPER** WIRE KIND & SIZE

2 - MICRO CUT SAMPLES





3 - CRIMPING HEIGHT STABILITY

	NOMINAL	AVERAGE	Cmk
mm	0,93	0,93	3,33
	+/-0.03		

	NOMINAL	AVERAGE	Cmk
mm	1,05	1,05	4,03
	+/-0.05		

REMARKS:

Aplicable wire range 0.50mm²~0.75mm².
Size 0.50mm² C/W(I)-1.89mm
Size 0.75mm² C/W(I)-1.93mm

EVALUATION DECISION

SUITABLE [X]
NOT SUITABLE [ ]
FOR USE IN PRODUCTION

APPROVED (Section Chief) 3485	CHECKED (Operator) 44	PREPARED (Operator) nº 2988
Date: 2024/jul/08	Date: 2024/jun/24	Date: 2024/jun/21

YAZAKI
PORTO TECHNICAL CENTRE

APPLICATOR VALIDATION REPORT

Applicator Serial Nº
1301E077

LOWER WIRE KIND & SIZE

Wire kind: FLRYA

Wire size: 0,5 mm²

Nominal Cr. Height:	0,93	1,85	mm
+/-	0,03	0,1	mm

Sample number	Crimp height WIRE (mm)	Crimp height INSULATION (mm)
1	0,937	1,857
2	0,939	1,849
3	0,938	1,853
4	0,940	1,848
5	0,935	1,851
6	0,935	1,853
7	0,939	1,855
8	0,934	1,849
9	0,937	1,852
10	0,932	1,856
11	0,931	1,857
12	0,932	1,853
13	0,930	1,857
14	0,930	1,856
15	0,932	1,851
16	0,935	1,859
17	0,931	1,860
18	0,930	1,855
19	0,929	1,856
20	0,929	1,861
21	0,932	1,862
22	0,930	1,858
23	0,931	1,853
24	0,932	1,851
25	0,933	1,849
26	0,931	1,859
27	0,931	1,855
28	0,934	1,847
29	0,934	1,852
30	0,933	1,853
31	0,932	1,852
32	0,933	1,855
33	0,934	1,855
34	0,932	1,848
35	0,935	1,857
36	0,936	1,853
37	0,932	1,848
38	0,932	1,856
39	0,935	1,860
40	0,935	1,849
41	0,932	1,849
42	0,932	1,858
43	0,936	1,848
44	0,934	1,854
45	0,936	1,852
46	0,937	1,848
47	0,935	1,847
48	0,933	1,846
49	0,934	1,856
50	0,935	1,855
Average	0,93	1,85
Cmk	3,33	7,82

UPPER WIRE KIND & SIZE

Wire kind: FLRYA

Wire size: 0,75 mm²

Nominal Cr. Height:	1,05	2,05	mm
+/-	0,05	0,1	mm

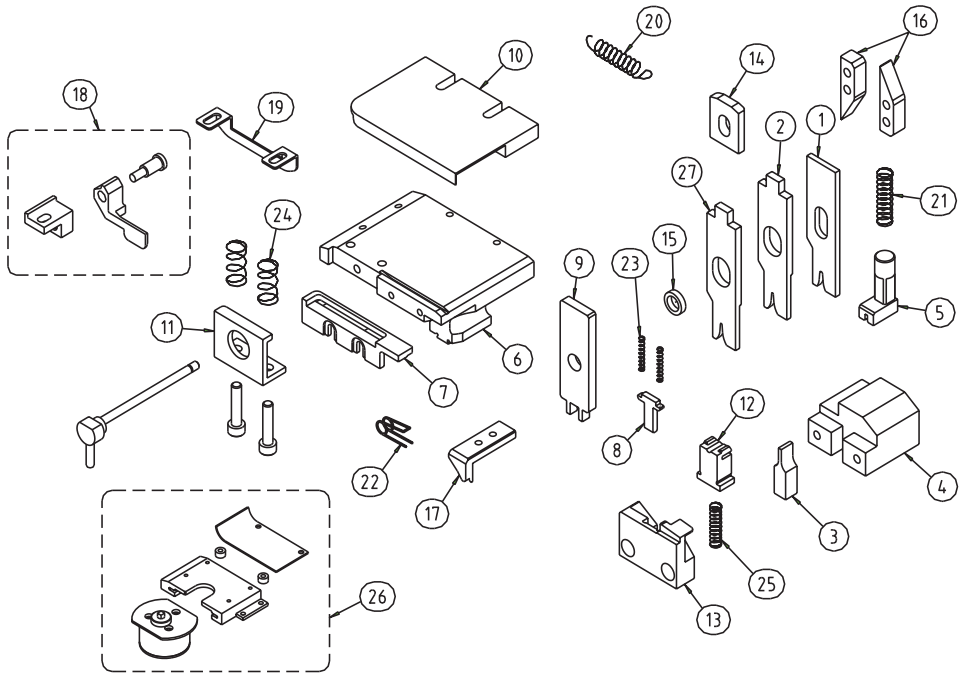
Sample number	Crimp height WIRE (mm)	Crimp height INSULATION (mm)
1	1,062	2,059
2	1,057	2,054
3	1,054	2,062
4	1,059	2,066
5	1,052	2,060
6	1,057	2,058
7	1,061	2,056
8	1,058	2,061
9	1,054	2,058
10	1,050	2,055
11	1,057	2,060
12	1,057	2,057
13	1,051	2,063
14	1,056	2,064
15	1,056	2,056
16	1,050	2,054
17	1,057	2,057
18	1,049	2,060
19	1,054	2,058
20	1,058	2,059
21	1,058	2,059
22	1,053	2,055
23	1,061	2,053
24	1,053	2,060
25	1,059	2,060
26	1,062	2,053
27	1,054	2,054
28	1,051	2,057
29	1,059	2,056
30	1,056	2,052
31	1,050	2,057
32	1,050	2,056
33	1,050	2,052
34	1,058	2,053
35	1,054	2,056
36	1,050	2,057
37	1,057	2,053
38	1,053	2,051
39	1,051	2,055
40	1,057	2,057
41	1,056	2,056
42	1,048	2,050
43	1,049	2,054
44	1,057	2,056
45	1,054	2,058
46	1,052	2,052
47	1,055	2,049
48	1,055	2,055
49	1,051	2,056
50	1,049	2,052
Average	1,05	2,06
Cmk	4,03	8,74

Acceptance criteria: Cmk>= 2,0

END

04 APPLICATOR CONSUMABLE PARTS LIST ／ 04 アプリケーター 消耗部品表

PRODUCT No. 製品番号	C0100-5633	TERMINAL No. 端子品番	7216-7793
共通品番	– – – – – – – –		



No,	PARTS No, 部品番号	DRW No, 図番	PARTS NAME 部品名称	No,	PARTS No, 部品番号	DRW No, 図番	PARTS NAME 部品名称
1	7216-7793XW		WIRE CRIMPER ワイヤークリンパー	17	48A47013	-001	FEEDING CLAW 送り爪
2	7216-7793XI		INSULATION CRIMPER インシュレーションクリンパー	18	48A19100	-005	WIRE STOPPER Assy 電線ストッパーアッシー
3	7216-7793XA		ANVIL アンビル	19	48A19047	002 ①	TERMINAL SCRAPER 端子掻き落とし
4	7216-7793XJE		ANVIL HOLDER アンビルホルダー	20	48A47031		RETURN SPRING 戻しスプリング
5	7216-7793XYY		SUPPORTING STOPPER サポーティングストッパー	21	48A47032	-001	SUPPORTING STOPPER SPRING サポーティングストッパースプリング
6	7216-7793XYB		BASE ベース	22	48A19017	-003	FEEDING CLAW SPRING 送り爪スプリング
7	7216-7793XYH		TERMINAL GUIDE PLATE B ターミナルガイドプレートB	23	48A19023	-002	WIRE HOLDER SPRING 電線押さえスプリング
8	48A47016	-001	WIRE HOLDER 電線押さえ	24	48A19074		TERMINAL HOLDER SPRING ターミナル押さえスプリング
9	48A47017	-002	CUTTING PUNCH & WIRE HOLDER 切断ポンチ兼電線押さえホルダー	25	48A19050		SHEARBLADE SPRING シャーブレードスプリング
10	48A47020	-A04	TERMINAL GUIDE PLATE A ターミナルガイドプレートA	26	48A19999		TERMINAL OIL UNIT ターミナル塗油ユニット
11	48A47022	-001	TERMINAL HOLDER ターミナル押さえ		7216-7793XKP		BRACKET ブラケット
12	48A47024	-001	SHEARBLADE シャーブレード	27	~~7216-7793XQ~~		~~STABILIZER CRIMPER スタビライザークリンパー~~
13	48A47025	-002	OUTER SHEARBLADE アウターシャーブレード	〈OPTION オプション〉			
14	48A19007	-025	INSULATION ADJUSTING PIECE インシュレーション調整コマ	13	48A47025	-101	OUTER SHEARBLADE アウターシャーブレード
15	48A19019	-019	BUSH ブッシュ	14	48A47042	-001	INSULATION ADJUSTING PIECE(MECAL) インシュレーション調整コマ(メカル)
16	48A47014	-003	FEEDING CAM 送りカム				

MARK 記号	DATE 日付	REVISION RECORD 改訂記録	No. 番号	CHECKED 点検	APPRICATION POST 申請部署	DESIGNED 設計	ISSUED 発行
					YUL		
					DESIGNED DATE 設計日		
					2/18/2013		
					APPROVED 承認	DESIGNED 設計	
①	2014/11/5	003→002	14K-021	Y.YAGI	T,Maki	C.Almeida	
					2/18/2013	2/18/2013	

ISSUE
5/29/2018
YAZAKI PARTS CO.,LTD. HIB MACHINE PRODUCT DEP.