PTC - Avenida D. Manuel I
Zona Industrial de Ovar
3880-109 OVAR

YAZAKI
PORTO TECHNICAL CENTRE

APPLICATOR VALIDATION REPORT

(Spec. YEL-RP-02-0004)

Applicator Serial Nº
A0201712

TOOLS MANAGEMENT INFORMATION ---> TOOL Nº 70037607 SEQUENCE Nº 9

Terminal Nº	Rubber Seal	Applicator Type	Purchasing Order Nº	Project / Model
7003-7607-02	*	**BC_G1**	**YSD-3500206820**	*





Anvil		
7003-7607-00BAN/7003-7607-00BAP		(N/N)
CW (c) 15.00	*CW (i)* 16.10	



Wire Crimper	
7003-7607-00BW	(N)
CW 14.36	

Insulation Crimper	
7003-7607-00BI	(N)
CW 15.12	

1 - VISUAL CHECK ITEMS

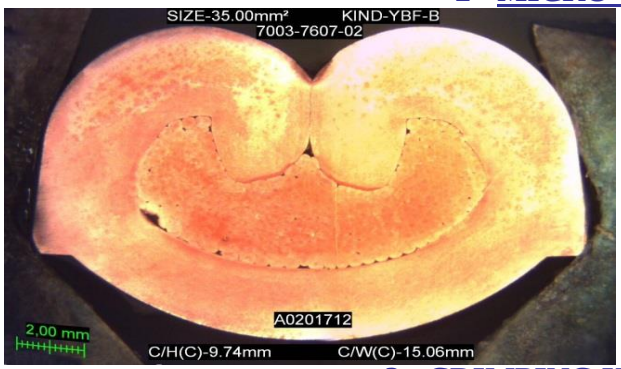
O - ok **X** - ng **NA** - not aplicable

	The two sides of the insulation grips are in the correct position.	O
	Not found any Bell Mouth in the insulation area.	O
	The lance height and shape are not deformed.	NA
	Not found any burr in the cutting carrier.	NA
	Not found any crack in the terminal.	O
	The wire barrel is free from major burrs.	O

	The Bell Mouth is within the spec.**(*)**	O
	The dimension of the cutting carrier is within the spec.**(*)**	NA
	Bend up and Bend down are within the criteria**(*)**	O
	The exposed conductor is within the spec.(*)	O
	The terminal is not bent sideway, looking from the top**(*)**	O
	The body of the terminal is not twisted**(*)**	O

LOWER WIRE KIND & SIZE	**UPPER** WIRE KIND & SIZE

2 - MICRO CUT SAMPLES



3 - CRIMPING HEIGHT STABILITY

	NOMINAL	AVERAGE	Cmk
mm	9.7	9.74	13.16
	+/-0.2		

	NOMINAL	AVERAGE	Cmk
mm	NA		
	+/-NA		

REMARKS:

Aplicable Wire Range 35.00mm²~50.00mm²
Wire 35.00mm² C/W(I)-15.50mm

EVALUATION DECISION

SUITABLE [X]
NOT SUITABLE [ ]
FOR USE IN PRODUCTION

APPROVED (Section Chief) 3485	CHECKED (Operator) 44	PREPARED (Operator) nº 678
Date: 2021/Feb/01	Date: 2021/Jan/26	Date: 2021/Jan/25

YAZAKI
PORTO TECHNICAL CENTRE

APPLICATOR VALIDATION REPORT

Applicator Serial Nº
A0201712

LOWER WIRE KIND & SIZE

Wire kind:	YBF-B		
Wire size:	35		mm^2
Nominal Cr. Height:	9.7	14.2	mm
+/-	0.2	0.2	mm

Sample number	Crimp height **WIRE** (mm)	Crimp height **INSULATION** (mm)
1	9.741	14.221
2	9.736	14.218
3	9.743	14.222
4	9.741	14.229
5	9.738	14.232
6	9.733	14.225
7	9.732	14.231
8	9.728	14.231
9	9.732	14.238
10	9.738	14.237
11	9.738	14.230
12	9.734	14.226
13	9.734	14.224
14	9.738	14.222
15	9.743	14.230
16	9.746	14.232
17	9.739	14.228
18	9.738	14.224
19	9.738	14.222
20	9.742	14.222
21	9.745	14.219
22	9.743	14.225
23	9.740	14.227
24	9.738	14.230
25	9.742	14.222
26	9.742	14.221
27	9.736	14.230
28	9.736	14.231
29	9.734	14.234
30	9.740	14.231
31	9.743	14.228
32	9.743	14.225
33	9.737	14.231
34	9.736	14.231
35	9.735	14.229
36	9.742	14.227
37	9.744	14.225
38	9.746	14.222
39	9.739	14.227
40	9.737	14.230
41	9.735	14.233
42	9.744	14.234
43	9.744	14.228
44	9.737	14.227
45	9.736	14.226
46	9.735	14.232
47	9.743	14.235
48	9.742	14.236
49	9.738	14.232
50	9.735	14.231
Average	9.74	14.23
Cmk	13.16	12.02

UPPER WIRE KIND & SIZE

Wire kind:	NA	+	NA	
Wire size:	NA	+	NA	mm^2
Nominal Cr. Height:	NA		NA	mm
+/-	NA		NA	mm

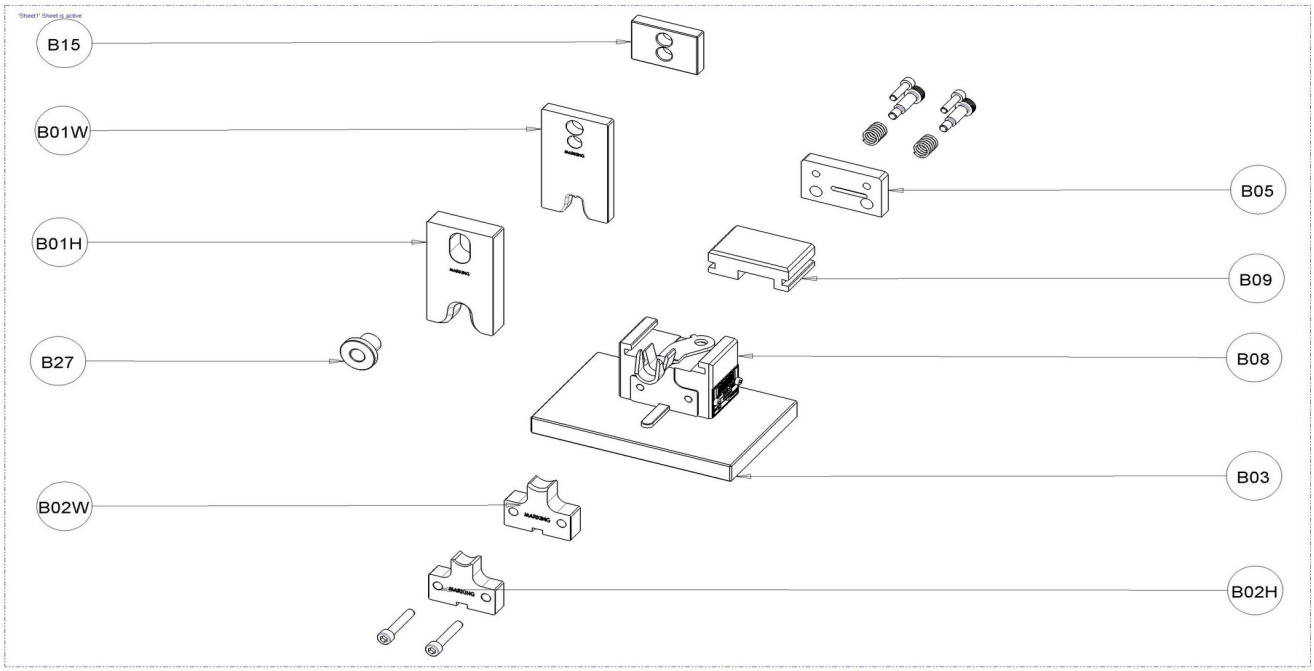
Sample number	Crimp height **WIRE** (mm)	Crimp height **INSULATION** (mm)
1		
2		
3		
4		
5		
6		
7		
8		
9		
10		
11		
12		
13		
14		
15		
16		
17		
18		
19		
20		
21		
22		
23		
24		
25		
26		
27		
28		
29		
30		
31		
32		
33		
34		
35		
36		
37		
38		
39		
40		
41		
42		
43		
44		
45		
46		
47		
48		
49		
50		
Average		
Cmk		

Acceptance criteria: Cmk>= 2.0

END

APP BATTERY CABLE CONSUMABLE PART LIST

A0201712 | **7003-7607**



NUMBER	PARTS NUMBER	PARTS NAME	QUANTITY
B01H	***7003-7607-00BI***	INSULATION CRIMPER	1
B01W	***7003-7607-00BW***	WIRE CRIMPER	1
B02H	***7003-7607-00BAP***	INSULATION ANVIL	1
B02W	***7003-7607-00BAN***	WIRE ANVIL	1
B03	7003-7607 B03	DIE BASE	1
B05	7003-7607 B05	STOPPER PLATE	1
B08	7003-7607 B08	MAIN BLOCK	1
B09	7003-7607 B09	SLIDER	1
B15	B15	FRAME SPACER	1
B27	***7003-7607-00BYC***	BUSH	1