PTC - Avenida D. Manuel I
Zona Industrial de Ovar
3880-109 OVAR

YAZAKI
PORTO TECHNICAL CENTRE

APPLICATOR VALIDATION REPORT

(Spec. YEL-RP-02-0004)

Applicator Serial Nº
A0201716





TOOLS MANAGEMENT INFORMATION ---> TOOL Nº 70037778 SEQUENCE Nº 9





Terminal Nº	Rubber Seal	Applicator Type	Purchasing Order Nº	Project / Model
7003-7778-02	*	**BC**	**YSD-3500198099**	*

Anvil		Wire Crimper		Insulation Crimper	
7003-7778-00BA	(N)	7003-7778-00BW	(N)	NA	
CW (c) 15.00	*CW (i)*	*CW* 14.36		*CW*	

1 - VISUAL CHECK ITEMS

O - ok **X** - ng **NA** - not aplicable

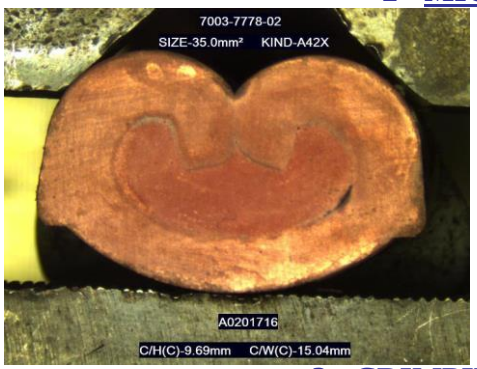
	The two sides of the insulation grips are in the correct position.	NA
	Not found any Bell Mouth in the insulation area.	NA
	The lance height and shape are not deformed.	NA
	Not found any burr in the cutting carrier.	NA
	Not found any crack in the terminal.	O
	The wire barrel is free from major burrs.	O

	The Bell Mouth is within the spec.**(*)**	O
	The dimension of the cutting carrier is within the spec.**(*)**	O
	Bend up and Bend down are within the criteria**(*)**	O
	The exposed conductor is within the spec.(*)	O
	The terminal is not bent sideway, look-king from the top**(*)**	O
	The body of the terminal is not twisted**(*)**	O

LOWER WIRE KIND & SIZE

UPPER WIRE KIND & SIZE

2 - MICRO CUT SAMPLES





3 - CRIMPING HEIGHT STABILITY

	NOMINAL	AVERAGE	Cmk
mm	9.7	9.72	5.22
	+/-0.2		

	NOMINAL	AVERAGE	Cmk
mm	10.1	10.10	7.09
	+/-0.2		

REMARKS:

Aplicable wire range-35.0mm²~50.0mm².

EVALUATION DECISION

SUITABLE [X]
NOT SUITABLE [ ]
FOR USE IN PRODUCTION

APPROVED (Section Chief) 3485	CHECKED (Operator) 44	PREPARED (Operator) nº 5061
Date: 2021/Mar/15	Date: 2021/Mar/08	Date: 2021/Mar/04

YAZAKI
PORTO TECHNICAL CENTRE

APPLICATOR VALIDATION REPORT

Applicator Serial Nº
A0201716

LOWER WIRE KIND & SIZE

Wire kind:	A42X		
Wire size:	35		mm^2
Nominal Cr. Height:	9.7	NA	mm
+/-	0.2	NA	mm

Sample number	Crimp height **WIRE** (mm)	Crimp height **INSULATION** (mm)
1	9.717	
2	9.723	
3	9.714	
4	9.729	
5	9.740	
6	9.732	
7	9.720	
8	9.744	
9	9.715	
10	9.710	
11	9.708	
12	9.702	
13	9.702	
14	9.714	
15	9.703	
16	9.694	
17	9.693	
18	9.719	
19	9.702	
20	9.694	
21	9.712	
22	9.718	
23	9.705	
24	9.724	
25	9.725	
26	9.708	
27	9.732	
28	9.719	
29	9.709	
30	9.709	
31	9.709	
32	9.708	
33	9.704	
34	9.701	
35	9.713	
36	9.725	
37	9.736	
38	9.711	
39	9.703	
40	9.714	
41	9.729	
42	9.715	
43	9.707	
44	9.730	
45	9.716	
46	9.725	
47	9.729	
48	9.709	
49	9.713	
50	9.719	
Average	9.72	
Cmk	5.22	

UPPER WIRE KIND & SIZE

Wire kind:	A42X		
Wire size:	50		mm^2
Nominal Cr. Height:	10.1	NA	mm
+/-	0.2	NA	mm

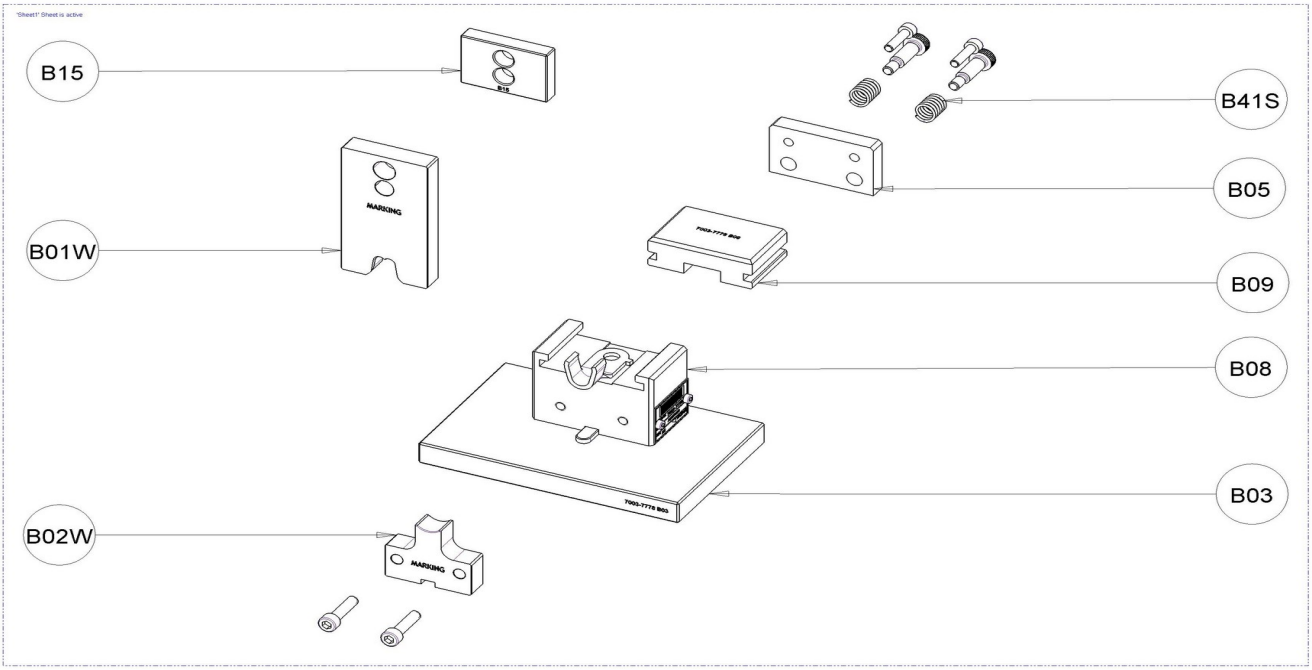
Sample number	Crimp height **WIRE** (mm)	Crimp height **INSULATION** (mm)
1	10.135	
2	10.107	
3	10.100	
4	10.114	
5	10.115	
6	10.101	
7	10.098	
8	10.093	
9	10.110	
10	10.116	
11	10.101	
12	10.094	
13	10.110	
14	10.115	
15	10.100	
16	10.114	
17	10.105	
18	10.114	
19	10.108	
20	10.103	
21	10.110	
22	10.098	
23	10.108	
24	10.097	
25	10.104	
26	10.117	
27	10.105	
28	10.111	
29	10.101	
30	10.095	
31	10.107	
32	10.095	
33	10.104	
34	10.110	
35	10.093	
36	10.089	
37	10.102	
38	10.105	
39	10.105	
40	10.096	
41	10.093	
42	10.103	
43	10.094	
44	10.094	
45	10.092	
46	10.103	
47	10.092	
48	10.089	
49	10.096	
50	10.086	
Average	10.10	
Cmk	7.09	

Acceptance criteria: Cmk>= 2.0

END

APP BATTERY CABLE CONSUMABLE PART LIST

A0201716	7003-7778G1



NUMBER	PARTS NUMBER	PARTS NAME	QUANTITY
B01	***7003-7778-00BW***	WIRE CRIMPER	1
B02	***7003-7778-00BA***	ANVIL	1
B03	7003-7778 B03	DIE BASE	1
B05	B05	STOPPER PLATE	1
B08	7003-7778 B08	MAIN BLOCK	1
B09	7003-7778 B09	SLIDER	1
B15	B15	FRAME SPACER	1
B41S	***41P00000811***	SPRING	2