PTC - Avenida D. Manuel I
Zona Industrial de Ovar
3880-109 OVAR

YAZAKI
PORTO TECHNICAL CENTRE

APPLICATOR VALIDATION REPORT

(Spec. YEL-RP-02-0004)

Applicator Serial Nº
A0202333

TOOLS MANAGEMENT INFORMATION ---> TOOL Nº 70045778 G1 SEQUENCE Nº 9





Validation Terminal Nº	Accessory	Applicator Type	Purchasing Order Nº	Project / Model
7004-5778-02	*	BC	4514310934	DAIMLER TRUCK - XVK81



Applicable Terminals for this Tool:

7004-5778-02

Anvil		Wire Crimper		Insulation Crimper	
7004-5778-ZOBA	(N)	7004-5778-ZOBW	(N)	NA	
CW (c) 14.10	*CW (i)* NA	*CW* 14.10		*CW* NA	

1 - VISUAL / MEASURED CHECK ITEMS

	The two sides of the insulation grips are in the correct position.	NA
	Not found any Bell Mouth in the insulation area.	NA
	The lance height and shape are not deformed.	NA
	Not found any burr in the cutting carrier.	O
	Not found any crack in the terminal.	O
	The wire barrel is free from burrs.	O

Spec. (*)	Value (**)			O - ok X - ng NA - not aplicable
2 - 3 mm	2.56		The Bell Mouth is within the spec.	O
			The dimension of the cutting carrier is within the spec.	NA
0 - 5 ° 0 - 5 °	0.8		Bend up and Bend down are within the criteria.	O
			The exposed conductor is within the spec.	NA
0 - 10 °	0.3		The terminal is not bent sideways while looking from the top.	O
			The body of the terminal is not twisted.	NA

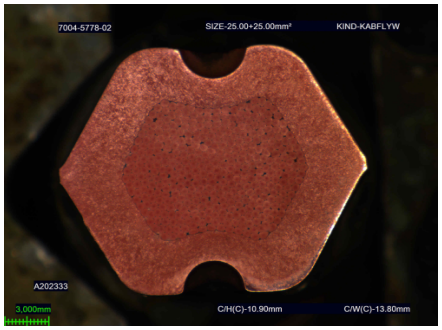
(*) - Specified on Crimping Spec.

(**) - Measured Value(From Lower Wire Kind&Size Sample)

LOWER WIRE KIND & SIZE

UPPER WIRE KIND & SIZE

2 - MICRO CUT SAMPLES



3 - CRIMPING HEIGHT STABILITY

	NOMINAL	AVERAGE	Cmk
mm	10.9	10.90	8.46
	+/- **0.1**		

	NOMINAL	AVERAGE	Cmk
mm			
	+/-		

REMARKS:

Applicable wire range 50.00mm²

EVALUATION DECISION

SUITABLE [X]
NOT SUITABLE [ ]
FOR USE IN PRODUCTION

APPROVED (Section Chief) nº33288	CHECKED (Operator) nº44	PREPARED (Operator) nº18388
Date: 05/03/2026	Date: 05/03/2026	Date: 05/03/2026

YAZAKI

PORTO TECHNICAL CENTRE

APPLICATOR VALIDATION REPORT

Applicator Serial N°

A0202333

LOWER WIRE KIND & SIZE

C/W(l): mm

Wire kind: KABFLYW

Wire size: 25 + 25 mm^2

Nominal Cr. Height:	10.9	NA	mm
+/-	0.1	NA	mm

Sample number	Crimp height **WIRE** (mm)	Crimp height **INSULATION** (mm)
1	10.904	
2	10.902	
3	10.897	
4	10.906	
5	10.908	
6	10.904	
7	10.909	
8	10.897	
9	10.908	
10	10.904	
11	10.902	
12	10.909	
13	10.906	
14	10.898	
15	10.908	
16	10.904	
17	10.902	
18	10.906	
19	10.904	
20	10.897	
21	10.908	
22	10.909	
23	10.902	
24	10.906	
25	10.908	
26	10.898	
27	10.902	
28	10.904	
29	10.908	
30	10.904	
31	10.909	
32	10.898	
33	10.902	
34	10.904	
35	10.906	
36	10.897	
37	10.902	
38	10.908	
39	10.904	
40	10.906	
41	10.902	
42	10.904	
43	10.908	
44	10.902	
45	10.909	
46	10.898	
47	10.908	
48	10.902	
49	10.908	
50	10.909	
Average	10.90	
Cmk	8.46	

UPPER WIRE KIND & SIZE

C/W(l): mm

Wire kind: NA + NA

Wire size: NA + NA mm^2

Nominal Cr. Height:	NA	NA	mm
+/-	NA	NA	mm

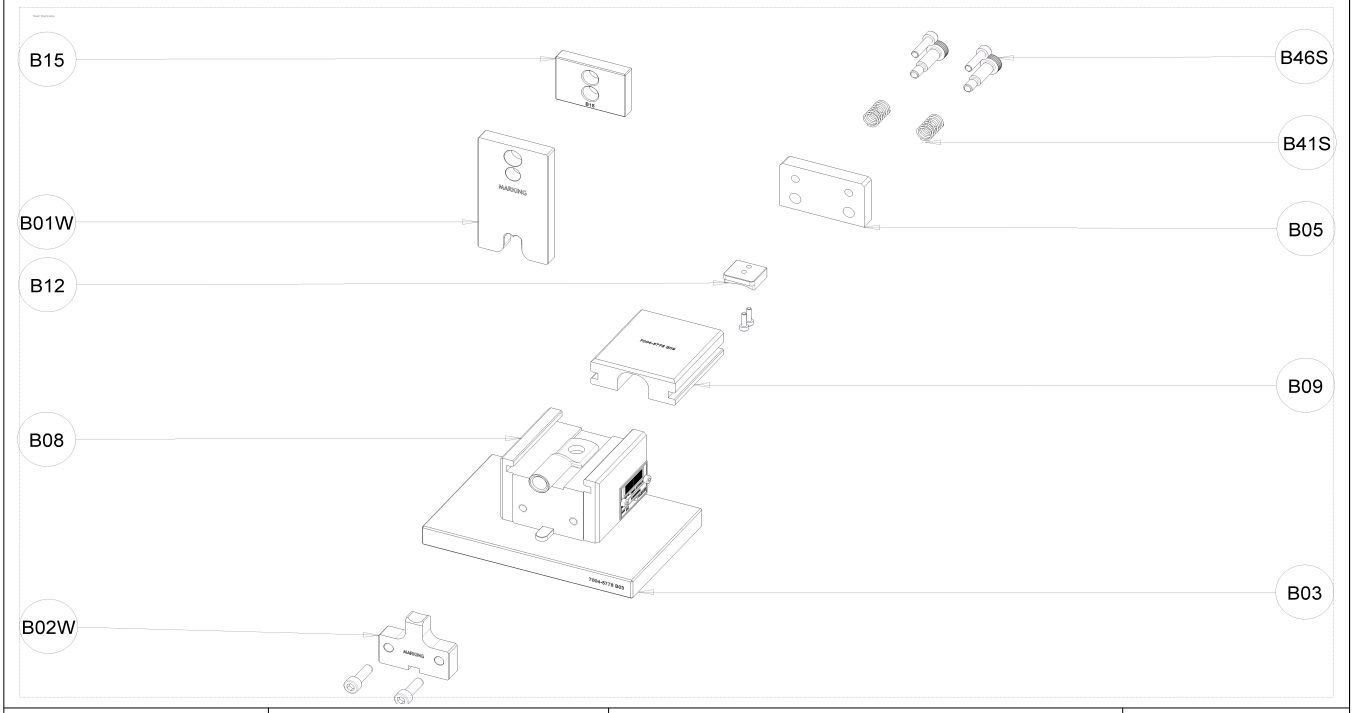
Sample number	Crimp height **WIRE** (mm)	Crimp height **INSULATION** (mm)
1		
2		
3		
4		
5		
6		
7		
8		
9		
10		
11		
12		
13		
14		
15		
16		
17		
18		
19		
20		
21		
22		
23		
24		
25		
26		
27		
28		
29		
30		
31		
32		
33		
34		
35		
36		
37		
38		
39		
40		
41		
42		
43		
44		
45		
46		
47		
48		
49		
50		
Average		
Cmk		

Acceptance criteria: Cmk >= 2

END

APP BATTERY CABLE CONSUMABLE PART LIST

A0202333	7004-5778G1



NUMBER	PARTS NUMBER	PARTS NAME	QUANTITY
B01	***7004-5778-Z0BW***	WIRE CRIMPER	1
B02	***7004-5778-Z0BA***	ANVIL	1
B03	7004-5778 B03	DIE BASE	1
B05	B05	STOPPER PLATE	1
B08	7004-5778 B08	MAIN BLOCK	1
B09	7004-5778 B09	SLIDER	1
B12	7004-5778 B12	TERMINAL STOPPER	1
B15	B15	FRAME SPACER	1
B41S	41P00000811	SPRING	2
B46S	Ø8 x 20 (ISO 7379)	SHOULDER SCREW	2