PTC - Avenida D. Manuel I
Zona Industrial de Ovar
3880-109 OVAR

YAZAKI
PORTO TECHNICAL CENTRE



# APPLICATOR VALIDATION REPORT

**(Spec. YEL-RP-02-0004)**

| Applicator Serial Nº |
|---|
| 2405E010 |

***TOOLS MANAGEMENT INFORMATION ---> TOOL Nº 7114-4446 * SEQUENCE Nº*** 9

| Validation Terminal Nº | Accessory | Applicator Type | Purchasing Order Nº | Project / Model |
|---|---|---|---|---|
| **7114-4446-02** | **7157-3345-40** | **MXD** | **YSD-4514078957** | **MLER TRUCK XV** |

**Applicable Terminals for this Tool:**





| 7114-4446-02 | | | |
|---|---|---|---|





| Anvil | | |
|---|---|---|
| 7114-4416XAD | | (N) |
| *CW (c)* 1,97 | *CW (i)* 3,20 | |

| Wire Crimper | | |
|---|---|---|
| 7114-4446XW | | (1) |
| *CW* 1,95 | | |

| Insulation Crimper | | |
|---|---|---|
| 7114-4446XID | | (1) |
| *CW* 3,20 | | |

## 1 - VISUAL / MEASURED CHECK ITEMS

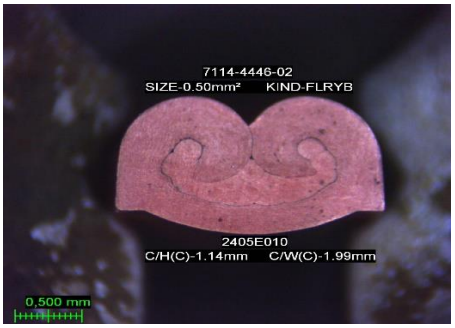
| | | |
|---|---|---|
|  | The two sides of the insulation grips are in the correct position. | O |
|  | Not found any Bell Mouth in the insulation area. | O |
|  | The lance height and shape are not deformed. | O |
|  | Not found any burr in the cutting carrier. | O |
|  | Not found any crack in the terminal. | O |
|  | The wire barrel is free from major burrs. | O |

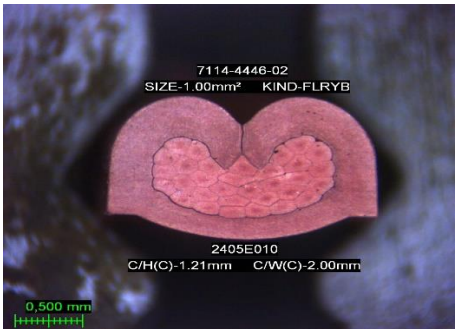
| Spec. (*) | Value (**) | O - ok X - ng NA - not aplicable | | |
|---|---|---|---|---|
| 0~0.30mm<br>0.20~0.60mm | 0.19<br>0.48 |  | The Bell Mouth is within the spec.(*) | O |
| 0~0.50mm | 0.07 |  | The dimension of the cutting carrier is within the spec.(*) | O |
| 0~0.20mm<br>0~0.20mm | 0<br>- |  | Bend up and Bend down are within the criteria(*) | O |
| 0.10~0.50mm | 0.32 |  | The exposed conductor is within the spec.(*) | O |
| 3º | 0.5 |  | The terminal is not bent sideway, look-king from the top(*) | O |
| 0~0.40mm | 0.05 |  | The body of the terminal is not twisted(*) | O |

**(*)** - Specified on Crimping Spec. **(**)** - Measured Value(From Lower Wire Kind&Size Sample)

| **LOWER** WIRE KIND & SIZE | **UPPER** WIRE KIND & SIZE |
|---|---|

## 2 - MICRO CUT SAMPLES




## 3 - CRIMPING HEIGHT STABILITY

| | NOMINAL | AVERAGE | Cmk |
|---|---|---|---|
| mm | 1,15 | 1,15 | 2,70 |
| | **+/-0.05** | | |

| | NOMINAL | AVERAGE | Cmk |
|---|---|---|---|
| mm | 1,2 | 1,20 | 3,60 |
| | **+/-0.05** | | |

**REMARKS:**

Aplicable wire range 0.50mm²~1.00mm²
Size 0.50mm² C/W(I)-3.14mm
Size 1.00mm² C/W(I)-3.24mm

**EVALUATION DECISION**

SUITABLE [X]
NOT SUITABLE [ ]
FOR USE IN PRODUCTION

| APPROVED (Section Chief) 3485 | CHECKED (Operator) 44 | PREPARED (Operator) nº 2988 |
|---|---|---|
| Date: 2024/jun/21 | Date: 2024/jun/11 | Date: 2024/jun/07 |

YAZAKI
PORTO TECHNICAL CENTRE

# APPLICATOR VALIDATION REPORT

| Applicator Serial Nº |
|---|
| 2405E010 |

## LOWER WIRE KIND & SIZE

Wire kind: FLRYB

Wire size: 0,5 mm²

| | | | |
|---|---|---|---|
| Nominal Cr. Height: | 1,15 | 3 | mm |
| +/- | 0,05 | 0,1 | mm |

| Sample number | Crimp height WIRE (mm) | Crimp height INSULATION (mm) |
|---|---|---|
| 1 | 1,146 | 3,009 |
| 2 | 1,150 | 3,008 |
| 3 | 1,152 | 3,004 |
| 4 | 1,146 | 3,012 |
| 5 | 1,153 | 3,006 |
| 6 | 1,149 | 2,998 |
| 7 | 1,153 | 3,004 |
| 8 | 1,147 | 3,006 |
| 9 | 1,145 | 3,003 |
| 10 | 1,152 | 3,001 |
| 11 | 1,145 | 2,996 |
| 12 | 1,145 | 3,005 |
| 13 | 1,151 | 2,999 |
| 14 | 1,153 | 2,996 |
| 15 | 1,146 | 2,994 |
| 16 | 1,154 | 3,005 |
| 17 | 1,154 | 3,005 |
| 18 | 1,153 | 3,002 |
| 19 | 1,147 | 3,006 |
| 20 | 1,152 | 3,002 |
| 21 | 1,149 | 2,998 |
| 22 | 1,148 | 3,009 |
| 23 | 1,155 | 3,001 |
| 24 | 1,150 | 3,005 |
| 25 | 1,150 | 3,013 |
| 26 | 1,158 | 3,011 |
| 27 | 1,151 | 3,004 |
| 28 | 1,148 | 3,001 |
| 29 | 1,157 | 2,998 |
| 30 | 1,155 | 3,006 |
| 31 | 1,150 | 3,007 |
| 32 | 1,156 | 2,997 |
| 33 | 1,152 | 3,004 |
| 34 | 1,150 | 3,008 |
| 35 | 1,158 | 3,008 |
| 36 | 1,160 | 2,998 |
| 37 | 1,152 | 3,003 |
| 38 | 1,156 | 3,007 |
| 39 | 1,159 | 3,007 |
| 40 | 1,157 | 2,996 |
| 41 | 1,159 | 3,004 |
| 42 | 1,165 | 3,007 |
| 43 | 1,159 | 3,010 |
| 44 | 1,166 | 3,000 |
| 45 | 1,167 | 2,996 |
| 46 | 1,159 | 3,006 |
| 47 | 1,158 | 3,010 |
| 48 | 1,164 | 2,996 |
| 49 | 1,162 | 2,998 |
| 50 | 1,159 | 3,007 |
| Average | 1,15 | 3,00 |
| Cmk | 2,70 | 6,64 |

## UPPER WIRE KIND & SIZE

Wire kind: FLRYB

Wire size: 1 mm²

| | | | |
|---|---|---|---|
| Nominal Cr. Height: | 1,2 | 3,1 | mm |
| +/- | 0,05 | 0,1 | mm |

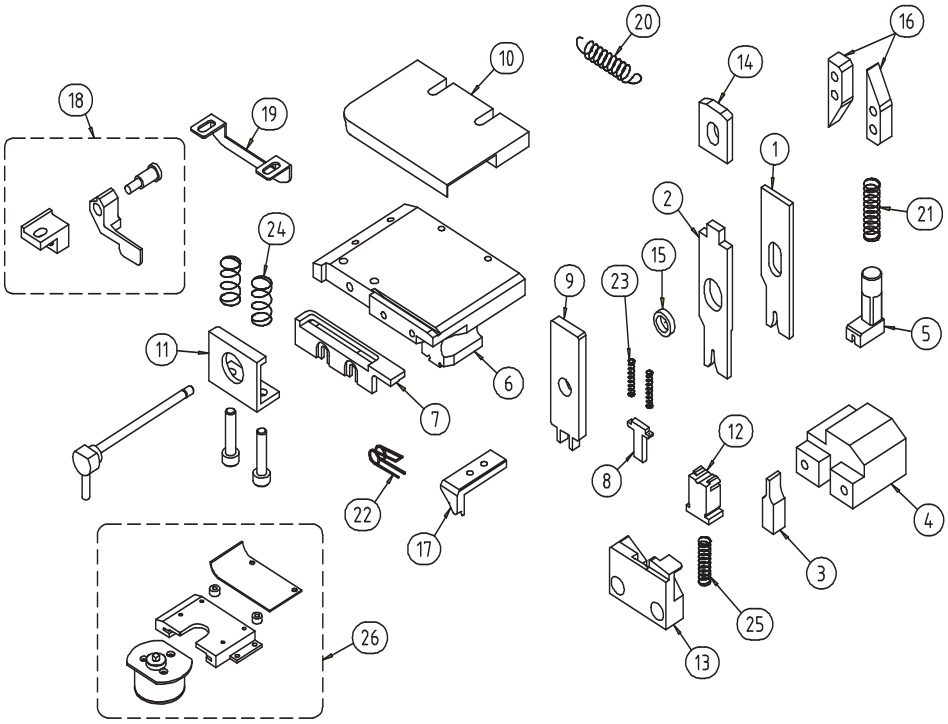
| Sample number | Crimp height WIRE (mm) | Crimp height INSULATION (mm) |
|---|---|---|
| 1 | 1,208 | 3,104 |
| 2 | 1,199 | 3,098 |
| 3 | 1,204 | 3,096 |
| 4 | 1,205 | 3,099 |
| 5 | 1,198 | 3,104 |
| 6 | 1,204 | 3,109 |
| 7 | 1,202 | 3,102 |
| 8 | 1,205 | 3,102 |
| 9 | 1,201 | 3,106 |
| 10 | 1,207 | 3,099 |
| 11 | 1,203 | 3,103 |
| 12 | 1,199 | 3,099 |
| 13 | 1,208 | 3,106 |
| 14 | 1,210 | 3,106 |
| 15 | 1,202 | 3,101 |
| 16 | 1,209 | 3,101 |
| 17 | 1,202 | 3,106 |
| 18 | 1,205 | 3,098 |
| 19 | 1,210 | 3,106 |
| 20 | 1,206 | 3,109 |
| 21 | 1,198 | 3,111 |
| 22 | 1,207 | 3,112 |
| 23 | 1,208 | 3,104 |
| 24 | 1,206 | 3,103 |
| 25 | 1,210 | 3,106 |
| 26 | 1,201 | 3,101 |
| 27 | 1,210 | 3,105 |
| 28 | 1,199 | 3,106 |
| 29 | 1,204 | 3,101 |
| 30 | 1,204 | 3,107 |
| 31 | 1,203 | 3,108 |
| 32 | 1,209 | 3,099 |
| 33 | 1,210 | 3,105 |
| 34 | 1,202 | 3,108 |
| 35 | 1,202 | 3,109 |
| 36 | 1,210 | 3,098 |
| 37 | 1,202 | 3,105 |
| 38 | 1,196 | 3,107 |
| 39 | 1,199 | 3,107 |
| 40 | 1,208 | 3,098 |
| 41 | 1,195 | 3,104 |
| 42 | 1,206 | 3,102 |
| 43 | 1,206 | 3,097 |
| 44 | 1,195 | 3,103 |
| 45 | 1,203 | 3,108 |
| 46 | 1,207 | 3,100 |
| 47 | 1,203 | 3,105 |
| 48 | 1,199 | 3,107 |
| 49 | 1,208 | 3,099 |
| 50 | 1,209 | 3,109 |
| Average | 1,20 | 3,10 |
| Cmk | 3,60 | 8,07 |

**Acceptance criteria: Cmk>= 2,0**

**END**

# 04 アプリケーター 消耗部品表 ／04 APPLICATOR CONSUMABLE PARTS LIST

| 製品番号 PRODUCT No. | C0100-4126 | 端子品番 TERMINAL No. | 7114-4446DD |
|---|---|---|---|




| No. | 部品番号 PARTS No. | 図番 DRW. No. | 部品名称 PARTS NAME | No. | 部品番号 PARTS No. | 図番 DRW. No. | 部品名称 PARTS NAME |
|---|---|---|---|---|---|---|---|
| 1 | 7114-4446XW | | ワイヤークリンパー WIRE CRIMPER | 16 | 48A47014 | 001 | 送りカム FEEDING CAM |
| 2 | 7114-4446XID | | インシュクリンパー INSULATION CRIMPER | 17 | 48A47013 | | 送り爪 FEEDING CLAW |
| 3 | 7114-4446XAD | | アンビル ANVIL | 18 | 48A19100 | 005 | 電線ストッパー Assy WIRE STOPPER Assy |
| 4 | 7114-4446DDXJE | | アンビルホルダー ANVIL HOLDER | 19 | 48A19047 | 001 | 端子掻き落とし TERMINAL SCRAPER |
| 5 | 7114-4446DDXYY | | サポーティングストッパー SUPPORTING STOPPER | 20 | 48A47031 | | 戻しスプリング RETURN SPRING |
| 6 | 7114-4446DDXYB | | ベース BASE | 21 | 48A47032 | 001 | サポーティングストッパースプリング SUPPORTING STOPPER SPRING |
| 7 | 7114-4446DDXYH | | ターミナルガイドプレートB TERMINAL GUIDE PLATE B | 22 | 48A19017 | 003 | 送り爪スプリング FEEDING CLAW SPRING |
| 8 | 48A47016 | 101 ② | 電線押さえ WIRE HOLDER | 23 | 48A19023 | 001 | 電線押さえスプリング WIRE HOLDER SPRING |
| 9 | 48A47017 | 103 ② | 切断ポンチ兼電線押さえホルダー CUTTING PUNCH & WIRE HOLDER | 24 | 48A19074 | | ターミナル押さえスプリング TERMINAL HOLDER SPRING |
| 10 | 48A47020 | A03 | ターミナルガイドプレートA TERMINAL GUIDE PLATE A | 25 | 48A19050 | | シャープレードスプリング SHEARBLADE SPRING |
| 11 | 48A47022 | 001 ① | ターミナル押さえ TERMINAL HOLDER | 26 | 48A47999 | | ターミナル塗油ユニット TERMINAL OIL UNIT |
| 12 | 48A19049 | 018 ② | シャープレード SHEARBLADE | 27 | 7114-4446DDXKP | | ブラケット BRACKET |
| 13 | 48A47025 | 006 ② | アウターシャープレード OUTER SHEARBLADE | | | | |
| 14 | 48A19007 | 021 ① | インシュ調整コマ INSULATION ADJUSTING PIECE | 〈オプション OPTION〉 | | | |
| 15 | 48A19019 | 023 | ブッシュ BUSH | 14 | 48A47042 | -001 ① | INSULATION ADJUSTING PIECE(MECAL) インシュレーション調整コマ(メカル) |

| MARK | DATE | REVISION RECORD | No. | CHECKED |
|---|---|---|---|---|
| | | | | |
| | | | | |
| | | | | |
| ② | 2016/9/13 | SHEARBLADE 002→018<br>OUTER SHEARBLADE 003→006 | 16I-010 | Y.Nakamura |
| ↓ | ↓ | WIRE HOLDER 002→101<br>CUTTING PUNCH & WIRE HOLDER 003→103 | ↓ | ↓ |
| ① | 2007/11/5 | CHANGED No. | QX7 | T.Suzuki |

| APPRICATION POST | |
|---|---|
| QX7 | |
| DESIGNED DATE | |
| 2006/12/4 | |
| APPROVED | DESIGNED |
| Hiraguchi | Yagi |
| 2006/12/4 | 2006/12/4 |

ISSUE
2017/09/15
YAZAKI PARTS CO.LTD HAIBARA OFFICE

ISSUED MARK