PTC - Avenida D. Manuel I
Zona Industrial de Ovar
3880-109 OVAR

YAZAKI
PORTO TECHNICAL CENTRE

APPLICATOR VALIDATION REPORT

(Spec. YEL-RP-02-0004)

Applicator Serial Nº
2405E011

TOOLS MANAGEMENT INFORMATION ---> TOOL Nº 7114-4446 * SEQUENCE Nº 9

Validation Terminal Nº	Accessory	Applicator Type	Purchasing Order Nº	Project / Model
7114-4446-02	**7157-3345-40**	**MYD**	**YSD-4514078957**	**MLER TRUCK XV**

Applicable Terminals for this Tool:





7114-4446-02			




Anvil		
7114-4416XAD		(N)
CW (c) 1,97	*CW (i)* 3,20	

Wire Crimper		
7114-4446XW		(1)
CW 1,95		

Insulation Crimper		
7114-4446XID		(1)
CW 3,20		

1 - VISUAL / MEASURED CHECK ITEMS

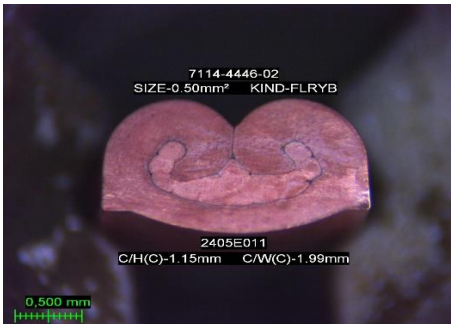
	The two sides of the insulation grips are in the correct position.	O
	Not found any Bell Mouth in the insulation area.	O
	The lance height and shape are not deformed.	O
	Not found any burr in the cutting carrier.	O
	Not found any crack in the terminal.	O
	The wire barrel is free from major burrs.	O

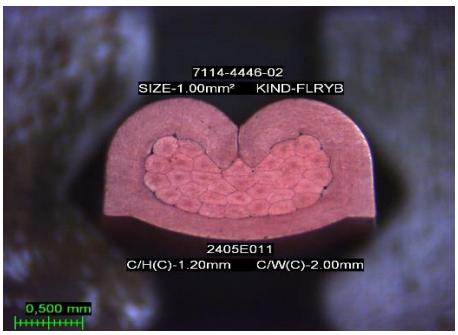
Spec. (*)	Value (**)	O - ok X - ng NA - not aplicable		
0~0.30mm 0.20~0.60mm	0.24 0.44		The Bell Mouth is within the spec.(*)	O
0~0.50mm	0.09		The dimension of the cutting carrier is within the spec.(*)	O
0~0.20mm 0~0.20mm	0 -		Bend up and Bend down are within the criteria(*)	O
0.10~0.50mm	0.27		The exposed conductor is within the spec.(*)	O
3º	1		The terminal is not bent sideway, look-king from the top(*)	O
0~0.40mm	0.05		The body of the terminal is not twisted(*)	O

(*) - Specified on Crimping Spec. **(**)** - Measured Value(From Lower Wire Kind&Size Sample)

LOWER WIRE KIND & SIZE	**UPPER** WIRE KIND & SIZE

2 - MICRO CUT SAMPLES





3 - CRIMPING HEIGHT STABILITY

	NOMINAL	AVERAGE	Cmk
mm	1,15	1,15	4,30
	+/-0.05		

	NOMINAL	AVERAGE	Cmk
mm	1,2	1,20	3,99
	+/-0.05		

REMARKS:

Aplicable wire range 0.50mm²~1.00mm²
Size 0.50mm² C/W(I)-3.14mm
Size 1.00mm² C/W(I)-3.23mm

EVALUATION DECISION

SUITABLE [X]
NOT SUITABLE [ ]
FOR USE IN PRODUCTION

APPROVED (Section Chief) 3485	CHECKED (Operator) 44	PREPARED (Operator) nº 2988
Date: 2024/jun/21	Date: 2024/jun/11	Date: 2024/jun/07

YAZAKI
PORTO TECHNICAL CENTRE

APPLICATOR VALIDATION REPORT

Applicator Serial Nº
2405E011

LOWER WIRE KIND & SIZE

Wire kind: FLRYB

Wire size: 0,5 mm²

Nominal Cr. Height:	1,15	3	mm
+/-	0,05	0,1	mm

Sample number	Crimp height WIRE (mm)	Crimp height INSULATION (mm)
1	1,155	3,013
2	1,159	3,006
3	1,154	3,006
4	1,153	3,013
5	1,157	3,003
6	1,153	3,008
7	1,159	3,014
8	1,150	3,009
9	1,147	3,017
10	1,147	3,010
11	1,151	3,006
12	1,154	3,013
13	1,149	3,017
14	1,153	3,006
15	1,156	3,006
16	1,150	3,015
17	1,149	3,005
18	1,153	3,011
19	1,156	3,016
20	1,149	3,011
21	1,151	3,008
22	1,155	3,017
23	1,156	3,014
24	1,150	3,005
25	1,155	3,001
26	1,156	3,004
27	1,151	3,012
28	1,156	3,016
29	1,149	3,005
30	1,153	3,001
31	1,152	2,999
32	1,154	3,008
33	1,157	3,007
34	1,150	2,999
35	1,146	3,011
36	1,150	3,003
37	1,160	3,002
38	1,160	3,005
39	1,152	2,999
40	1,156	3,004
41	1,151	3,006
42	1,155	2,998
43	1,157	3,000
44	1,157	3,012
45	1,159	3,000
46	1,151	2,997
47	1,153	3,006
48	1,159	2,999
49	1,152	3,002
50	1,157	3,006
Average	1,15	3,01
Cmk	4,30	5,46

UPPER WIRE KIND & SIZE

Wire kind: FLRYB

Wire size: 1 mm²

Nominal Cr. Height:	1,2	3,1	mm
+/-	0,05	0,1	mm

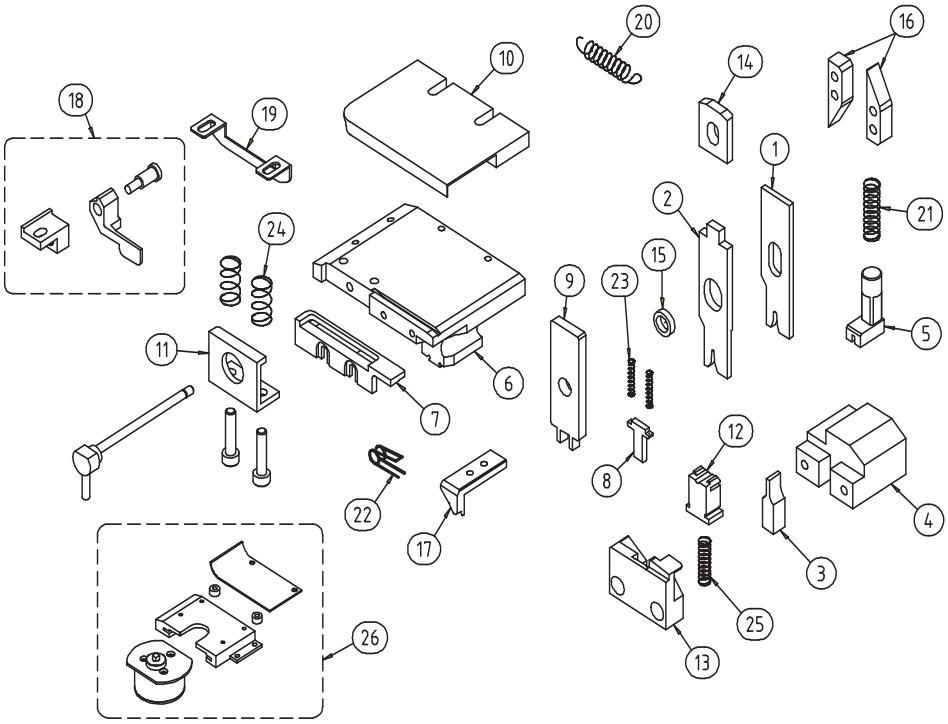
Sample number	Crimp height WIRE (mm)	Crimp height INSULATION (mm)
1	1,204	3,105
2	1,209	3,112
3	1,201	3,103
4	1,208	3,109
5	1,203	3,097
6	1,199	3,098
7	1,199	3,108
8	1,206	3,102
9	1,196	3,098
10	1,203	3,107
11	1,208	3,097
12	1,200	3,108
13	1,206	3,101
14	1,208	3,098
15	1,200	3,106
16	1,202	3,112
17	1,207	3,099
18	1,209	3,098
19	1,201	3,100
20	1,207	3,102
21	1,200	3,102
22	1,201	3,096
23	1,207	3,094
24	1,209	3,103
25	1,204	3,107
26	1,199	3,099
27	1,208	3,094
28	1,202	3,107
29	1,200	3,107
30	1,206	3,099
31	1,210	3,106
32	1,209	3,110
33	1,202	3,110
34	1,198	3,103
35	1,206	3,105
36	1,209	3,099
37	1,200	3,105
38	1,207	3,109
39	1,206	3,101
40	1,201	3,098
41	1,203	3,108
42	1,208	3,103
43	1,202	3,099
44	1,199	3,104
45	1,198	3,106
46	1,205	3,098
47	1,208	3,104
48	1,210	3,108
49	1,204	3,110
50	1,203	3,101
Average	1,20	3,10
Cmk	3,99	6,75

Acceptance criteria: Cmk>= 2,0

END

04 アプリケーター 消耗部品表 ／04 APPLICATOR CONSUMABLE PARTS LIST

製品番号 PRODUCT No.	C0100-4126	端子品番 TERMINAL No.	7114-4446DD



No.	部品番号 PARTS No.	図番 DRW. No.	部品名称 PARTS NAME	No.	部品番号 PARTS No.	図番 DRW. No.	部品名称 PARTS NAME
1	7114-4446XW		ワイヤークリンパー WIRE CRIMPER	16	48A47014	001	送りカム FEEDING CAM
2	7114-4446XID		インシュクリンパー INSULATION CRIMPER	17	48A47013		送り爪 FEEDING CLAW
3	7114-4446XAD		アンビル ANVIL	18	48A19100	005	電線ストッパー Assy WIRE STOPPER Assy
4	7114-4446DDXJE		アンビルホルダー ANVIL HOLDER	19	48A19047	001	端子掻き落とし TERMINAL SCRAPER
5	7114-4446DDXYY		サポーティングストッパー SUPPORTING STOPPER	20	48A47031		戻しスプリング RETURN SPRING
6	7114-4446DDXYB		ベース BASE	21	48A47032	001	サポーティングストッパースプリング SUPPORTING STOPPER SPRING
7	7114-4446DDXYH		ターミナルガイドプレートB TERMINAL GUIDE PLATE B	22	48A19017	003	送り爪スプリング FEEDING CLAW SPRING
8	48A47016	101 ②	電線押さえ WIRE HOLDER	23	48A19023	001	電線押さえスプリング WIRE HOLDER SPRING
9	48A47017	103 ②	切断ポンチ兼電線押さえホルダー CUTTING PUNCH & WIRE HOLDER	24	48A19074		ターミナル押さえスプリング TERMINAL HOLDER SPRING
10	48A47020	A03	ターミナルガイドプレートA TERMINAL GUIDE PLATE A	25	48A19050		シャープレードスプリング SHEARBLADE SPRING
11	48A47022	001 ①	ターミナル押さえ TERMINAL HOLDER	26	48A47999		ターミナル塗油ユニット TERMINAL OIL UNIT
12	48A19049	018 ②	シャープレード SHEARBLADE	27	7114-4446DDXKP		ブラケット BRACKET
13	48A47025	006 ②	アウターシャープレード OUTER SHEARBLADE				
14	48A19007	021 ①	インシュ調整コマ INSULATION ADJUSTING PIECE	〈オプション OPTION〉			
15	48A19019	023	ブッシュ BUSH	14	48A47042	-001 ①	INSULATION ADJUSTING PIECE(MECAL) インシュレーション調整コマ(メカル)

MARK	DATE	REVISION RECORD	No.	CHECKED
②	2016/9/13	SHEARBLADE 002→018 OUTER SHEARBLADE 003→006	16I-010	Y.Nakamura
↓	↓	WIRE HOLDER 002→101 CUTTING PUNCH & WIRE HOLDER 003→103	↓	↓
①	2007/11/5	CHANGED No.	QX7	T.Suzuki

APPRICATION POST	
QX7	
DESIGNED DATE	
2006/12/4	
APPROVED	DESIGNED
Hiraguchi	Yagi
2006/12/4	2006/12/4

ISSUE
2017/09/15
YAZAKI PARTS CO.LTD HAIBARA OFFICE

ISSUED MARK