A2	PROSOIL	BOREHOLE NO: BH-1	
		LOCATION : Goinghat, Sylhet.	
PROJECT : Telecommunication Tower.		DEPTH OF BORING : 21.0m	R. L.: 0.91m below from Road Level.
CLIENT : Grameenphone Ltd.		DATE OF BORING : 31-07-2009.	G. W. T : 0.15m above from E. G. L. (Paddy Field)

THICKNESS	SOIL STRATA	BORELOG	UNDISTURBED SAMPLE	DISTURBED SAMPLE	DEPTH (m) SPT VALUES (BLOWS / 300mm)	Grain Size Distribution, % Clay %, Silt %, Sand %	Max^{m} Penetration
2.0m	Very pale brown 10YR (7/4), very loose, cohesionless Silt, SM.			D-1 to D-2	2, 2		
7.0m	Gray 10YR (6/1), very loose to medium dense, cohesionless Silt, SM.			D-3 to D-8	1, 3, 4, 5, 4, 9		
12.45m	Gray 10YR (6/1), medium dense, silty Sand, SM.			D-9 to D-16	7, 7, 8, 9, 7, 10, 9, 11		

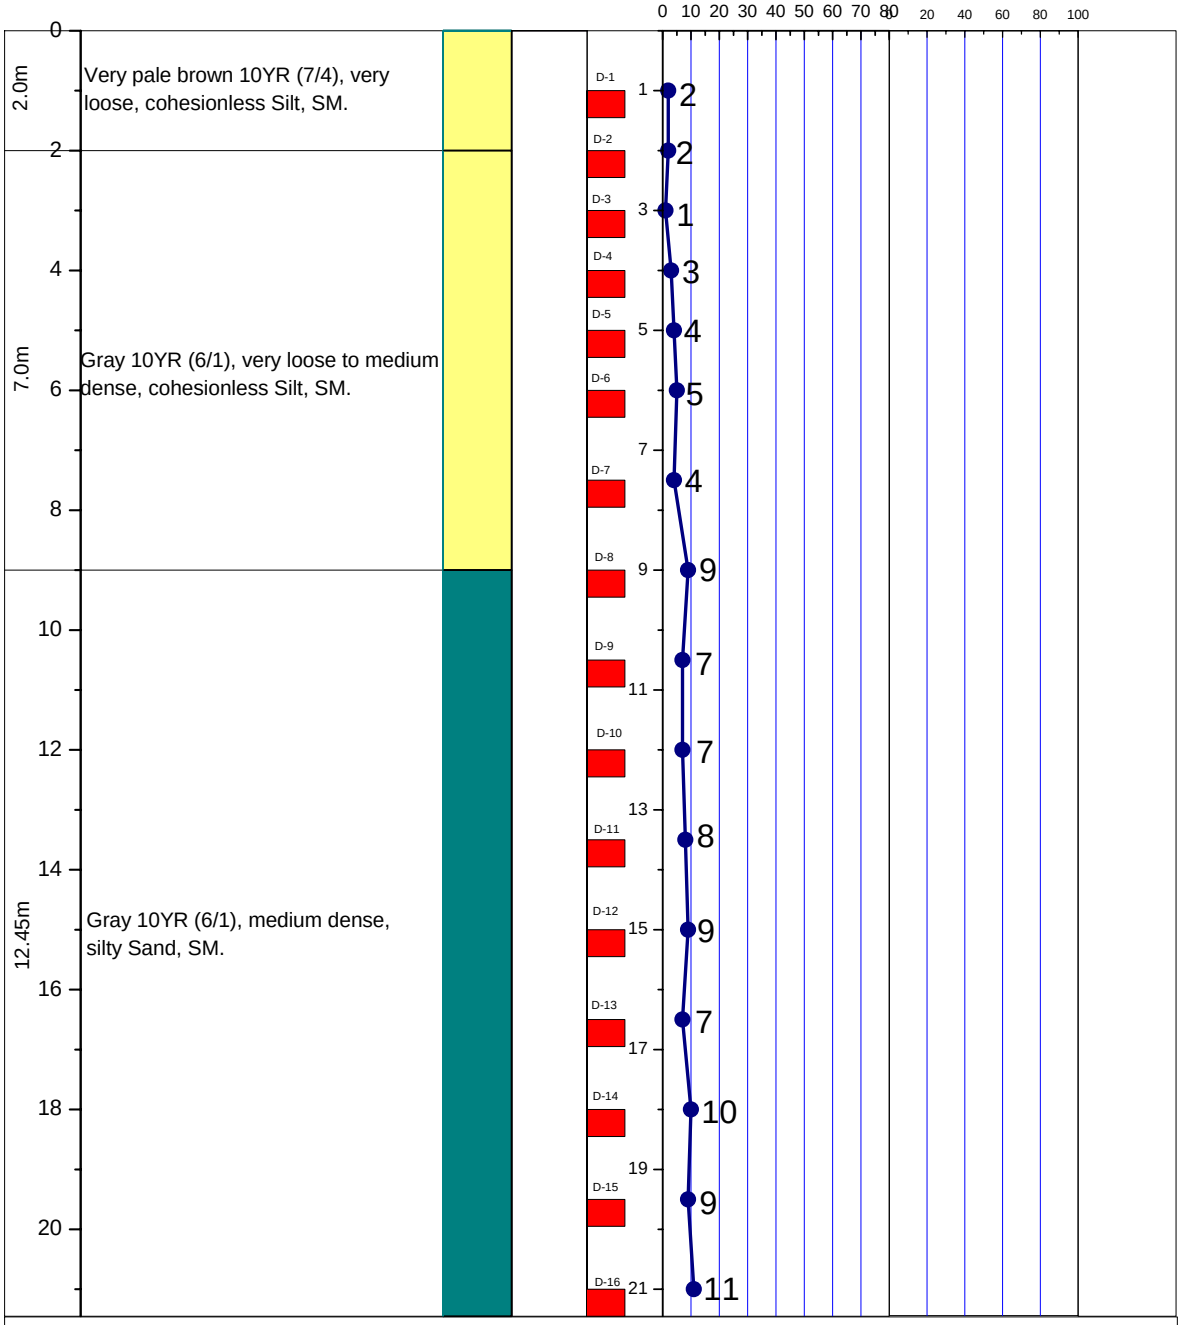

LEGEND FOR BORELOG AND GRAIN SIZE DISTRIBUTION

PLASTIC SILTY CLAY

LOW PLASTIC CLAYEY SILT

NON PLASTIC SILT

SAND

ORGANIC

UNDISTURBED SAMPLE

DISTURBED SAMPLE

SHALE

N- BLOWS DELIVERED PER FOOT BY A 140 LB HAMMER FALLING 30 INCHES

MAX^{m} PENETRATION= 50 BLOWS

AFTER 50 BLOWS PENETRATION DEPTH WERE MEASURED