A2 PROSOIL	BOREHOLE NO: BH-1	
	LOCATION : Char Bata, Noakhali.	
PROJECT : Telecommunication Tower.	DEPTH OF BORING : 21.0m	R. L.: 2.44m below from Road Level.
CLIENT : TM International, Bangladesh Ltd.	DATE OF BORING : 19-09-2006	G. W. T : Rain Water

THICKNESS	SOIL STRATA	BORELOG	UNDISTURBED SAMPLE	DISTURBED SAMPLE	DEPTH (m) SPT VALUES (BLOWS / 300mm)	Grain Size Distribution, % Clay %, Silt %, Sand %	Max^{m} Penetration

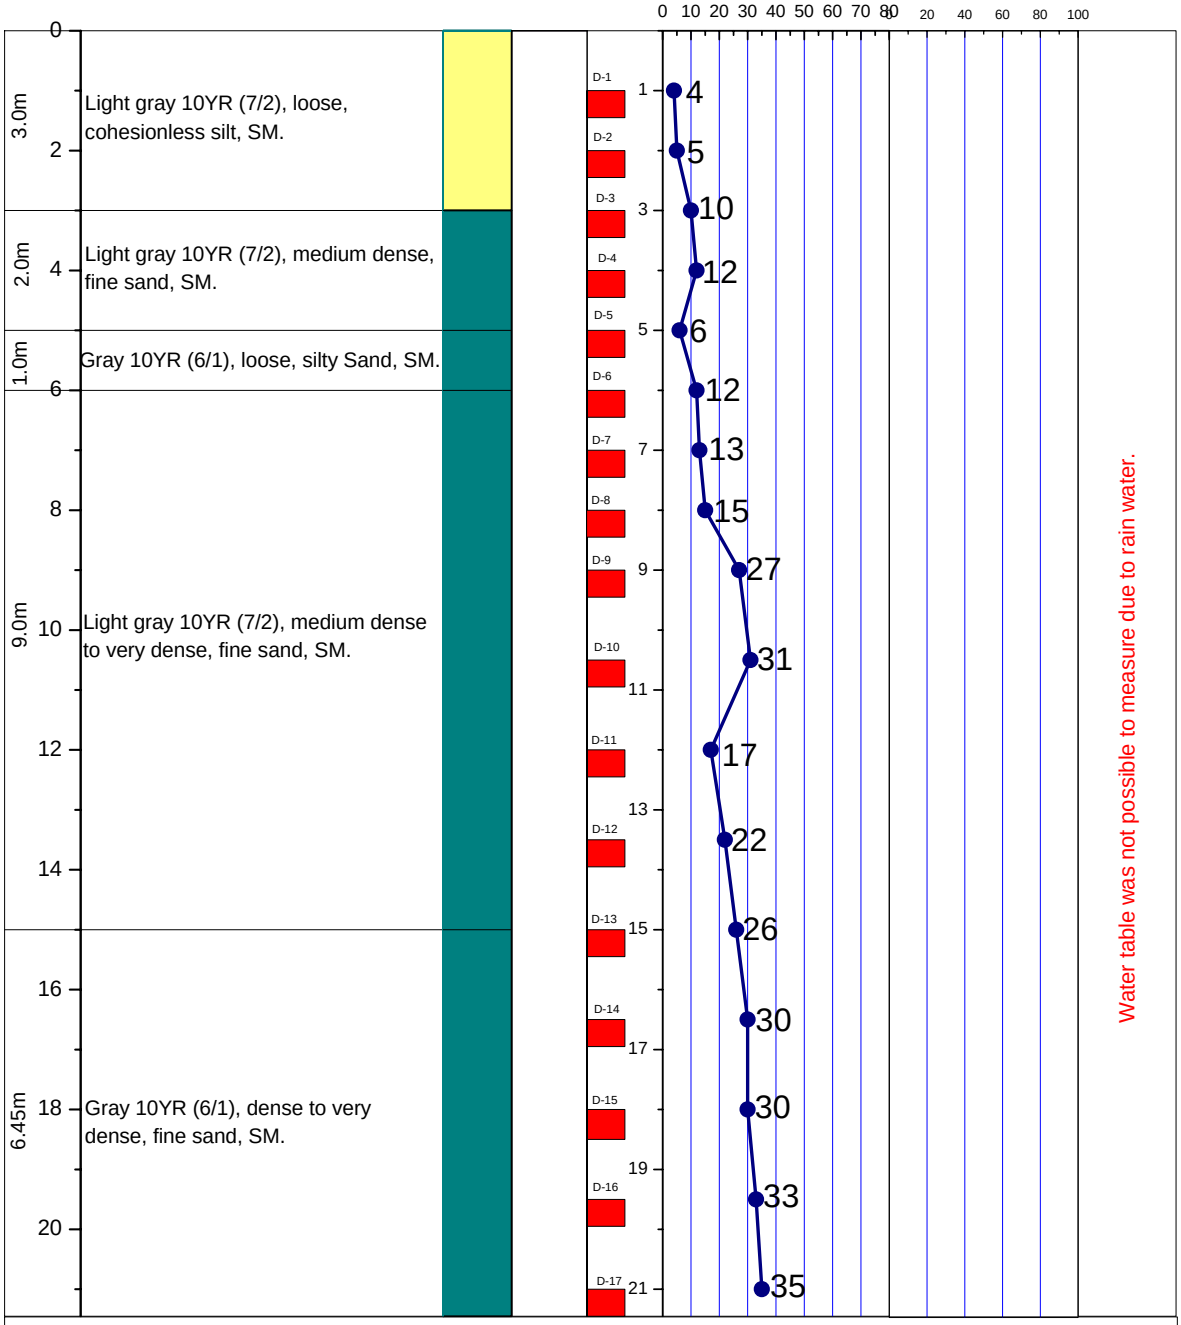

LEGEND FOR BORELOG AND GRAIN SIZE DISTRIBUTION

PLASTIC SILTY CLAY

LOW PLASTIC CLAYEY SILT

NON PLASTIC SILT

SAND

ORGANIC

UNDISTURBED SAMPLE

DISTURBED SAMPLE

SHALE

N- BLOWS DELIVERED PER FOOT BY A 140 LB HAMMER FALLING 30 INCHES

MAX^{m} PENETRATION= 50 BLOWS

AFTER 50 BLOWS PENETRATION DEPTH WERE MEASURED

A2 PROSOIL	BOREHOLE NO: BH-2	
	LOCATION : Char Bata, Noakhali.	
PROJECT : Telecommunication Tower.	DEPTH OF BORING : 21.0m	R. L.: 2.44m below from Road Level.
CLIENT : TM International, Bangladesh Ltd.	DATE OF BORING : 20-09-2006	G. W. T : Rain Water

THICKNESS	SOIL STRATA	BORELOG	UNDISTURBED SAMPLE	DISTURBED SAMPLE	DEPTH (m) SPT VALUES (BLOWS / 300mm)	Grain Size Distribution, % Clay %, Silt %, Sand %	Max^{m} Penetration
2.0m	Light gray 10YR (7/2), loose, cohesionless silt, SM.			D-1 to D-2	4, 6		
3.0m	Light gray 10YR (7/2), loose to medium dense, fine sand, SM.			D-3 to D-5	9, 10, 7		
1.0m	Gray 10YR (6/1), medium dense, silty Sand, SM.			D-6	12		
15.45m	Light gray 10YR (7/2), medium dense to very dense, fine sand, SM.			D-7 to D-17	14, 17, 26, 30, 16, 21, 29, 26, 28, 34, 39		

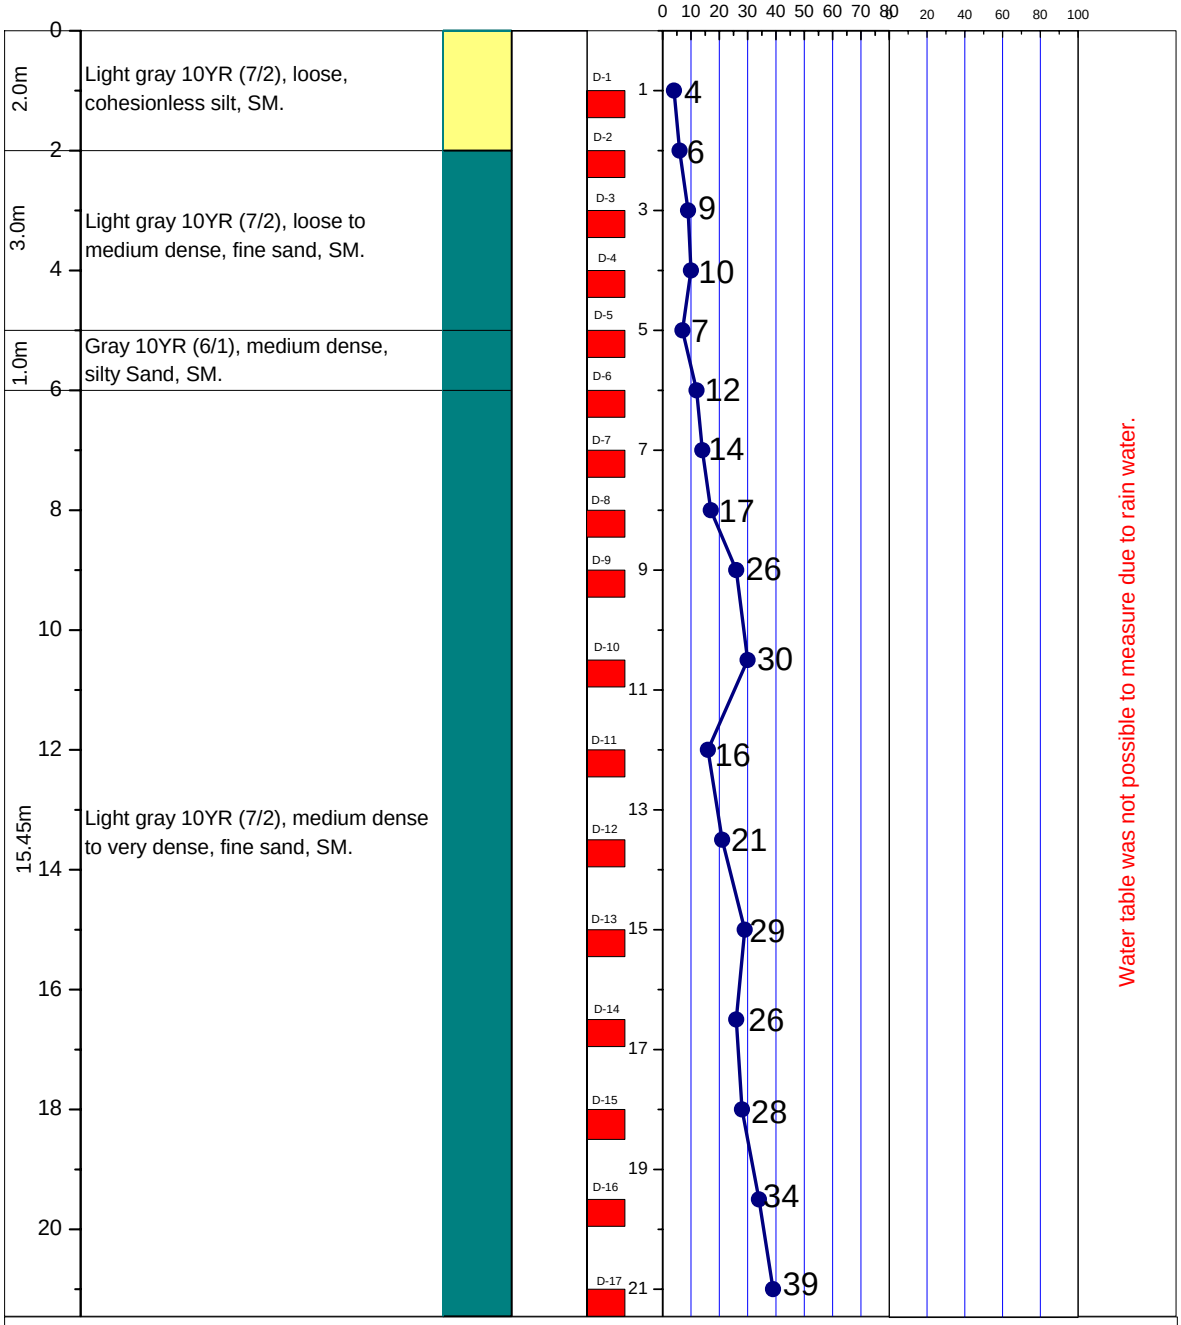

LEGEND FOR BORELOG AND GRAIN SIZE DISTRIBUTION

PLASTIC SILTY CLAY

LOW PLASTIC CLAYEY SILT

NON PLASTIC SILT

SAND

ORGANIC

UNDISTURBED SAMPLE

DISTURBED SAMPLE

SHALE

N- BLOWS DELIVERED PER FOOT BY A 140 LB HAMMER FALLING 30 INCHES

MAX^{m} PENETRATION= 50 BLOWS

AFTER 50 BLOWS PENETRATION DEPTH WERE MEASURED

A2 PROSOIL	BOREHOLE NO: BH-3	
	LOCATION : Char Bata, Noakhali.	
PROJECT : Telecommunication Tower.	DEPTH OF BORING : 21.0m	R. L.: 2.44m below from Road Level.
CLIENT : TM International, Bangladesh Ltd.	DATE OF BORING : 21-09-2006	G. W. T : Rain Water

THICKNESS	SOIL STRATA	BORELOG	UNDISTURBED SAMPLE	DISTURBED SAMPLE	DEPTH (m) SPT VALUES (BLOWS / 300mm)	Grain Size Distribution, % Clay %, Silt %, Sand %	Max^{m} Penetration

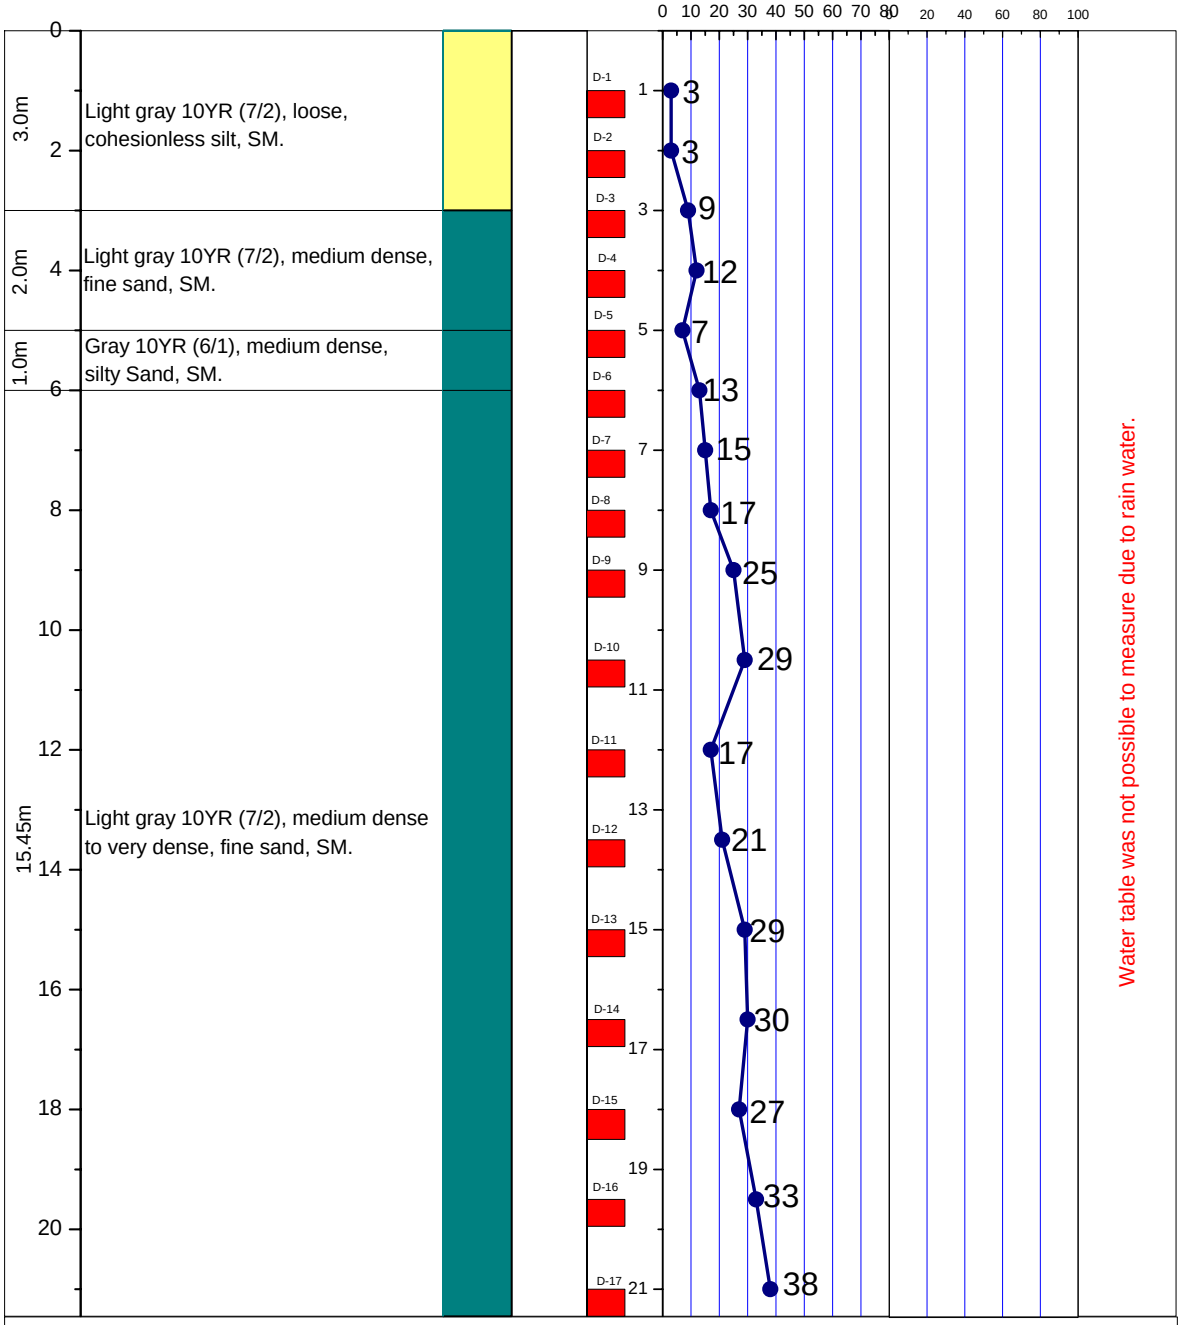

LEGEND FOR BORELOG AND GRAIN SIZE DISTRIBUTION

PLASTIC SILTY CLAY

LOW PLASTIC CLAYEY SILT

NON PLASTIC SILT

SAND

ORGANIC

UNDISTURBED SAMPLE

DISTURBED SAMPLE

SHALE

N- BLOWS DELIVERED PER FOOT BY A 140 LB HAMMER FALLING 30 INCHES

MAX^{m} PENETRATION= 50 BLOWS

AFTER 50 BLOWS PENETRATION DEPTH WERE MEASURED