A2 PROSOIL	BOREHOLE NO: BH-1	
	LOCATION: Innani Beach, Cox's Bazar.	
PROJECT : Telecommunication Tower.	DEPTH OF BORING: 5.0m	R. L.:On Road Level.
CLIENT : AXIATA (Bangladesh) Ltd.	DATE OF BORING: 30-07-2010.	G. W. T : 0.07m below from E. G. L.

THICKNESS	SOIL STRATA	BORELOG	UNDISTURBED SAMPLE	DISTURBED SAMPLE	DEPTH (m) SPT VALUES (BLOWS / 300mm)	Grain Size Distribution, % Clay %, Silt %, Sand %	Max^{m} Penetration
5.45m	Light bluish Gray Gley2 (7/1), very hard, silty Shale, CL.			D-1, D-2, D-3, D-4, D-5	50, 50, 50, 50, 50		Over, Over, Over, Over, Over
16.0m	Boring was not possible due to very hard silty Shale.						

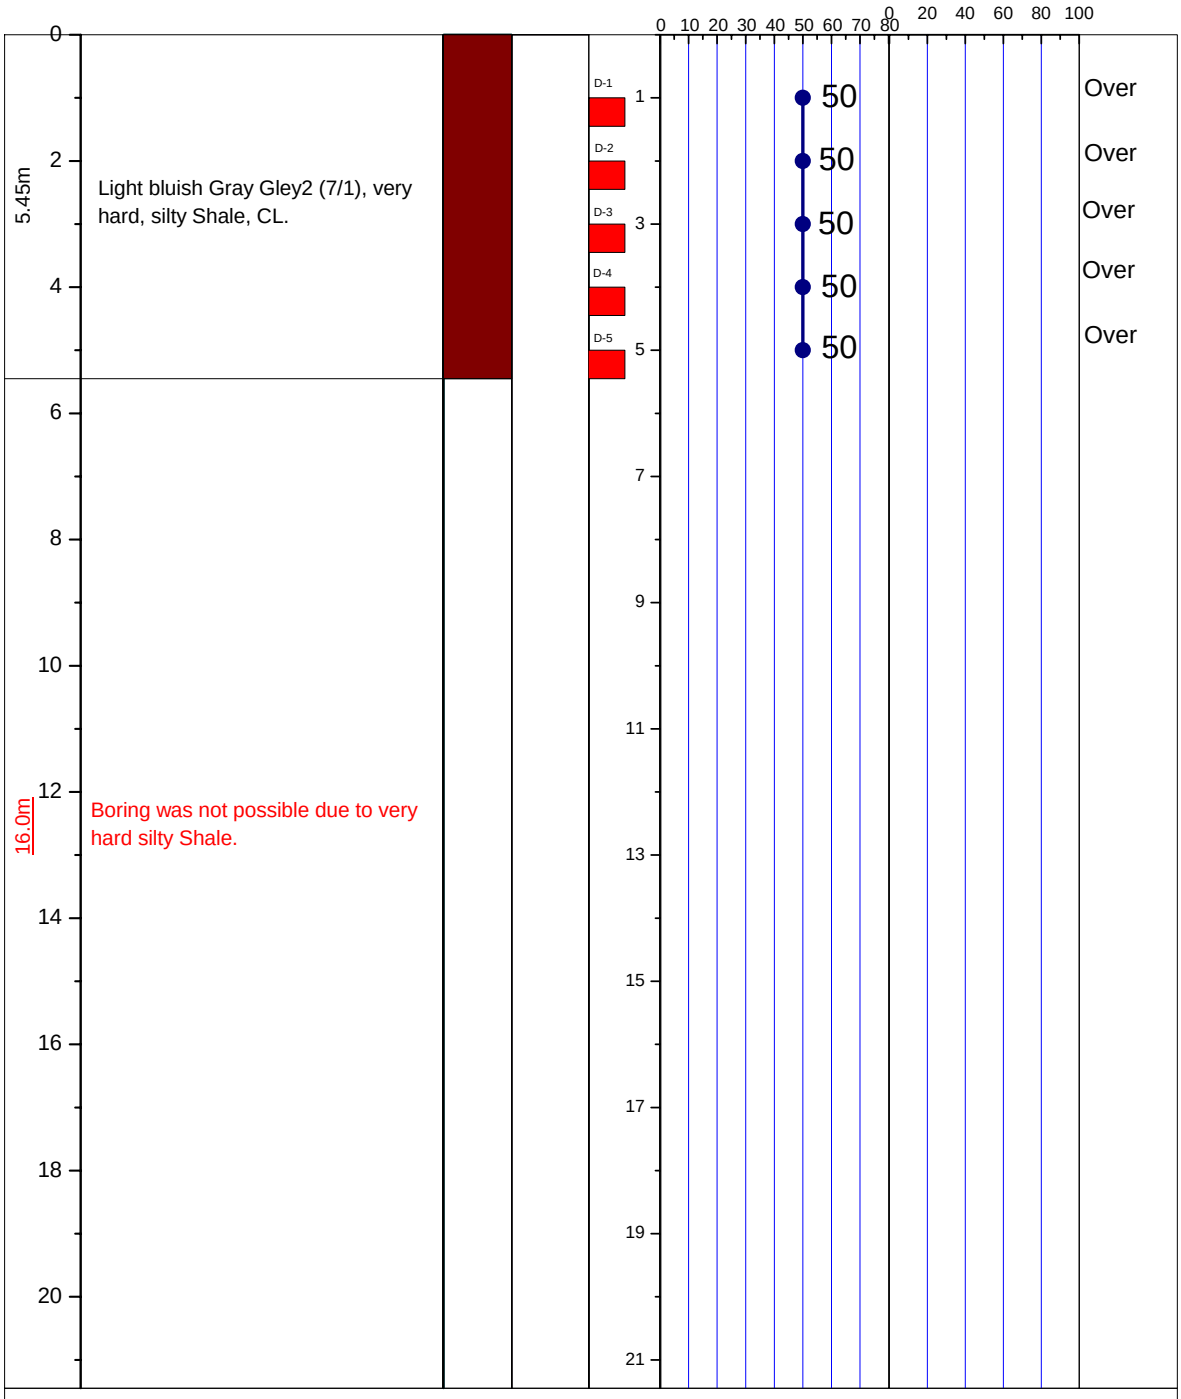

LEGEND FOR BORELOG AND GRAIN SIZE DISTRIBUTION (BASED ON 'ASTM CLASSIFICATION D-2487')

PLASTIC CLAY	SAND	SILT	SHALE
PEAT/HIGHLY ORGANIC SOIL	MICACEOUS FINE SAND/SILT	UNDISTURBED SAMPLE	DISTURBED SAMPLE

N- BLOWS DELIVERED PER FOOT BY A 140 LB HAMMER FALLING 30 INCHES

MAX^{m} PENETRATION= 50 BLOWS

AFTER 50 BLOWS PENETRATION DEPTH WERE MEASURED