| A2 | PROSOIL | BOREHOLE NO: BH-1 | |
|---|---|---|---|
| | | LOCATION: Kuriana, Pirojpur. | |
| PROJECT : Telecommunication Tower. | | DEPTH OF BORING: 21.0m | R. L.: 0.45m below from Road Level. |
| CLIENT : AXIATA (Bangladesh) Ltd. | | DATE OF BORING: 10-06-2010. | G. W. T : 0.61m below from E. G. L. |

| THICKNESS | SOIL STRATA | BORELOG | UNDISTURBED SAMPLE | DISTURBED SAMPLE | DEPTH (m) SPT VALUES ( BLOWS / 300mm ) | Grain Size Distribution, % Clay %, Silt %, Sand % | Max$^{m}$ Penetration |
|---|---|---|---|---|---|---|---|
| 6.0m | Very Dark Gray 10YR (3/1), medium plasticity, very soft, silty Clay, CL. | | UD-1 to UD-4 | D-1 to D-6 | 1, 1, 4, 1, 1, 5 | | |
| 1.0m | Bluish grayGley2 (5/1), loose to dense Silt, ML. | | | D-7 | 21 | | |
| 5.0m | White 10YR (8/1), dense, fine Sand, SW. | | | D-8 to D-10 | 24, 31, 27 | | |
| 3.0m | Light gray 7.5YR (7/1), medium dense, micaceous Sand, SM. | | | D-11 to D-13 | 16, 18, 50 | | |
| 6.45m | Gray 7.5YR (6/1), very dense, fine Sand, SW. | | | D-14 to D-17 | 43, 40, 41, 44 | | |

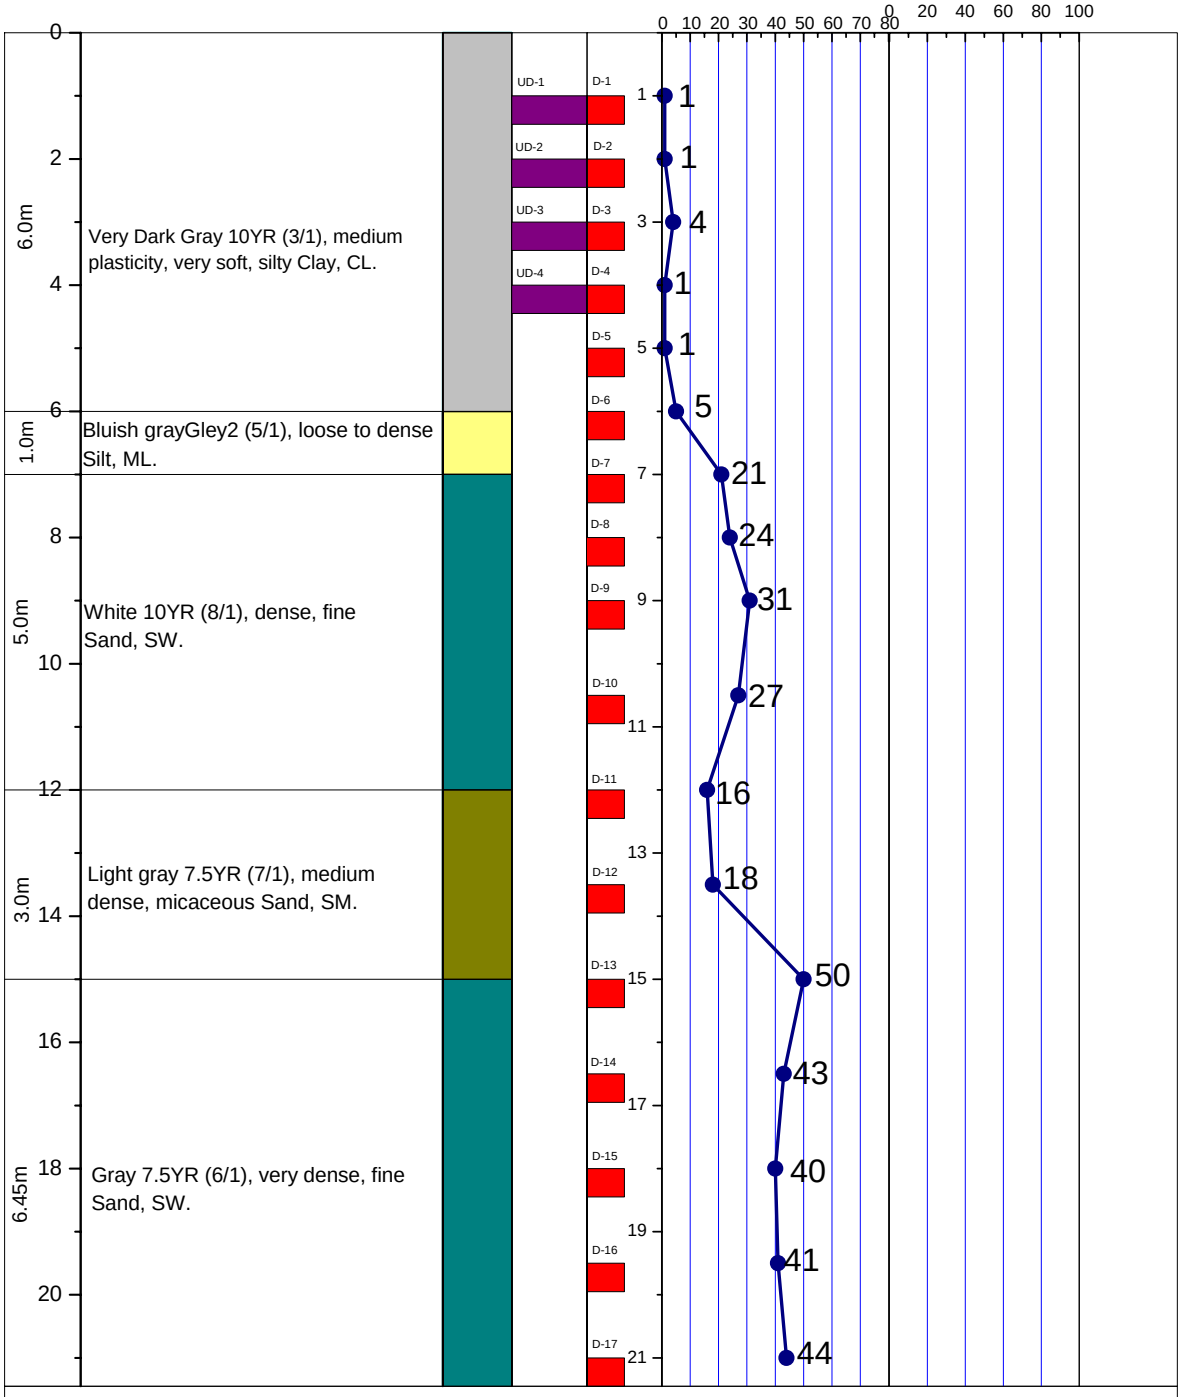


LEGEND FOR BORELOG AND GRAIN SIZE DISTRIBUTION (BASED ON 'ASTM CLASSIFICATION D-2487')

| | | | |
|---|---|---|---|
| PLASTIC CLAY | SAND | SILT | SHALE |
| PEAT/HIGHLY ORGANIC SOIL | MICACEOUS FINE SAND/SILT | UNDISTURBED SAMPLE | DISTURBED SAMPLE |

N- BLOWS DELIVERED PER FOOT BY A 140 LB HAMMER FALLING 30 INCHES

MAX$^{m}$ PENETRATION= 50 BLOWS

AFTER 50 BLOWS PENETRATION DEPTH WERE MEASURED