A2	PROSOIL	BOREHOLE NO: BH-1	
		LOCATION: Baroisuti, Baroipara, Atabha, Kaliakur, Gazipur.	
PROJECT : Telecommunication Tower.		DEPTH OF BORING: 21.0m	R. L.: 1.17m below from Road Level.
CLIENT : Grameenphone Ltd.		DATE OF BORING: 21-04-2012.	G. W. T : 3.05m below from E. G. L.

THICKNESS	SOIL STRATA	BORELOG	UNDISTURBED SAMPLE	DISTURBED SAMPLE	DEPTH (m) SPT VALUES (BLOWS / 300mm)	Grain Size Distribution, % Clay %, Silt %, Sand %	Max^{m} Penetration
3.0m	Light Gray 10YR (7/1), medium plasticity, very soft to soft, silty Clay, CL.		UD-1, UD-2, UD-3	D-1, D-2, D-3	1, 2, 3		
4.5m	Brown 7.5YR (5/3), medium plasticity, soft to medium stiff, silty Clay, CL.		UD-4	D-4, D-5, D-6	7, 8, 7		
13.95m	Brown 7.5YR (5/3), medium dense to very dense, silty Sand, SM.			D-7, D-8, D-9, D-10, D-11, D-12, D-13, D-14, D-15, D-16	10, 17, 23, 22, 23, 25, 35, 37, 32, 34		

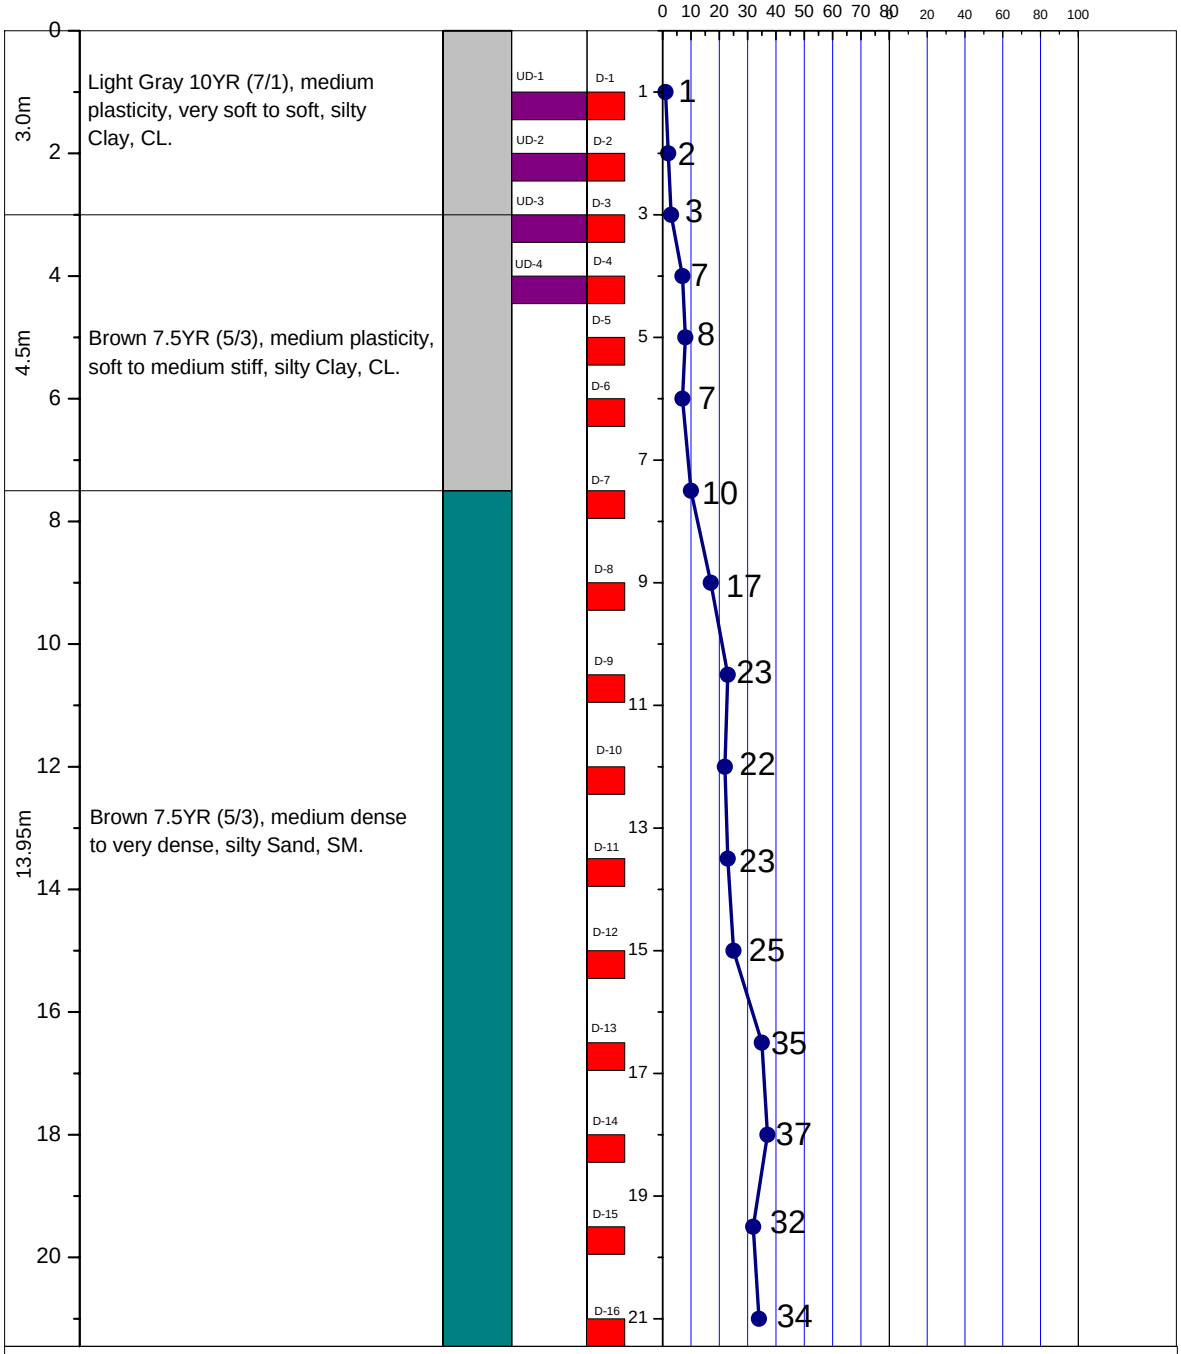

LEGEND FOR BORELOG AND GRAIN SIZE DISTRIBUTION (BASED ON 'ASTM CLASSIFICATION D-2487')

PLASTIC CLAY | SHALE | SILT | SAND

PEAT/HIGHLY ORGANIC SOIL | MICACEOUS FINE SAND/SILT | UNDISTURBED SAMPLE | DISTURBED SAMPLE

N- BLOWS DELIVERED PER FOOT BY A 140 LB HAMMER FALLING 30 INCHES

MAX^{m} PENETRATION= 50 BLOWS

AFTER 50 BLOWS PENETRATION DEPTH WERE MEASURED