A2	PROSOIL	BOREHOLE NO: BH-1	
		LOCATION: Dhontola, South Betgari, Rangpur.	
PROJECT : Telecommunication Tower.		DEPTH OF BORING: 21.0m	R. L.: 0.46m below from Road Level.
CLIENT : Grameenphone Ltd.		DATE OF BORING: 23-04-2015.	B. W. T : 4.57m below from E. G. L.

THICKNESS	SOIL STRATA	BORELOG	UNDISTURBED SAMPLE	DISTURBED SAMPLE	DEPTH (m) SPT VALUES (BLOWS / 300mm)	Grain Size Distribution, % Clay %, Silt %, Sand %	Max^{m} Penetration
2.0m	Gray 7.5YR (5/1), loose to medium dense, silty Sand, SM.			D-1 to D-3	4, 7, 10		
1.0m	Very Pale Brown 10YR (8/2), medium dense, silty Sand, SM.			D-3 to D-4	12		
18.45m	Gray 7.5YR (5/1), medium dense to very dense, fine Sand, SM.			D-4 to D-16	15, 18, 20, 21, 24, 25, 28, 30, 31, 34, 37, 39		

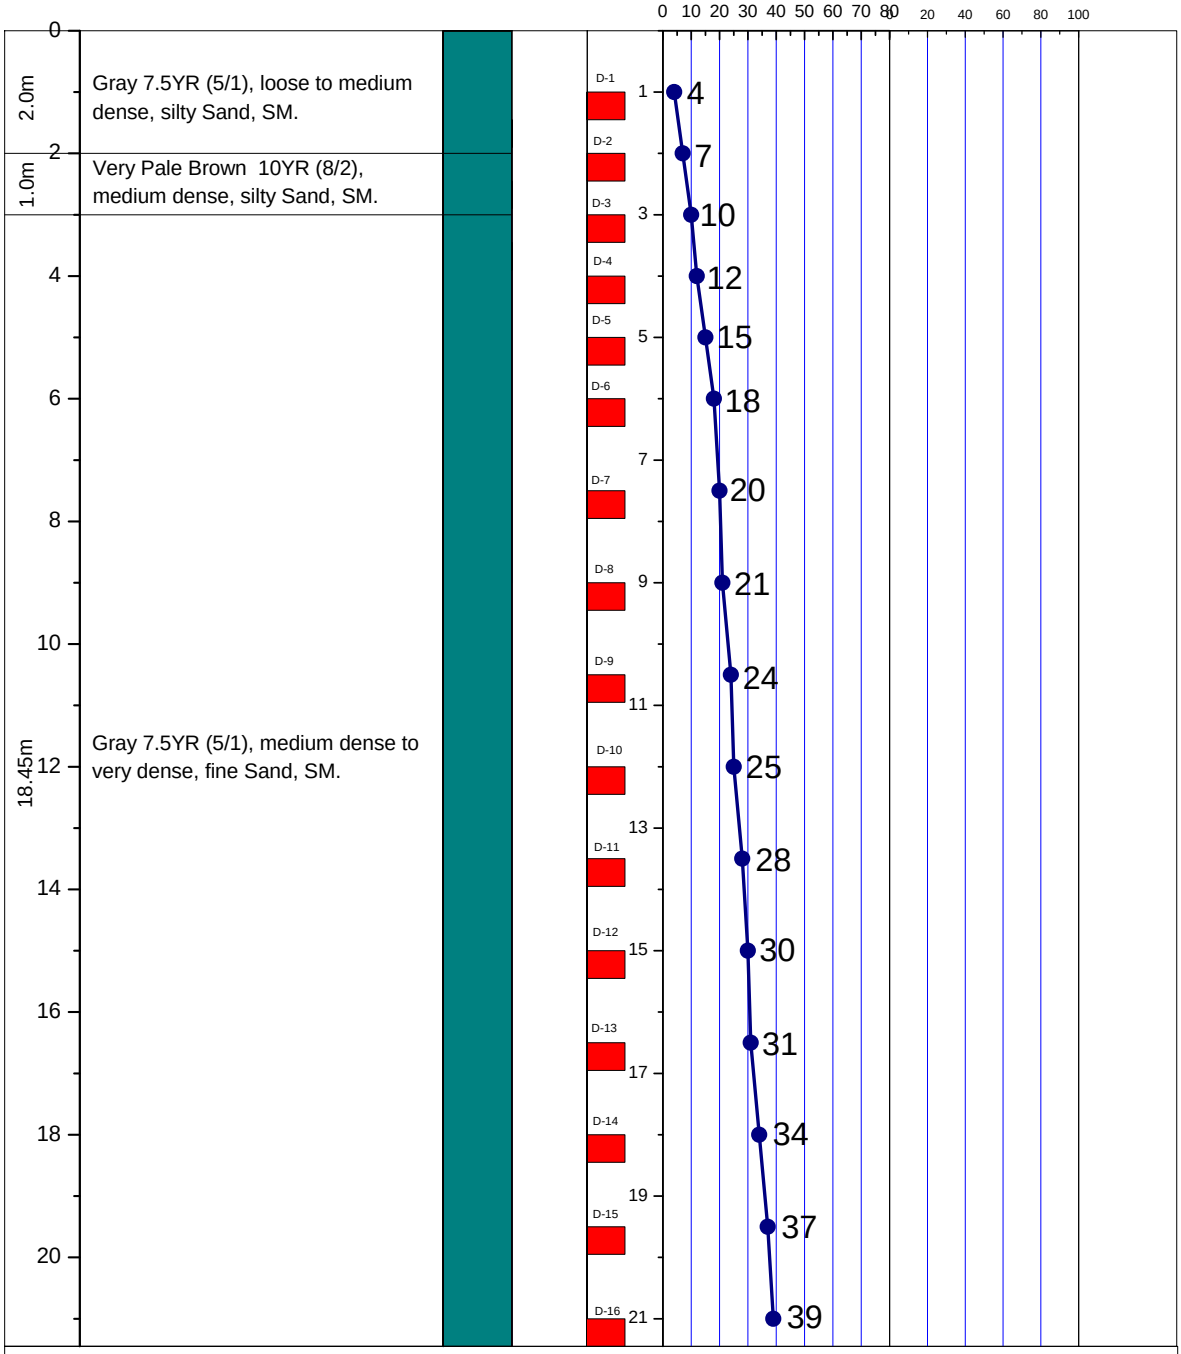

LEGEND FOR BORELOG AND GRAIN SIZE DISTRIBUTION (BASED ON 'ASTM CLASSIFICATION D-2487')

PLASTIC CLAY | SHALE | SILT | SAND

PEAT/HIGHLY ORGANIC SOIL | MICACEOUS FINE SAND/SILT | UNDISTURBED SAMPLE | DISTURBED SAMPLE

N- BLOWS DELIVERED PER FOOT BY A 140 LB HAMMER FALLING 30 INCHES

MAX^{m} PENETRATION= 50 BLOWS

AFTER 50 BLOWS PENETRATION DEPTH WERE MEASURED