A2	PROSOIL	BOREHOLE NO: BH-1 LOCATION: Vill: Goapalpur Moddopara, P. O: Shampur, P. S: Bodorgonj, Dis:Rangpur.	
PROJECT : Telecommunication Tower.		DEPTH OF BORING: 21.0m	R. L.: 0.48m below from Road Level.
CLIENT : Grameenphone Ltd.		DATE OF BORING: 11-02-2015.	B. W. T : 4.57m below from E. G. L.

THICKNESS	SOIL STRATA	BORELOG	UNDISTURBED SAMPLE	DISTURBED SAMPLE	DEPTH (m) SPT VALUES (BLOWS / 300mm)	Grain Size Distribution, % Clay %, Silt %, Sand %	Max^{m} Penetration
4.0m	Raddish Brown 2.5YR (5/4), medium dense, Silt, ML.			D-1 to D-4	7, 8, 9, 8		
3.5m	Brown 7.5YR (5/3), medium dense, silty sand, SM.			D-5 to D-7	8, 12, 14		
13.95m	Brown 7.5YR (5/3), medium dense to very dense, fine sand, SM.			D-8 to D-16	18, 23, 25, 28, 36, 38, 40, 42, 44		

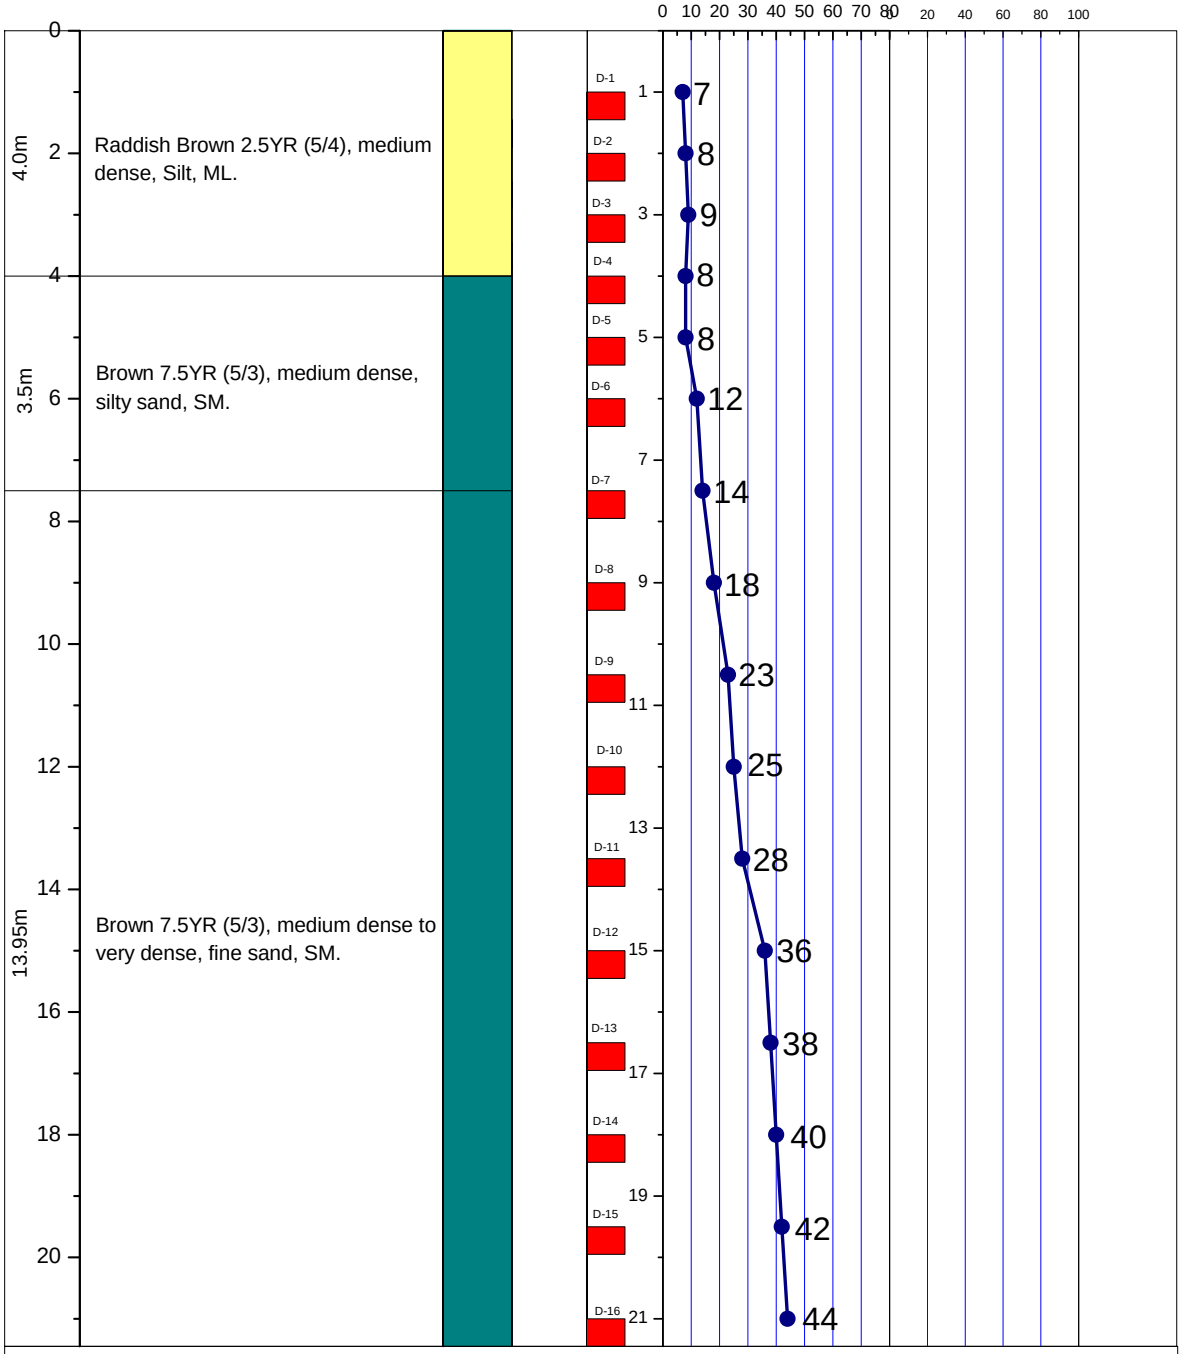

LEGEND FOR BORELOG AND GRAIN SIZE DISTRIBUTION (BASED ON 'ASTM CLASSIFICATION D-2487')

PLASTIC CLAY	SHALE	SILT	SAND
PEAT/HIGHLY ORGANIC SOIL	MICACEOUS FINE SAND/SILT	UNDISTURBED SAMPLE	DISTURBED SAMPLE

N- BLOWS DELIVERED PER FOOT BY A 140 LB HAMMER FALLING 30 INCHES

MAX^{m} PENETRATION= 50 BLOWS

AFTER 50 BLOWS PENETRATION DEPTH WERE MEASURED