A2	PROSOIL	BOREHOLE NO: BH-1	
		LOCATION : Biala Bazar 32m, Joypurhat.	
PROJECT : Telecommunication Tower.		DEPTH OF BORING : 21.0m	R. L.: 0.30m below from Road Level.
CLIENT : AXIATA (Bangladesh) Ltd.		DATE OF BORING : 08-03-2010.	G. W. T : 3.65m below from E. G. L.

THICKNESS	SOIL STRATA	BORELOG	UNDISTURBED SAMPLE	DISTURBED SAMPLE	DEPTH (m) SPT VALUES (BLOWS / 300mm)	Grain Size Distribution, % Clay %, Silt %, Sand %	Max^{m} Penetration
3.0m	Gray 10YR (5/1), medium plastic, soft to medium stiff, silty Clay, CL.		UD-1, UD-2, UD-3	D-1, D-2, D-3	8, 10, 12		
3.0m	Yellowish brown 10YR (5/4), medium plastic, stiff to very stiff, silty Clay, CL.		UD-4	D-4, D-5, D-6	14, 16, 19		
4.5m	Light yellowish brown 10YR (6/4), dense to very dense, fine Sand, SM.			D-7, D-8, D-9, D-10	23, 25, 24, 31		
10.95m	Brown 10YR (5/3), very dense, fine Sand, SM.			D-11, D-12, D-13, D-14, D-15, D-16, D-17	36, 40, 42, 45, 47, 50, 50		over, over

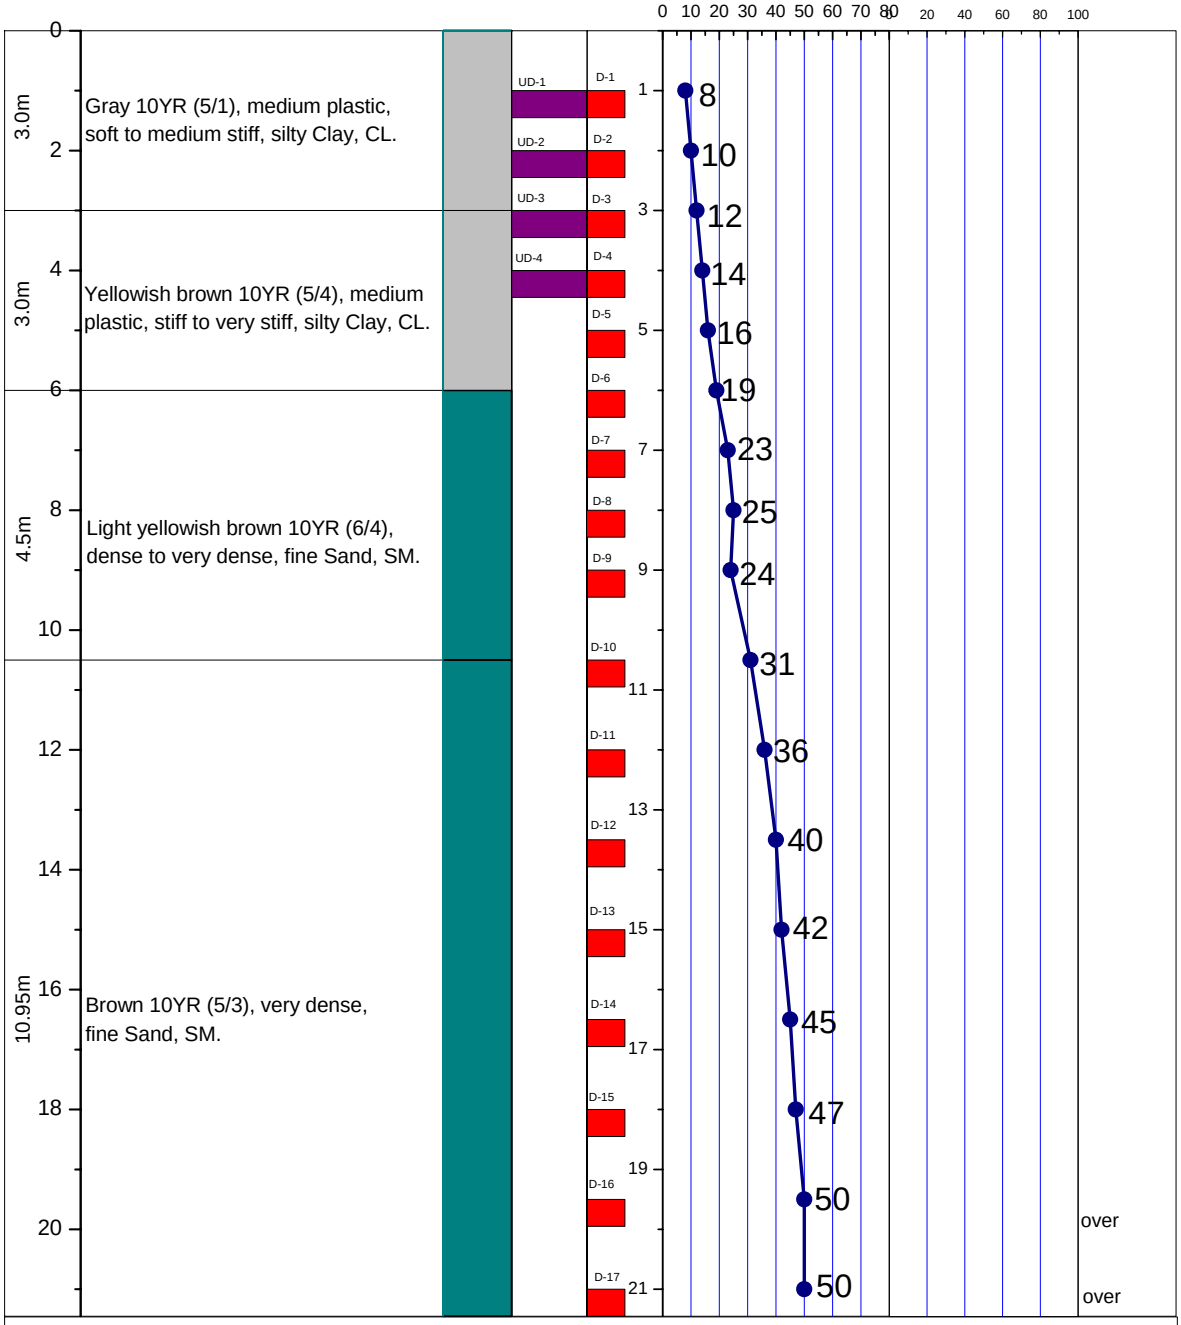

LEGEND FOR BORELOG AND GRAIN SIZE DISTRIBUTION (BASED ON 'ASTM CLASSIFICATION D-2487')

PLASTIC CLAY | SAND | SILT | SHALE

ORGANIC SOIL | MICACEOUS FINE SAND/SILT | UNDISTURBED SAMPLE | DISTURBED SAMPLE

N- BLOWS DELIVERED PER FOOT BY A 140 LB HAMMER FALLING 30 INCHES

MAX^{m} PENETRATION= 50 BLOWS

AFTER 50 BLOWS PENETRATION DEPTH WERE MEASURED