

# Metro Wastewater COVID-19 Monitoring

Metropolitan Council

July 8, 2022


## Total Viral Load

### Tracking COVID-19 Prevalence with Metro Plant Wastewater

The daily amount of SARS-CoV-2 viral RNA flowing into the Metro Plant correlates closely with the number of new daily cases reported by the Minnesota Department of Health. The plant serves nearly 2 million people in Minneapolis, Saint Paul, and 64 other metro area communities.

How to read this graph:

The blue line and points show the total amount of SARS-CoV-2 viral RNA in wastewater flowing into the Metro Plant, in millions copies of the SARS-CoV-2 genome per person served by the wastewater plant, per day. Blue points are daily values; the blue line is a running average of the previous 7 days. The gray line shows the number of new daily COVID-19 cases in the Metro Plant's service area per 100,000 residents, by sample collection date (data from the Minnesota Department of Health). The most recent case data (darker gray) are incomplete and subject to change.

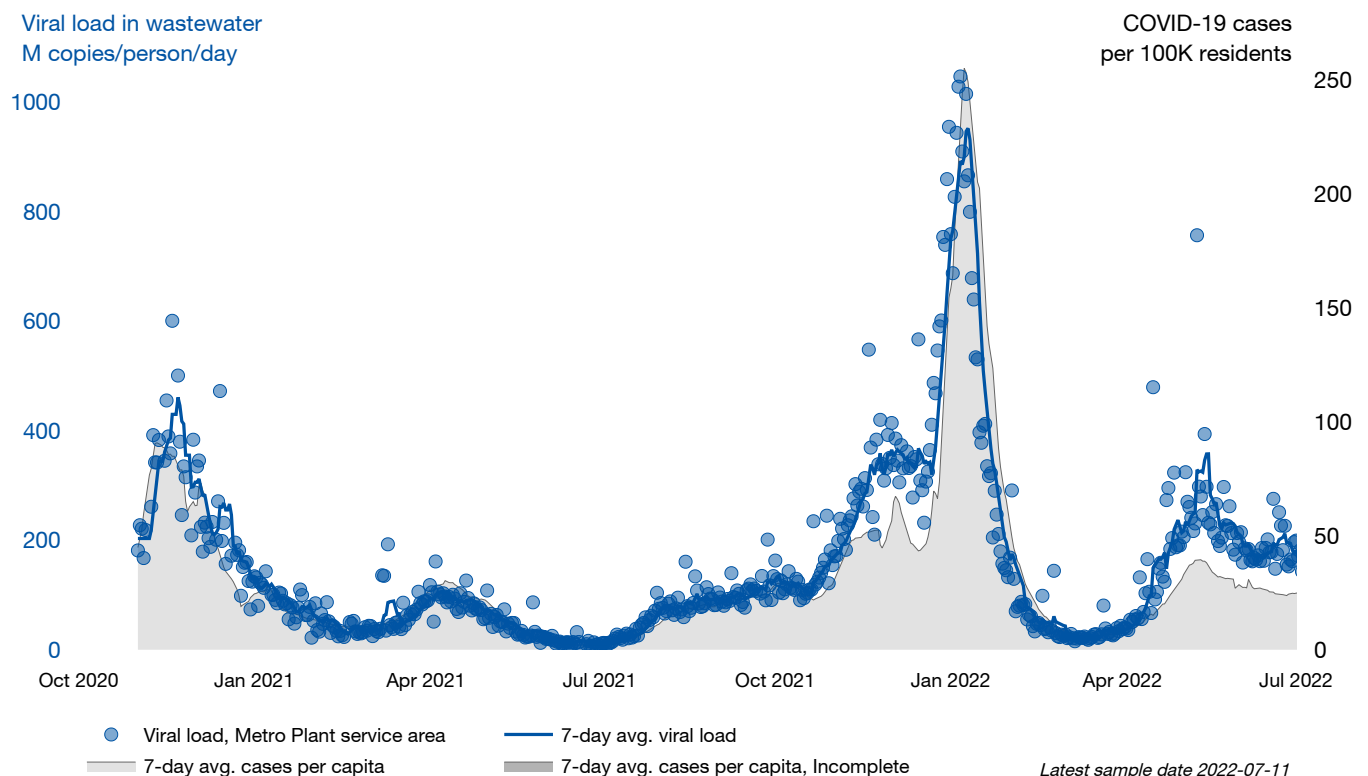


# COVID-19 Variants

The dominance of various SARS-CoV-2 variants in wastewater entering the Metro Plant in Saint Paul has ebbed and flowed over time. Omicron BA.1 replaced Delta as the dominant variant in late December 2021. In February 2022, we observed the appearance and increase of Omicron BA.2. In April, sub-lineage BA.2.12.1 increased in prevalence, becoming the dominant variant by mid-May. Since then, subvariant BA.5 has increased rapidly and overtaken BA.2.12.1 as the dominant SARS-CoV-2 variant in Metro Plant influent wastewater.

How to read this graph:

This graph shows the frequency of SARS-CoV-2 variants in Metro Plant wastewater. This frequency is the percentage of the total viral RNA that was identified as being from each particular variant. Points are daily data; lines and shaded areas are averages of the previous 7 days.

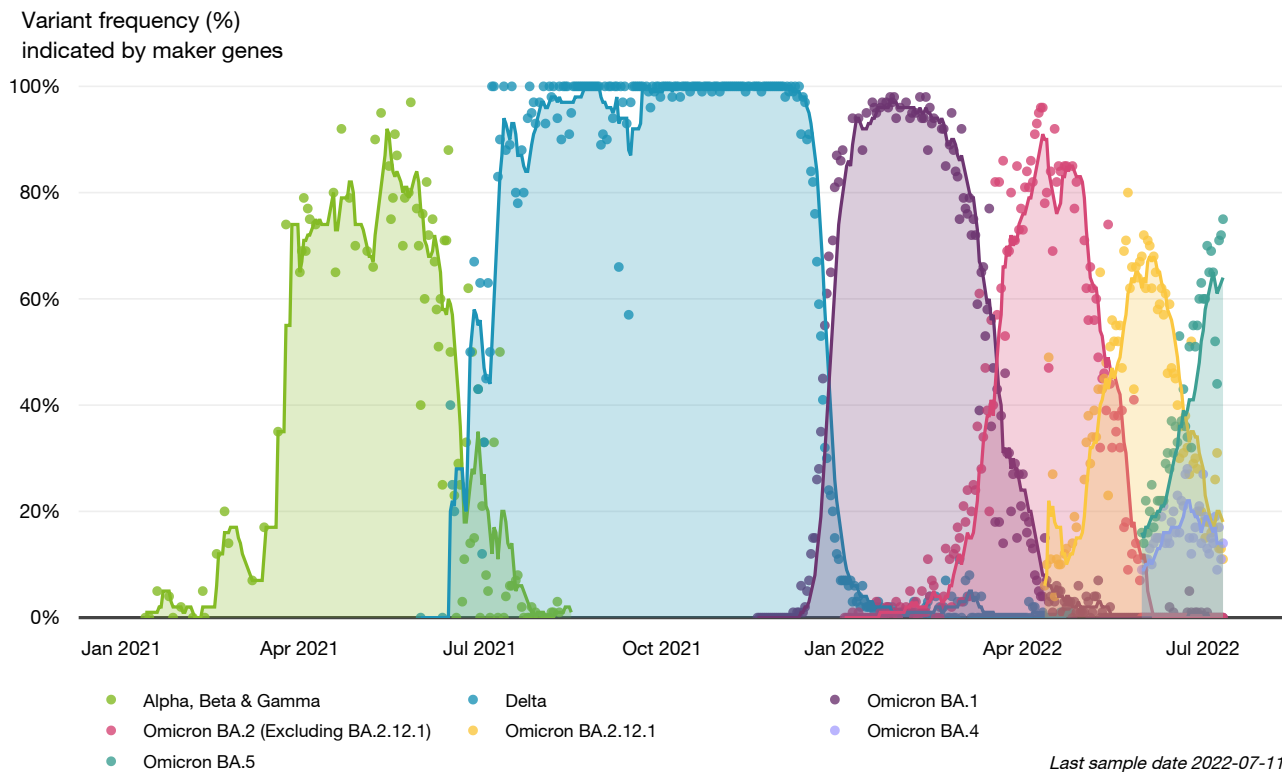

# COVID-19 Load by Variant


## Another way of looking at the variant data

This plot shows the total amount (“load”) of each variant entering the Metro Plant, over time. Recently, BA.5 has increased rapidly and overtaken BA.2.12.1 as the dominant variant.

How to read this graph:

This graph shows the measured number of copies per person per day of each variant in wastewater. Points are daily data; lines and shaded areas are averages of the previous 7 days. The gray area in the background is the 7-day average total viral load. Variant proportions do not always add to 100%, so slight discrepancies between the total viral load and that of the individual variants are expected.

Viral load in wastewater  
M copies/person/day

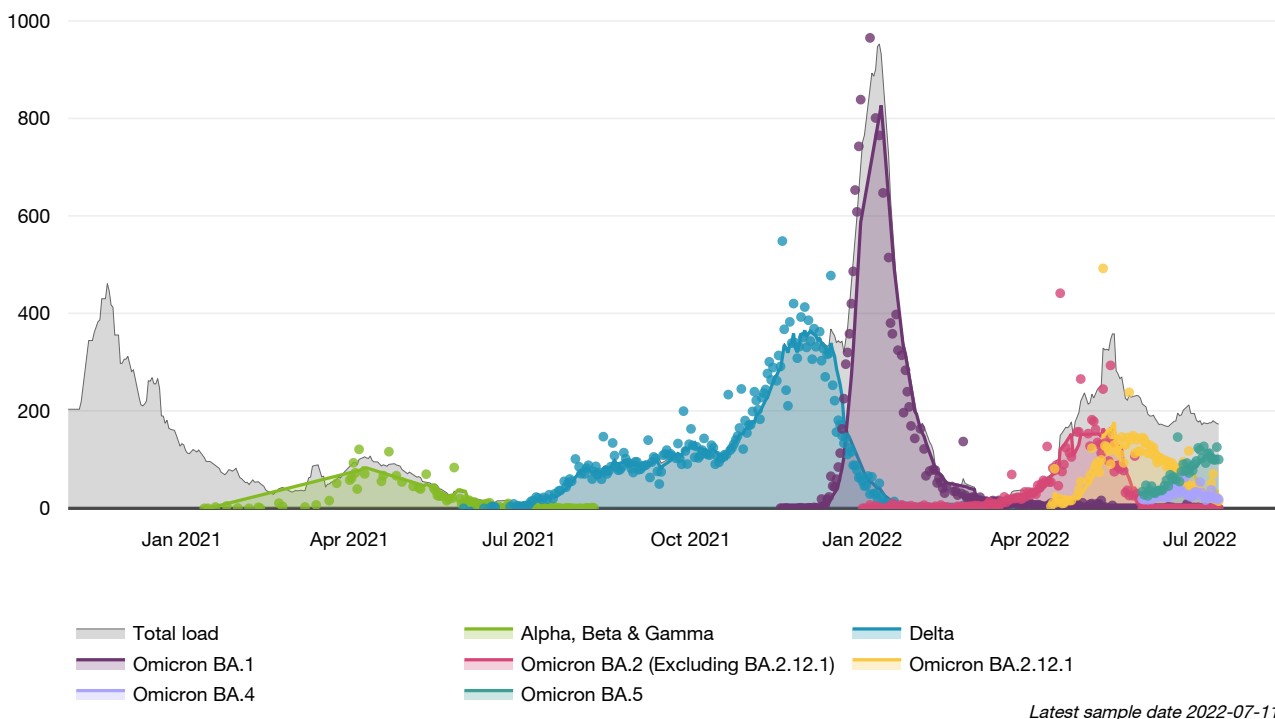

More information about variant detection

Variant frequencies are inferred from the presence of key mutations in the SARS-CoV-2 genome. Alpha, Beta and Gamma frequencies are inferred from the presence of the N501Y mutation; Delta from the L452R mutation; and Omicron from the K417N mutation. Some variants share mutations: presence of K417N mutation before November 18 were inferred to be the Beta variant. The two sub-lineages of Omicron (BA.1 and BA.2) are distinguished by the HV 69/70 deletion: Omicron BA.1 contains both the K417N mutation and the HV 69/70 deletion. Omicron BA.2 has the K417N mutation but not the HV 69/70 deletion. Omicron BA.2.12.1 has the L452Q mutation. BA.4 and BA.5 are distinguished by the return of the L452R mutation, which was also seen previously in Delta.