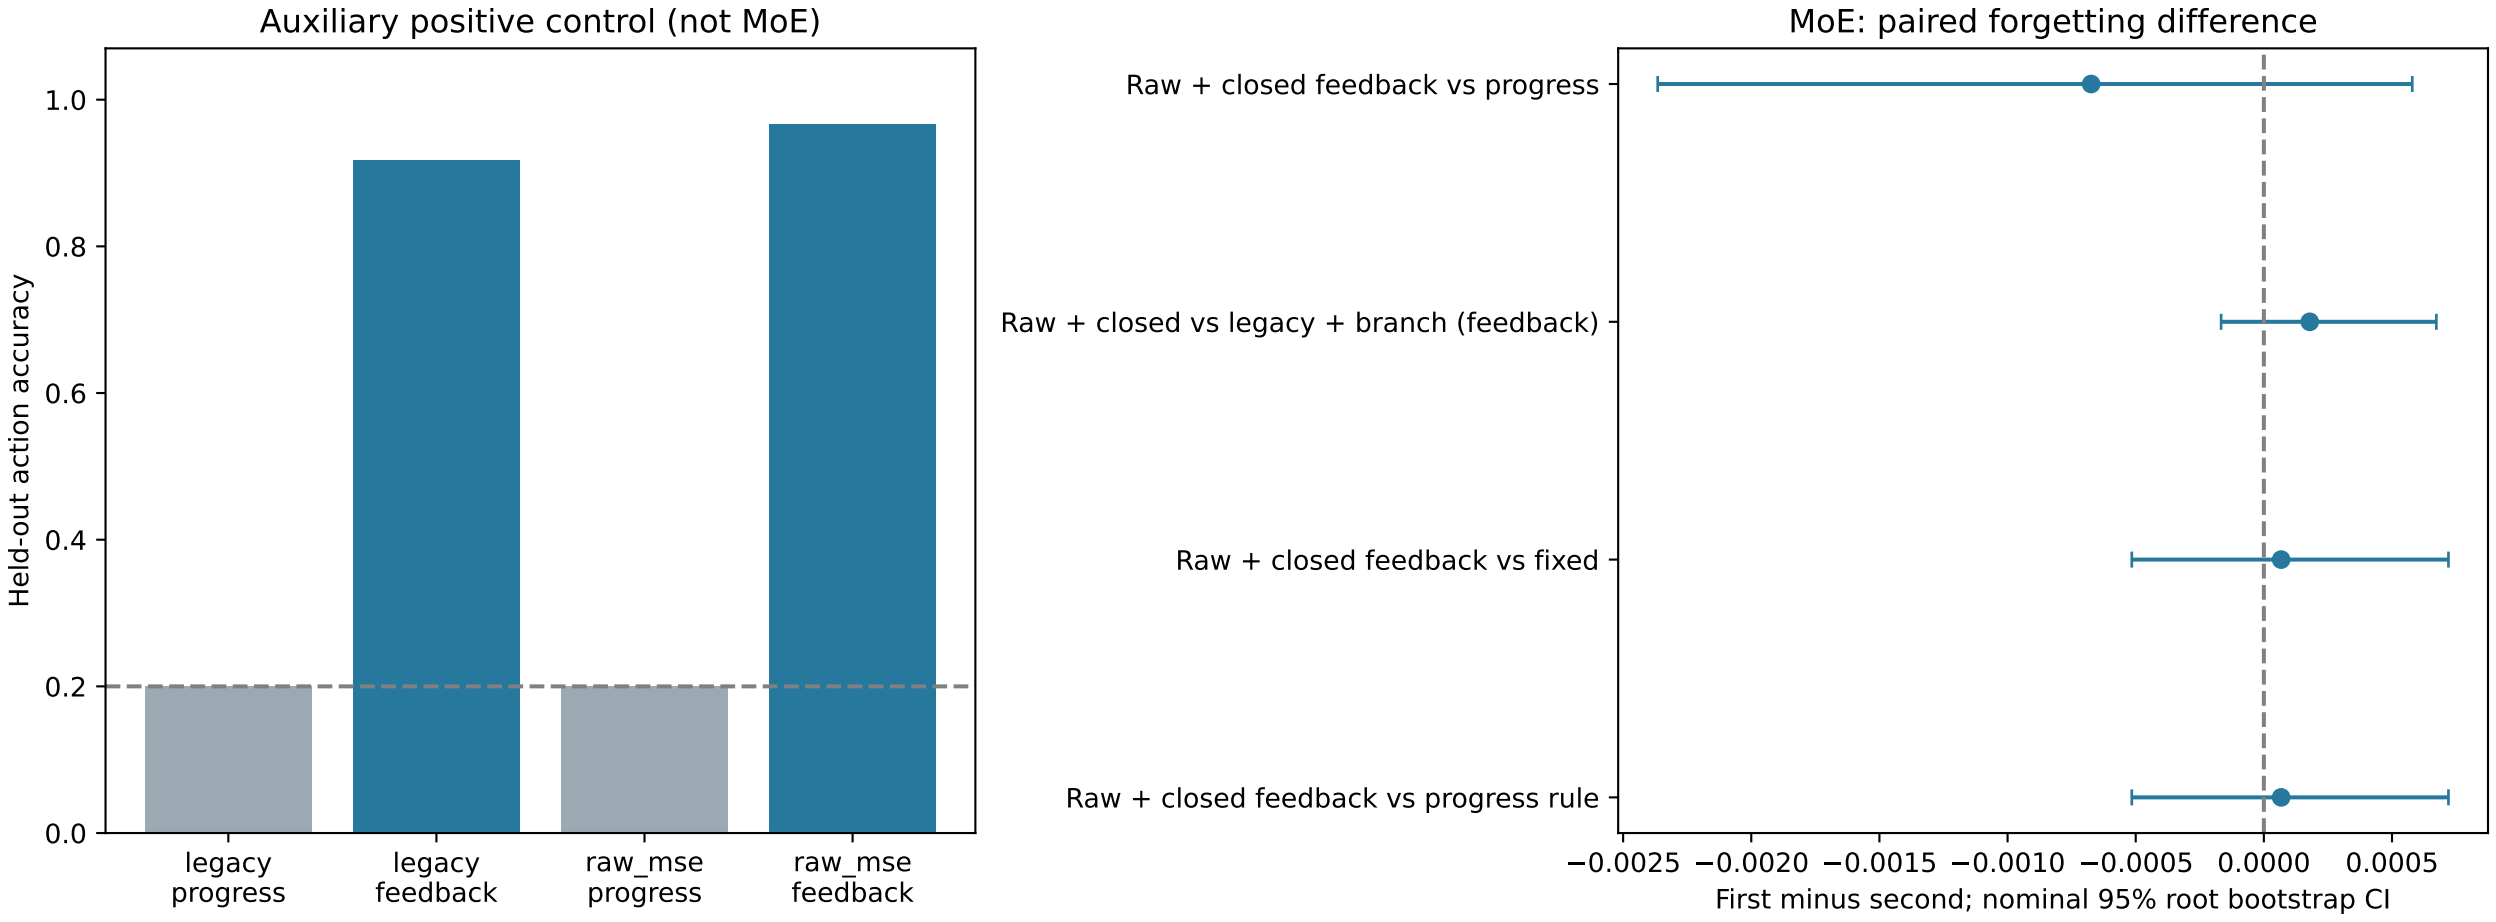
Auxiliary positive control (not MoE)
Held-out action accuracy
1.0
0.8
0.6
0.4
0.2
0.0
legacy progress
legacy feedback
raw_mse progress
raw_mse feedback
MoE: paired forgetting difference
Raw + closed feedback vs progress
Raw + closed vs legacy + branch (feedback)
Raw + closed feedback vs fixed
Raw + closed feedback vs progress rule
−0.0025
−0.0020
−0.0015
−0.0010
−0.0005
0.0000
0.0005
First minus second; nominal 95% root bootstrap CI