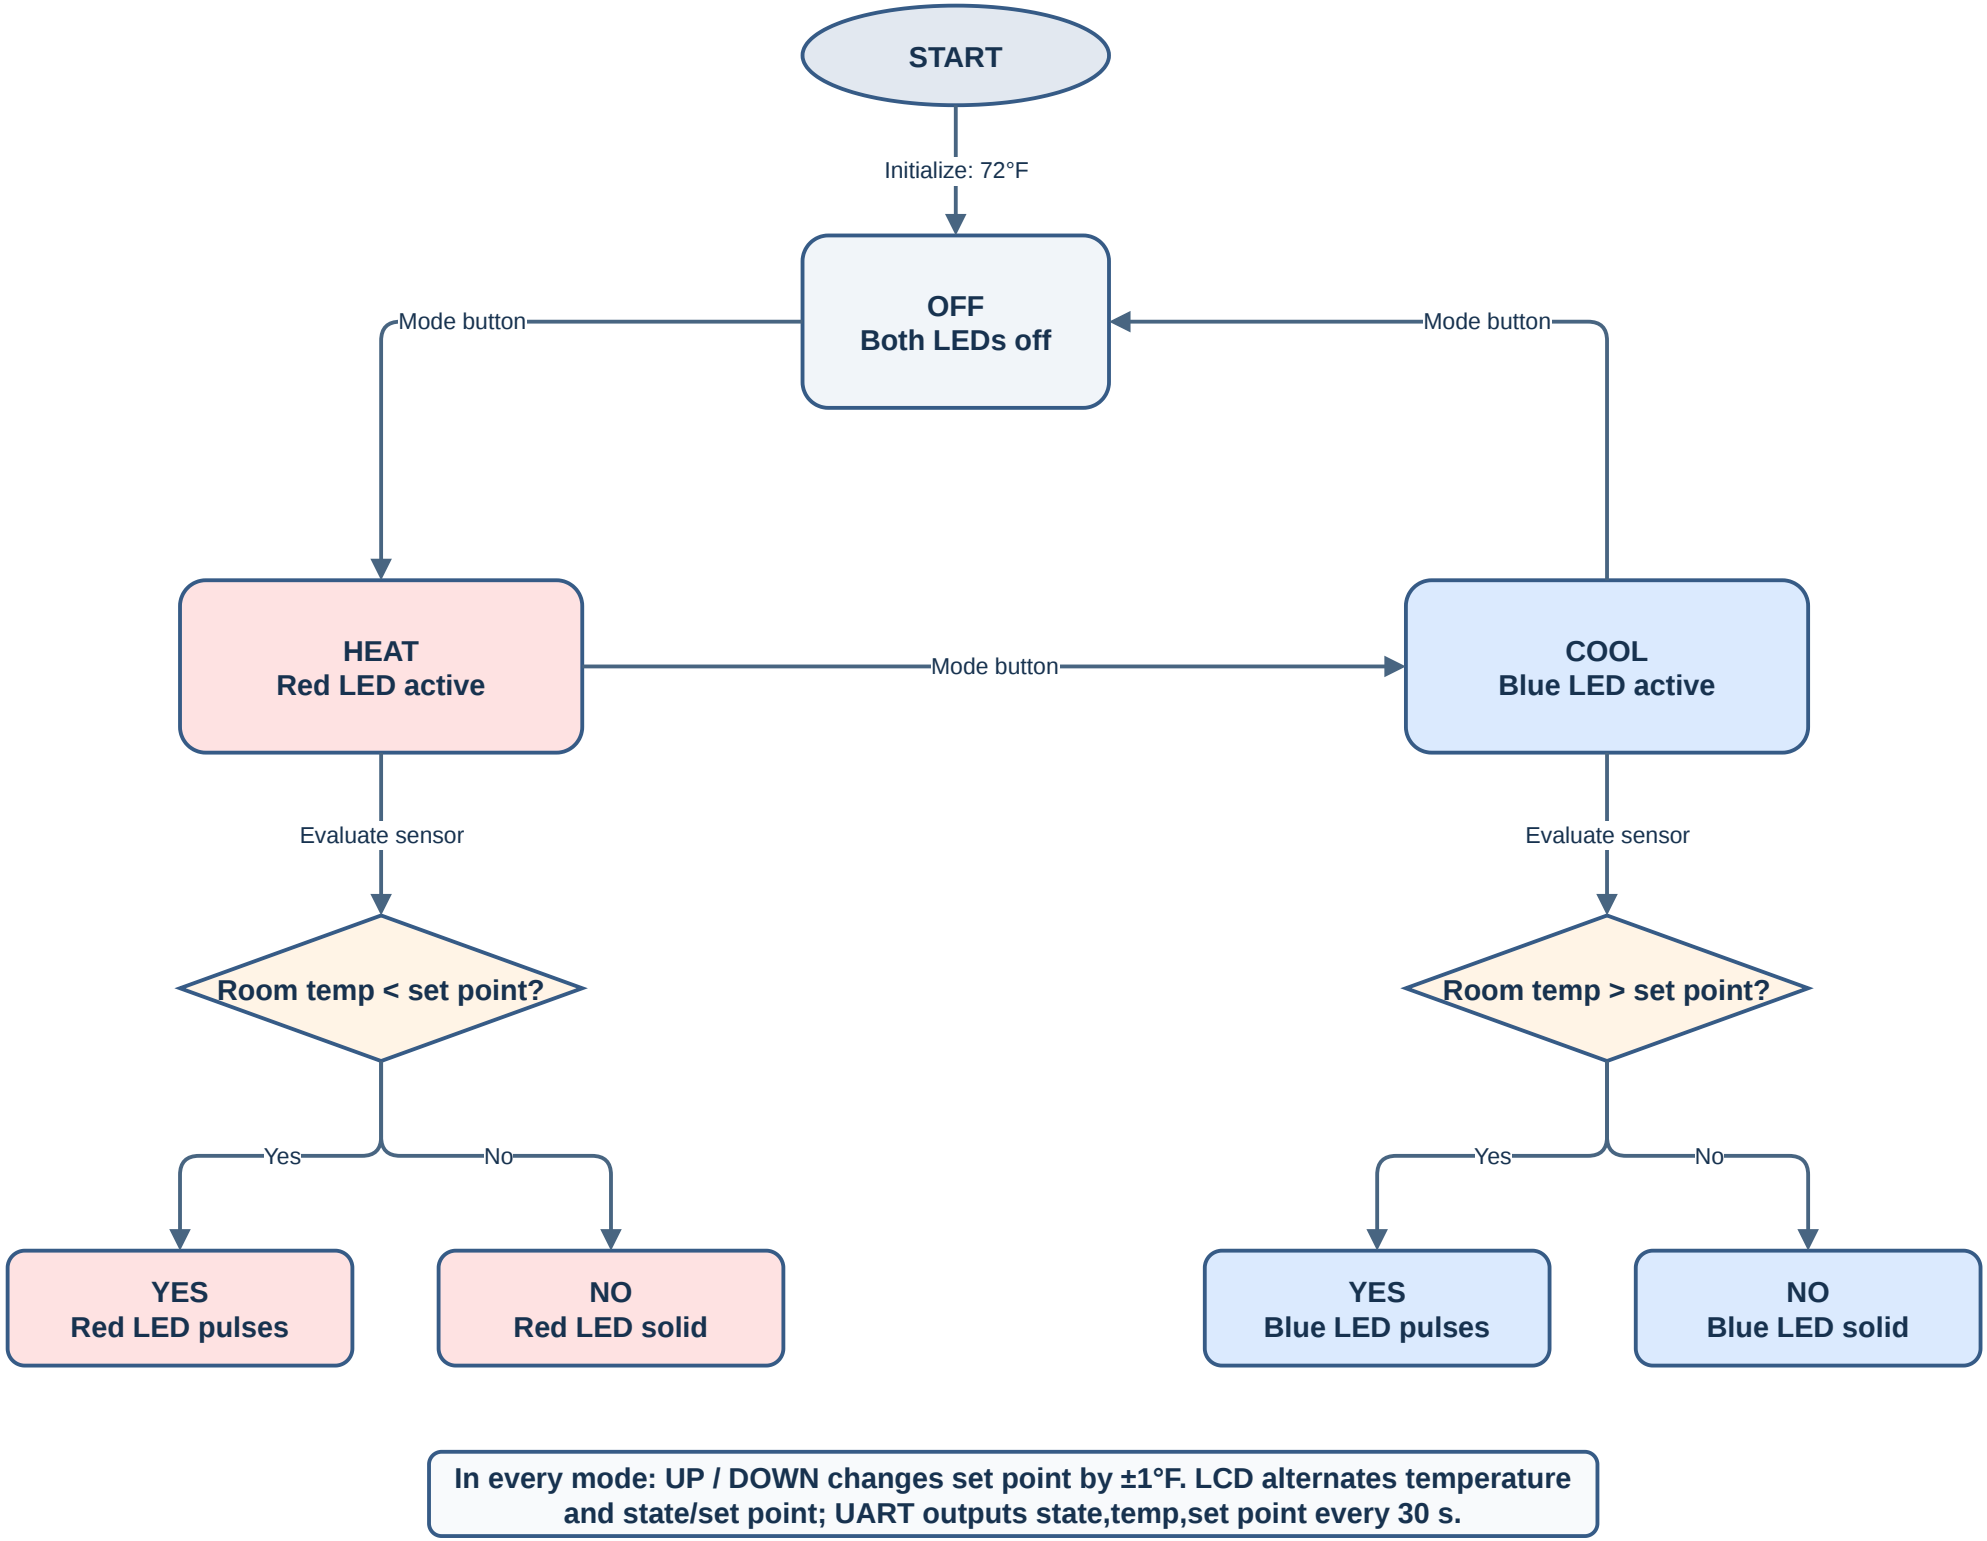
START
Initialize: 72°F
OFF
Both LEDs off
Mode button
Mode button
HEAT
Red LED active
Mode button
COOL
Blue LED active
Evaluate sensor
Evaluate sensor
Room temp < set point?
Room temp > set point?
Yes
No
Yes
No
YES
Red LED pulses
NO
Red LED solid
YES
Blue LED pulses
NO
Blue LED solid
In every mode: UP / DOWN changes set point by ±1°F. LCD alternates temperature and state/set point; UART outputs state,temp,set point every 30 s.