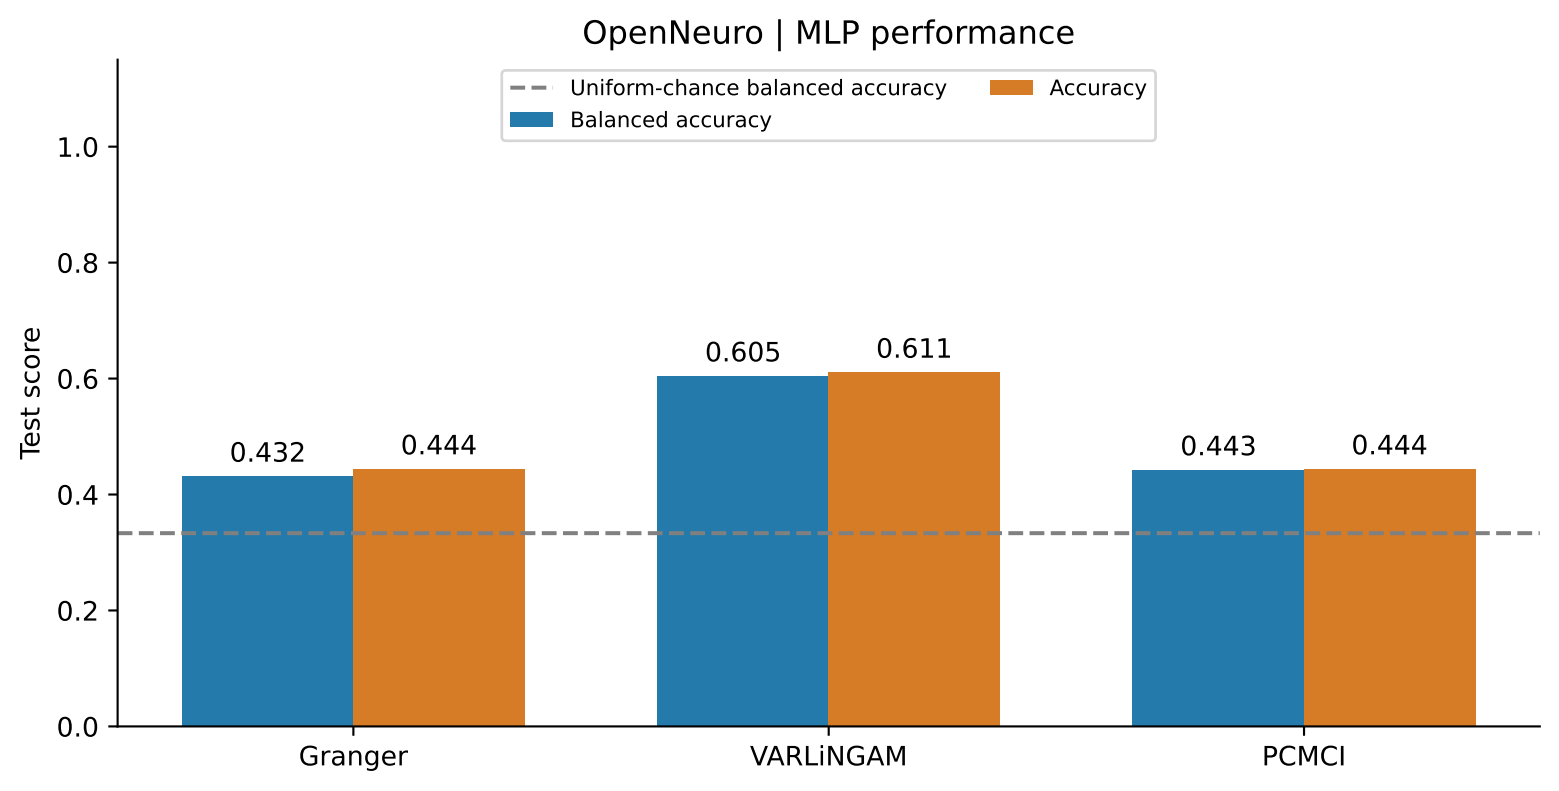
OpenNeuro | MLP performance
Uniform-chance balanced accuracy
Balanced accuracy
Accuracy
Test score
1.0
0.8
0.6
0.4
0.2
0.0
0.432
0.444
0.605
0.611
0.443
0.444
Granger
VARLiNGAM
PCMCI