



Circuit Reliability Review

Ventura District 5

January 2017

Providing Safe, Reliable, and Affordable Power

Southern California Edison is modernizing the power grid to meet the changing needs and expectations of our customers and to help California achieve its clean energy goals.

We are investing more than \$12 billion into our power grid between 2015 – 2017 with the goal of increasing power reliability through significant upgrades. These investments include:

- Updating thousands of transmission and distribution poles
- Replacing hundreds of miles of underground cables
- Replacing hundreds of underground structures such as vaults and manholes
- Upgrading critical distribution equipment; capacitor banks, switches, and circuit breakers
- Building new distribution circuits to serve electrical demands in our communities
- Inspecting and replacing overhead conductor and equipment to improve public safety

Our investments in local communities will help ensure that customers receive safe, reliable, and affordable electricity now and in the future.

Understanding Your Reliability Report

As your electric utility, we want you to always have power when you need it. To get there, we constantly track and monitor electric outages across our service territory, and we measure our “system reliability” from this data.

The two metrics we rely on are common in the electric utility industry: the System Average Interruption Duration Index (SAIDI) and the System Average Interruption Frequency Index (SAIFI). Both are described in more detail on the next page.

Replacing and upgrading our infrastructure will help SCE maintain or improve SAIDI and SAIFI measurements.

This report provides historical reliability data for the circuits that serve your jurisdiction and our proposed infrastructure upgrades for the current year.

To view other reliability reports, visit [sce.com>Outage Center>Maintaining Reliable Service](https://sce.com/OutageCenter/MaintainingReliableService)

Reliability Metrics

MOMENTARY OUTAGES:

OUTAGES LASTING 5 MINUTES OR LESS

MAIFI:

- The number of times the average customer is interrupted by Momentary outages each year.

SUSTAINED OUTAGES:

OUTAGES LASTING LONGER THAN 5 MINUTES

SAIFI:

- The number of times the average customer is interrupted by Sustained outages each year.

SAIDI:

- The cumulative amount of time the average customer is interrupted by Sustained outages each year.

Cities in the Ventura District

Camarillo

Channel Islands Beach

El Rio

Fillmore

Meiners Oaks

Mira Monte

Oak View

Ojai

Oxnard

Port Hueneme

San Buenaventura (Ventura)

Santa Paula

Ventura

Reliability by SCE District (No Exclusions)

District Name	2012				2013				2014				2015				2016			
	District SAIDI	SAIDI RANKING	District SAIFI	SAIFI Ranking	District SAIDI	SAIDI RANKING	District SAIFI	SAIFI Ranking	District SAIDI	SAIDI RANKING	District SAIFI	SAIFI Ranking	District SAIDI	SAIDI RANKING	District SAIFI	SAIFI Ranking	District SAIDI	SAIDI RANKING	District SAIFI	SAIFI Ranking
ANTELOPE VALLEY	78.60	28	0.56	31	94.42	22	0.62	31	51.05	35	0.59	34	104.34	22	0.68	30	107.67	24	0.87	29
ARROWHEAD	129.58	13	1.31	7	180.59	7	1.39	8	193.25	5	1.59	5	362.61	4	3.97	1	659.46	3	2.85	5
BARSTOW	184.80	7	1.15	12	204.33	6	1.40	7	201.53	4	1.34	10	187.11	8	1.17	12	134.83	18	1.35	9
BIG CREEK	1184.25	1	4.52	1	176.51	8	3.08	1	920.25	1	1.34	11	422.77	2	3.42	2	1062.01	2	4.99	1
BISHOP	463.09	2	1.25	9	104.44	17	0.51	35	118.79	17	0.59	35	298.11	6	2.22	4	168.59	8	1.22	14
BLYTHE	225.88	6	1.53	3	483.13	1	1.38	9	707.54	2	2.42	2	427.00	1	1.52	7	396.38	5	2.71	6
CATALINA	78.46	30	0.72	29	105.94	16	2.97	2	97.02	24	4.17	1	42.56	35	2.25	3	65.01	35	3.66	3
COVINA	108.73	19	0.92	19	100.51	19	0.86	20	91.60	27	0.87	22	100.08	23	0.81	25	112.13	22	0.97	24
DOMINGUEZ HILLS	117.22	18	0.82	24	89.17	26	0.80	21	82.30	29	0.71	28	130.63	15	0.97	17	146.38	12	1.11	17
FOOTHILL	91.69	25	0.90	20	85.80	27	0.79	24	93.35	25	0.93	21	109.64	20	0.95	20	142.81	14	1.03	21
FULLERTON	68.99	33	0.42	35	90.57	25	0.79	22	82.23	30	0.72	27	76.59	29	0.67	31	92.72	30	0.76	34
HUNTINGTON BEACH	95.78	23	0.89	21	66.51	32	0.68	29	79.61	31	0.78	25	98.32	25	0.95	19	128.02	20	1.26	12
KERNVILLE	226.76	5	1.31	6	232.18	4	1.96	3	178.69	8	1.99	3	286.38	7	0.96	18	2421.32	1	3.67	2
LONG BEACH	75.83	31	0.55	33	75.11	30	0.70	28	66.33	34	0.61	32	164.46	9	0.89	23	135.16	17	0.86	31
MENIFEE	99.32	22	0.84	23	107.39	15	1.26	10	156.68	11	1.32	12	111.46	19	0.98	16	156.75	9	1.31	10
MONROVIA	108.11	20	1.13	15	99.12	20	1.02	16	133.32	14	1.16	16	96.68	26	0.88	24	116.57	21	0.84	32
MONTEBELLO	131.06	12	1.13	14	118.08	13	1.17	12	158.34	10	1.16	15	150.28	12	1.18	11	133.52	19	1.17	15
ONTARIO	93.09	24	0.87	22	77.39	29	0.79	23	97.91	23	1.00	19	94.04	27	0.74	27	105.07	27	0.93	27
PALM SPRINGS	175.92	8	1.27	8	112.80	14	0.77	25	107.04	20	0.71	29	99.54	24	0.80	26	107.58	25	1.07	19
REDLANDS	120.13	16	1.11	16	96.48	21	1.04	15	154.25	12	1.04	18	124.52	17	1.01	14	137.11	16	0.98	23
RIDGECREST	229.65	4	1.44	4	161.95	9	1.12	13	176.84	9	1.57	6	148.90	13	1.01	15	254.31	6	1.05	20
SADDLEBACK	83.01	27	0.73	27	70.69	31	0.53	34	99.07	22	0.74	26	46.03	34	0.39	35	65.99	34	0.65	35
SAN JOAQUIN	135.90	10	1.04	18	244.44	2	1.45	6	138.25	13	1.17	14	127.50	16	1.05	13	108.44	23	1.09	18
SANTA ANA	78.60	29	0.55	32	93.35	24	0.74	26	91.68	26	0.84	23	67.46	32	0.71	29	97.27	29	1.00	22
SANTA BARBARA	153.81	9	1.15	13	82.00	28	0.70	27	183.78	7	1.38	9	152.37	11	1.52	6	156.66	10	1.41	8
SANTA MONICA	101.69	21	0.79	25	122.78	12	1.00	17	110.76	19	0.99	20	75.41	30	0.62	32	91.08	31	0.95	26
SOUTH BAY	122.68	15	1.17	10	142.15	10	1.49	5	125.28	16	1.39	8	164.07	10	1.31	8	183.90	7	1.88	7
TEHACHAPI	117.96	17	1.43	5	232.67	3	1.12	14	130.70	15	1.29	13	298.96	5	1.21	9	97.29	28	1.13	16
THOUSAND OAKS	127.73	14	1.05	17	93.86	23	0.91	18	104.37	21	1.10	17	106.59	21	0.92	21	143.78	13	1.31	11
VALENCIA	62.01	35	0.46	34	51.04	34	0.53	33	79.23	32	0.61	33	72.27	31	0.61	33	105.09	26	0.97	25
VENTURA	134.81	11	1.15	11	100.52	18	1.21	11	183.79	6	1.65	4	148.85	14	1.19	10	150.41	11	1.24	13
VICTORVILLE	67.70	34	0.66	30	61.33	33	0.63	30	68.85	33	0.63	31	87.03	28	0.91	22	79.35	33	0.92	28
WHITTIER	72.60	32	0.74	26	135.04	11	0.86	19	87.60	28	0.70	30	114.52	18	0.73	28	137.34	15	0.81	33
WILDOMAR	88.54	26	0.72	28	40.51	35	0.56	32	118.49	18	0.81	24	52.70	33	0.60	34	84.01	32	0.87	30
YUCCA VALLEY	319.82	3	3.41	2	216.97	5	1.50	4	304.25	3	1.49	7	389.08	3	1.80	5	463.68	4	3.39	4
SCE SystemWide	108.13		0.89		102.61		0.91		112.00		0.96		114.83		0.92		134.48		1.10	

Exclusions are days which utilities are allowed to remove from their metrics because the outages on those days were caused by a severe acts of nature.

**In the columns showing "Rank," lower numbers indicate poorer performance.


Overview of Ventura District 5

There are 17 circuits that serve Ventura District 5

Circuit Type	Sum of Customers	Circuit Type	Sum of Customers	Circuit Type	Sum of Customers	Circuit Type	Sum of Customers
ALVARADO(16KV)	2,311						
BEARDSLEY(16KV)	571						
BROOME(16KV)	1,373						
BUCKAROO(16KV)	2,417						
CARNEGIE(16KV)	4,355						
CORSICA(16KV)	5,310						
DITCH(16KV)	2,911						
ENTERPRISE(16KV)	3,140						
FIFTH ST.(16KV)	284						
GIZMO(16KV)	4,320						
MAXSON(16KV)	3,309						
RAMAC(16KV)	870						
REIMANN(16KV)	1,697						
SARATOGA(16KV)	193						
SCHOONER(16KV)	5,451						
SIDEWINDER(16KV)	2,777						
TIROS(16KV)	1,139						


Grand Total 42,428

Reliability History of Circuits Serving Ventura District 5 (No Exclusions)

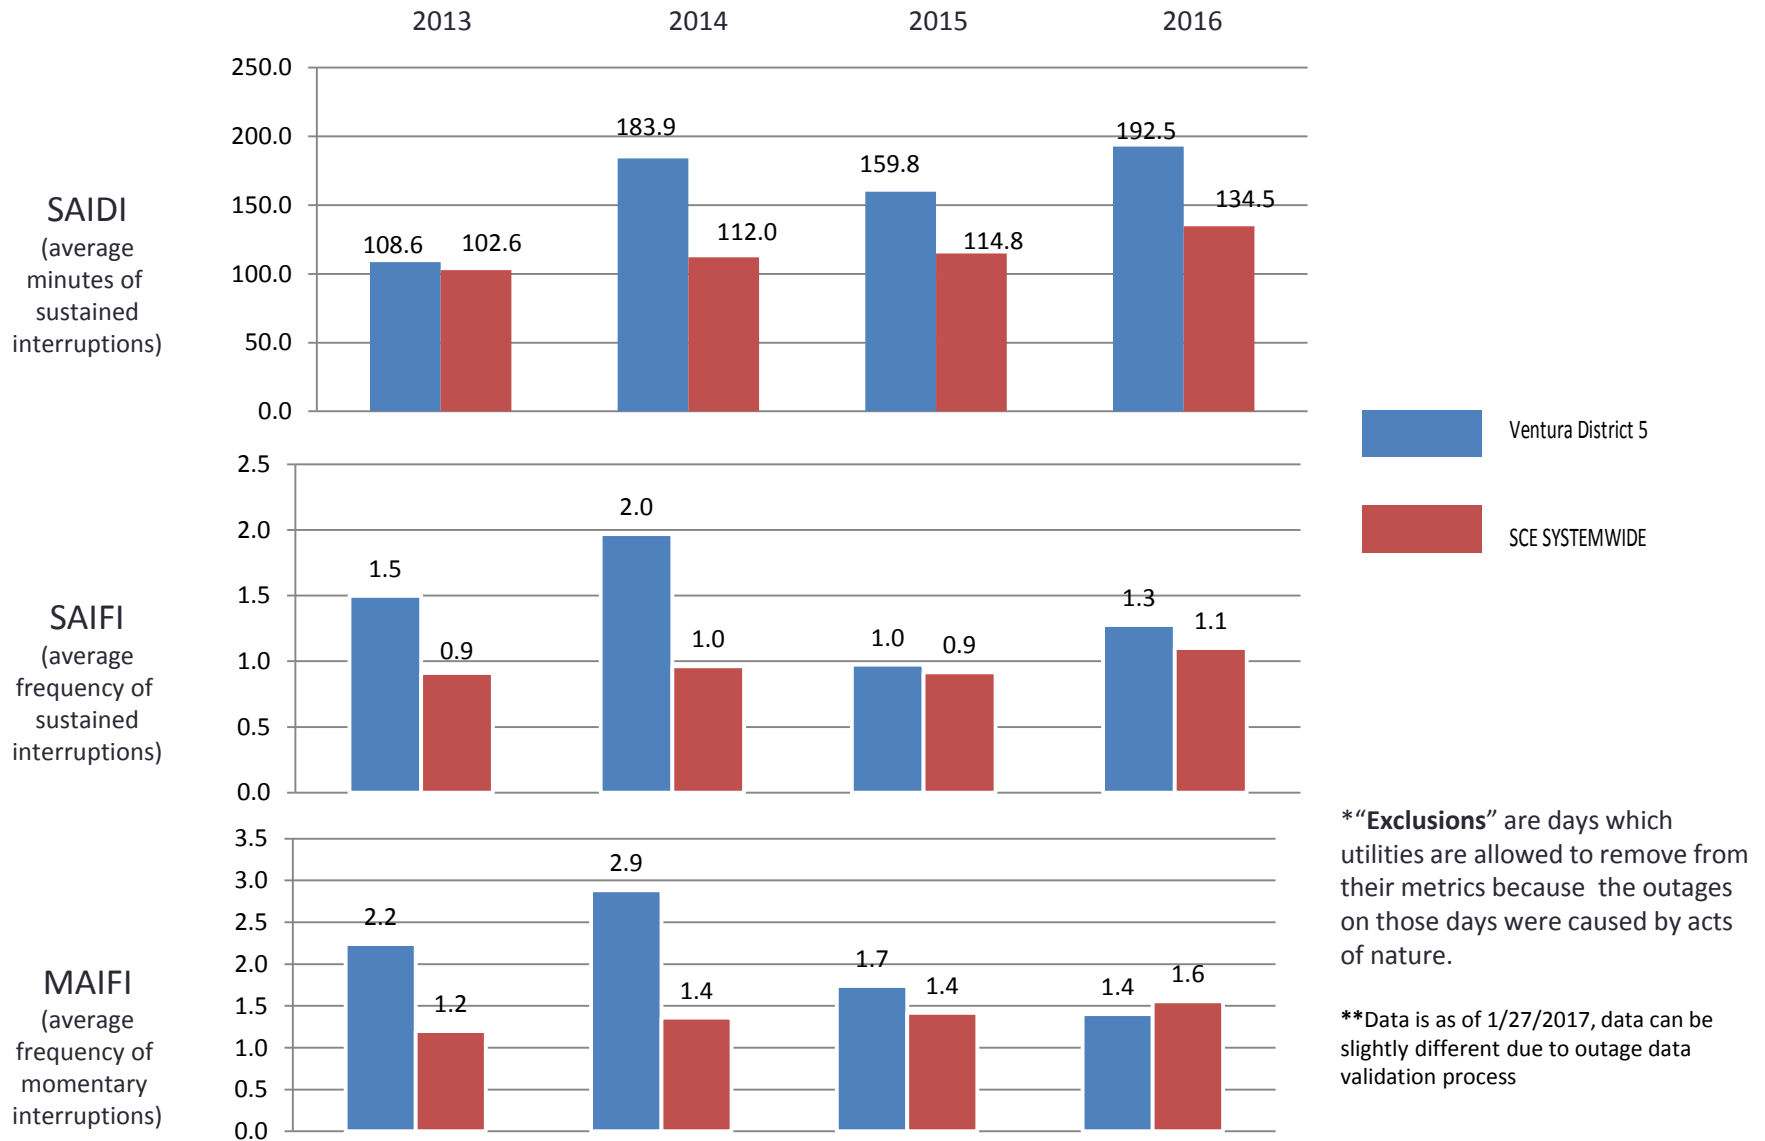

Causes of Repair Outages in Ventura District 5 Circuits 2016 YTD


Contributions to SAIDI by Outage Cause

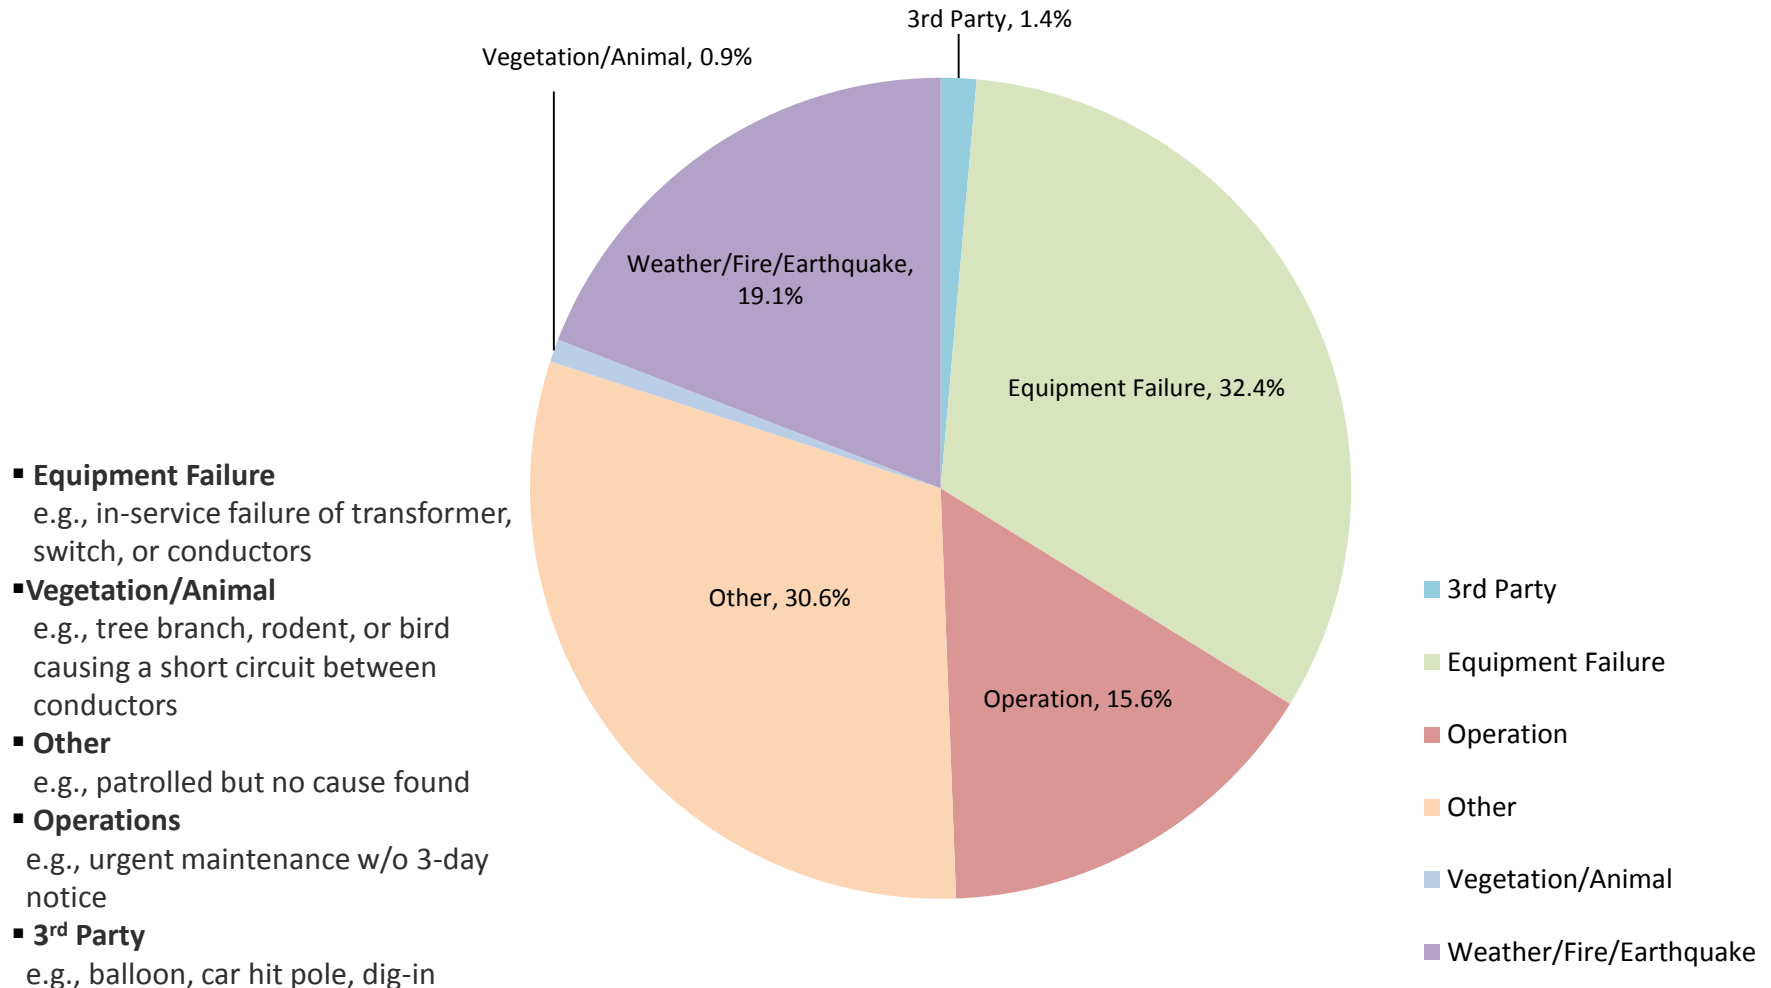

SAIDI = the cumulative amount of time the average customer is interrupted by “sustained” outages each year.

Causes of Repair Outages in Ventura District 5 Circuits 2016 YTD

Contributions to SAIFI by Outage Cause

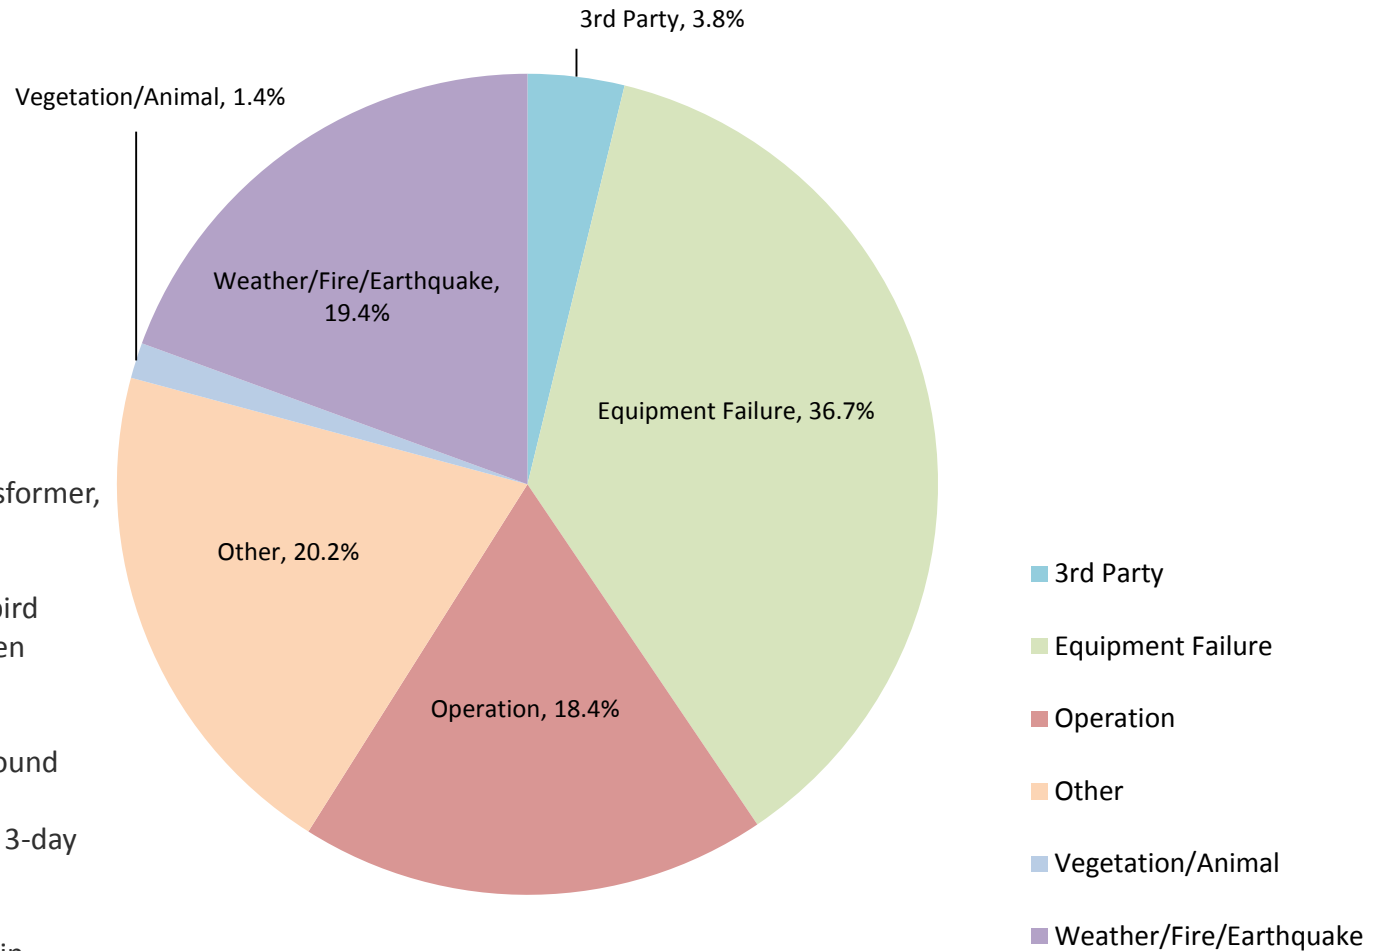

- **Equipment Failure**
e.g., in-service failure of transformer, switch, or conductors
- **Vegetation/Animal**
e.g., tree branch, rodent, or bird causing a short circuit between conductors
- **Other**
e.g., patrolled but no cause found
- **Operations**
e.g., urgent maintenance w/o 3-day notice
- **3rd Party**
e.g., balloon, car hit pole, dig-in

SAIFI = the number of times the average customer is interrupted by “sustained” outages each year.

Ventura County District 5 Unincorporated Areas 2017 Capital Improvement Plan

Unincorporated Community

Unincorporated County Area

Supervisory District

Replacement/Equipment Upgrade

• Pole Replacement

Other Work

• Circuit Public Safety Upgrade

• Circuit Rebuild

Replacement/Equipment Upgrade (Transmission)

✱ Electrical Equipment Replacement

✱ Pole Replacement

Other Work (Transmission)

■ Circuit Reliability Upgrade

Disclaimer: This report is intended solely for informational purposes. The information included is reflective as of January 1, 2017 and is subject to change without further notice.



Date: 2/23/2017
File Name: Ventura_Districts_2017_CIP.mxd

Features displayed herein are sharing; new sources are intended for informational purposes only. Data and sources may be outdated at this scale. Always consult with the proper legal authorities regarding such matters. Also, report on, or report to, the proper legal authorities. Turner Data Systems is a registered trademark of Turner Data Systems & Company. Reproduced with permission from Turner Data Systems & Company. © Turner Data Systems & Company. All rights reserved. Service Layer Credits: Content may not reflect National Geographic's current map policy. Sources: National Geographic, CartoDeLune, HDOP, WGS84, USGS, NASA, EPA.



Back-up Slides

Reliability Histories of Circuits Serving Ventura District 5

Updated through Year-End 2016

Average Reliability of 17 Circuits Serving Ventura District 5

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
Ventura District 5	108.6	1.5	2.2	183.9	2.0	2.9	159.8	1.0	1.7	92.6	0.5	0.4	34.7	0.3	0.4	20.1	0.2	0.2	45.0	0.3	0.4	192.5	1.3	1.4
3rd Party	12%	28%	24%	19%	23%	38%	5%	6%	17%	0%	1%	2%	0%	0%	11%	2%	1%	20%	5%	14%	0%	1%	4%	7%
Equipment Failure	50%	31%	17%	41%	32%	20%	84%	74%	19%	5%	4%	2%	82%	69%	72%	74%	80%	40%	33%	33%	27%	32%	37%	34%
Operation	10%	9%	2%	16%	11%	2%	8%	10%	1%	11%	10%	0%	17%	29%	17%	15%	9%	0%	24%	26%	6%	16%	18%	6%
Other	4%	3%	13%	12%	18%	12%	2%	7%	40%	61%	50%	40%	1%	1%	0%	1%	0%	0%	5%	3%	66%	31%	20%	30%
Vegetation/Animal	4%	13%	31%	11%	15%	29%	0%	0%	18%	1%	0%	14%	0%	0%	0%	6%	8%	41%	0%	0%	0%	1%	1%	10%
Weather/Fire/Earthquake	19%	17%	13%	1%	0%	0%	2%	3%	5%	23%	35%	42%	1%	0%	0%	2%	2%	0%	34%	23%	1%	19%	19%	13%
SCE Systemwide	102.6	0.9	1.2	112.0	1.0	1.4	114.8	0.9	1.4	40.5	0.3	0.4	34.8	0.3	0.4	29.4	0.2	0.3	29.8	0.3	0.4	134.5	1.1	1.6

Notes:

No outages are excluded from the metrics.

Outage Causes:

Other: e.g., patrolled but no cause could be found

Operations: e.g., urgent maintenance w/o 3-day notice to customers

3rd Party: e.g., balloons, car hit pole, dig-in

Vegetation/Animal: e.g., tree branch, rodent, or bird causing short circuit across conductors

SAIDI (minutes) = the cumulative amount of time the average customer is interrupted by "sustained" (longer than 5 minutes) outages.

SAIFI (interruptions) = the number of times the average customer is interrupted by "sustained" outages.

MAIFI (interruptions) = the number of times the average customer is interrupted by "momentary" (lasting 5 minutes or less) outages.

Reliability Histories for Individual Circuits Serving Ventura District 5

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
ALVARADO(16KV) - Customers: 2,311	23.4	0.2	1.0	173.3	2.2	3.0	31.1	1.0	2.0	10.1	0.1	0.0	40.5	0.3	0.2	21.7	0.1	0.0	18.7	0.2	1.0	91.0	0.7	1.2
3rd Party	0%	0%	0%	52%	91%	33%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	98%	99%	0%	48%	9%	0%	0%	0%	0%	0%	0%	0%	100%	100%	100%	0%	0%	0%	91%	80%	0%	63%	73%	18%
Operation	0%	0%	0%	0%	0%	0%	0%	1%	0%	100%	100%	0%	0%	0%	0%	100%	100%	0%	9%	20%	0%	37%	27%	0%
Other	2%	1%	0%	0%	0%	0%	100%	99%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	82%
Vegetation/Animal	0%	0%	100%	0%	0%	67%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
BEARDSLEY(16KV) - Customers: 571	132.1	1.6	1.7	185.7	1.6	1.0	192.6	1.8	0.0	0.5	0.0	0.0	34.4	0.3	1.2	1.4	0.0	0.0	0.0	0.0	0.0	36.3	0.3	1.2
3rd Party	3%	0%	58%	89%	89%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	35%	50%	0%	0%	0%	0%	1%	1%	100%
Equipment Failure	71%	93%	42%	1%	0%	0%	94%	99%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	1%	0%	0%
Operation	1%	1%	0%	10%	11%	0%	1%	1%	0%	0%	0%	0%	86%	92%	0%	0%	0%	0%	0%	0%	0%	81%	90%	0%
Other	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	65%	50%	0%	0%	0%	0%	3%	1%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	14%	8%	0%	0%	0%	0%	0%	0%	0%	13%	8%	0%
Weather/Fire/Earthquake	25%	5%	0%	0%	0%	0%	4%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
BROOME(16KV) - Customers: 1,373	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
BUCKAROO(16KV) - Customers: 2,417	90.0	1.1	2.0	73.5	0.4	2.1	59.8	0.7	7.3	228.2	1.2	1.0	0.0	0.0	0.0	2.3	0.0	0.0	15.4	0.0	0.0	245.9	1.2	1.0
3rd Party	0%	0%	0%	31%	25%	48%	20%	24%	25%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	77%	93%	0%	27%	31%	0%	45%	45%	23%	11%	9%	0%	0%	0%	0%	0%	0%	0%	46%	36%	0%	13%	10%	0%
Operation	23%	7%	0%	15%	6%	3%	18%	7%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	28%	26%	0%	2%	1%	0%
Other	0%	0%	50%	2%	2%	0%	17%	24%	39%	87%	90%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	81%	88%	0%
Vegetation/Animal	0%	0%	50%	0%	0%	48%	0%	0%	14%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%
Weather/Fire/Earthquake	0%	0%	0%	26%	37%	0%	0%	0%	0%	2%	1%	0%	0%	0%	0%	0%	0%	0%	27%	38%	0%	4%	1%	0%

Reliability Histories for Individual Circuits Serving Ventura District 5

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
CARNEGIE(16KV) - Customers: 4,355	43.8	2.5	0.6	132.5	1.1	2.3	72.4	0.6	2.0	70.4	0.2	1.0	4.6	0.1	0.0	14.4	0.2	0.0	103.3	0.7	1.2	192.7	1.1	2.2
3rd Party	0%	0%	0%	0%	0%	0%	40%	58%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	45%	42%	0%	45%	69%	54%	30%	19%	1%	20%	26%	1%	16%	3%	0%	0%	0%	0%	7%	6%	84%	11%	8%	46%
Operation	5%	0%	0%	45%	22%	0%	19%	9%	0%	0%	0%	0%	0%	0%	0%	25%	15%	0%	72%	84%	16%	40%	58%	9%
Other	1%	0%	0%	9%	9%	1%	0%	0%	50%	10%	24%	0%	40%	77%	0%	0%	0%	0%	21%	10%	0%	16%	14%	0%
Vegetation/Animal	16%	15%	100%	0%	0%	44%	0%	0%	49%	0%	0%	0%	0%	0%	0%	75%	85%	0%	0%	0%	0%	6%	13%	0%
Weather/Fire/Earthquake	34%	42%	0%	0%	0%	1%	10%	15%	0%	70%	51%	99%	44%	20%	0%	0%	0%	0%	0%	0%	0%	27%	8%	45%
CORSICA(16KV) - Customers: 5,310	21.3	1.0	2.0	135.7	2.8	5.4	26.4	0.2	1.0	67.2	1.0	0.0	15.7	0.1	0.0	30.4	0.1	0.0	9.2	0.0	1.0	122.4	1.2	1.0
3rd Party	0%	0%	0%	24%	8%	35%	0%	0%	0%	0%	0%	0%	0%	0%	0%	1%	1%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	2%	0%	0%	37%	55%	28%	86%	86%	2%	0%	0%	0%	100%	100%	0%	88%	63%	0%	0%	0%	0%	35%	9%	0%
Operation	28%	3%	0%	4%	1%	0%	14%	14%	0%	0%	0%	0%	0%	0%	0%	11%	37%	0%	100%	100%	0%	10%	4%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	98%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	100%
Vegetation/Animal	19%	49%	25%	35%	36%	37%	0%	0%	0%	6%	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	3%	1%	0%
Weather/Fire/Earthquake	51%	48%	75%	0%	0%	0%	0%	0%	0%	94%	99%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	52%	86%	0%
DITCH(16KV) - Customers: 2,911	152.7	1.2	1.1	287.1	3.2	11.1	328.2	2.3	3.0	128.1	1.1	0.0	18.8	0.9	1.0	13.5	0.1	0.0	0.0	0.0	1.0	160.4	2.0	2.0
3rd Party	0%	0%	0%	45%	61%	63%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	87%	84%	0%	46%	33%	8%	96%	88%	0%	6%	1%	0%	5%	0%	0%	0%	0%	0%	0%	0%	0%	6%	1%	0%
Operation	13%	16%	10%	9%	7%	2%	3%	12%	0%	6%	4%	0%	95%	100%	100%	100%	100%	0%	0%	0%	0%	24%	48%	50%
Other	0%	0%	0%	0%	0%	9%	0%	0%	34%	88%	95%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	70%	51%	50%
Vegetation/Animal	0%	0%	90%	0%	0%	18%	0%	0%	34%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	1%	0%	33%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
ENTERPRISE(16KV) - Customers: 3,140	14.9	0.1	3.9	512.4	5.4	3.4	343.8	1.4	6.8	301.8	1.0	3.0	151.7	1.3	2.6	1.1	0.0	1.0	323.7	2.0	0.1	778.3	4.2	6.7
3rd Party	26%	61%	49%	3%	2%	27%	1%	0%	29%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	66%	30%	0%	33%	21%	15%	83%	84%	41%	1%	0%	0%	86%	85%	100%	100%	100%	0%	38%	53%	0%	33%	50%	39%
Operation	1%	2%	0%	18%	19%	0%	17%	16%	0%	0%	0%	0%	14%	15%	0%	0%	0%	0%	0%	0%	0%	3%	4%	0%
Other	1%	0%	26%	11%	19%	29%	0%	0%	15%	99%	100%	67%	0%	0%	0%	0%	0%	0%	0%	0%	0%	39%	24%	30%
Vegetation/Animal	7%	7%	25%	35%	39%	29%	0%	0%	15%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	15%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	33%	0%	0%	0%	0%	0%	0%	62%	47%	100%	26%	22%	16%

Reliability Histories for Individual Circuits Serving Ventura District 5

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
FIFTH ST.(16KV) - Customers: 284	214.8	1.3	1.9	38.4	0.3	0.0	4.6	0.0	0.0	338.8	1.0	2.0	2.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	341.1	1.0	2.0
3rd Party	80%	76%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	5%	1%	60%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	1%	1%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	1%	2%	0%
Other	11%	20%	40%	0%	0%	0%	0%	0%	0%	100%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	99%	98%	100%
Vegetation/Animal	3%	2%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
GIZMO(16KV) - Customers: 4,320	284.8	2.1	3.1	278.8	3.2	2.9	315.9	3.4	0.0	0.0	0.0	0.0	122.3	1.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	122.3	1.0	0.0
3rd Party	9%	57%	35%	2%	3%	66%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	30%	3%	33%	52%	31%	0%	89%	93%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%
Operation	3%	2%	0%	6%	3%	0%	11%	7%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	39%	62%	34%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	57%	38%	32%	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
MAXSON(16KV) - Customers: 3,309	18.2	0.7	1.0	125.7	1.2	1.0	14.1	0.1	0.1	4.1	0.0	0.2	0.0	0.0	0.0	60.5	0.1	1.0	17.7	0.1	0.0	82.3	0.2	1.2
3rd Party	1%	0%	100%	47%	83%	0%	2%	2%	0%	53%	85%	67%	0%	0%	0%	0%	0%	0%	0%	0%	0%	3%	18%	11%
Equipment Failure	7%	1%	0%	52%	17%	0%	19%	11%	0%	4%	1%	33%	0%	0%	0%	98%	83%	100%	2%	4%	0%	72%	23%	88%
Operation	88%	99%	0%	1%	0%	0%	60%	58%	0%	0%	0%	0%	0%	0%	0%	2%	17%	0%	98%	96%	100%	23%	56%	2%
Other	4%	1%	0%	0%	0%	0%	19%	29%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	1%	0%	0%	0%	0%	100%	0%	0%	0%	9%	7%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	2%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	34%	7%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	2%	2%	0%
RAMAC(16KV) - Customers: 870	85.0	0.4	0.0	217.9	1.4	2.0	60.3	0.2	0.3	813.4	2.9	0.0	0.0	0.0	0.0	1.7	0.0	0.0	0.0	0.0	0.0	815.0	2.9	0.0
3rd Party	24%	30%	0%	59%	82%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	17%	5%	47%	13%	3%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%
Operation	19%	25%	0%	23%	12%	0%	36%	65%	0%	42%	62%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	42%	62%	0%
Other	0%	0%	0%	0%	0%	3%	0%	0%	25%	58%	38%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	58%	38%	0%
Vegetation/Animal	13%	16%	0%	1%	0%	50%	51%	32%	75%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	45%	29%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

Reliability Histories for Individual Circuits Serving Ventura District 5

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
REIMANN(16KV) - Customers: 1,697	28.4	0.3	0.7	226.5	1.7	0.1	12.7	0.0	2.0	212.0	1.0	0.0	38.1	0.1	0.0	8.6	0.1	1.0	48.1	1.1	0.0	306.8	2.3	1.0
3rd Party	0%	0%	0%	35%	45%	100%	0%	0%	50%	0%	0%	0%	0%	0%	0%	99%	99%	100%	99%	100%	0%	18%	51%	100%
Equipment Failure	49%	6%	0%	9%	1%	0%	99%	96%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	12%	3%	0%
Operation	51%	94%	100%	56%	54%	0%	1%	4%	0%	7%	5%	0%	0%	0%	0%	1%	1%	0%	1%	0%	0%	5%	2%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	93%	95%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	64%	44%	0%
SARATOGA(16KV) - Customers: 193	8.5	0.6	1.4	32.4	1.0	0.0	3.2	0.0	2.6	80.8	1.6	0.4	0.0	0.0	0.0	0.0	0.0	1.0	4.1	0.0	0.0	84.9	1.6	1.4
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	100%	100%	100%	19%	4%	0%	0%	0%	0%	93%	63%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	94%	63%	0%
Operation	0%	0%	0%	0%	0%	0%	7%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	81%	96%	0%	93%	50%	100%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	72%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	7%	37%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	6%	37%	28%
SCHOONER(16KV) - Customers: 5,451	117.9	3.6	5.2	163.6	1.1	1.0	5.4	0.1	0.0	12.9	0.0	0.0	3.7	0.0	0.0	56.8	1.0	0.0	0.0	0.0	0.0	73.4	1.1	0.0
3rd Party	27%	56%	19%	0%	0%	0%	85%	74%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	24%	17%	19%	59%	46%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	94%	98%	0%	0%	0%	0%	72%	91%	0%
Operation	7%	4%	0%	20%	11%	0%	15%	26%	0%	100%	100%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	23%	7%	0%
Other	22%	6%	17%	20%	43%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	20%	17%	46%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	6%	2%	0%	0%	0%	0%	5%	2%	0%
SIDEWINDER(16KV) - Customers: 2,777	113.5	0.3	1.0	31.5	0.2	1.0	14.4	0.2	0.2	11.1	0.0	0.0	23.6	0.1	1.0	1.4	0.0	0.0	0.4	0.0	0.0	36.5	0.1	1.0
3rd Party	30%	19%	93%	0%	0%	0%	34%	3%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	52%	37%	0%	42%	28%	0%	22%	1%	0%	31%	16%	0%	3%	1%	100%	97%	50%	0%	100%	100%	0%	16%	7%	100%
Operation	10%	11%	7%	1%	1%	0%	41%	96%	100%	0%	0%	0%	97%	99%	0%	3%	50%	0%	0%	0%	0%	63%	69%	0%
Other	8%	33%	0%	57%	70%	100%	0%	0%	0%	69%	84%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	21%	24%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	4%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

Reliability Histories for Individual Circuits Serving Ventura District 5

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
TIROS(16KV) - Customers: 1,139	743.0	3.2	4.8	104.1	1.1	0.9	1901.0	3.1	1.8	69.9	0.2	0.3	10.2	0.1	0.9	1.0	0.0	0.0	149.1	0.3	0.0	230.3	0.6	1.2
3rd Party	0%	1%	0%	0%	0%	0%	5%	14%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	7%	18%	0%	5%	8%	0%
Equipment Failure	87%	84%	79%	40%	10%	0%	91%	63%	53%	15%	31%	0%	100%	100%	100%	0%	0%	0%	85%	78%	0%	64%	62%	75%
Operation	12%	15%	0%	32%	82%	100%	0%	0%	0%	1%	3%	0%	0%	0%	0%	100%	100%	0%	8%	4%	0%	6%	3%	0%
Other	1%	0%	21%	11%	2%	0%	0%	0%	0%	85%	66%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	26%	26%	25%
Vegetation/Animal	0%	0%	0%	12%	5%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	4%	1%	0%	3%	23%	47%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%