



# Circuit Reliability Review

## **Costa Mesa**

---

January 2017

# Providing Safe, Reliable, and Affordable Power

Southern California Edison is modernizing the power grid to meet the changing needs and expectations of our customers and to help California achieve its clean energy goals.

We are investing more than \$12 billion into our power grid between 2015 – 2017 with the goal of increasing power reliability through significant upgrades. These investments include:

- Updating thousands of transmission and distribution poles
- Replacing hundreds of miles of underground cables
- Replacing hundreds of underground structures such as vaults and manholes
- Upgrading critical distribution equipment; capacitor banks, switches, and circuit breakers
- Building new distribution circuits to serve electrical demands in our communities
- Inspecting and replacing overhead conductor and equipment to improve public safety

Our investments in local communities will help ensure that customers receive safe, reliable, and affordable electricity now and in the future.

# Understanding Your Reliability Report

As your electric utility, we want you to always have power when you need it. To get there, we constantly track and monitor electric outages across our service territory, and we measure our “system reliability” from this data.

The two metrics we rely on are common in the electric utility industry: the System Average Interruption Duration Index (SAIDI) and the System Average Interruption Frequency Index (SAIFI). Both are described in more detail on the next page.

Replacing and upgrading our infrastructure will help SCE maintain or improve SAIDI and SAIFI measurements.

This report provides historical reliability data for the circuits that serve your jurisdiction and our proposed infrastructure upgrades for the current year.

To view other reliability reports, visit [sce.com>Outage Center>Maintaining Reliable Service](https://www.sce.com/Outage-Center/Maintaining-Reliable-Service)

# Reliability Metrics

## MOMENTARY OUTAGES:

OUTAGES LASTING 5 MINUTES OR LESS

### MAIFI:

- The number of times the average customer is interrupted by Momentary outages each year.

## SUSTAINED OUTAGES:

OUTAGES LASTING LONGER THAN 5 MINUTES

### SAIFI:

- The number of times the average customer is interrupted by Sustained outages each year.

### SAIDI:

- The cumulative amount of time the average customer is interrupted by Sustained outages each year.

# Cities in the Huntington District

**Costa Mesa**

Fountain Valley

Huntington Beach

Newport Beach

Westminster

# Reliability by SCE District (No Exclusions)

District Name	2012				2013				2014				2015				2016			
	District SAIDI	SAIDI RANKING	District SAIFI	SAIFI Ranking	District SAIDI	SAIDI RANKING	District SAIFI	SAIFI Ranking	District SAIDI	SAIDI RANKING	District SAIFI	SAIFI Ranking	District SAIDI	SAIDI RANKING	District SAIFI	SAIFI Ranking	District SAIDI	SAIDI RANKING	District SAIFI	SAIFI Ranking
ANTELOPE VALLEY	78.60	28	0.56	31	94.42	22	0.62	31	51.05	35	0.59	34	104.34	22	0.68	30	107.67	24	0.87	29
ARROWHEAD	129.58	13	1.31	7	180.59	7	1.39	8	193.25	5	1.59	5	362.61	4	3.97	1	659.46	3	2.85	5
BARSTOW	184.80	7	1.15	12	204.33	6	1.40	7	201.53	4	1.34	10	187.11	8	1.17	12	134.83	18	1.35	9
BIG CREEK	1184.25	1	4.52	1	176.51	8	3.08	1	920.25	1	1.34	11	422.77	2	3.42	2	1062.01	2	4.99	1
BISHOP	463.09	2	1.25	9	104.44	17	0.51	35	118.79	17	0.59	35	298.11	6	2.22	4	168.59	8	1.22	14
BLYTHE	225.88	6	1.53	3	483.13	1	1.38	9	707.54	2	2.42	2	427.00	1	1.52	7	396.38	5	2.71	6
CATALINA	78.46	30	0.72	29	105.94	16	2.97	2	97.02	24	4.17	1	42.56	35	2.25	3	65.01	35	3.66	3
COVINA	108.73	19	0.92	19	100.51	19	0.86	20	91.60	27	0.87	22	100.08	23	0.81	25	112.13	22	0.97	24
DOMINGUEZ HILLS	117.22	18	0.82	24	89.17	26	0.80	21	82.30	29	0.71	28	130.63	15	0.97	17	146.38	12	1.11	17
FOOTHILL	91.69	25	0.90	20	85.80	27	0.79	24	93.35	25	0.93	21	109.64	20	0.95	20	142.81	14	1.03	21
FULLERTON	68.99	33	0.42	35	90.57	25	0.79	22	82.23	30	0.72	27	76.59	29	0.67	31	92.72	30	0.76	34
HUNTINGTON BEACH	95.78	23	0.89	21	66.51	32	0.68	29	79.61	31	0.78	25	98.32	25	0.95	19	128.02	20	1.26	12
KERNVILLE	226.76	5	1.31	6	232.18	4	1.96	3	178.69	8	1.99	3	286.38	7	0.96	18	2421.32	1	3.67	2
LONG BEACH	75.83	31	0.55	33	75.11	30	0.70	28	66.33	34	0.61	32	164.46	9	0.89	23	135.16	17	0.86	31
MENIFEE	99.32	22	0.84	23	107.39	15	1.26	10	156.68	11	1.32	12	111.46	19	0.98	16	156.75	9	1.31	10
MONROVIA	108.11	20	1.13	15	99.12	20	1.02	16	133.32	14	1.16	16	96.68	26	0.88	24	116.57	21	0.84	32
MONTEBELLO	131.06	12	1.13	14	118.08	13	1.17	12	158.34	10	1.16	15	150.28	12	1.18	11	133.52	19	1.17	15
ONTARIO	93.09	24	0.87	22	77.39	29	0.79	23	97.91	23	1.00	19	94.04	27	0.74	27	105.07	27	0.93	27
PALM SPRINGS	175.92	8	1.27	8	112.80	14	0.77	25	107.04	20	0.71	29	99.54	24	0.80	26	107.58	25	1.07	19
REDLANDS	120.13	16	1.11	16	96.48	21	1.04	15	154.25	12	1.04	18	124.52	17	1.01	14	137.11	16	0.98	23
RIDGECREST	229.65	4	1.44	4	161.95	9	1.12	13	176.84	9	1.57	6	148.90	13	1.01	15	254.31	6	1.05	20
SADDLEBACK	83.01	27	0.73	27	70.69	31	0.53	34	99.07	22	0.74	26	46.03	34	0.39	35	65.99	34	0.65	35
SAN JOAQUIN	135.90	10	1.04	18	244.44	2	1.45	6	138.25	13	1.17	14	127.50	16	1.05	13	108.44	23	1.09	18
SANTA ANA	78.60	29	0.55	32	93.35	24	0.74	26	91.68	26	0.84	23	67.46	32	0.71	29	97.27	29	1.00	22
SANTA BARBARA	153.81	9	1.15	13	82.00	28	0.70	27	183.78	7	1.38	9	152.37	11	1.52	6	156.66	10	1.41	8
SANTA MONICA	101.69	21	0.79	25	122.78	12	1.00	17	110.76	19	0.99	20	75.41	30	0.62	32	91.08	31	0.95	26
SOUTH BAY	122.68	15	1.17	10	142.15	10	1.49	5	125.28	16	1.39	8	164.07	10	1.31	8	183.90	7	1.88	7
TEHACHAPI	117.96	17	1.43	5	232.67	3	1.12	14	130.70	15	1.29	13	298.96	5	1.21	9	97.29	28	1.13	16
THOUSAND OAKS	127.73	14	1.05	17	93.86	23	0.91	18	104.37	21	1.10	17	106.59	21	0.92	21	143.78	13	1.31	11
VALENCIA	62.01	35	0.46	34	51.04	34	0.53	33	79.23	32	0.61	33	72.27	31	0.61	33	105.09	26	0.97	25
VENTURA	134.81	11	1.15	11	100.52	18	1.21	11	183.79	6	1.65	4	148.85	14	1.19	10	150.41	11	1.24	13
VICTORVILLE	67.70	34	0.66	30	61.33	33	0.63	30	68.85	33	0.63	31	87.03	28	0.91	22	79.35	33	0.92	28
WHITTIER	72.60	32	0.74	26	135.04	11	0.86	19	87.60	28	0.70	30	114.52	18	0.73	28	137.34	15	0.81	33
WILDOMAR	88.54	26	0.72	28	40.51	35	0.56	32	118.49	18	0.81	24	52.70	33	0.60	34	84.01	32	0.87	30
YUCCA VALLEY	319.82	3	3.41	2	216.97	5	1.50	4	304.25	3	1.49	7	389.08	3	1.80	5	463.68	4	3.39	4
<b>SCE SystemWide</b>	<b>108.13</b>		<b>0.89</b>		<b>102.61</b>		<b>0.91</b>		<b>112.00</b>		<b>0.96</b>		<b>114.83</b>		<b>0.92</b>		<b>134.48</b>		<b>1.10</b>	

\*\*Exclusions\*\* are days which utilities are allowed to remove from their metrics because the outages on those days were caused by a severe acts of nature.


\*\*In the columns showing "Rank," lower numbers indicate poorer performance.

# Overview of Costa Mesa

## There are 54 circuits that serve Costa Mesa

Circuit Type	Sum of Customers	Circuit Type	Sum of Customers	Circuit Type	Sum of Customers	Circuit Type	Sum of Customers
AGENA(12KV)	1,182	MOONWALK(12KV)	3,080				
ALUMINUM(12KV)	2,035	NIMBUS(12KV)	2,791				
ANNIKA(12KV)	1,541	OGLE(4.16KV)	1,036				
BASS(12KV)	2,362	OILWELL(12KV)	1,042				
BAYVIEW(4.16KV)	771	ORBITER(12KV)	2,275				
BEGONIA(12KV)	251	PELICAN(12KV)	106				
BILLINGS(12KV)	131	PERCH(12KV)	2,080				
CAPE(4.16KV)	780	PIKE(12KV)	1,796				
CASSINI(12KV)	76	REDHILL(12KV)	134				
CATFISH(12KV)	2,773	SAKIOKA(12KV)	978				
CHALLENGER(12KV)	143	SCORE(12KV)	4,187				
CLIFF(4.16KV)	653	SEGERSTROM(12KV)	973				
CORBINA(12KV)	1,892	SEWELL(12KV)	4,080				
DELHI(12KV)	1,268	SKYLAB(12KV)	305				
ELMIRA(4.16KV)	734	SNEAD(12KV)	3,252				
EXPLORER(12KV)	222	SPEAKER(12KV)	78				
FELLER(12KV)	1,579	SUNFLOWER(12KV)	553				
FLORES(12KV)	279	SURVEYOR(12KV)	571				
GEHRIG(12KV)	3,800	TARPON(12KV)	3,678				
GRUNION(12KV)	1,570	VARDON(12KV)	547				
HARPER(4.16KV)	819	VIPER(12KV)	1,477				
HOGAN(12KV)	2,111	VOYAGER(12KV)	297				
INLET(4.16KV)	602	WEISKOFF(12KV)	1,133				
JANUARY(12KV)	4,360	YELLOWTAIL(12KV)	3,920				
KLINGON(12KV)	218						
LITTLER(12KV)	133						
LYELL(12KV)	1,750						
MANGRUM(12KV)	565						
METEOR(12KV)	915						
MIDDLECOFF(12KV)	1,491						
<b>Grand Total</b>	<b>77,375</b>						

# Reliability History of Circuits Serving Costa Mesa (No Exclusions)

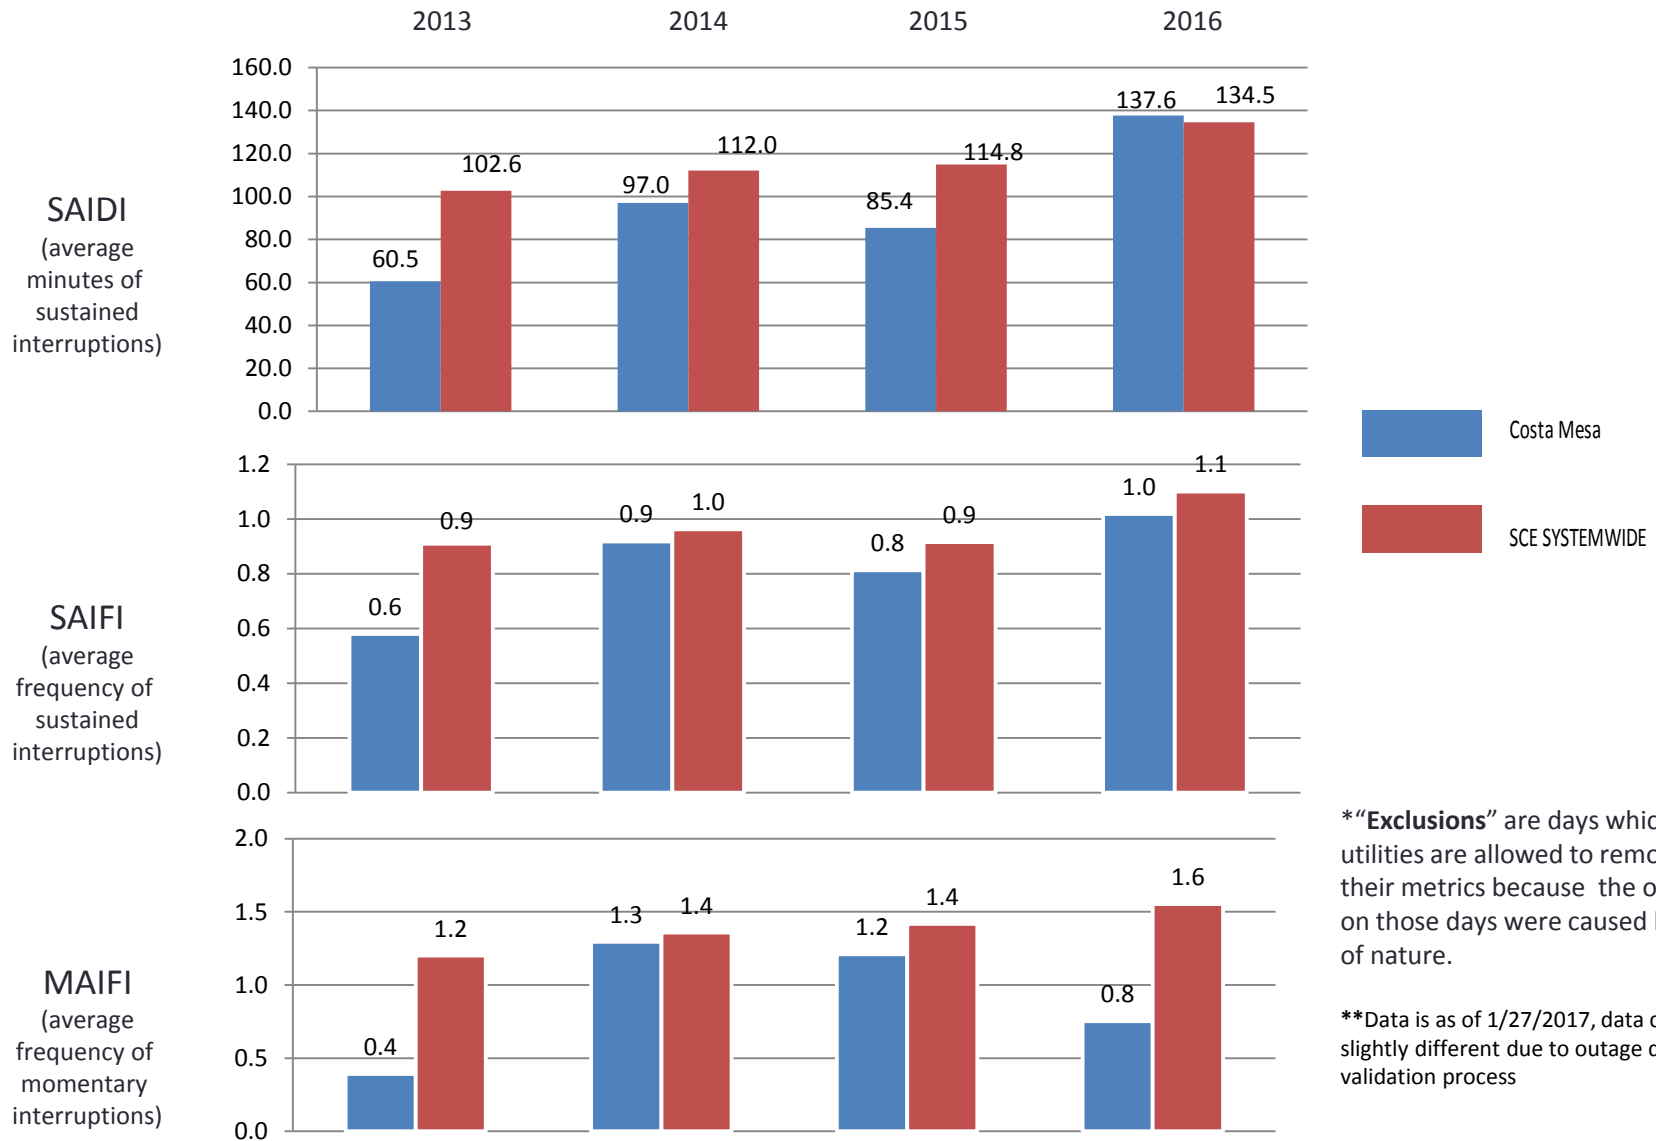




# Causes of Repair Outages in Costa Mesa Circuits 2016

## YTD


### Contributions to SAIDI by Outage Cause

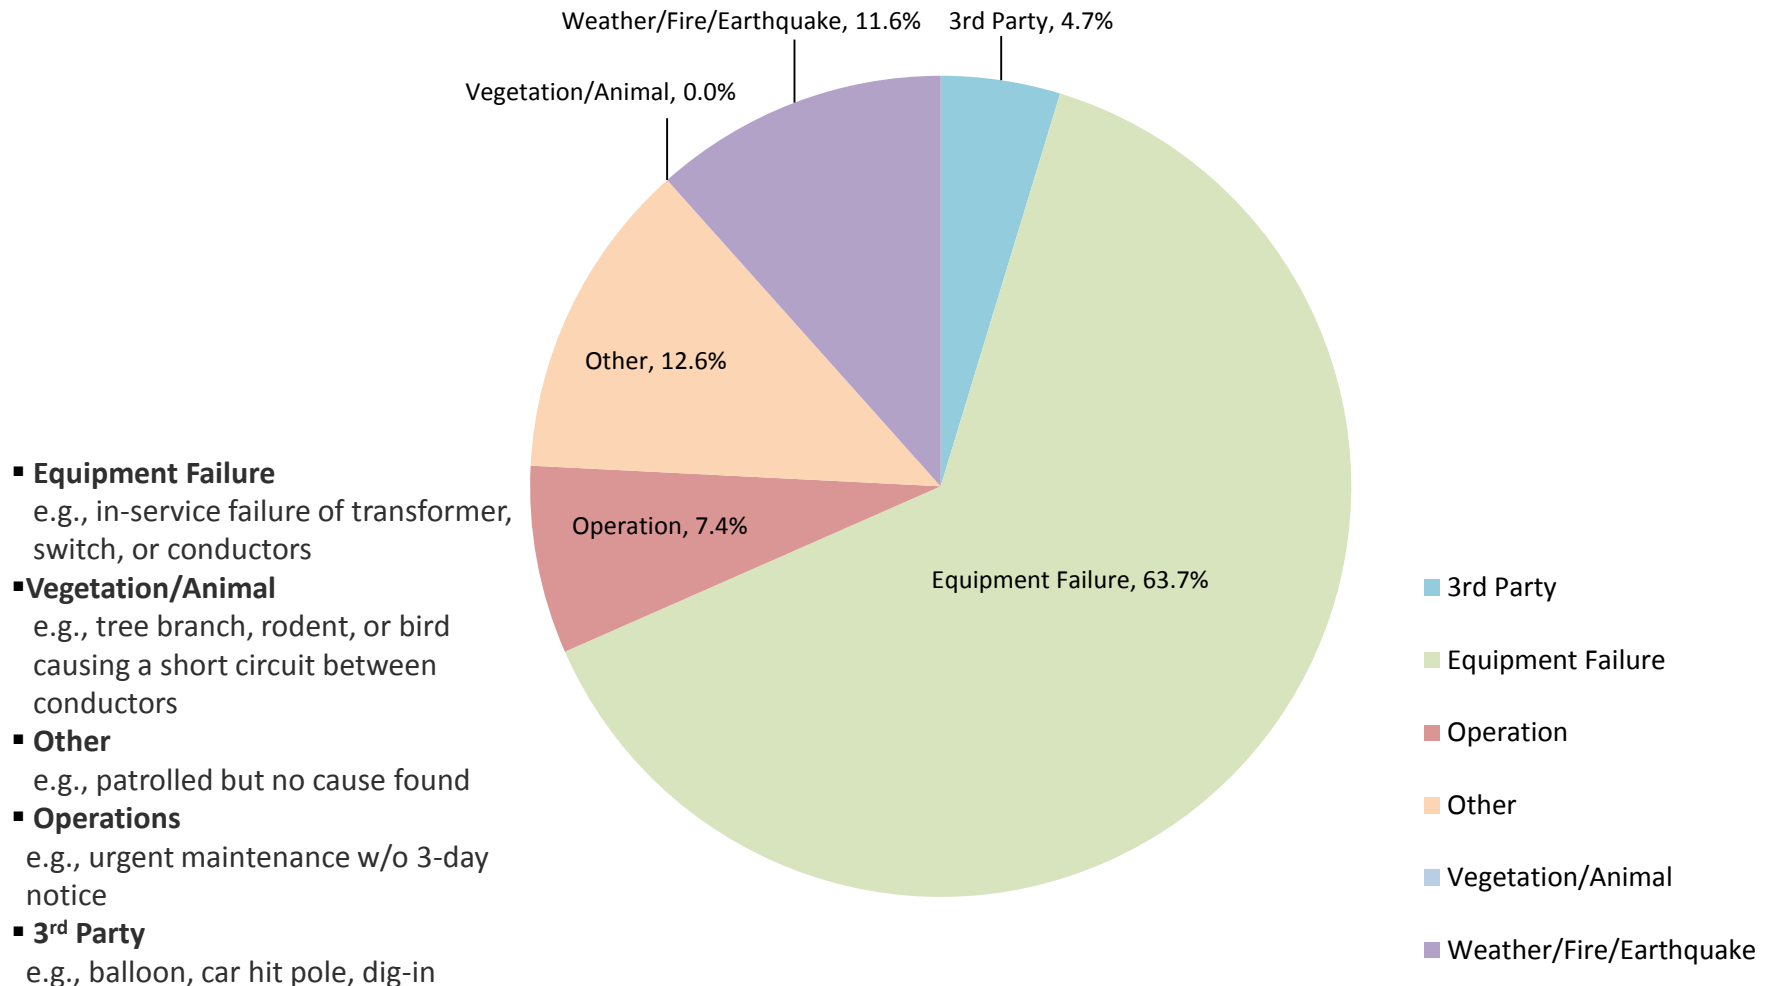


**SAIDI** = the cumulative amount of time the average customer is interrupted by “sustained” outages each year.

# Causes of Repair Outages in Costa Mesa Circuits 2016 YTD


## Contributions to SAIFI by Outage Cause

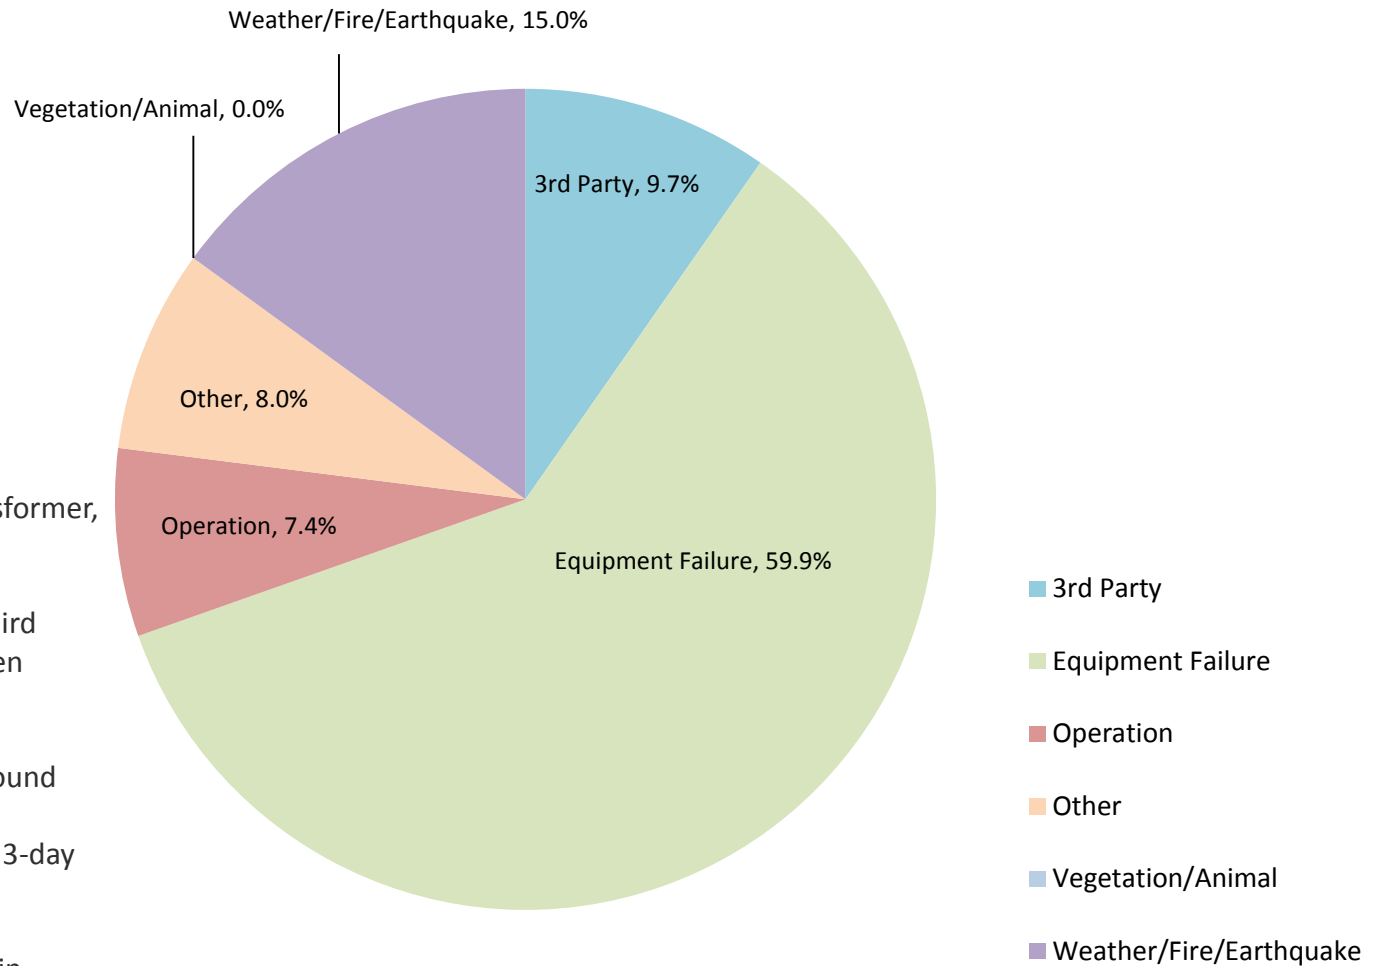

**SAIFI** = the number of times the average customer is interrupted by “sustained” outages each year.

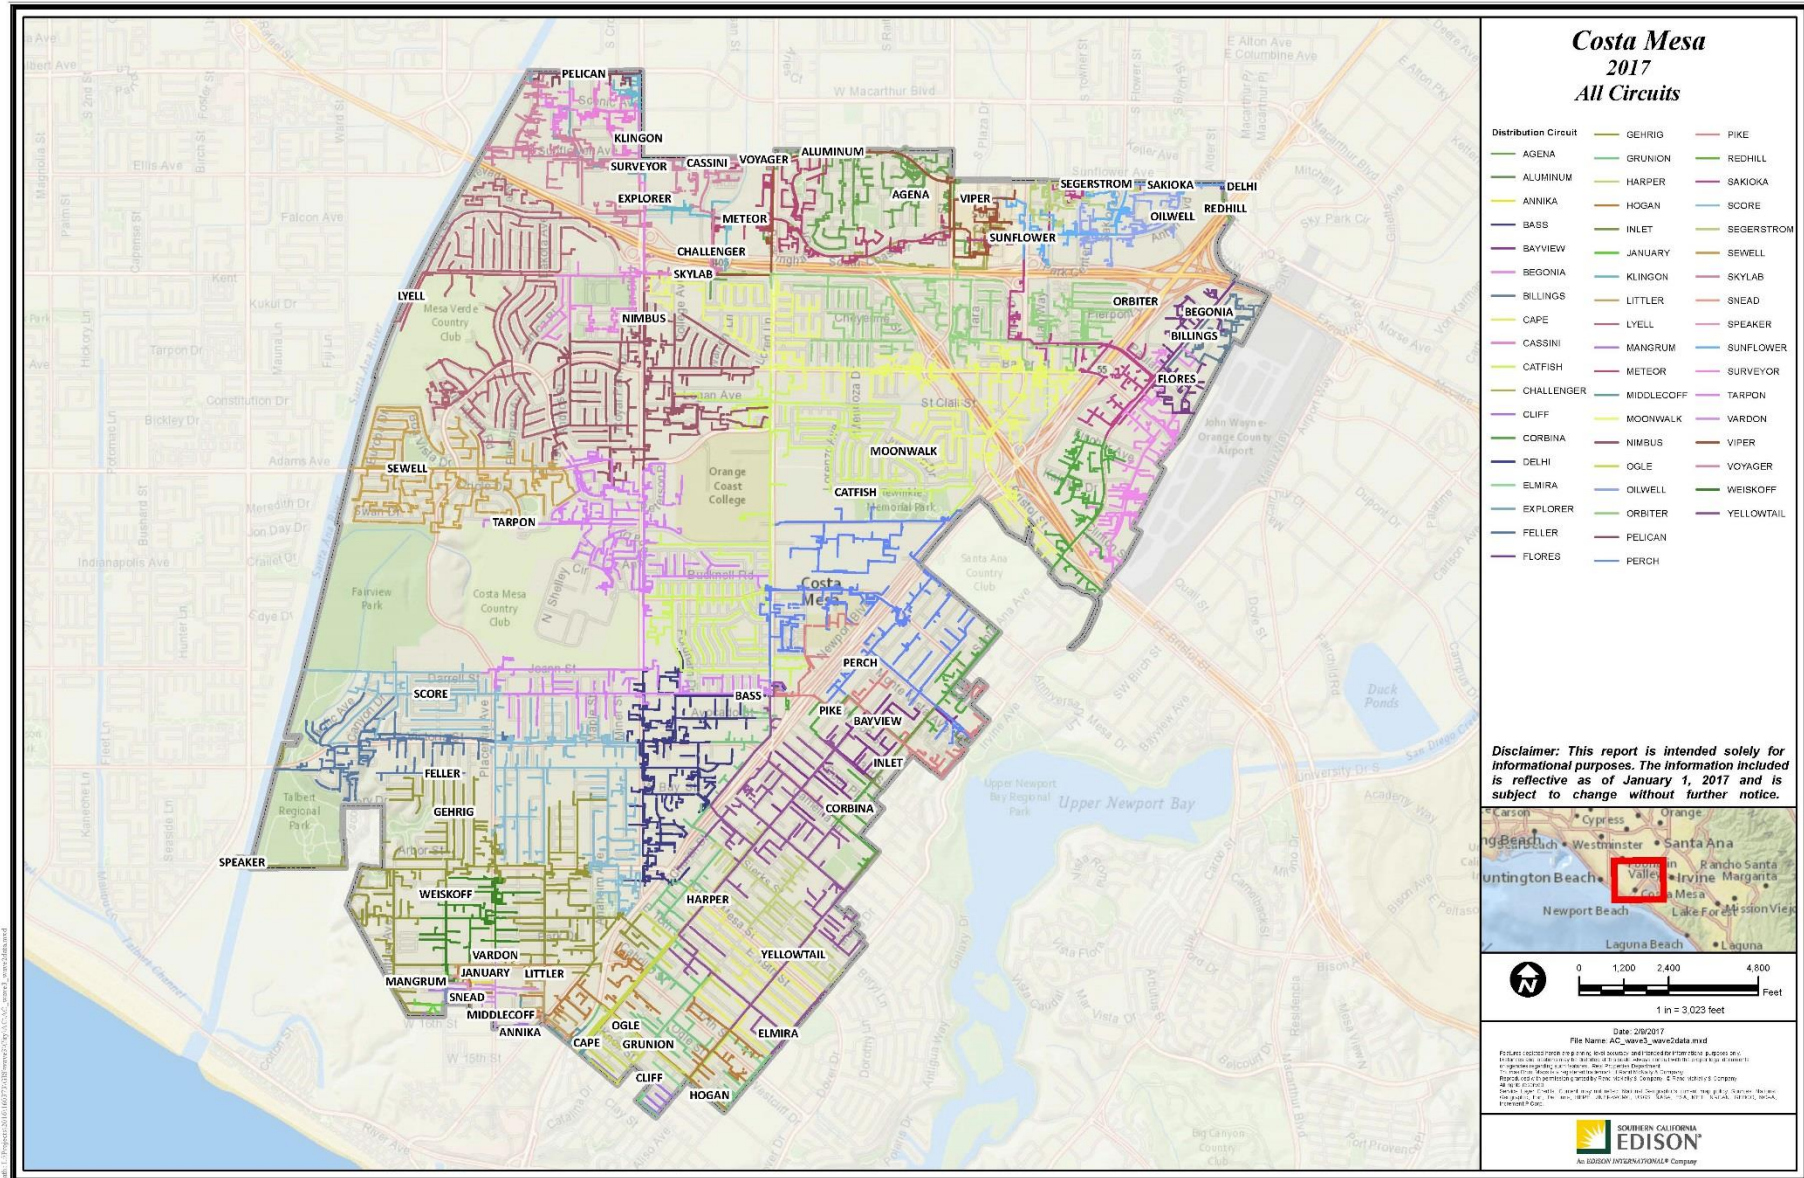



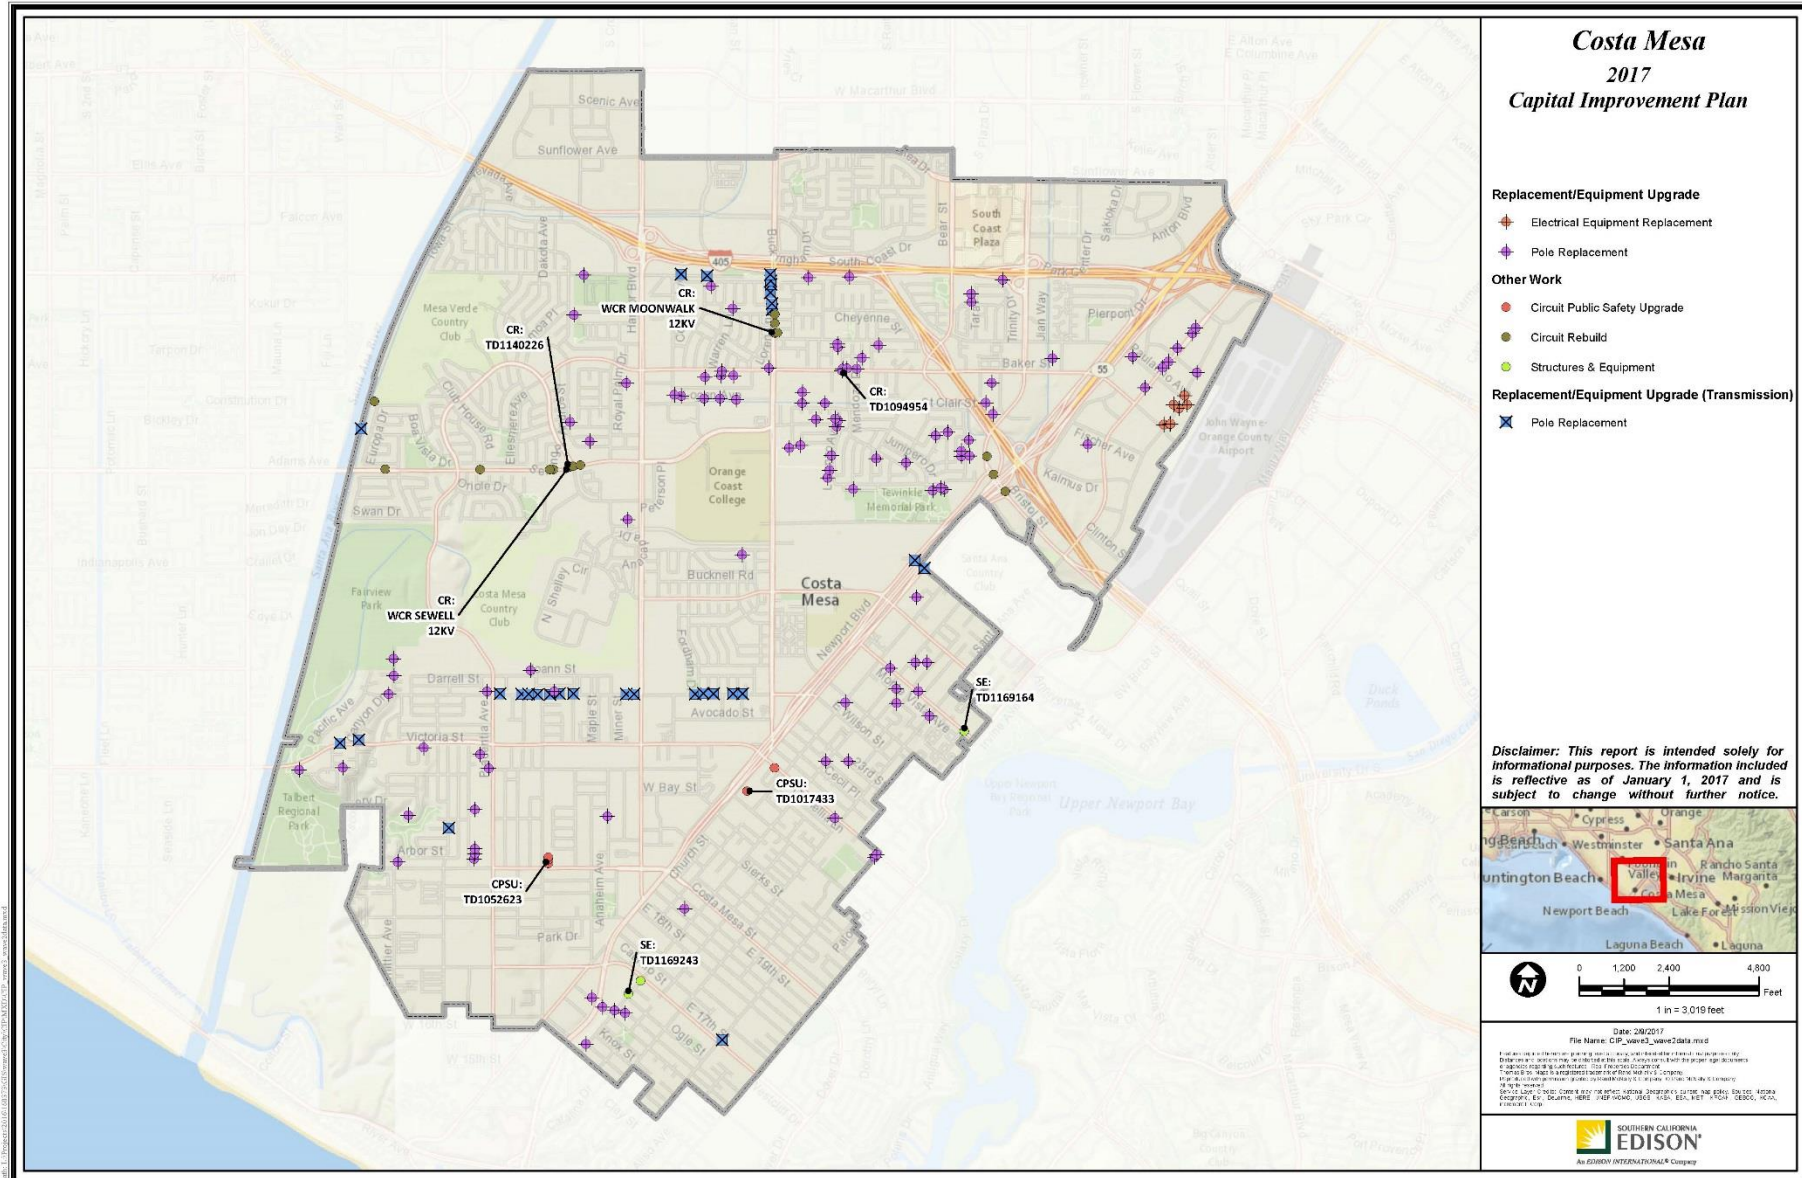

# Back-up Slides

**Reliability Histories of Circuits Serving Costa Mesa**

**Updated through Year-End 2016**

# Average Reliability of 54 Circuits Serving Costa Mesa

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
<b>Costa Mesa</b>	<b>60.5</b>	<b>0.6</b>	<b>0.4</b>	<b>97.0</b>	<b>0.9</b>	<b>1.3</b>	<b>85.4</b>	<b>0.8</b>	<b>1.2</b>	<b>53.0</b>	<b>0.4</b>	<b>0.2</b>	<b>34.0</b>	<b>0.2</b>	<b>0.3</b>	<b>20.3</b>	<b>0.2</b>	<b>0.1</b>	<b>30.3</b>	<b>0.2</b>	<b>0.2</b>	<b>137.6</b>	<b>1.0</b>	<b>0.8</b>
3rd Party	8%	9%	22%	10%	18%	20%	18%	27%	12%	8%	18%	0%	0%	0%	19%	2%	15%	0%	5%	1%	33%	5%	10%	17%
Equipment Failure	75%	70%	53%	59%	51%	47%	51%	44%	36%	45%	35%	20%	91%	94%	41%	75%	77%	93%	58%	54%	4%	64%	60%	28%
Operation	7%	6%	1%	6%	8%	5%	16%	11%	3%	2%	8%	43%	9%	6%	21%	22%	8%	7%	6%	8%	0%	7%	7%	20%
Other	4%	7%	10%	0%	2%	13%	4%	5%	40%	32%	22%	2%	0%	0%	19%	0%	0%	0%	1%	0%	4%	13%	8%	9%
Vegetation/Animal	0%	1%	13%	7%	10%	8%	1%	1%	3%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	16%	0%	0%	5%
Weather/Fire/Earthquake	5%	7%	1%	17%	11%	7%	10%	13%	6%	13%	18%	36%	0%	0%	0%	0%	0%	0%	30%	37%	43%	12%	15%	22%
<b>SCE Systemwide</b>	<b>102.6</b>	<b>0.9</b>	<b>1.2</b>	<b>112.0</b>	<b>1.0</b>	<b>1.4</b>	<b>114.8</b>	<b>0.9</b>	<b>1.4</b>	<b>40.5</b>	<b>0.3</b>	<b>0.4</b>	<b>34.8</b>	<b>0.3</b>	<b>0.4</b>	<b>29.4</b>	<b>0.2</b>	<b>0.3</b>	<b>29.8</b>	<b>0.3</b>	<b>0.4</b>	<b>134.5</b>	<b>1.1</b>	<b>1.6</b>

## Notes:

No outages are excluded from the metrics.

## Outage Causes:

Other: e.g., patrolled but no cause could be found

Operations: e.g., urgent maintenance w/o 3-day notice to customers

3<sup>rd</sup> Party: e.g., balloons, car hit pole, dig-in

Vegetation/Animal: e.g., tree branch, rodent, or bird causing short circuit across conductors

SAIDI (minutes) = the cumulative amount of time the average customer is interrupted by "sustained" (longer than 5 minutes) outages.

SAIFI (interruptions) = the number of times the average customer is interrupted by "sustained" outages.

MAIFI (interruptions) = the number of times the average customer is interrupted by "momentary" (lasting 5 minutes or less) outages.

# Reliability Histories for Individual Circuits Serving Costa Mesa

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
<b>AGENA(12KV) - Customers: 1,182</b>	<b>14.0</b>	<b>0.1</b>	<b>0.0</b>	<b>725.6</b>	<b>1.0</b>	<b>0.0</b>	<b>58.7</b>	<b>0.5</b>	<b>0.0</b>	<b>2.7</b>	<b>0.0</b>	<b>0.0</b>	<b>24.4</b>	<b>0.1</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>27.0</b>	<b>0.1</b>	<b>0.0</b>
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	90%	44%	0%	100%	100%	0%	2%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	90%	74%	0%
Operation	10%	56%	0%	0%	0%	0%	98%	100%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	10%	26%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>ALUMINUM(12KV) - Customers: 2,035</b>	<b>41.9</b>	<b>1.2</b>	<b>1.7</b>	<b>17.4</b>	<b>0.1</b>	<b>1.0</b>	<b>7.7</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>34.9</b>	<b>0.1</b>	<b>0.0</b>	<b>15.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>49.9</b>	<b>0.1</b>	<b>0.0</b>
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	100%	100%	100%	100%	100%	100%	100%	100%	0%	0%	0%	0%	100%	100%	0%	100%	100%	0%	0%	0%	0%	100%	100%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>ANNIKA(12KV) - Customers: 1,541</b>	<b>51.2</b>	<b>0.1</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>124.9</b>	<b>1.0</b>	<b>2.0</b>	<b>1.6</b>	<b>0.0</b>	<b>0.0</b>	<b>22.4</b>	<b>0.0</b>	<b>1.0</b>	<b>201.6</b>	<b>2.4</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>225.6</b>	<b>2.5</b>	<b>1.0</b>
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	100%	99%	0%	0%	0%	0%	97%	99%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	89%	97%	0%
Operation	0%	1%	0%	0%	0%	0%	3%	1%	0%	100%	100%	0%	100%	100%	100%	0%	0%	0%	0%	0%	0%	11%	3%	100%
Other	0%	0%	100%	0%	0%	0%	0%	0%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>BASS(12KV) - Customers: 2,362</b>	<b>0.1</b>	<b>0.0</b>	<b>0.0</b>	<b>0.1</b>	<b>0.0</b>	<b>0.0</b>	<b>14.4</b>	<b>0.1</b>	<b>0.0</b>	<b>51.0</b>	<b>0.1</b>	<b>0.0</b>	<b>3.1</b>	<b>0.0</b>	<b>0.0</b>	<b>13.2</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>67.2</b>	<b>1.1</b>	<b>0.0</b>
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	20%	92%	0%
Equipment Failure	100%	100%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	15%	8%	0%	0%	0%	0%	0%	0%	0%	76%	8%	0%
Operation	0%	0%	0%	100%	100%	0%	53%	6%	0%	0%	0%	0%	85%	92%	0%	0%	0%	0%	0%	0%	0%	4%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	47%	94%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

# Reliability Histories for Individual Circuits Serving Costa Mesa

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
<b>BAYVIEW(4.16KV) - Customers: 771</b>	<b>7.3</b>	<b>0.0</b>	<b>0.0</b>	<b>99.7</b>	<b>0.3</b>	<b>2.5</b>	<b>0.0</b>	<b>0.0</b>	<b>1.0</b>	<b>25.7</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.5</b>	<b>0.0</b>	<b>0.0</b>	<b>26.2</b>	<b>0.0</b>	<b>0.0</b>
3rd Party	0%	0%	0%	0%	0%	30%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	100%	100%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	98%	52%	0%
Operation	0%	0%	0%	100%	100%	70%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	2%	48%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>BEGONIA(12KV) - Customers: 251</b>	<b>136.1</b>	<b>2.0</b>	<b>2.0</b>	<b>202.6</b>	<b>1.0</b>	<b>0.0</b>	<b>305.6</b>	<b>3.1</b>	<b>1.7</b>	<b>189.5</b>	<b>1.0</b>	<b>0.0</b>	<b>2.1</b>	<b>0.0</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>191.6</b>	<b>1.0</b>	<b>1.0</b>
3rd Party	0%	0%	50%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	99%	100%	0%
Equipment Failure	100%	100%	0%	100%	100%	0%	39%	64%	0%	0%	0%	0%	100%	100%	100%	0%	0%	0%	0%	0%	0%	1%	0%	100%
Operation	0%	0%	0%	0%	0%	0%	46%	30%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	50%	0%	0%	0%	15%	5%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>BILLINGS(12KV) - Customers: 131</b>	<b>41.4</b>	<b>0.2</b>	<b>2.0</b>	<b>0.1</b>	<b>0.0</b>	<b>0.0</b>	<b>383.4</b>	<b>2.1</b>	<b>2.6</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>7.3</b>	<b>0.0</b>	<b>0.7</b>	<b>47.1</b>	<b>0.7</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>54.4</b>	<b>0.7</b>	<b>0.7</b>
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	71%	48%	0%	0%	0%	0%	91%	93%	100%	0%	0%	0%	100%	100%	100%	100%	100%	0%	0%	0%	0%	100%	100%	100%
Operation	29%	52%	0%	100%	100%	0%	9%	7%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>CAPE(4.16KV) - Customers: 780</b>	<b>136.5</b>	<b>1.7</b>	<b>0.2</b>	<b>16.2</b>	<b>0.0</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>2.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>
3rd Party	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	34%	20%	100%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	66%	80%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%



# Reliability Histories for Individual Circuits Serving Costa Mesa

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
<b>CASSINI(12KV) - Customers: 76</b>	<b>165.0</b>	<b>2.3</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>133.6</b>	<b>1.0</b>	<b>0.8</b>	<b>133.6</b>	<b>1.0</b>	<b>1.8</b>
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	100%	100%	100%	45%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	55%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>CATFISH(12KV) - Customers: 2,773</b>	<b>0.4</b>	<b>0.0</b>	<b>0.0</b>	<b>9.5</b>	<b>0.0</b>	<b>1.0</b>	<b>230.7</b>	<b>1.2</b>	<b>1.0</b>	<b>47.0</b>	<b>1.0</b>	<b>0.3</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>27.8</b>	<b>0.1</b>	<b>0.0</b>	<b>41.7</b>	<b>0.1</b>	<b>0.9</b>	<b>116.5</b>	<b>1.2</b>	<b>1.3</b>
3rd Party	0%	0%	0%	0%	0%	0%	33%	81%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	100%	36%	6%	73%
Equipment Failure	25%	11%	0%	100%	100%	1%	48%	10%	100%	100%	99%	100%	0%	0%	0%	58%	13%	0%	0%	0%	0%	54%	86%	27%
Operation	75%	89%	0%	0%	0%	0%	19%	9%	0%	0%	1%	0%	0%	0%	0%	42%	87%	0%	0%	0%	0%	10%	8%	0%
Other	0%	0%	0%	0%	0%	99%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>CHALLENGER(12KV) - Customers: 143</b>	<b>567.3</b>	<b>1.5</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>CLIFF(4.16KV) - Customers: 653</b>	<b>11.4</b>	<b>0.1</b>	<b>0.0</b>	<b>531.3</b>	<b>2.0</b>	<b>2.0</b>	<b>75.0</b>	<b>1.0</b>	<b>1.0</b>	<b>0.5</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>1.1</b>	<b>11.3</b>	<b>0.1</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>11.8</b>	<b>0.1</b>	<b>1.1</b>
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	100%
Equipment Failure	0%	0%	0%	12%	50%	0%	23%	2%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	96%	69%	0%
Operation	87%	78%	0%	0%	0%	0%	77%	98%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	4%	31%	0%
Other	13%	22%	0%	3%	3%	50%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	85%	47%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

# Reliability Histories for Individual Circuits Serving Costa Mesa

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
<b>CORBINA(12KV) - Customers: 1,892</b>	<b>11.6</b>	<b>0.1</b>	<b>0.0</b>	<b>124.5</b>	<b>2.3</b>	<b>2.9</b>	<b>16.3</b>	<b>0.1</b>	<b>2.9</b>	<b>19.2</b>	<b>0.0</b>	<b>0.0</b>	<b>1.4</b>	<b>0.0</b>	<b>0.0</b>	<b>0.2</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>20.7</b>	<b>0.1</b>	<b>0.0</b>
3rd Party	100%	100%	0%	35%	4%	32%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	36%	52%	68%	33%	14%	34%	78%	74%	0%	100%	100%	0%	100%	100%	0%	0%	0%	0%	80%	89%	0%
Operation	0%	0%	0%	1%	1%	0%	67%	86%	32%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	34%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	28%	44%	0%	0%	0%	0%	22%	26%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	20%	11%	0%
<b>DELHI(12KV) - Customers: 1,268</b>	<b>197.5</b>	<b>1.2</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>69.3</b>	<b>0.3</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>62.2</b>	<b>0.1</b>	<b>0.0</b>	<b>0.9</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>63.1</b>	<b>0.2</b>	<b>0.0</b>
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	76%	81%	0%	0%	0%	0%	87%	39%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	99%	78%	0%
Operation	24%	19%	0%	0%	0%	0%	13%	61%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	1%	22%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>ELMIRA(4.16KV) - Customers: 734</b>	<b>82.4</b>	<b>0.9</b>	<b>0.2</b>	<b>98.8</b>	<b>2.1</b>	<b>0.4</b>	<b>22.5</b>	<b>0.1</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>4.2</b>	<b>0.0</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>4.2</b>	<b>0.0</b>	<b>1.0</b>
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	100%
Equipment Failure	11%	1%	0%	25%	1%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	34%	3%	100%	5%	2%	0%	100%	100%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	9%	49%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	56%	95%	0%	60%	48%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>EXPLORER(12KV) - Customers: 222</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

# Reliability Histories for Individual Circuits Serving Costa Mesa

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
<b>FELLER(12KV) - Customers: 1,579</b>	<b>8.5</b>	<b>0.0</b>	<b>0.0</b>	<b>458.6</b>	<b>1.6</b>	<b>1.2</b>	<b>0.2</b>	<b>0.0</b>	<b>0.0</b>	<b>110.3</b>	<b>0.8</b>	<b>0.2</b>	<b>0.0</b>	<b>0.0</b>	<b>1.0</b>	<b>5.2</b>	<b>0.1</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>115.5</b>	<b>0.9</b>	<b>1.2</b>
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	83%
Equipment Failure	8%	6%	0%	0%	0%	0%	0%	0%	0%	99%	98%	100%	0%	0%	0%	100%	100%	0%	0%	0%	0%	99%	98%	17%
Operation	0%	0%	0%	0%	0%	0%	100%	100%	0%	1%	2%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	1%	2%	0%
Other	92%	94%	0%	1%	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	2%	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	97%	98%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>FLORES(12KV) - Customers: 279</b>	<b>51.8</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>1.5</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	1%	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	99%	99%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>GEHRIG(12KV) - Customers: 3,800</b>	<b>45.4</b>	<b>2.0</b>	<b>0.0</b>	<b>9.7</b>	<b>1.0</b>	<b>2.0</b>	<b>97.2</b>	<b>1.1</b>	<b>1.1</b>	<b>309.6</b>	<b>1.6</b>	<b>1.0</b>	<b>221.2</b>	<b>1.0</b>	<b>1.9</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>54.9</b>	<b>1.1</b>	<b>0.5</b>	<b>585.7</b>	<b>3.7</b>	<b>3.4</b>
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	87%	56%	0%	0%	0%	50%	4%	1%	0%	88%	63%	0%	99%	96%	100%	0%	0%	0%	47%	50%	0%	88%	68%	57%
Operation	13%	44%	0%	0%	0%	0%	0%	0%	0%	4%	35%	100%	1%	4%	0%	0%	0%	0%	0%	0%	0%	3%	16%	29%
Other	0%	0%	0%	100%	100%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	96%	99%	0%	8%	1%	0%	0%	0%	0%	0%	0%	0%	53%	50%	100%	9%	15%	14%
<b>GRUNION(12KV) - Customers: 1,570</b>	<b>109.2</b>	<b>1.0</b>	<b>1.1</b>	<b>32.2</b>	<b>0.6</b>	<b>0.5</b>	<b>65.4</b>	<b>1.6</b>	<b>2.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>36.8</b>	<b>0.1</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>32.8</b>	<b>0.3</b>	<b>0.0</b>	<b>69.6</b>	<b>0.4</b>	<b>0.0</b>
3rd Party	100%	100%	87%	0%	0%	0%	78%	98%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	5%	0%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	13%	5%	3%	0%	17%	1%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	100%	100%	0%	100%	100%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	95%	97%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

# Reliability Histories for Individual Circuits Serving Costa Mesa

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
<b>HARPER(4.16KV) - Customers: 819</b>	<b>130.3</b>	<b>2.6</b>	<b>0.0</b>	<b>46.8</b>	<b>1.0</b>	<b>0.0</b>	<b>43.4</b>	<b>1.0</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>1.0</b>
3rd Party	41%	38%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	100%
Equipment Failure	4%	1%	0%	0%	0%	0%	9%	2%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	13%	21%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	42%	39%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	91%	98%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>HOGAN(12KV) - Customers: 2,111</b>	<b>139.0</b>	<b>0.3</b>	<b>0.0</b>	<b>49.7</b>	<b>1.0</b>	<b>1.9</b>	<b>109.6</b>	<b>0.2</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>59.1</b>	<b>0.3</b>	<b>0.1</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>59.1</b>	<b>0.3</b>	<b>0.1</b>
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	100%	100%	0%	0%	0%	0%	88%	68%	0%	0%	0%	0%	0%	0%	0%	96%	74%	100%	0%	0%	0%	96%	74%	100%
Operation	0%	0%	0%	3%	1%	0%	9%	16%	1%	0%	0%	0%	0%	0%	0%	4%	26%	0%	0%	0%	0%	4%	26%	0%
Other	0%	0%	0%	0%	0%	0%	3%	16%	99%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	4%	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	93%	98%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>INLET(4.16KV) - Customers: 602</b>	<b>55.1</b>	<b>0.1</b>	<b>2.0</b>	<b>982.9</b>	<b>2.3</b>	<b>1.0</b>	<b>21.5</b>	<b>0.1</b>	<b>1.0</b>	<b>66.5</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>66.5</b>	<b>1.0</b>	<b>0.0</b>
3rd Party	0%	0%	51%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	93%	78%	100%	84%	37%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	7%	22%	0%	16%	63%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	100%	100%	49%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%
<b>JANUARY(12KV) - Customers: 4,360</b>	<b>115.0</b>	<b>1.1</b>	<b>0.0</b>	<b>42.7</b>	<b>1.1</b>	<b>1.0</b>	<b>61.8</b>	<b>0.4</b>	<b>1.8</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>106.9</b>	<b>1.3</b>	<b>0.0</b>	<b>86.9</b>	<b>1.0</b>	<b>0.0</b>	<b>59.4</b>	<b>0.2</b>	<b>1.0</b>	<b>253.2</b>	<b>2.5</b>	<b>1.0</b>
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	91%	98%	0%	66%	95%	100%	94%	91%	44%	0%	0%	0%	100%	100%	0%	100%	100%	100%	93%	73%	2%	98%	98%	2%
Operation	9%	2%	0%	34%	5%	0%	6%	9%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	7%	27%	0%	2%	2%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	56%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	98%	0%	0%	98%

# Reliability Histories for Individual Circuits Serving Costa Mesa

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
<b>KLINGON(12KV) - Customers: 218</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>32.5</b>	<b>0.1</b>	<b>1.0</b>	<b>12.9</b>	<b>0.3</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	100%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>LITTLER(12KV) - Customers: 133</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>14.7</b>	<b>0.1</b>	<b>2.2</b>	<b>197.0</b>	<b>0.5</b>	<b>0.9</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>274.1</b>	<b>0.6</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.7</b>	<b>274.1</b>	<b>0.6</b>	<b>0.7</b>
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	48%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	100%	100%	0%	100%	100%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%
Other	0%	0%	0%	0%	0%	52%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	100%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>LYELL(12KV) - Customers: 1,750</b>	<b>114.2</b>	<b>1.0</b>	<b>0.2</b>	<b>61.7</b>	<b>0.2</b>	<b>2.2</b>	<b>24.0</b>	<b>0.0</b>	<b>0.0</b>	<b>12.6</b>	<b>1.0</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>32.2</b>	<b>0.1</b>	<b>0.0</b>	<b>7.1</b>	<b>0.0</b>	<b>1.0</b>	<b>51.9</b>	<b>1.1</b>	<b>2.0</b>
3rd Party	64%	74%	100%	0%	0%	45%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	35%	20%	0%	100%	100%	55%	100%	100%	0%	100%	100%	100%	0%	0%	0%	100%	100%	0%	0%	0%	0%	86%	99%	50%
Operation	1%	6%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	14%	1%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	50%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>MANGRUM(12KV) - Customers: 565</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>1.4</b>	<b>0.0</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>336.3</b>	<b>1.0</b>	<b>1.9</b>	<b>336.3</b>	<b>1.0</b>	<b>1.9</b>
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	100%	100%	100%	100%

# Reliability Histories for Individual Circuits Serving Costa Mesa

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
<b>METEOR(12KV) - Customers: 915</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>64.2</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>MIDDLECOFF(12KV) - Customers: 1,491</b>	<b>240.7</b>	<b>1.1</b>	<b>0.0</b>	<b>261.7</b>	<b>2.1</b>	<b>0.1</b>	<b>355.3</b>	<b>2.5</b>	<b>3.9</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>11.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.9</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>11.8</b>	<b>0.0</b>	<b>0.0</b>
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	100%	100%	0%	100%	100%	100%	88%	90%	75%	0%	0%	0%	0%	0%	0%	3%	33%	0%	0%	0%	0%	0%	6%	0%
Operation	0%	0%	0%	0%	0%	0%	12%	10%	0%	0%	0%	0%	100%	100%	0%	97%	67%	0%	0%	0%	0%	100%	94%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	25%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>MOONWALK(12KV) - Customers: 3,080</b>	<b>3.0</b>	<b>0.0</b>	<b>0.0</b>	<b>167.0</b>	<b>3.3</b>	<b>2.0</b>	<b>35.6</b>	<b>0.9</b>	<b>1.7</b>	<b>12.6</b>	<b>0.1</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>4.0</b>	<b>0.0</b>	<b>0.0</b>	<b>1.2</b>	<b>0.0</b>	<b>1.0</b>	<b>17.8</b>	<b>0.1</b>	<b>1.0</b>
3rd Party	0%	0%	0%	49%	60%	49%	0%	0%	0%	17%	18%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	12%	15%	99%
Equipment Failure	76%	26%	0%	46%	31%	38%	40%	90%	100%	0%	0%	0%	0%	0%	0%	100%	100%	100%	0%	0%	0%	23%	6%	1%
Operation	0%	0%	0%	4%	8%	13%	40%	8%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	7%	13%	0%
Other	0%	0%	0%	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	24%	74%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	20%	2%	0%	83%	82%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	59%	66%	0%
<b>NIMBUS(12KV) - Customers: 2,791</b>	<b>2.2</b>	<b>0.0</b>	<b>0.0</b>	<b>34.4</b>	<b>1.6</b>	<b>0.4</b>	<b>102.3</b>	<b>1.7</b>	<b>0.4</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.7</b>	<b>0.0</b>	<b>0.0</b>	<b>2.9</b>	<b>0.0</b>	<b>0.0</b>	<b>10.8</b>	<b>0.0</b>	<b>0.0</b>	<b>14.4</b>	<b>0.1</b>	<b>0.0</b>
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	20%	21%	0%
Equipment Failure	94%	71%	0%	99%	100%	100%	66%	62%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	95%	78%	0%	76%	63%	0%
Operation	6%	29%	0%	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	10%	2%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	24%	36%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	5%	22%	0%	4%	16%	0%

# Reliability Histories for Individual Circuits Serving Costa Mesa

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
<b>OGLE(4.16KV) - Customers: 1,036</b>	<b>22.1</b>	<b>1.0</b>	<b>0.0</b>	<b>6.1</b>	<b>0.0</b>	<b>1.0</b>	<b>106.6</b>	<b>1.0</b>	<b>1.0</b>	<b>6.9</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>4.7</b>	<b>0.0</b>	<b>0.0</b>	<b>11.7</b>	<b>0.0</b>	<b>0.0</b>
3rd Party	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	100%	100%	0%	2%	2%	0%	54%	25%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	32%	7%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	46%	75%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	68%	93%	0%
Other	100%	100%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	98%	98%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>OILWELL(12KV) - Customers: 1,042</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>17.7</b>	<b>0.0</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>17.7</b>	<b>0.0</b>	<b>1.0</b>
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	100%	0%	0%	0%	0%	0%	0%	100%	100%	100%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>ORBITER(12KV) - Customers: 2,275</b>	<b>71.3</b>	<b>1.1</b>	<b>0.0</b>	<b>48.3</b>	<b>0.2</b>	<b>1.0</b>	<b>38.8</b>	<b>0.3</b>	<b>2.5</b>	<b>0.0</b>	<b>0.0</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>2.0</b>
3rd Party	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	7%	2%	0%	69%	21%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	2%	2%	0%	10%	65%	0%	4%	5%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	50%
Other	0%	0%	0%	0%	0%	0%	0%	0%	39%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	91%	96%	0%	21%	14%	0%	96%	95%	61%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	50%
<b>PELICAN(12KV) - Customers: 106</b>	<b>0.0</b>	<b>0.0</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.3</b>	<b>0.1</b>	<b>0.0</b>	<b>185.2</b>	<b>1.0</b>	<b>0.0</b>	<b>185.5</b>	<b>1.1</b>	<b>0.0</b>
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	100%	100%	0%	100%	100%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

# Reliability Histories for Individual Circuits Serving Costa Mesa

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
<b>PERCH(12KV) - Customers: 2,080</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>49.3</b>	<b>0.6</b>	<b>1.5</b>	<b>4.0</b>	<b>0.0</b>	<b>1.0</b>	<b>12.0</b>	<b>0.2</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>7.7</b>	<b>0.1</b>	<b>0.0</b>	<b>3.4</b>	<b>0.2</b>	<b>0.0</b>	<b>23.1</b>	<b>0.5</b>	<b>0.0</b>
3rd Party	0%	0%	0%	0%	0%	68%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	53%	17%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	99%	99%	0%	0%	0%	0%	33%	19%	0%
Operation	0%	0%	0%	47%	83%	32%	25%	6%	0%	0%	0%	0%	0%	0%	0%	1%	1%	0%	100%	100%	0%	15%	38%	0%
Other	0%	0%	0%	0%	0%	0%	12%	19%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	63%	75%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	52%	43%	0%
<b>PIKE(12KV) - Customers: 1,796</b>	<b>5.6</b>	<b>0.0</b>	<b>0.0</b>	<b>43.7</b>	<b>0.1</b>	<b>1.9</b>	<b>6.0</b>	<b>0.1</b>	<b>1.0</b>	<b>233.1</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>233.1</b>	<b>1.0</b>	<b>0.0</b>
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	100%	100%	100%	0%	0%	100%	75%	12%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	75%	12%	0%
Operation	100%	100%	0%	0%	0%	0%	32%	76%	0%	1%	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	1%	1%	0%
Other	0%	0%	0%	0%	0%	0%	68%	24%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	24%	87%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	24%	87%	0%
<b>REDHILL(12KV) - Customers: 134</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.4</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>SAKIOKA(12KV) - Customers: 978</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>127.7</b>	<b>1.0</b>	<b>0.0</b>	<b>171.7</b>	<b>3.3</b>	<b>0.6</b>	<b>79.6</b>	<b>1.8</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.4</b>	<b>0.0</b>	<b>1.0</b>	<b>80.1</b>	<b>1.8</b>	<b>1.0</b>
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	89%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	88%	50%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	3%	30%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	92%	39%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	4%	30%	0%	11%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	11%	50%	0%
Vegetation/Animal	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	100%	1%	0%	100%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%



# Reliability Histories for Individual Circuits Serving Costa Mesa

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
<b>SCORE(12KV) - Customers: 4,187</b>	<b>0.9</b>	<b>0.0</b>	<b>0.0</b>	<b>62.1</b>	<b>1.0</b>	<b>4.0</b>	<b>48.1</b>	<b>0.7</b>	<b>1.0</b>	<b>53.3</b>	<b>0.5</b>	<b>0.8</b>	<b>1.6</b>	<b>0.0</b>	<b>1.0</b>	<b>64.2</b>	<b>0.1</b>	<b>0.1</b>	<b>203.2</b>	<b>2.0</b>	<b>0.1</b>	<b>322.3</b>	<b>2.7</b>	<b>1.9</b>
3rd Party	0%	0%	0%	0%	0%	0%	9%	1%	0%	0%	0%	0%	49%	10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	14%	1%	50%	62%	73%	0%	0%	0%	0%	11%	42%	0%	0%	0%	0%	48%	51%	0%	30%	38%	0%
Operation	26%	67%	0%	2%	1%	0%	29%	26%	2%	0%	0%	0%	40%	48%	0%	100%	100%	100%	4%	2%	0%	22%	7%	4%
Other	0%	0%	0%	0%	0%	50%	0%	0%	98%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	53%
Vegetation/Animal	0%	0%	0%	84%	98%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	74%	33%	0%	0%	0%	0%	0%	0%	0%	100%	100%	100%	0%	0%	0%	0%	0%	0%	49%	47%	100%	47%	55%	44%
<b>SEGERSTROM(12KV) - Customers: 973</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>47.1</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	96%	96%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	4%	4%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>SEWELL(12KV) - Customers: 4,080</b>	<b>73.9</b>	<b>0.1</b>	<b>2.0</b>	<b>121.7</b>	<b>1.2</b>	<b>2.5</b>	<b>152.3</b>	<b>2.0</b>	<b>2.8</b>	<b>320.2</b>	<b>1.3</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>11.8</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>332.0</b>	<b>1.4</b>	<b>0.0</b>
3rd Party	0%	0%	0%	34%	80%	20%	7%	49%	36%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	93%	71%	100%	66%	20%	80%	62%	27%	28%	0%	0%	0%	0%	0%	0%	30%	58%	0%	0%	0%	0%	1%	2%	0%
Operation	7%	29%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	70%	42%	0%	0%	0%	0%	3%	1%	0%
Other	0%	0%	0%	0%	0%	0%	31%	24%	36%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	96%	97%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>SKYLAB(12KV) - Customers: 305</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>133.6</b>	<b>2.0</b>	<b>0.0</b>	<b>23.6</b>	<b>0.0</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>124.5</b>	<b>1.0</b>	<b>0.0</b>	<b>148.1</b>	<b>1.0</b>	<b>2.0</b>
3rd Party	0%	0%	0%	0%	0%	0%	59%	51%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	41%	49%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	84%	96%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	16%	4%	50%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	50%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

# Reliability Histories for Individual Circuits Serving Costa Mesa

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
<b>SNEAD(12KV) - Customers: 3,252</b>	<b>263.5</b>	<b>3.3</b>	<b>0.0</b>	<b>77.8</b>	<b>0.7</b>	<b>1.6</b>	<b>114.8</b>	<b>1.3</b>	<b>0.9</b>	<b>1.9</b>	<b>0.0</b>	<b>1.0</b>	<b>305.9</b>	<b>1.9</b>	<b>0.0</b>	<b>8.2</b>	<b>0.3</b>	<b>1.0</b>	<b>151.2</b>	<b>0.2</b>	<b>0.0</b>	<b>467.2</b>	<b>2.4</b>	<b>2.0</b>
3rd Party	0%	0%	0%	88%	98%	37%	52%	81%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	100%	100%	0%	2%	0%	63%	16%	4%	0%	0%	0%	0%	95%	95%	0%	65%	87%	100%	100%	100%	0%	96%	94%	52%
Operation	0%	0%	0%	10%	2%	0%	33%	15%	0%	100%	100%	100%	5%	5%	0%	35%	13%	0%	0%	0%	0%	4%	6%	48%
Other	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>SPEAKER(12KV) - Customers: 78</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>20.2</b>	<b>0.1</b>	<b>0.0</b>	<b>20.2</b>	<b>0.1</b>	<b>0.0</b>
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	100%	100%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>SUNFLOWER(12KV) - Customers: 553</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.5</b>	<b>0.0</b>	<b>0.0</b>	<b>1.9</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	100%	100%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>SURVEYOR(12KV) - Customers: 571</b>	<b>179.0</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>17.2</b>	<b>0.3</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

# Reliability Histories for Individual Circuits Serving Costa Mesa

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
<b>TARPON(12KV) - Customers: 3,678</b>	<b>106.8</b>	<b>1.0</b>	<b>1.0</b>	<b>217.2</b>	<b>1.7</b>	<b>2.7</b>	<b>98.2</b>	<b>0.7</b>	<b>3.0</b>	<b>1.6</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>1.6</b>	<b>0.0</b>	<b>0.0</b>
3rd Party	0%	0%	0%	0%	0%	36%	0%	0%	33%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	100%	100%	0%	89%	97%	27%	69%	90%	33%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	11%	3%	0%	27%	9%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	33%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%
Vegetation/Animal	0%	0%	100%	0%	0%	37%	4%	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>VARDON(12KV) - Customers: 547</b>	<b>134.2</b>	<b>0.3</b>	<b>0.8</b>	<b>0.7</b>	<b>0.0</b>	<b>0.0</b>	<b>231.4</b>	<b>0.3</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>267.3</b>	<b>3.6</b>	<b>1.2</b>	<b>0.1</b>	<b>0.0</b>	<b>2.0</b>	<b>267.3</b>	<b>3.6</b>	<b>3.2</b>
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	34%	26%	0%	100%	100%	0%	98%	54%	0%	0%	0%	0%	0%	0%	0%	100%	100%	100%	0%	0%	50%	100%	100%	69%
Operation	0%	0%	0%	0%	0%	0%	2%	46%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	50%	0%	0%	31%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	66%	74%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>VIPER(12KV) - Customers: 1,477</b>	<b>46.1</b>	<b>0.2</b>	<b>0.1</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>71.9</b>	<b>1.3</b>	<b>0.0</b>	<b>71.9</b>	<b>1.3</b>	<b>0.0</b>
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	100%	100%	0%
Operation	100%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>VOYAGER(12KV) - Customers: 297</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.4</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>1.0</b>
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	100%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

## Reliability Histories for Individual Circuits Serving Costa Mesa

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
<b>WEISKOFF(12KV) - Customers: 1,133</b>	<b>2.7</b>	<b>0.0</b>	<b>0.0</b>	<b>49.5</b>	<b>0.3</b>	<b>0.9</b>	<b>73.4</b>	<b>0.3</b>	<b>3.8</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>3.8</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>3.8</b>	<b>0.0</b>	<b>0.0</b>
3rd Party	0%	0%	0%	2%	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	12%	3%	79%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	100%	100%	0%
Operation	100%	100%	0%	13%	49%	0%	61%	78%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	21%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	86%	50%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	27%	19%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>YELLOWTAIL(12KV) - Customers: 3,920</b>	<b>81.5</b>	<b>0.9</b>	<b>1.6</b>	<b>119.2</b>	<b>1.9</b>	<b>1.1</b>	<b>276.7</b>	<b>2.2</b>	<b>0.0</b>	<b>56.7</b>	<b>1.0</b>	<b>0.0</b>	<b>1.3</b>	<b>0.0</b>	<b>0.0</b>	<b>0.2</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>58.3</b>	<b>1.0</b>	<b>0.0</b>
3rd Party	1%	0%	64%	0%	0%	0%	64%	50%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	97%	99%	0%
Equipment Failure	98%	99%	36%	88%	76%	50%	36%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	1%	1%	0%	12%	24%	50%	0%	0%	0%	0%	0%	0%	100%	100%	0%	100%	100%	0%	0%	0%	0%	3%	1%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%