



# Circuit Reliability Review

## **Artesia**

---

January 2017

# Providing Safe, Reliable, and Affordable Power

Southern California Edison is modernizing the power grid to meet the changing needs and expectations of our customers and to help California achieve its clean energy goals.

We are investing more than \$12 billion into our power grid between 2015 – 2017 with the goal of increasing power reliability through significant upgrades. These investments include:

- Updating thousands of transmission and distribution poles
- Replacing hundreds of miles of underground cables
- Replacing hundreds of underground structures such as vaults and manholes
- Upgrading critical distribution equipment; capacitor banks, switches, and circuit breakers
- Building new distribution circuits to serve electrical demands in our communities
- Inspecting and replacing overhead conductor and equipment to improve public safety

Our investments in local communities will help ensure that customers receive safe, reliable, and affordable electricity now and in the future.

# Understanding Your Reliability Report

As your electric utility, we want you to always have power when you need it. To get there, we constantly track and monitor electric outages across our service territory, and we measure our “system reliability” from this data.

The two metrics we rely on are common in the electric utility industry: the System Average Interruption Duration Index (SAIDI) and the System Average Interruption Frequency Index (SAIFI). Both are described in more detail on the next page.

Replacing and upgrading our infrastructure will help SCE maintain or improve SAIDI and SAIFI measurements.

This report provides historical reliability data for the circuits that serve your jurisdiction and our proposed infrastructure upgrades for the current year.

To view other reliability reports, visit [sce.com>Outage Center>Maintaining Reliable Service](https://www.sce.com/Outage-Center/Maintaining-Reliable-Service)

# Reliability Metrics

## MOMENTARY OUTAGES:

OUTAGES LASTING 5 MINUTES OR LESS

### MAIFI:

- The number of times the average customer is interrupted by Momentary outages each year.

## SUSTAINED OUTAGES:

OUTAGES LASTING LONGER THAN 5 MINUTES

### SAIFI:

- The number of times the average customer is interrupted by Sustained outages each year.

### SAIDI:

- The cumulative amount of time the average customer is interrupted by Sustained outages each year.

# Cities in the Covina District

## **Artesia**

Cerritos

Hawaiian Gardens

Lakewood

Long Beach

Los Alamitos

Los Angeles

Rossmore

Seal Beach

Signal Hill

# Reliability by SCE District (No Exclusions)

District Name	2012				2013				2014				2015				2016			
	District SAIDI	SAIDI RANKING	District SAIFI	SAIFI Ranking	District SAIDI	SAIDI RANKING	District SAIFI	SAIFI Ranking	District SAIDI	SAIDI RANKING	District SAIFI	SAIFI Ranking	District SAIDI	SAIDI RANKING	District SAIFI	SAIFI Ranking	District SAIDI	SAIDI RANKING	District SAIFI	SAIFI Ranking
ANTELOPE VALLEY	78.60	28	0.56	31	94.42	22	0.62	31	51.05	35	0.59	34	104.34	22	0.68	30	107.67	24	0.87	29
ARROWHEAD	129.58	13	1.31	7	180.59	7	1.39	8	193.25	5	1.59	5	362.61	4	3.97	1	659.46	3	2.85	5
BARSTOW	184.80	7	1.15	12	204.33	6	1.40	7	201.53	4	1.34	10	187.11	8	1.17	12	134.83	18	1.35	9
BIG CREEK	1184.25	1	4.52	1	176.51	8	3.08	1	920.25	1	1.34	11	422.77	2	3.42	2	1062.01	2	4.99	1
BISHOP	463.09	2	1.25	9	104.44	17	0.51	35	118.79	17	0.59	35	298.11	6	2.22	4	168.59	8	1.22	14
BLYTHE	225.88	6	1.53	3	483.13	1	1.38	9	707.54	2	2.42	2	427.00	1	1.52	7	396.38	5	2.71	6
CATALINA	78.46	30	0.72	29	105.94	16	2.97	2	97.02	24	4.17	1	42.56	35	2.25	3	65.01	35	3.66	3
COVINA	108.73	19	0.92	19	100.51	19	0.86	20	91.60	27	0.87	22	100.08	23	0.81	25	112.13	22	0.97	24
DOMINGUEZ HILLS	117.22	18	0.82	24	89.17	26	0.80	21	82.30	29	0.71	28	130.63	15	0.97	17	146.38	12	1.11	17
FOOTHILL	91.69	25	0.90	20	85.80	27	0.79	24	93.35	25	0.93	21	109.64	20	0.95	20	142.81	14	1.03	21
FULLERTON	68.99	33	0.42	35	90.57	25	0.79	22	82.23	30	0.72	27	76.59	29	0.67	31	92.72	30	0.76	34
HUNTINGTON BEACH	95.78	23	0.89	21	66.51	32	0.68	29	79.61	31	0.78	25	98.32	25	0.95	19	128.02	20	1.26	12
KERNVILLE	226.76	5	1.31	6	232.18	4	1.96	3	178.69	8	1.99	3	286.38	7	0.96	18	2421.32	1	3.67	2
LONG BEACH	75.83	31	0.55	33	75.11	30	0.70	28	66.33	34	0.61	32	164.46	9	0.89	23	135.16	17	0.86	31
MENIFEE	99.32	22	0.84	23	107.39	15	1.26	10	156.68	11	1.32	12	111.46	19	0.98	16	156.75	9	1.31	10
MONROVIA	108.11	20	1.13	15	99.12	20	1.02	16	133.32	14	1.16	16	96.68	26	0.88	24	116.57	21	0.84	32
MONTEBELLO	131.06	12	1.13	14	118.08	13	1.17	12	158.34	10	1.16	15	150.28	12	1.18	11	133.52	19	1.17	15
ONTARIO	93.09	24	0.87	22	77.39	29	0.79	23	97.91	23	1.00	19	94.04	27	0.74	27	105.07	27	0.93	27
PALM SPRINGS	175.92	8	1.27	8	112.80	14	0.77	25	107.04	20	0.71	29	99.54	24	0.80	26	107.58	25	1.07	19
REDLANDS	120.13	16	1.11	16	96.48	21	1.04	15	154.25	12	1.04	18	124.52	17	1.01	14	137.11	16	0.98	23
RIDGECREST	229.65	4	1.44	4	161.95	9	1.12	13	176.84	9	1.57	6	148.90	13	1.01	15	254.31	6	1.05	20
SADDLEBACK	83.01	27	0.73	27	70.69	31	0.53	34	99.07	22	0.74	26	46.03	34	0.39	35	65.99	34	0.65	35
SAN JOAQUIN	135.90	10	1.04	18	244.44	2	1.45	6	138.25	13	1.17	14	127.50	16	1.05	13	108.44	23	1.09	18
SANTA ANA	78.60	29	0.55	32	93.35	24	0.74	26	91.68	26	0.84	23	67.46	32	0.71	29	97.27	29	1.00	22
SANTA BARBARA	153.81	9	1.15	13	82.00	28	0.70	27	183.78	7	1.38	9	152.37	11	1.52	6	156.66	10	1.41	8
SANTA MONICA	101.69	21	0.79	25	122.78	12	1.00	17	110.76	19	0.99	20	75.41	30	0.62	32	91.08	31	0.95	26
SOUTH BAY	122.68	15	1.17	10	142.15	10	1.49	5	125.28	16	1.39	8	164.07	10	1.31	8	183.90	7	1.88	7
TEHACHAPI	117.96	17	1.43	5	232.67	3	1.12	14	130.70	15	1.29	13	298.96	5	1.21	9	97.29	28	1.13	16
THOUSAND OAKS	127.73	14	1.05	17	93.86	23	0.91	18	104.37	21	1.10	17	106.59	21	0.92	21	143.78	13	1.31	11
VALENCIA	62.01	35	0.46	34	51.04	34	0.53	33	79.23	32	0.61	33	72.27	31	0.61	33	105.09	26	0.97	25
VENTURA	134.81	11	1.15	11	100.52	18	1.21	11	183.79	6	1.65	4	148.85	14	1.19	10	150.41	11	1.24	13
VICTORVILLE	67.70	34	0.66	30	61.33	33	0.63	30	68.85	33	0.63	31	87.03	28	0.91	22	79.35	33	0.92	28
WHITTIER	72.60	32	0.74	26	135.04	11	0.86	19	87.60	28	0.70	30	114.52	18	0.73	28	137.34	15	0.81	33
WILDOMAR	88.54	26	0.72	28	40.51	35	0.56	32	118.49	18	0.81	24	52.70	33	0.60	34	84.01	32	0.87	30
YUCCA VALLEY	319.82	3	3.41	2	216.97	5	1.50	4	304.25	3	1.49	7	389.08	3	1.80	5	463.68	4	3.39	4
<b>SCE SystemWide</b>	<b>108.13</b>		<b>0.89</b>		<b>102.61</b>		<b>0.91</b>		<b>112.00</b>		<b>0.96</b>		<b>114.83</b>		<b>0.92</b>		<b>134.48</b>		<b>1.10</b>	

\*\*Exclusions\*\* are days which utilities are allowed to remove from their metrics because the outages on those days were caused by a severe acts of nature.

\*\*In the columns showing "Rank," lower numbers indicate poorer performance.

# Overview of Artesia


## There are 15 circuits that serve Artesia

Circuit Type	Sum of Customers	Circuit Type	Sum of Customers	Circuit Type	Sum of Customers	Circuit Type	Sum of Customers
ABERDEEN(12KV)	1,268						
ALORA(12KV)	606						
BABER(12KV)	2,321						
BRAHMA(12KV)	2,096						
CORBY(12KV)	566						
DORNES(12KV)	2,368						
DURHAM(12KV)	1,551						
FALLON(12KV)	2,424						
GRIDLEY(12KV)	367						
HARVEST(12KV)	378						
LONGHORN(12KV)	2,056						
MAPES(12KV)	3,653						
ROSETON(12KV)	1,468						
SEMORA(12KV)	1,158						
WATUSI(12KV)	2,358						

**Grand Total**

24,638


# Reliability History of Circuits Serving Artesia (No Exclusions)

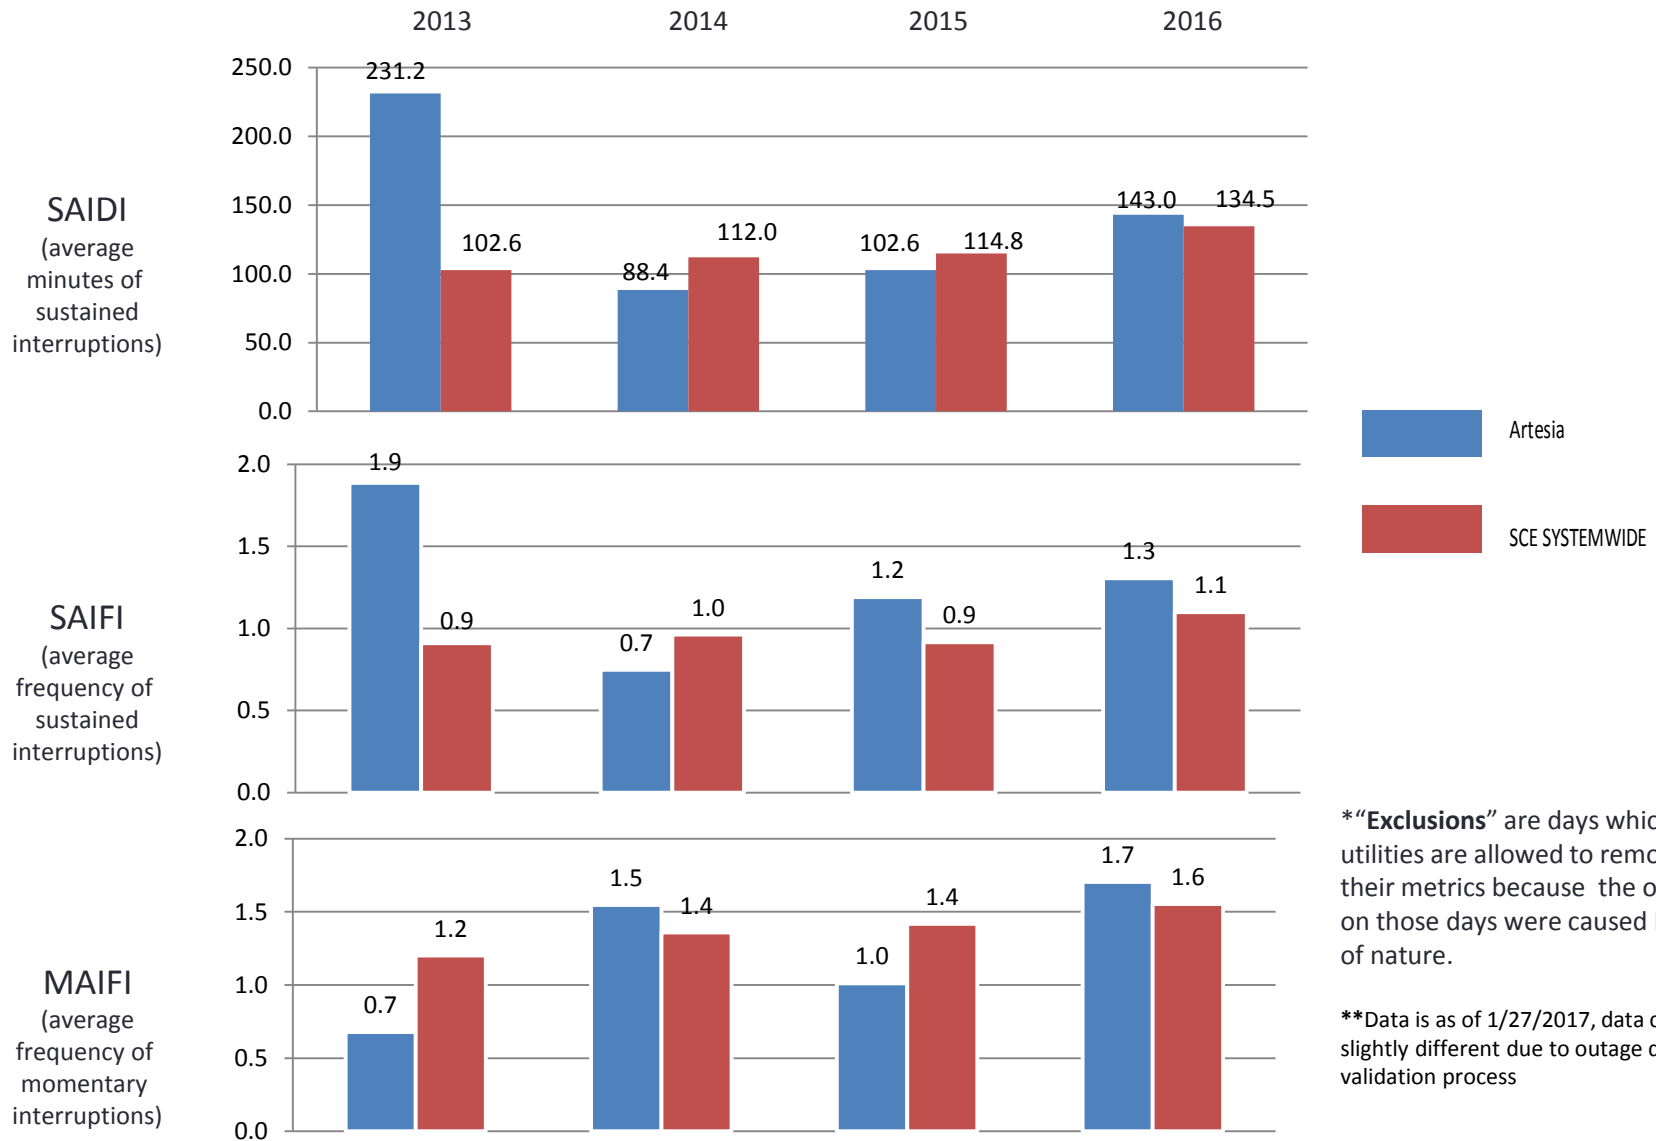



# Causes of Repair Outages in Artesia Circuits 2016 YTD


## Contributions to SAIDI by Outage Cause

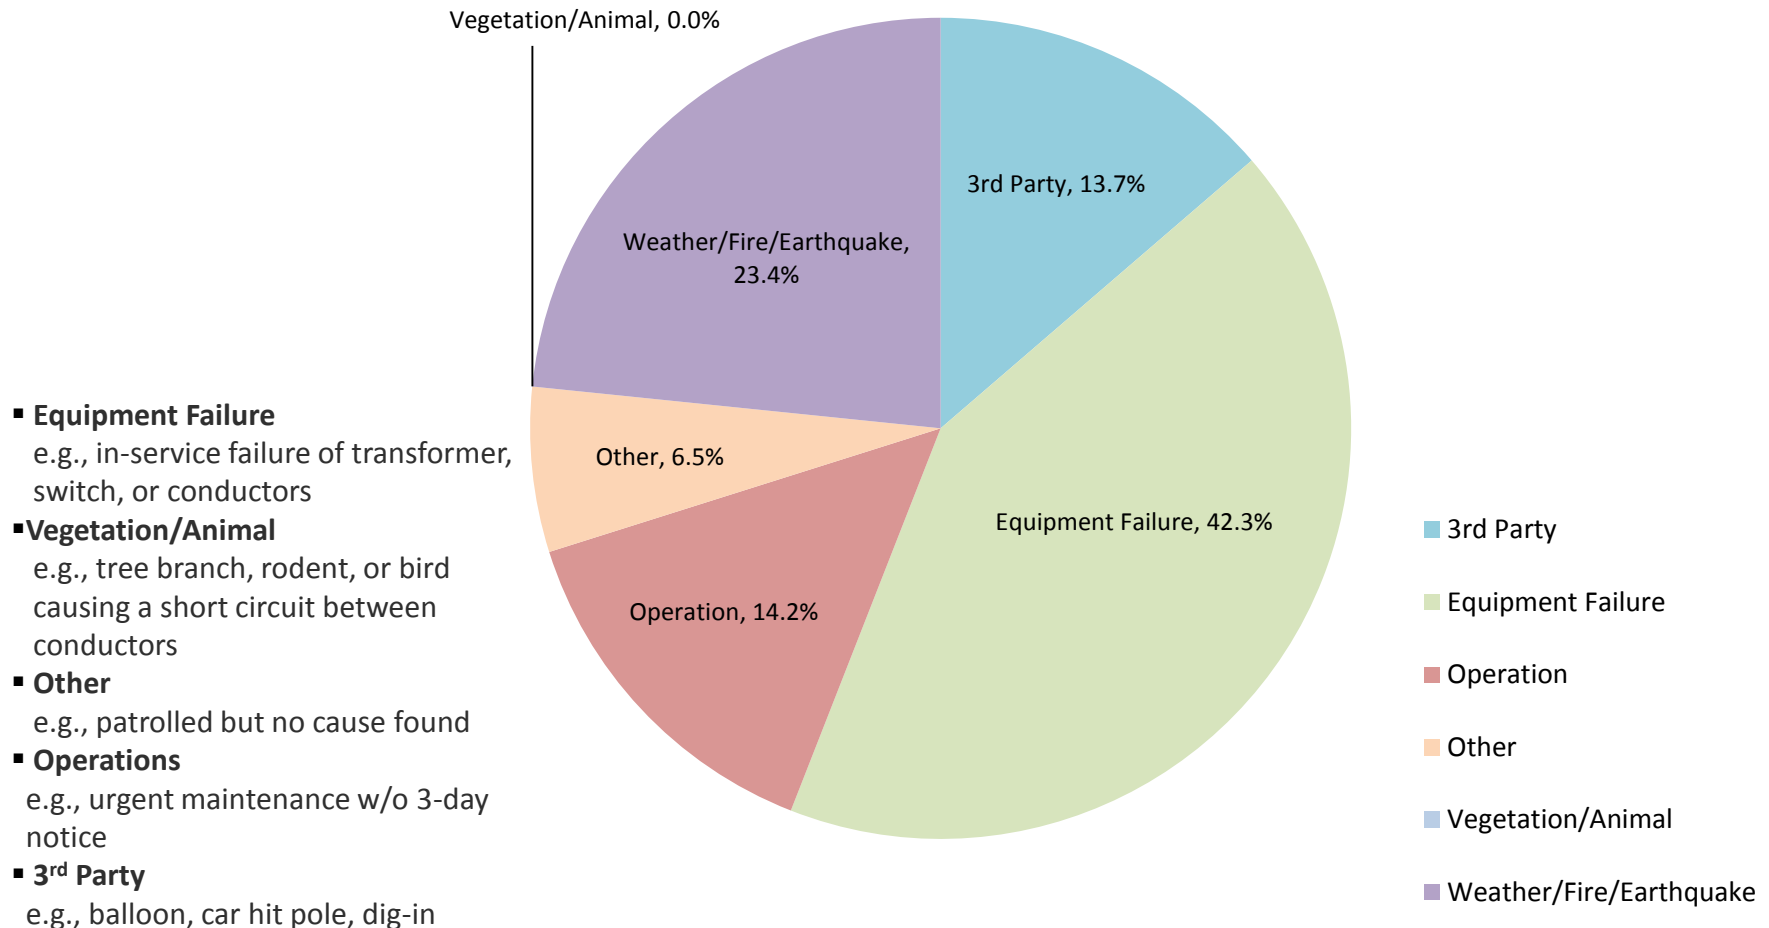


**SAIDI** = the cumulative amount of time the average customer is interrupted by “sustained” outages each year.

# Causes of Repair Outages in Artesia Circuits 2016 YTD

## Contributions to SAIFI by Outage Cause

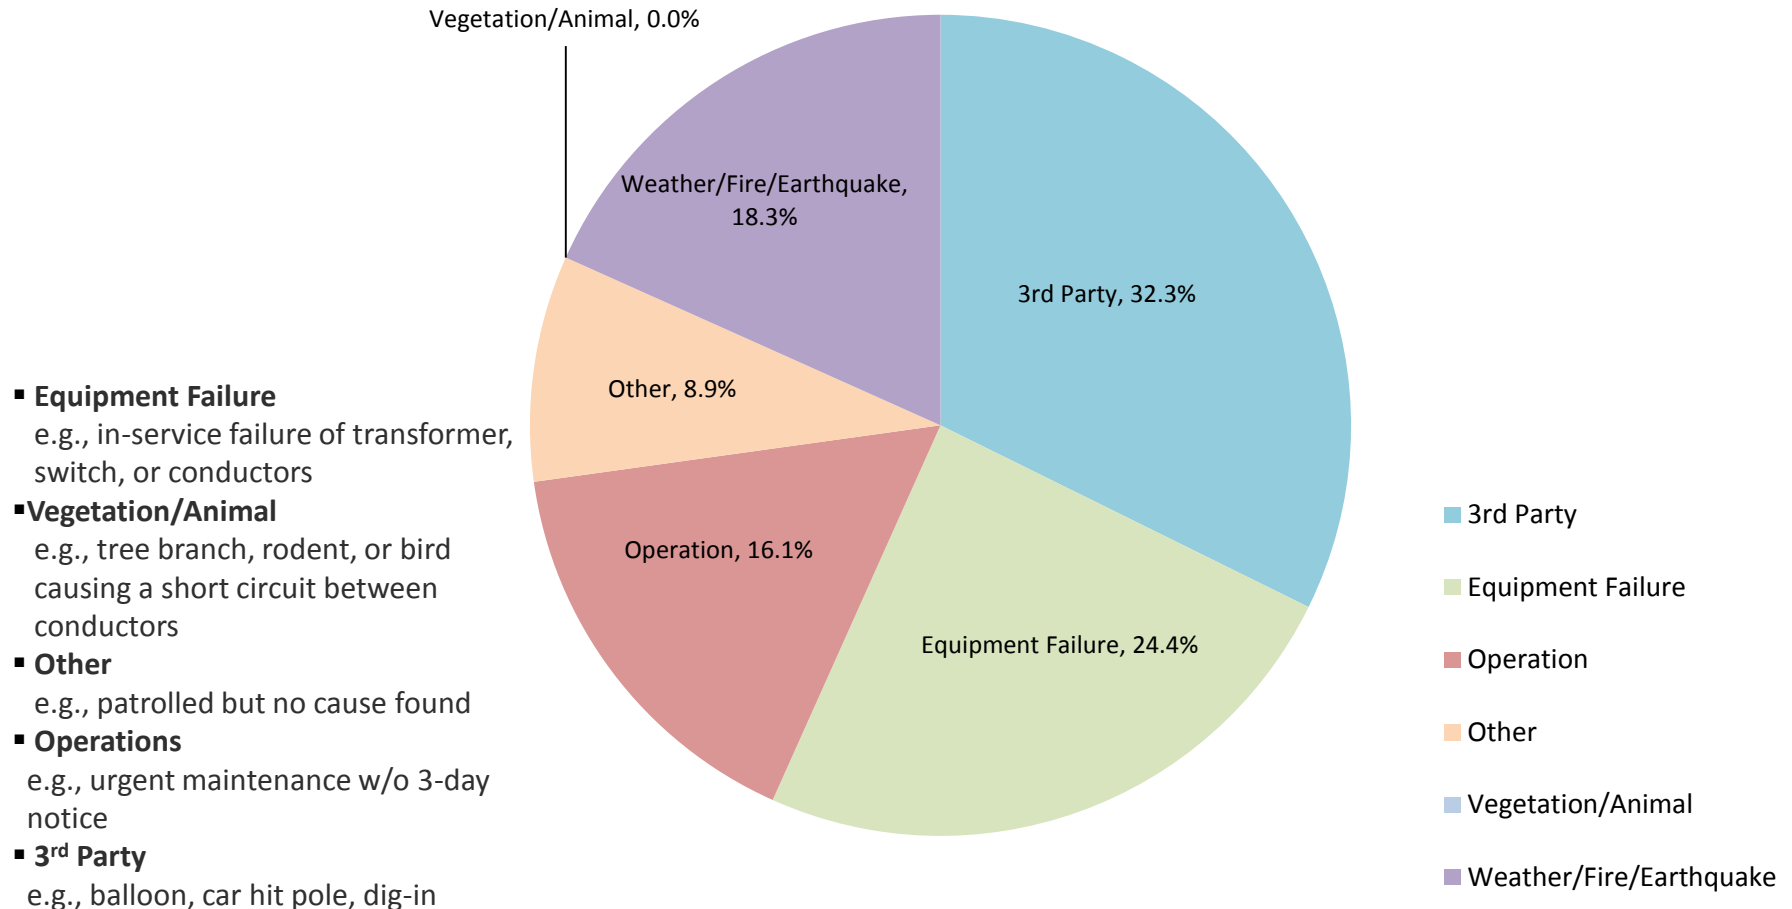

**SAIFI** = the number of times the average customer is interrupted by “sustained” outages each year.

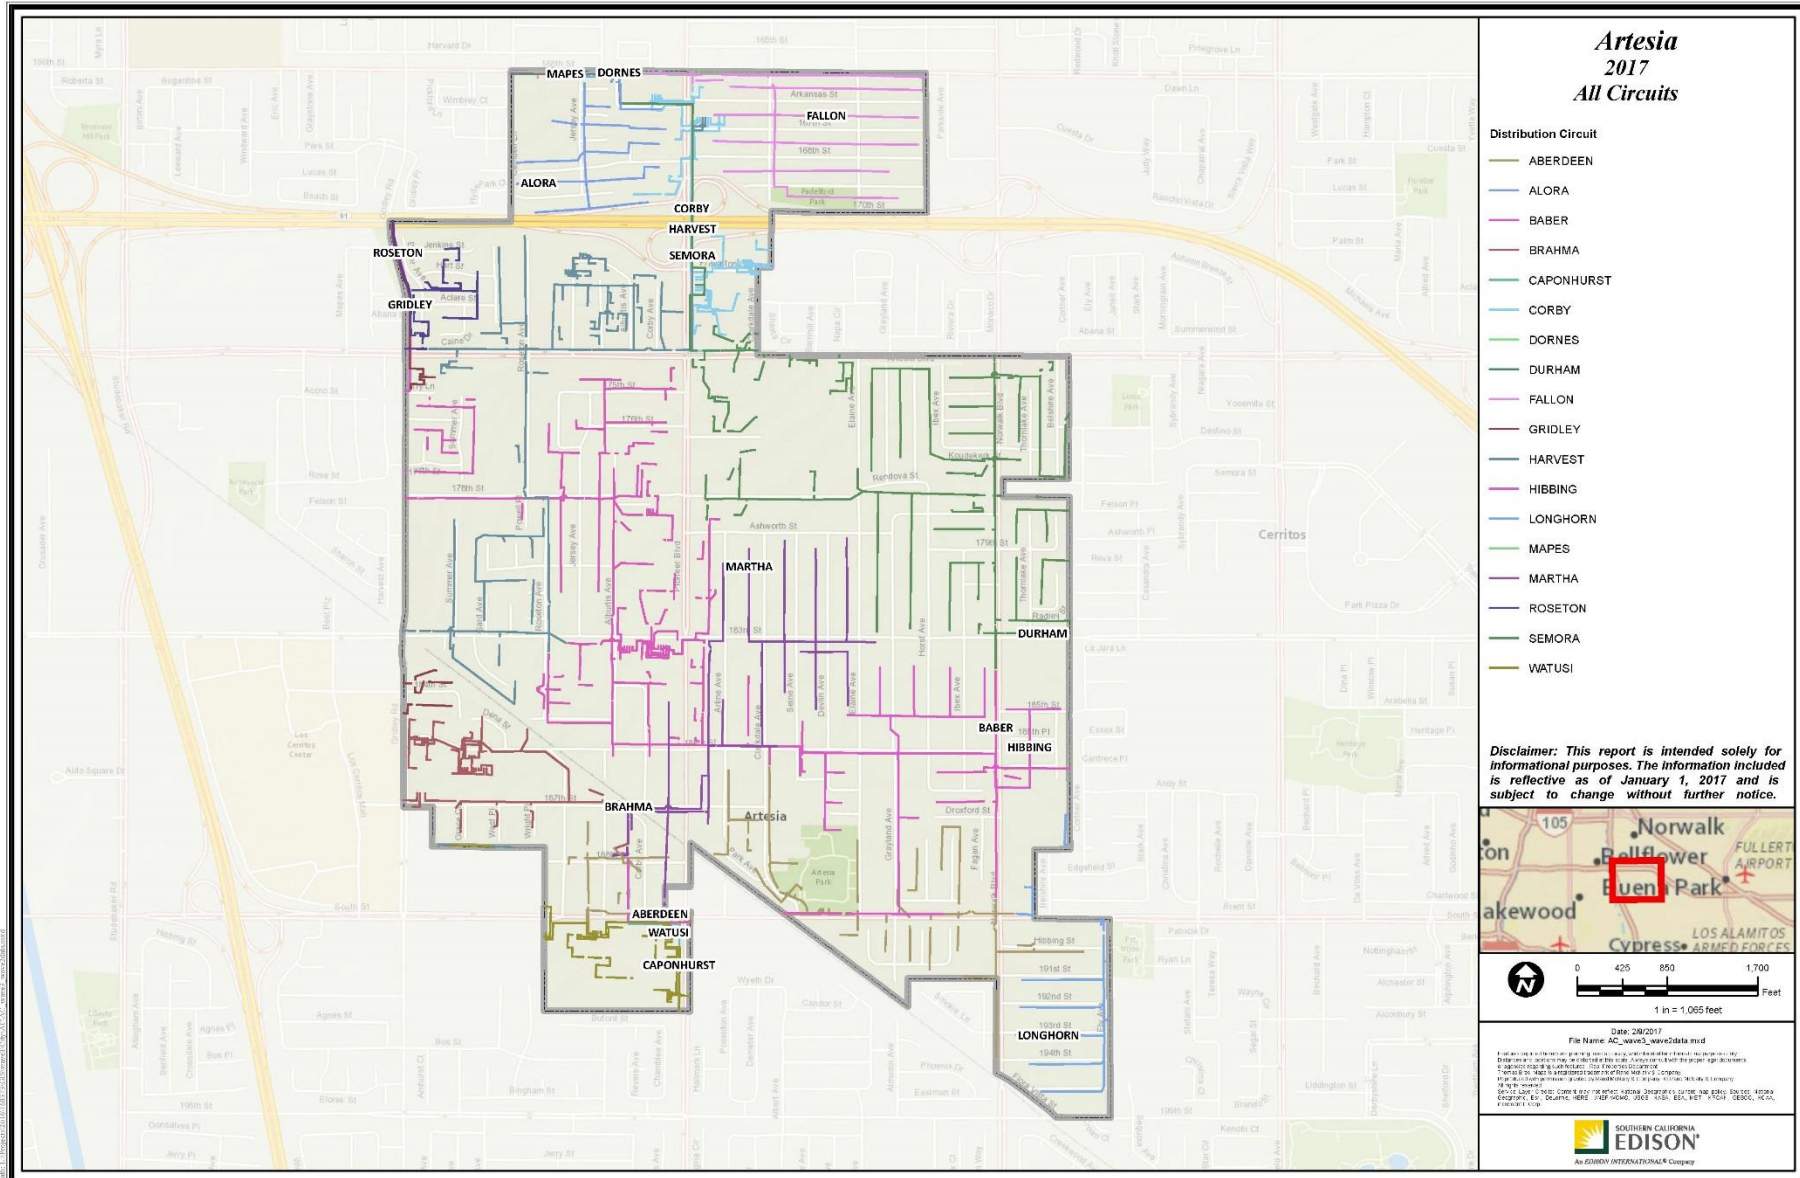

# Artesia 2017 Capital Improvement Plan

## Replacement/Equipment Upgrade



✦ Pole Replacement

## Other Work

● Circuit Public Safety Upgrade

● Circuit Rebuild


**Disclaimer:** This report is intended solely for informational purposes. The information included is reflective as of January 1, 2017 and is subject to change without further notice.

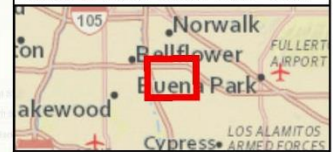

Date: 2/8/2017

File Name: CIP\_2017\_wareData.mxd

This document is the property of Southern California Edison Company. It contains confidential information and is not to be distributed outside the company without the express written permission of Southern California Edison Company. This document is for informational purposes only and does not constitute a contract. Southern California Edison Company is not responsible for any errors or omissions in this document. Southern California Edison Company is not responsible for any damages, including consequential damages, arising from the use of this document. Southern California Edison Company is not responsible for any damages, including consequential damages, arising from the use of this document.

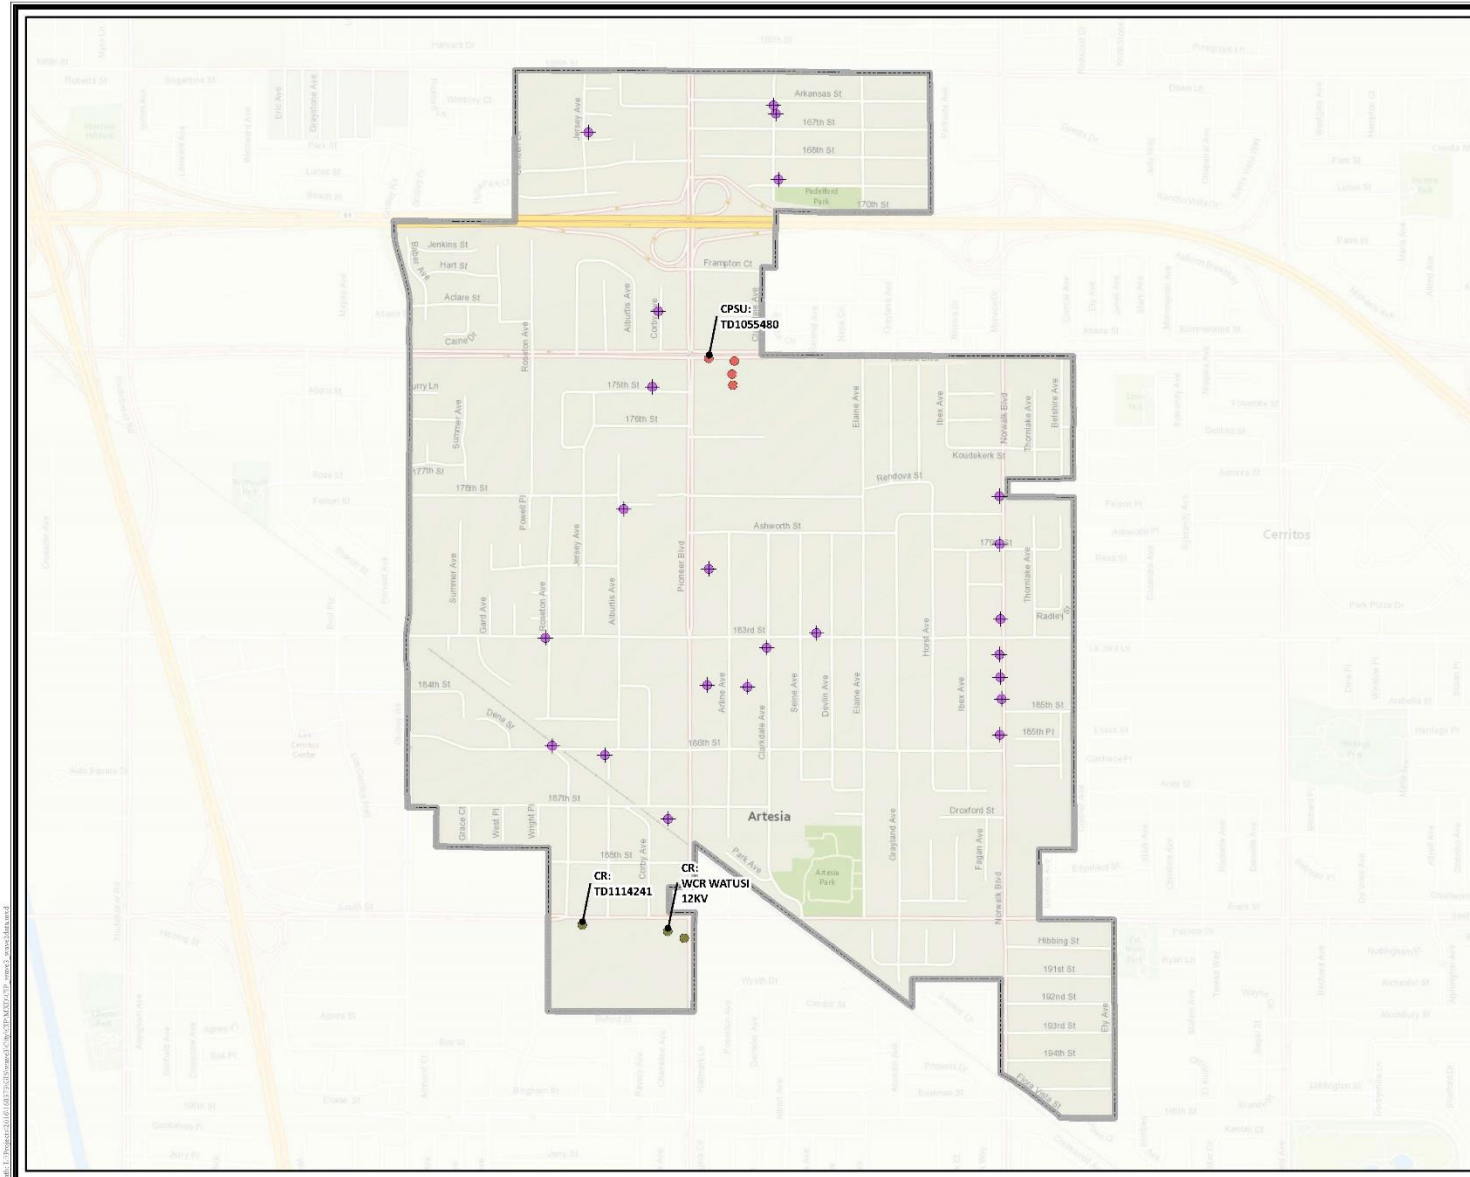

# Back-up Slides

**Reliability Histories of Circuits Serving Artesia**

**Updated through Year-End 2016**

# Average Reliability of 15 Circuits Serving Artesia

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
Artesia	231.2	1.9	0.7	88.4	0.7	1.5	102.6	1.2	1.0	56.7	0.4	0.5	22.0	0.3	0.2	37.1	0.4	0.3	27.2	0.2	0.7	143.0	1.3	1.7
3rd Party	15%	11%	29%	23%	18%	25%	22%	27%	24%	0%	0%	42%	34%	61%	35%	14%	24%	5%	25%	60%	0%	14%	32%	17%
Equipment Failure	63%	72%	36%	63%	69%	33%	48%	34%	21%	43%	38%	0%	17%	2%	65%	40%	24%	9%	63%	31%	49%	42%	24%	31%
Operation	3%	2%	0%	3%	2%	0%	14%	23%	16%	2%	2%	0%	8%	2%	0%	44%	50%	86%	4%	2%	0%	14%	16%	15%
Other	16%	14%	25%	0%	0%	5%	4%	1%	0%	11%	23%	20%	4%	2%	0%	1%	1%	0%	8%	7%	51%	6%	9%	27%
Vegetation/Animal	1%	0%	11%	1%	1%	0%	11%	15%	39%	0%	0%	17%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	5%
Weather/Fire/Earthquake	1%	1%	0%	11%	9%	37%	1%	0%	0%	44%	37%	21%	38%	33%	0%	0%	0%	0%	0%	0%	0%	23%	18%	6%
SCE Systemwide	102.6	0.9	1.2	112.0	1.0	1.4	114.8	0.9	1.4	40.5	0.3	0.4	34.8	0.3	0.4	29.4	0.2	0.3	29.8	0.3	0.4	134.5	1.1	1.6

## Notes:

No outages are excluded from the metrics.

## Outage Causes:

Other: e.g., patrolled but no cause could be found

Operations: e.g., urgent maintenance w/o 3-day notice to customers

3<sup>rd</sup> Party: e.g., balloons, car hit pole, dig-in

Vegetation/Animal: e.g., tree branch, rodent, or bird causing short circuit across conductors

SAIDI (minutes) = the cumulative amount of time the average customer is interrupted by "sustained" (longer than 5 minutes) outages.

SAIFI (interruptions) = the number of times the average customer is interrupted by "sustained" outages.

MAIFI (interruptions) = the number of times the average customer is interrupted by "momentary" (lasting 5 minutes or less) outages.

# Reliability Histories for Individual Circuits Serving Artesia

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
<b>ABERDEEN(12KV) - Customers: 1,268</b>	<b>87.6</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>1.0</b>	<b>27.1</b>	<b>0.1</b>	<b>1.0</b>	<b>11.5</b>	<b>0.1</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>51.0</b>	<b>0.1</b>	<b>2.4</b>	<b>62.4</b>	<b>0.3</b>	<b>2.4</b>
3rd Party	0%	0%	0%	0%	0%	0%	5%	16%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	94%	98%	0%	0%	0%	0%	95%	84%	0%	64%	76%	0%	0%	0%	0%	0%	0%	0%	100%	100%	50%	93%	88%	50%
Operation	6%	2%	0%	0%	0%	0%	0%	0%	0%	36%	24%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	7%	12%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	50%	0%	0%	50%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>ALORA(12KV) - Customers: 606</b>	<b>184.5</b>	<b>2.0</b>	<b>0.0</b>	<b>200.0</b>	<b>1.1</b>	<b>0.4</b>	<b>14.1</b>	<b>1.4</b>	<b>1.4</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>67.4</b>	<b>0.2</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>40.0</b>	<b>0.1</b>	<b>0.0</b>	<b>107.4</b>	<b>0.3</b>	<b>0.0</b>
3rd Party	0%	0%	0%	0%	0%	0%	78%	99%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	43%	50%	0%	35%	7%	6%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	2%	2%	0%	22%	1%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	100%	100%	0%	100%	100%	0%
Other	57%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	63%	91%	94%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>BABER(12KV) - Customers: 2,321</b>	<b>146.8</b>	<b>1.3</b>	<b>1.0</b>	<b>12.2</b>	<b>0.0</b>	<b>0.0</b>	<b>108.4</b>	<b>1.7</b>	<b>0.0</b>	<b>10.7</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>58.2</b>	<b>1.0</b>	<b>0.0</b>	<b>3.7</b>	<b>0.0</b>	<b>1.0</b>	<b>72.5</b>	<b>1.0</b>	<b>1.0</b>
3rd Party	0%	0%	100%	0%	0%	0%	28%	6%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	80%	99%	0%
Equipment Failure	62%	78%	0%	100%	100%	0%	64%	93%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	100%	100%	100%	20%	1%	100%
Operation	38%	22%	0%	0%	0%	0%	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	5%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	1%	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>BRAHMA(12KV) - Customers: 2,096</b>	<b>118.6</b>	<b>1.1</b>	<b>0.0</b>	<b>0.3</b>	<b>0.0</b>	<b>1.1</b>	<b>97.9</b>	<b>0.3</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>37.3</b>	<b>0.1</b>	<b>0.9</b>	<b>37.3</b>	<b>0.1</b>	<b>0.9</b>
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	93%	97%	0%	100%	100%	0%	82%	48%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	93%	63%	0%	93%	63%	0%
Operation	7%	3%	0%	0%	0%	0%	16%	45%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	7%	37%	0%	7%	37%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	100%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	2%	7%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%



# Reliability Histories for Individual Circuits Serving Artesia

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
<b>CORBY(12KV) - Customers: 566</b>	<b>98.4</b>	<b>1.2</b>	<b>0.0</b>	<b>11.1</b>	<b>0.0</b>	<b>0.0</b>	<b>203.1</b>	<b>0.9</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	81%	82%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	19%	18%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>DORNES(12KV) - Customers: 2,368</b>	<b>323.3</b>	<b>1.7</b>	<b>2.4</b>	<b>157.5</b>	<b>2.5</b>	<b>6.6</b>	<b>151.8</b>	<b>0.9</b>	<b>2.3</b>	<b>264.1</b>	<b>1.8</b>	<b>0.0</b>	<b>105.7</b>	<b>1.1</b>	<b>1.0</b>	<b>48.1</b>	<b>0.1</b>	<b>1.0</b>	<b>41.8</b>	<b>0.4</b>	<b>0.6</b>	<b>459.6</b>	<b>3.4</b>	<b>2.6</b>
3rd Party	50%	12%	34%	0%	0%	15%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	37%	77%	66%	94%	99%	55%	71%	47%	29%	0%	0%	0%	12%	3%	100%	59%	44%	0%	100%	100%	100%	18%	15%	62%
Operation	5%	4%	0%	1%	1%	0%	15%	46%	71%	0%	0%	0%	0%	0%	0%	41%	56%	100%	0%	0%	0%	4%	2%	38%
Other	0%	0%	0%	0%	0%	0%	10%	3%	0%	5%	19%	0%	8%	7%	0%	0%	0%	0%	0%	0%	0%	5%	12%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	9%	7%	0%	4%	1%	30%	5%	3%	0%	95%	81%	0%	81%	90%	0%	0%	0%	0%	0%	0%	0%	73%	71%	0%
<b>DURHAM(12KV) - Customers: 1,551</b>	<b>512.1</b>	<b>4.4</b>	<b>0.0</b>	<b>110.9</b>	<b>1.2</b>	<b>1.0</b>	<b>41.7</b>	<b>0.9</b>	<b>1.0</b>	<b>147.7</b>	<b>0.3</b>	<b>0.0</b>	<b>84.7</b>	<b>1.0</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.3</b>	<b>0.0</b>	<b>1.0</b>	<b>232.6</b>	<b>1.3</b>	<b>1.9</b>
3rd Party	25%	23%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	70%	97%	0%	0%	0%	0%	0%	0%	0%	26%	78%	0%
Equipment Failure	70%	76%	0%	100%	100%	0%	100%	100%	0%	96%	81%	0%	30%	3%	100%	0%	0%	0%	100%	100%	0%	72%	19%	50%
Operation	4%	1%	0%	0%	0%	0%	0%	0%	0%	4%	19%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	2%	4%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	50%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>FALLON(12KV) - Customers: 2,424</b>	<b>106.6</b>	<b>1.0</b>	<b>0.0</b>	<b>6.3</b>	<b>0.0</b>	<b>0.0</b>	<b>10.2</b>	<b>0.1</b>	<b>0.0</b>	<b>49.3</b>	<b>0.6</b>	<b>0.3</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>36.0</b>	<b>0.1</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>85.3</b>	<b>0.7</b>	<b>0.3</b>
3rd Party	0%	0%	0%	0%	0%	0%	7%	4%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	100%	100%	0%	0%	0%	0%	13%	18%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	100%	100%	0%	80%	78%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	42%	14%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	58%	86%	100%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%



# Reliability Histories for Individual Circuits Serving Artesia

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
<b>GRIDLEY(12KV) - Customers: 367</b>	<b>183.6</b>	<b>2.1</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>26.8</b>	<b>0.1</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>12.3</b>	<b>0.0</b>	<b>0.0</b>	<b>177.9</b>	<b>1.1</b>	<b>0.0</b>	<b>217.0</b>	<b>1.2</b>	<b>0.0</b>
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	100%	100%	0%	88%	92%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	12%	8%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>HARVEST(12KV) - Customers: 378</b>	<b>132.6</b>	<b>1.4</b>	<b>0.7</b>	<b>0.0</b>	<b>0.0</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>5.5</b>	<b>0.0</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>2.0</b>	<b>0.0</b>	<b>0.0</b>	<b>2.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>5.5</b>	<b>0.0</b>	<b>5.0</b>
3rd Party	5%	23%	100%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	100%	0%	0%	50%	0%	0%	0%	0%	0%	80%
Equipment Failure	68%	68%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	50%	0%	0%	0%	100%	100%	20%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	27%	9%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>LONGHORN(12KV) - Customers: 2,056</b>	<b>271.0</b>	<b>2.0</b>	<b>0.4</b>	<b>13.7</b>	<b>0.1</b>	<b>1.0</b>	<b>192.3</b>	<b>1.5</b>	<b>1.0</b>	<b>103.2</b>	<b>1.2</b>	<b>1.1</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>104.3</b>	<b>0.9</b>	<b>0.3</b>	<b>0.0</b>	<b>0.0</b>	<b>0.9</b>	<b>207.5</b>	<b>2.1</b>	<b>2.2</b>
3rd Party	0%	0%	0%	0%	0%	0%	31%	70%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	100%	100%	100%	61%	40%	0%	44%	6%	0%	91%	98%	0%	0%	0%	0%	100%	100%	100%	0%	0%	0%	96%	99%	13%
Operation	0%	0%	0%	0%	0%	0%	25%	24%	0%	0%	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	1%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	39%
Vegetation/Animal	0%	0%	0%	39%	60%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	100%	0%	0%	0%	9%	2%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	4%	1%	48%
<b>MAPES(12KV) - Customers: 3,653</b>	<b>327.5</b>	<b>2.7</b>	<b>1.3</b>	<b>69.2</b>	<b>0.7</b>	<b>1.3</b>	<b>144.7</b>	<b>2.7</b>	<b>0.6</b>	<b>0.0</b>	<b>0.0</b>	<b>1.0</b>	<b>22.6</b>	<b>0.7</b>	<b>0.3</b>	<b>66.1</b>	<b>1.0</b>	<b>0.9</b>	<b>49.2</b>	<b>0.9</b>	<b>0.9</b>	<b>137.8</b>	<b>2.7</b>	<b>3.1</b>
3rd Party	18%	25%	24%	95%	95%	100%	17%	25%	51%	0%	0%	100%	100%	100%	100%	0%	0%	0%	82%	92%	0%	46%	58%	45%
Equipment Failure	29%	37%	0%	0%	0%	0%	20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	28%
Operation	0%	0%	0%	5%	5%	0%	19%	37%	0%	0%	0%	0%	0%	0%	0%	100%	100%	100%	0%	0%	0%	48%	39%	28%
Other	53%	38%	76%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	18%	8%	0%	6%	3%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	44%	37%	49%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

## Reliability Histories for Individual Circuits Serving Artesia

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
<b>ROSETON(12KV) - Customers: 1,468</b>	<b>103.5</b>	<b>1.0</b>	<b>0.0</b>	<b>15.7</b>	<b>0.1</b>	<b>0.0</b>	<b>243.5</b>	<b>1.4</b>	<b>1.9</b>	<b>0.0</b>	<b>0.0</b>	<b>1.0</b>	<b>16.3</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>16.3</b>	<b>0.0</b>	<b>1.0</b>
3rd Party	0%	0%	0%	0%	0%	0%	65%	17%	39%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	100%	100%	0%	38%	5%	0%	21%	73%	61%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%
Operation	0%	0%	0%	62%	95%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	15%	10%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>SEMORA(12KV) - Customers: 1,158</b>	<b>324.1</b>	<b>2.1</b>	<b>1.7</b>	<b>0.0</b>	<b>0.0</b>	<b>1.0</b>	<b>5.4</b>	<b>0.0</b>	<b>1.3</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>2.5</b>	<b>0.0</b>	<b>0.0</b>	<b>2.5</b>	<b>0.0</b>	<b>0.0</b>
3rd Party	1%	3%	0%	0%	0%	0%	84%	50%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	80%	86%	42%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	100%	100%	0%
Operation	0%	0%	0%	0%	0%	0%	16%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	7%	8%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	12%	4%	58%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>WATUSI(12KV) - Customers: 2,358</b>	<b>84.9</b>	<b>1.0</b>	<b>0.0</b>	<b>495.1</b>	<b>2.9</b>	<b>4.0</b>	<b>49.4</b>	<b>1.1</b>	<b>2.0</b>	<b>68.0</b>	<b>0.2</b>	<b>0.9</b>	<b>0.4</b>	<b>0.0</b>	<b>0.0</b>	<b>32.0</b>	<b>0.1</b>	<b>0.0</b>	<b>63.9</b>	<b>0.1</b>	<b>1.1</b>	<b>164.3</b>	<b>0.4</b>	<b>2.0</b>
3rd Party	0%	0%	0%	25%	9%	25%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	5%	0%
Equipment Failure	98%	100%	0%	75%	91%	50%	92%	93%	50%	100%	100%	0%	0%	0%	0%	88%	35%	0%	88%	60%	0%	93%	73%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	8%	7%	0%	0%	0%	0%	0%	0%	0%	12%	65%	0%	12%	40%	100%	7%	22%	54%
Vegetation/Animal	2%	0%	0%	0%	0%	0%	0%	0%	50%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	46%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	25%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%